

**2022 WATER DISTRIBUTION  
MASTER PLAN**

**ENGINEERING REPORT**



***CITY OF CARROLLTON, TEXAS***


*Submitted By*

***BIRKHOFF, HENDRICKS & CARTER, L.L.P.  
CONSULTING ENGINEERS  
DALLAS, TEXAS***

*October 2023*

# TABLE OF CONTENTS

	<u>Page No.</u>
A. GENERAL .....	1
B. PLANNING AREA .....	1
C. POPULATION .....	2
D. PROJECTED WATER USE .....	4
E. WATER DISTRIBUTION SYSTEM ANALYSIS .....	7
1) Low Service Area	
2) Medium Service Area	
3) High and Midway Service Areas	
4) Golden Bear Service Area	
F. WATER SUPPLY .....	9
G. PUMP STATIONS & GROUND STORAGE .....	10
1) Don Cline Pump Station	
2) Columbian Club Pump Station	
3) Bobby Ballard Pump Station (North Pump Station)	
4) Marsh North Pump Station	
5) Golden Bear Pump Station	
H. ELEVATED STORAGE .....	12
I. FIRE FLOW ANALYSIS .....	13
J. RECOMMENDATIONS FOR SYSTEM IMPROVEMENTS.....	14
K. 10-YEAR CAPITAL IMPROVEMENT PROGRAM .....	16
L. HYDRAULIC ANALYSIS .....	17

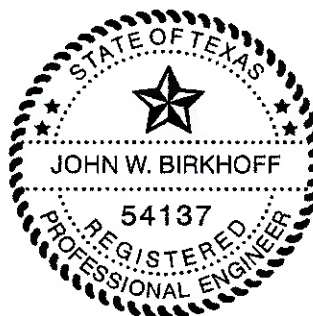

*John W. Birkhoff*

John W. Birkhoff, P.E.

10/11/23

**APPENDIX:**

DIURNAL CURVE

SUMMARY OF SUMMER 2022

LAND USE MAP

COMPUTER RESULTS:

- ELEVATED TANK RESULTS
- INPUT DATA
- OUTPUT DATA
- BUILD-OUT FIRE FLOW RESULTS

BUILD-OUT WATER DISTRIBUTION MAP

## CITY OF CARROLLTON, TEXAS

### 2022 WATER DISTRIBUTION MASTER PLAN

#### A. GENERAL

Long range plans for the City of Carrollton's Water Distribution System have been based upon previous analyses, the latest of which was completed in 2001. However, since 2001, the transit oriented developments (TOD) continue to evolve and are becoming more dense, and along with some operation difficulties have brought about the need for a more comprehensive analysis of the system. The analysis is based on a 72-hour extended period computer simulation on the days of maximum usage. This analysis and report presents a comprehensive plan for the completion of the water distribution system to serve the City of Carrollton at build-out conditions. This plan is based on the best available information on existing and projected future land uses.

Although the proposed system is designed to accommodate the ultimate development of the City, it should be examined at intervals and revised to conform to changing conditions as the City continues to grow and redevelop. Likewise, prior to undertaking a major expenditure, an examination should be made to verify that the design criteria utilized in the overall plan development is still valid.

#### B. PLANNING AREA

The planning area for the 2022 Water Distribution Master Plan includes the entire area within the city limits as it now exists. The system is designed to serve approximately 22,000 acres of land utilizing five existing pressure planes. The existing Low, Medium and High Service Areas have high water levels at their corresponding elevated tanks of 640 feet, 699 feet, and 770 feet, respectively. The highest existing pressure plane, the Midway Pressure Plane (822 feet) utilizes a booster station in order to increase pressure from the High Service Area elevation of 770 feet. The Golden Bear Pressure Plane (780 ft) utilized a booster station in order to increase pressure from the High Service Area elevation of 770 feet. The Midway and Golden Bear Service Areas are relatively small land masses.

## C. POPULATION

The demand for water in a community is closely related to its residential population. Total population of a fully developed area along with commercial and industrial demand dictates the ultimate size of facilities required, whereas the rate of growth is important to determine the timing of the construction of system improvements.

The city provided a list of all the multi-family complex buildings in the city and the number of units at each of these buildings. The population for these establishments were calculated using population densities. The remaining population was calculated by dividing the City into polygons in order to create GIS shapefiles. These shapefiles were then loaded with parcel count numbers and land use category information in order to calculate the population for these areas. The densities used for calculating the existing and build-out residential population are shown in Table 1.

**TABLE 1**  
**RESIDENTIAL UNIT AND POPULATION DENSITIES**

<b>Land Use</b>	<b>Units Per Acre</b>	<b>Population Per Unit</b>
Single Family - Detached	3.5	2.87
Single Family - Attached	4.0	2.3
Multi-Family	24.0	1.9

Because the estimated water demand in this analysis is based on the growth rate shown, any change will directly affect estimated demand rates. Table 2 provides a summary of the historical and projected residential population from 1980 to 2036.

**TABLE 2**  
**RESIDENTIAL POPULATION PROJECTIONS**

<b>Year</b>	<b>Status</b>	<b>Population</b>
1980	Reported	40,595
1990	Reported	82,591
2000	Reported	109,839
2010	Reported	119,097
2020	Reported	133,434
2036	Projected	146,187

As shown in Table 3, steady residential growth is expected, which should result in the projected build-out of residential areas by the year 2036.

## D) PROJECTED WATER USE

The design of the water distribution system involves various rates of water use which are generally, referred to as water demand. The three most significant rates and a definition of each are:

- 1) Maximum Daily Demand: This is the total amount of water used during the day of heaviest consumption in any given year and the minimum rate, which the high service pumps must be capable of pumping. Water must be supplied to the pumps at this rate.
- 2) Maximum Hourly Demand: This is the rate at which water is drawn from the entire distribution system during the hour of maximum consumption on the day of maximum demand. This rate is generally of a short duration and is most economically provided for by the use of elevated storage in addition to water supplied to the system by pumps. The distribution system, including storage and pumping capacity, must be able to satisfy this demand.
- 3) Minimum Hourly Demand: This is the rate at which water is drawn from the entire distribution system during the hour of minimum demand on the day of maximum demand. This demand rate is used in the water distribution analysis to determine the adequacies of the system to replenish elevated storage.

Analysis and design of the proposed water distribution system is based on the maximum water demand and the distribution of that demand according to the projected future land use anticipated in the City of Carrollton. This maximum demand typically occurs after an extended period in which consecutive 100°F days which most often occurs within the months of July, August and September. A water demand study was completed by obtaining hourly pumping and elevated storage records, provided by the City, for the summer of 2022, in order to establish a calculated residential per capita water rate in gallons per capita per day (gpcd). Included in the 2022 data collection was water volume of commercial and industrial land uses. The day of maximum demand occurred on July 27, 2022. Table 3 provides a summary of the residential design demand rates.

**TABLE 3**  
**RESIDENTIAL WATER DESIGN DEMAND RATES**

Land Use	Maximum Daily Demand	Maximum Hourly Demand	Peaking Factor
Low Density Residential	250 gpcd	433 gpcd	1.73
Medium Density Residential	250 gpcd	433 gpcd	1.73
High Density Residential	250 gpcd	433 gpcd	1.73

Non-residential demand rates were established by comparing the anticipated land and water use in Carrollton to that of other communities in North Central Texas. The non-residential demand rates were also calculated from billing data provided by the City for the Summer of 2022. Table 4 summarizes the non-residential design demand rate applied to the water distribution system.

**TABLE 4**  
**LAND USE AND DESIGN DEMANDS**

Land Use	Max Daily Demand	Max Hourly Demand
Commercial - High Intensity	4,500 gpad	8,325 gpad
Commercial - Medium Intensity	3,600 gpad	6,600 gpad
Commercial - Low Intensity	3,000 gpad	5,550 gpad
Industrial	1,000 gpad	1,850 gpad
Mixed Use - Transit	1,000 gpad	1,850 gpad
Mixed Use - Urban	1,300 gpad	2,405 gpad
Office - High Intensity	1,500 gpad	2,775 gpad
Office - Medium Intensity	1,400 gpad	2,590 gpad
Office - Low Intensity	1,300 gpad	2,405 gpad
Public Institution - School	1,200 gpad	2,220 gpad
Park - Private	1,000 gpad	1,850 gpad
Park - Public	500 gpad	925 gpad



The following table presents the projected design demand rates in million gallons per day placed on the overall water distribution system at build-out:

**TABLE 5**  
**BUILD-OUT WATER DEMANDS BY SERVICE AREA**

Land Use	Max Daily Demand	Max Hourly Demand
Low Service Area (640)	2.81	5.19
Medium Service Area (699)	21.47	39.73
High Service Area (770)	17.26	31.06
Midway Service Area (822)	2.12	3.81
Golden Bear Service Area (780)	0.48	0.87
<b>TOTAL</b>	<b>44.14</b>	<b>80.66</b>

## **E. WATER DISTRIBUTION SYSTEM ANALYSIS**

Analysis of the water distribution system was performed utilizing Infowater Pro (Version 2.9.0) computer software to aid in developing an overall system of water mains, storage facilities and pump stations to serve the City of Carrollton as development is now envisioned. Hydraulic models were created at projected build-out (Year 2036) and for the existing water distribution system (Year 2022) to aid in the development of a capital improvements program.

The development of the build-out water distribution system was based on a 72-hour extended period computer simulation (EPS). A design 72-hour diurnal curve was developed from Carrollton's summer of 2022 demand study. Modeling the water distribution system over a 72-hour period allowed for verification of the ability to draw down and refill ground storage reservoirs and elevated storage tanks under severe conditions.

### **a. Low Service Area (640)**

The existing pressure divide between the Low and Medium Service Areas is generally located along and east of IH-35E and south of Sandy Lake Road. Ground elevations range from 400-feet MSL to 500-feet MSL within the Low Service Area. The Hutton Elevated Tank serves the Low Service Area and it has a high water level established at 640 feet. This service area contains areas primarily zoned as industrial. The City of Dallas' Burning Tree delivery point maintains pressure in this service area with a backup supply and pressure from the City of Carrollton's Don Cline Pump Station, through pressure reducing valves.

### **b. Medium Service Area (699)**

The existing pressure divide between the Medium and High Service Areas is generally located near Josey Lane. The ground elevations range from 430-feet MSL to 560-feet MSL within the Medium Service Area. The Josey Elevated Tank and Hebron Elevated Tank serve the Medium Service Area and have a high water level established at 699 feet. The Don Cline and Columbian Club Pump Stations currently supply water to the Medium service area.

### **c. High Service Area (770)**

The existing pressure divide between the High and Midway Service Areas is generally located east of Marsh Lane. Ground elevations range from 500-feet MSL to 650-feet MSL within the High Service Area. The Marsh North Elevated Tank and Marsh South Elevated Tank serve the High Service Area and have a high water level established at 770 feet. The Columbian Club and Bobby Ballard Pump Stations currently supply water to this service area.

**d. Midway Service Area (822)**

The existing pressure divide between the High and Midway Service Area is generally located east of Marsh Lane. A portion of the Marsh North Elevated Tank is utilized to serve the Midway Service Area. The Marsh North Pump Station pumps water out of the Marsh North Elevated Tank in order to serve the Midway Service Area. Ground elevations range from 595-feet MSL to 710-feet MSL within the Midway Service Area

**e. Golden Bear Service Area (780)**

The existing pressure divide between the High Service Area and the Golden Bear Service Area is generally located east of Marsh Lane and south of Trinity Mills Road. The elevation in this general area increases from 600 feet above mean sea level to approximately 700 feet. The Golden Bear Booster Station currently supplies water to this service area.

## F. WATER SUPPLY

Potable water in the City of Carrollton is supplied by Dallas Water Utilities (DWU) at five delivery points within the system. Two of the delivery points are located at the Columbian Club Pump Station, Vault 1 and Vault 2 (Vault 2 was relocated and rebuilt as part of the DART Silver Line Project in 2023). The third delivery point is at the Jackson Road Vault, the fourth delivery point is at the Burning Tree Vault, and the fifth delivery point is at the Bobby Ballard Vault. The supply line feeding the Bobby Ballard Vault is a joint supply line from the DWU Elm Fork Water Treatment Plant supplying water to the Cities of Carrollton, Lewisville and The Colony. The three cities own the supply line. The contractual rate of delivery of treated water to the City is based on the maximum daily demand rate. Currently, the incoming flow rate from Dallas Water Utilities for the City of Carrollton is 41.0 MGD. Through the Extended Period Simulation Computer Model, it was determined that a build-out supply of approximately 44.13 MGD will be required to meet the maximum daily demand placed on the system. The following table presents the existing supply rates. The current rate of flow settings at each if the City's vaults are set to the maximum delivery capacity, so the contractual rate of delivery of treated water must be increased in order to meet the maximum daily demand rate.

**TABLE 6  
INCOMING SUPPLY FLOW**

<b>City of Carrollton Supply Location</b>	<b>2022 Current Rate of Flow Setting (MGD)*</b>	<b>Rate of Flow Setting Required at Buildout (MGD)</b>
Columbian Club Vault #1	4.2	4.2
Columbian Club Vault #2	8.8	8.8
Jackson Road Vault	19.0	20.0
Burning Tree Vault	1.0	2.81
Bobby Ballard Vault	8.0	8.32
<b>Total Incoming Flow:</b>	<b>41.0</b>	<b>44.13</b>

*\*Information obtained from the City.*

**G. PUMP STATIONS & GROUND STORAGE**

**1) Don Cline Pump Station**

The Don Cline Pump Station is located on Old Denton Road, south of Jackson Street, east of the Dallas Water Utilities' Elm Fork Water Treatment Plant. The Don Cline Pump Station currently serves as the primary source of supply for the Medium Service Area. The site contains two 10-million gallon concrete ground storage reservoirs. Each reservoir has a head range of 40.5 feet with a base elevation of 460 feet and a diameter of 200 feet. Seven vertical turbine pumps are presently utilized at this pump station. The system will have the capability to operate with the largest pump out at buildout in its current state. The current spare pump slot is being populated with a small pump to better meet low demands experienced in the winter months. The electrical system, piping and valves are being replaced in 2023. A 1000-kW standby generator is part of the 2023 modernization project.

**2) Columbian Club Pump Station**

The Columbian Club Pump Station is located on Country Club Road, east of Kelly Street. The Columbian Club Pump Station consists of two separate pump stations that serve the High Service Areas. The High Pump Station No. 1 contains three horizontal split case, double suction pumps and an additional slot is available for future expansion; while the High Pump Station No. 2 contains three split case, horizontal, double suction pumps with no slots for expansion. The site currently contains one 5-million gallon concrete ground storage reservoir and one 6-million gallon concrete ground storage reservoir. The total ground storage reservoir at this site is currently 11 million gallons. The five million gallon reservoir has a head range of 34 feet with a base elevation of 534 feet and a diameter of 158 feet. The six million gallon reservoir has a head range of 27 feet with a base elevation of 540 feet and a diameter of 192 feet. The system will have the capability to operate with the largest pump out at buildout in its current state. The Columbian Club Pump Station has a 750-kW standby generation for High Zone 1 and a 450-kW standby generator for High Zone 2. The electrical portion of the site was reconstructed in 2015.

3) **Bobby Ballard Pump Station**

The Bobby Ballard Pump Station is located on Josey Lane, south of Parker Road and west of Plano Parkway. The Bobby Ballard Pump Station currently serves the High Service Area. Supply is from DWU through the Bobby DWU meter vault. The site contains one 5.5-million gallon ground storage reservoir. The reservoir has a head range of 41 feet with a base elevation of 540 feet and a diameter of 150 feet. Three vertical turbine pumps are presently utilized for this pump station. One additional slot is available for future expansion. It is determined through a 72-hour extended period simulation that the Bobby Ballard Pump Station will require the addition of a new pump in order to meet the maximum daily demands at buildout. A 600-kW standby generator is being added to this station and should be in service by the summer of 2024.

4) **Marsh North Booster Pump Station**

The Marsh North Pump Station is located on the Marsh North EST site. The Marsh North Pump Station currently serves as the booster station for supply to the Midway Service Area. The pumps utilize the Marsh North Elevated Tank, which currently serves the High Service Area, as a source of supply. Three vertical turbine pumps are presently utilized for this pump station. One additional slot is available for future expansion. The boosted area experience high pressures in a small defined area. Isolating that area with pressure reducing valves (85 psi to 75 psi) is being proposed. A 150-kW standby generator is being added to this station and should be in service by the summer of 2024.

5) **Golden Bear Booster Pump Station**

The Golden Bear Booster Pump Station is located on the East side of Tarpley Road and south of Belmeade Drive. The booster station has two horizontal split case pumps of 1,015 gpm each. The site contains one 0.75 million gallon ground storage reservoir. The reservoir has a head range of 20 feet with a base elevation of 630 feet and a diameter of 25 feet. The booster station also contains a 12,000 gallon pneumatic tank. This area was converted from a pressure point system to a pneumatic tank system as required by TCEQ. As such, the city has experienced a pump failure and is in need to have automatic valves to open the high service area to maintain minimum pressures if and when such conditions occur. This station had a 200-kW standby generator added in 2021 as part of the reconstruction to meet TCEQ requirements.

## H. ELEVATED STORAGE

The volume of elevated storage required within a water distribution system is a function of the maximum daily demand rate (pumping rate) and the maximum hourly demand rate to provide supply for 6 hours. At buildout, each service area will have enough elevated storage to meet the maximum hourly demand and will not require additional elevated storage. The elevated storage required at buildout is 9.15-MG, which will be met with the existing 11.5-MG in elevated storage. Table 7 lists the existing elevated storage tanks with their respective tank volumes.

A 72-hour extended period simulation (EPS) was performed to ensure the existing and proposed elevated tanks would discharge and refill within an acceptable range, based on the size of the elevated storage tanks. The EPS was run by placing controls on pumps and linking them to the water level in the elevated tanks. As the water level in elevated storage tanks begin to drop, pumps will turn on according to the pump control settings. When the water level in the elevated storage tanks begins to rise, pumps will turn off according to the pump control settings. This allowed the maximum pumping capacity at each pump station to be optimized to the firm pumping rates.

**TABLE 7**

### **ELEVATED STORAGE REQUIREMENTS PER SERVICE AREA**

<b>Service Area</b>	<b>Elevated Storage Tank</b>	<b>Tank Volume</b>
<b>EXISTING ELEVATED STORAGE</b>		
Low	Hutton (June 1992)	2.0 MG
Medium	Josey (Nov. 2022)	2.0 MG
Medium	Hebron (1987)	3.0 MG
High	Marsh North* (Dec. 2006)	3.0 MG
High	Marsh South (Apr. 1997)	2.0 MG
<b>Subtotal: Existing</b>	<b>6 Tanks</b>	<b>12.0 MG</b>

\* Existing Midway Service Area utilizes a booster pump station, Marsh North Pump Station, which in turn pumps a percentage of storage from the Marsh North Elevated tank.

**I. FIRE FLOW ANALYSIS**

A fire hydrant is an element of the water distribution system that provides for public fire-protection service. The usage of a fire hydrant as a source of water for fire fighting is the primary purpose for which the element is installed. A fire flow analysis was performed on the water distribution system utilizing the InfoWater Pro software. Each service area was analyzed for fire protection during the maximum daily and maximum hourly demand at Build-out. Every junction node in each of the service areas was analyzed in order to meet the following constraints, which meet or exceed TCEQ standards:

- 1) Fire Flow Required for a Given Junction (1 hydrant) ..... 1.44 mgd (1,000 gpm)
- 2) Maximum Available Fire Flow ..... 3.00 mgd (2,083 gpm)
- 3) Residual Pressure at the Fire Flow Junction ..... 20 psi

A single fire hydrant has a maximum discharge rate of 1.44 MGD (1,000 gpm). The analysis consisted of placing up to 2.88 MGD (the equivalent of using 2 fire hydrants with 4 outlet nozzles each) at a junction node and requiring the water distribution system to maintain a minimum pressure of 20 psi during the maximum hourly demand. The Low, Medium, High, Midway and Golden Bear Service Areas met the minimum requirements.



**J. RECOMMENDATIONS FOR SYSTEM IMPROVEMENT****1) Pump Stations and Storage Facilities**

The following projects outlined in Tables 8 will need to be placed into service to improve pump stations capacities to meet system demands.

**TABLE 8  
PROPOSED PUMP STATION EXPANSION**

Service Area	Pump Station Expansion
High	Bobby Ballard Pump Station (1 New Pump – 4.1 MGD)

**2) Distribution Lines**

The following proposed waterlines outlined in Table 9 will need to be placed into service to either improve pressures and velocities during the maximum hourly demand in each of the Service Areas, and to fill in missing water distribution lines needed to complete closed loops within the system:

**TABLE 9  
PROPOSED TRANSMISSION AND DISTRIBUTION WATER LINES**

Service Area	Distribution Line (General Location)	Pipeline Label	Diameter (Inches)	Length (Feet)
Medium	East Trinity Mills Rd	1794	12	1,515
Medium	East Trinity Mills Rd	1798	12	490

### 3) **Control Valves:**

The proposed control valve project in the Midway Service Area are proposed for the subdivision located on Hebron Parkway and Marsh Lane where high pressures of above 90 psi are being experienced. Control valves were placed in three locations near the subdivision to help alleviate those pressures. The proposed control valves are placed at Hebron Pkwy and Haskell Dr. & Hebron Pkwy and Marsh Lane to flow water into the subdivision, and Creekway Drive and Riverview Drive to relieve over pressure.

Control valves in the Golden Bear Service Area are proposed to be installed to help back feed the area in the event of pressure loss. The locations of these valves are at Trinity Mills and Tarpley and at Commander west of Midway Road.

**TABLE 10  
SUMMARY OF VALVES AT BUILD-OUT**

<b>Location</b>	<b>Quantity (Ea.)</b>	<b>Diameter (in)</b>
Midway Service Area	3	8
Golden Bear Service Area	2	6

**K. 10-YEAR CAPITAL IMPROVEMENT PROGRAM SUMMARY**

The following tables contain the City of Carrollton’s 10-Year Capital Improvement Program for water distribution projects. All costs shown are in 2022 dollars and have no debt service attached.

**TABLE 11  
PROPOSED FACILITIES AND SYSTEM IMPROVEMENTS**

Item No.	Description	Quantity	Unit	Price	Amount
<b>BOBBY BALLARD PUMP STATION - NEW PUMP</b>					
1	Furnish, Install and Make Operational New Water Pump	1	Ea.	\$ 130,000.00	\$ 130,000.00
	<b>Subtotal:</b>				\$ 130,000.00
	Contingencies and Miscellaneous Items	20.0%			\$ 26,000.00
	<b>Construction Total</b>				\$ 156,000.00
	Engineering and Construction Admin	12.0%			\$ 18,700.00
	<b>Project Total:</b>				\$ <b>174,700.00</b>
<b>GOLDEN BEAR SERVICE AREA</b>					
1	Furnish & Install 6-inch Control Valve in 6-foot Manhole (at Trinity Mills and Tardley & at Commander west of Midway Rd.) to back feed area in event of pressure loss	2	Ea.	\$ 55,000.00	\$ 110,000.00
	<b>Subtotal:</b>				\$ 110,000.00
	Contingencies and Miscellaneous Items	20.0%			\$ 22,000.00
	<b>Construction Total</b>				\$ 132,000.00
	Engineering and Construction Admin	12.0%			\$ 15,800.00
	<b>Project Total:</b>				\$ <b>147,800.00</b>
<b>MIDWAY SERVICE AREA</b>					
1	Furnish & Install 8-inch Control Valve in 6-foot Manhole (at Hebron Pkwy and Haskell Dr, Hebron Pkwy and Marsh Ln & at Creekway Dr and Riverview Dr.)	3	Ea.	\$ 80,000.00	\$ 240,000.00
	<b>Subtotal:</b>				\$ 240,000.00
	Contingencies and Miscellaneous Items	20.0%			\$ 48,000.00
	<b>Construction Total</b>				\$ 288,000.00
	Engineering and Construction Admin	12.0%			\$ 34,600.00
	<b>Project Total:</b>				\$ <b>322,600.00</b>
<b>PROP. 12-INCH WATER LINE P1794 &amp; 1798 (CITY INITIATED)</b>					
1	Furnish & Install 12-inch Water Line	2,010	L.F.	\$ 180.00	\$ 361,800.00
2	Connect to Existing Water Line	1	Ea.	\$ 3,700.00	\$ 3,700.00
3	Trench Safety Plan and Implementation	2,010	L.F.	\$ 8.00	\$ 16,080.00
4	Erosion Control Plan and Implementation	1	L.S.	\$ 6,000.00	\$ 6,000.00
5	Surface Restoration (Pavement, Sod, or Hydromulch)	5,000	S.Y	\$ 20.00	\$ 100,000.00
6	Traffic Control Plan and Implementation	1	L.S.	\$ 6,000.00	\$ 6,000.00
	<b>Subtotal:</b>				\$ 493,580.00
	Contingencies and Miscellaneous Items	20.0%			\$ 98,700.00
	<b>Construction Total</b>				\$ 592,280.00
	Engineering and Construction Admin	12.0%			\$ 71,100.00
	<b>Project Total:</b>				\$ <b>663,380.00</b>


## L. HYDRAULIC ANALYSIS

A computer assisted analysis was performed utilizing Infowater computer software to aide in developing an overall system of water mains, storage facilities and pump stations to efficiently serve the entire City as development is now envisioned. The resulting plan is shown on the water distribution map inside this report. The master plan map shows the size and location of all existing and future feeder mains as well as existing and future elevated storage facilities. Also shown are reference numbers on pipes and pipe intersections or nodes. These numbers refer to additional information contained in the computer printout. Three computer analyses were undertaken: the maximum daily demand, the maximum hourly demand on the day of maximum demand, and the minimum hourly demand on the day of maximum demand.

The hydraulic information shown on the computer printout is described as follows:

- 1) **Pipe Label** - number shown on system map for each section of pipe between nodes.
- 2) **Junction Label** - Pump Station, intersection of pipe, or water use point. The first node number indicates the flow entering a section of pipe, the second node number indicates flow leaving that section of pipe. A minus sign indicates the flow opposite of the node order.
- 3) **Length** - Distance between nodes in feet.
- 4) **Diameter** - Pipe diameter in inches.
- 5) **Hazen William Coefficient** - Coefficient of friction designated to the section of pipe.
- 6) **Boundary Node** - Pressure zone elevation based on U.S.C. & G.S. datum. Location of elevated storage tank.
- 7) **Demand** - Design flow at nodes in million gallons per day (MGD). A minus sign indicates flow into the system.
- 8) **Elevation** - Ground elevation at node based on U.S.C. & G.S. datum.
- 9) **Connecting Pipe** - Pipe number connecting to junction node.
- 10) **Flow Rate** - Rate of flow in pipe section in million gallons per day.
- 11) **Pressure Pipe Headloss** - Friction headloss in section of pipe, in feet.
- 12) **Velocity** - Velocity of flow in section of pipe in feet per second (fps).
- 13) **Headloss Gradient ft/1000** - Friction loss in feet per thousand feet of pipe.
- 14) **Calculated Hydraulic Grade ft** - Elevation of water surface at node based on U.S.C. & G.S. datum (hydraulic gradient).
- 15) **Junction Pressure** - Pressure in pounds per square inch (psi) at the node.


**CITY OF CARROLLTON, TEXAS  
3 DAY WATER DEMAND CURVE  
(JULY 26 through JULY 28)**

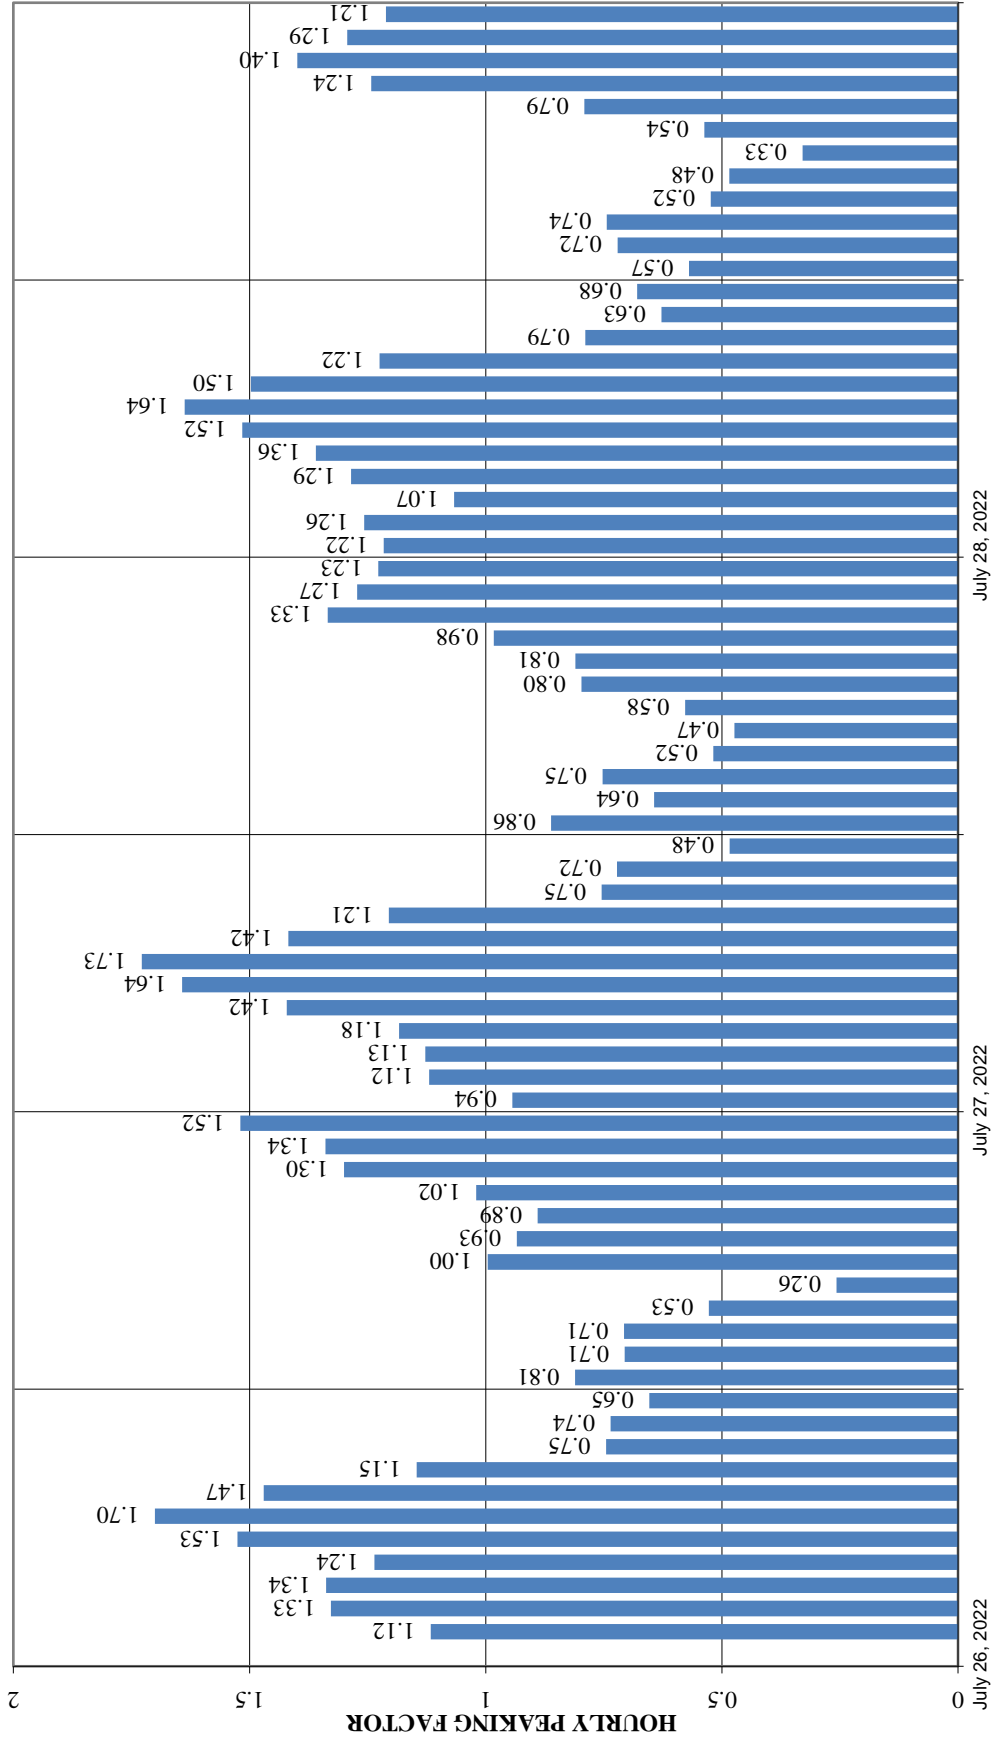

**TABLE 1: CITY OF CARROLLTON - DEMAND STUDY RESULTS**  
**July 26 - July 28, 2022**


DATE	Time (hr)	Total Hourly Pumpage (GAL)	Volume into Elev. Storage (GAL)	Volume out of Elev. Storage (GAL)	Difference Between Vol. into Elev. Stor. & Out of Elev Storage (GAL) ( ) Represents Refill Deficiency	Net System Demand (GAL)	Net System Hour Demand (gal/day)	HOURLY PEAKING FACTOR
July 26, 2022	0:00	2,281,740.1	0.0	0.0		0.0	0.0	0.00
	1:00	1,513,337.7	(20,706.4)	105,378.2		1,598,009.5	38,352,228.7	1.12
	2:00	1,702,014.0	(15,529.8)	214,135.2		1,900,619.4	45,614,866.6	1.33
	3:00	1,948,113.9	(78,420.3)	45,210.0		1,914,903.6	45,957,685.8	1.34
	4:00	1,919,470.2	(203,545.5)	52,745.0		1,768,669.7	42,448,073.3	1.24
	5:00	2,086,278.6	(59,118.5)	157,002.0		2,184,162.1	52,419,890.4	1.53
	6:00	2,223,104.4	(20,706.8)	232,193.2		2,434,590.8	58,430,178.6	1.70
	7:00	2,177,382.9	(78,090.9)	4,898.9		2,104,190.9	50,500,580.8	1.47
	8:00	1,825,775.3	(219,184.1)	34,292.3		1,640,883.5	39,381,205.1	1.15
	9:00	1,038,540.6	(48,028.2)	76,465.8		1,066,978.2	25,607,477.3	0.75
	10:00	606,851.9	0.0	446,259.6		1,053,111.5	25,274,676.5	0.74
	11:00	428,159.1	0.0	507,715.2		935,874.3	22,460,983.9	0.65
	12:00	719,014.2	0.0	441,921.9		1,160,936.1	27,862,465.5	0.81
	13:00	1,213,265.0	(202,613.5)	0.0		1,010,651.5	24,255,635.7	0.71
	14:00	1,369,724.0	(357,101.8)	0.0		1,012,622.2	24,302,933.5	0.71
	15:00	1,231,788.0	(476,815.0)	0.0		754,973.0	18,119,351.8	0.53
	16:00	409,328.3	(92,259.6)	51,009.7		368,078.4	8,833,881.6	0.26
	17:00	720,919.2	0.0	704,298.3		1,425,217.5	34,205,220.7	1.00
	18:00	1,747,677.8	(410,044.4)	0.0		1,337,633.4	32,103,200.8	0.93
	19:00	1,764,936.9	(490,544.4)	0.0		1,274,392.5	30,585,420.0	0.89
	20:00	1,785,045.6	(324,770.3)	0.0		1,460,275.3	35,046,608.3	1.02
	21:00	1,137,943.1	0.0	723,350.5		1,861,293.6	44,671,045.6	1.30
	22:00	1,653,809.2	0.0	263,167.0		1,916,976.2	46,007,429.8	1.34
	23:00	2,240,807.7	(103,873.0)	38,783.4		2,175,718.1	52,217,233.3	1.52
<b>TOTAL</b>		<b>35,745,027.8</b>	<b>(3,201,352.5)</b>	<b>4,098,826.2</b>	<b>(897,473.7)</b>	<b>DAILY DEMAND 34,360,761.4</b>		
July 27, 2022	0:00	2,165,301.9	(547,336.7)	0.0		1,617,965.2	38,831,165.0	0.94
	1:00	2,061,577.9	(186,192.4)	43,934.1		1,919,319.6	46,063,671.2	1.12
	2:00	2,018,456.7	(106,981.6)	22,201.1		1,933,676.2	46,408,228.9	1.13
	3:00	2,040,480.6	(94,809.0)	82,885.0		2,028,556.6	48,685,358.1	1.18
	4:00	2,308,474.8	(25,019.3)	153,431.8		2,436,887.3	58,485,295.6	1.42
	5:00	2,462,139.9	0.0	354,492.6		2,816,632.5	67,599,179.7	1.64
	6:00	2,672,800.3	(14,697.3)	305,080.8		2,963,183.8	71,116,411.4	<b>1.73</b>
	7:00	2,399,528.4	(59,004.3)	90,420.0		2,430,944.1	58,342,658.8	1.42
	8:00	2,250,521.3	(194,359.9)	9,777.4		2,065,938.8	49,582,530.9	1.21
	9:00	1,472,055.7	(178,536.2)	0.0		1,293,519.5	31,044,469.2	0.75
	10:00	1,064,207.5	(30,140.0)	203,606.7		1,237,674.2	29,704,180.9	0.72
	11:00	428,932.0	(30,140.0)	430,427.4		829,219.4	19,901,264.7	0.48
	12:00	1,167,378.2	0.0	309,132.8		1,476,511.0	35,436,263.3	0.86
	13:00	1,579,175.4	(476,693.8)	0.0		1,102,481.6	26,459,558.6	0.64
	14:00	1,669,311.5	(378,923.4)	0.0		1,290,388.1	30,969,314.9	0.75
	15:00	1,398,879.6	(510,537.3)	0.0		888,342.3	21,320,214.7	0.52
	16:00	994,314.0	(236,343.8)	53,273.0		811,243.2	19,469,837.1	0.47
	17:00	931,705.1	(160,535.0)	219,672.3		990,842.4	23,780,217.2	0.58
	18:00	1,353,225.7	(139,827.6)	153,539.0		1,366,937.1	32,806,490.9	0.80
	19:00	1,692,220.1	(303,077.9)	0.0		1,389,142.2	33,339,413.8	0.81
	20:00	1,627,266.4	(53,204.8)	110,320.1		1,684,381.7	40,425,160.3	0.98
	21:00	1,866,263.4	0.0	421,650.8		2,287,914.2	54,909,941.8	1.33
	22:00	2,257,775.2	(114,390.1)	37,675.0		2,181,060.1	52,345,443.0	1.27
	23:00	2,193,523.7	(142,518.2)	52,745.0		2,103,750.5	50,490,011.8	1.23
<b>TOTAL</b>		<b>42,075,515.4</b>	<b>(3,983,268.6)</b>	<b>3,054,264.9</b>	<b>929,003.7</b>	<b>DAILY DEMAND 41,146,511.7</b>		
July 28, 2022	0:00	2,247,134.4	(240,144.4)	0.0		2,006,990.0	48,167,760.9	1.22
	1:00	2,163,609.9	(156,811.0)	68,514.6		2,075,313.5	49,807,523.1	1.26
	2:00	1,812,797.4	(90,420.0)	37,839.5		1,760,216.9	42,245,204.6	1.07
	3:00	1,854,379.4	0.0	266,580.2		2,120,959.6	50,903,031.3	1.29
	4:00	2,019,560.0	0.0	223,989.6		2,243,549.6	53,845,189.3	1.36
	5:00	2,441,427.4	0.0	59,808.8		2,501,236.2	60,029,668.3	1.52
	6:00	2,419,763.3	(9,623.6)	292,584.5		2,702,724.2	64,865,381.0	1.64
	7:00	2,350,224.6	(14,557.8)	134,973.6		2,470,640.4	59,295,370.7	1.50
	8:00	2,292,795.7	(271,620.9)	0.0		2,021,174.8	48,508,195.9	1.22
	9:00	1,678,192.8	(375,833.4)	0.0		1,302,359.4	31,256,626.0	0.79
	10:00	1,234,321.5	(197,614.0)	0.0		1,036,707.5	24,880,980.9	0.63
	11:00	991,144.2	0.0	129,982.8		1,121,127.0	26,907,046.8	0.68
	12:00	815,642.7	(37,675.0)	161,974.8		939,942.5	22,558,619.6	0.57
	13:00	1,250,803.0	(85,359.8)	24,440.0		1,189,883.2	28,557,195.7	0.72
	14:00	1,440,365.9	(218,136.0)	4,888.0		1,227,117.9	29,450,830.3	0.74
	15:00	1,116,374.9	(252,137.2)	0.0		864,237.7	20,741,705.3	0.52
	16:00	693,116.1	(29,363.4)	135,379.7		799,132.4	19,179,176.5	0.48
	17:00	212,848.9	0.0	330,693.8		543,542.7	13,045,025.0	0.33
	18:00	430,919.2	0.0	455,365.7		886,284.9	21,270,838.2	0.54
	19:00	642,412.9	0.0	663,465.8		1,305,878.7	31,341,088.8	0.79
	20:00	1,650,582.1	0.0	400,135.6		2,050,717.7	49,217,225.2	1.24
	21:00	2,442,632.8	(133,747.8)	0.0		2,308,885.0	55,413,239.1	1.40
	22:00	2,432,050.9	(297,525.3)	0.0		2,134,525.6	51,228,613.8	1.29
	23:00	2,388,753.2	(390,123.7)	0.0		1,998,629.5	47,967,109.1	1.21
<b>TOTAL</b>		<b>39,021,853.2</b>	<b>(2,800,693.3)</b>	<b>3,390,617.0</b>	<b>(589,923.7)</b>	<b>DAILY DEMAND 39,611,776.9</b>		

# CITY OF CARROLLTON, TEXAS HOURLY TANK LEVELS July 26 through 28, 2022

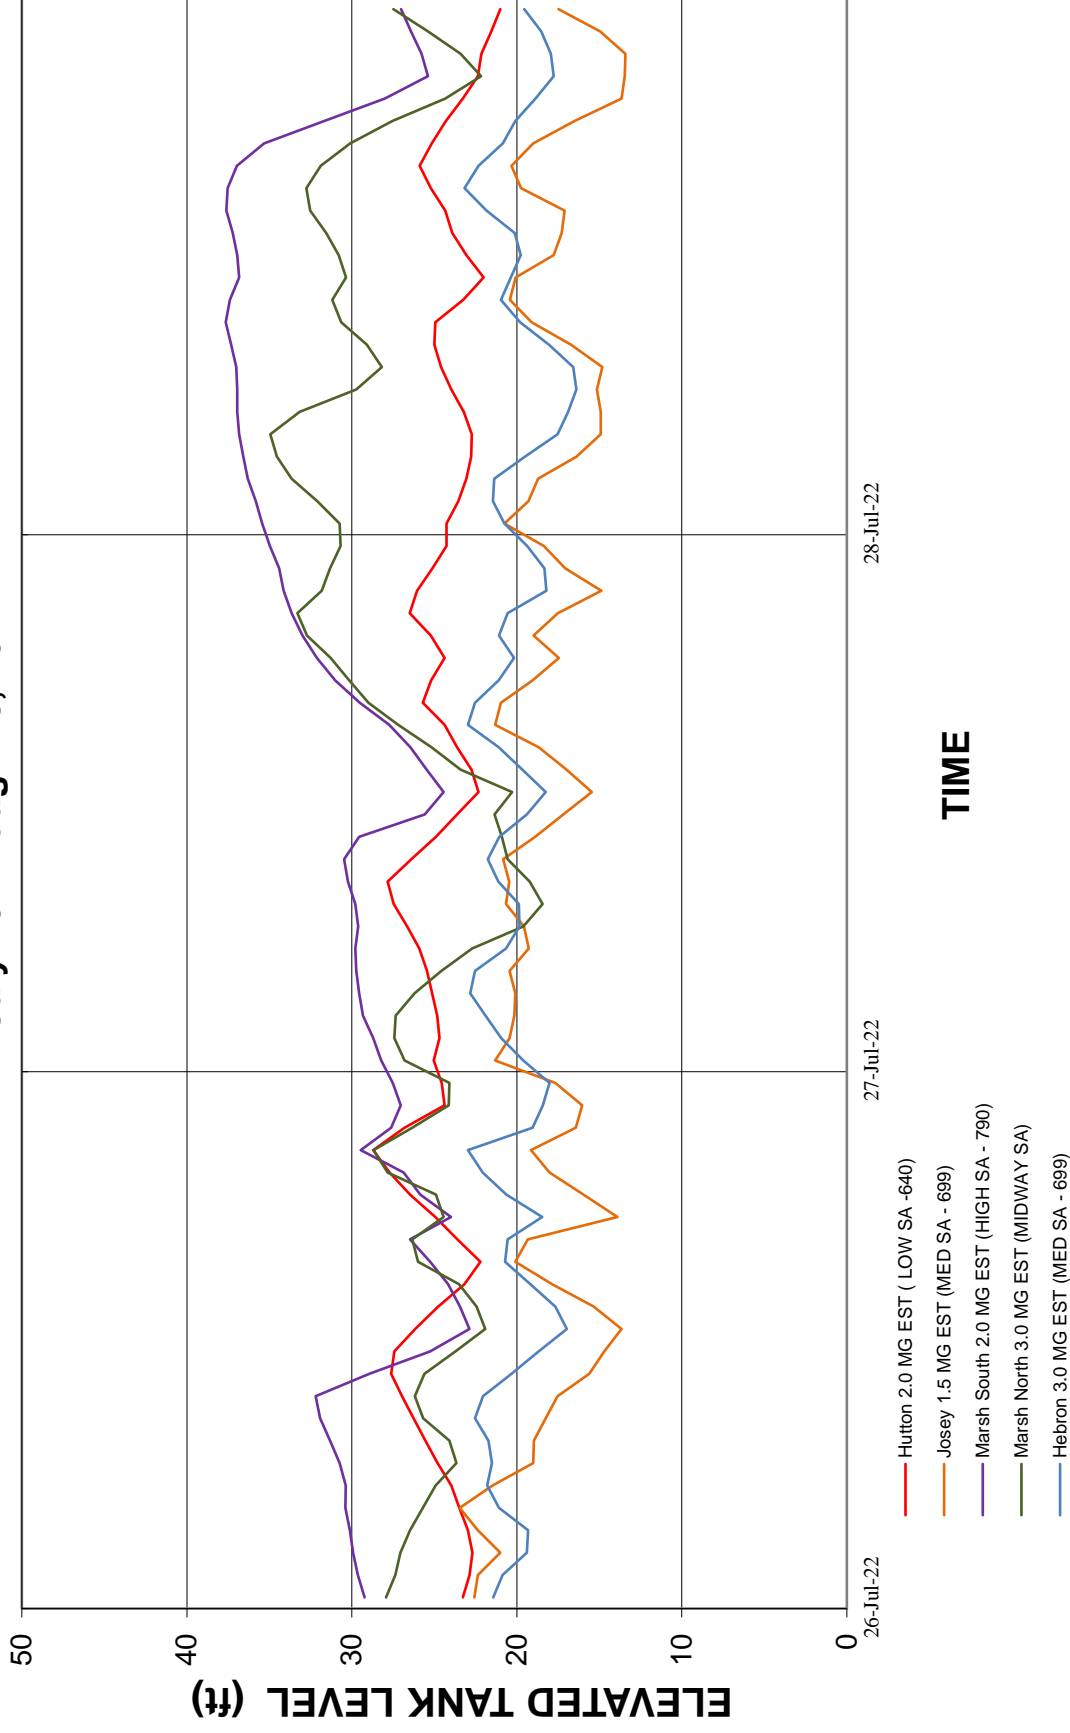



# City of Carrollton Future Land Use Plan

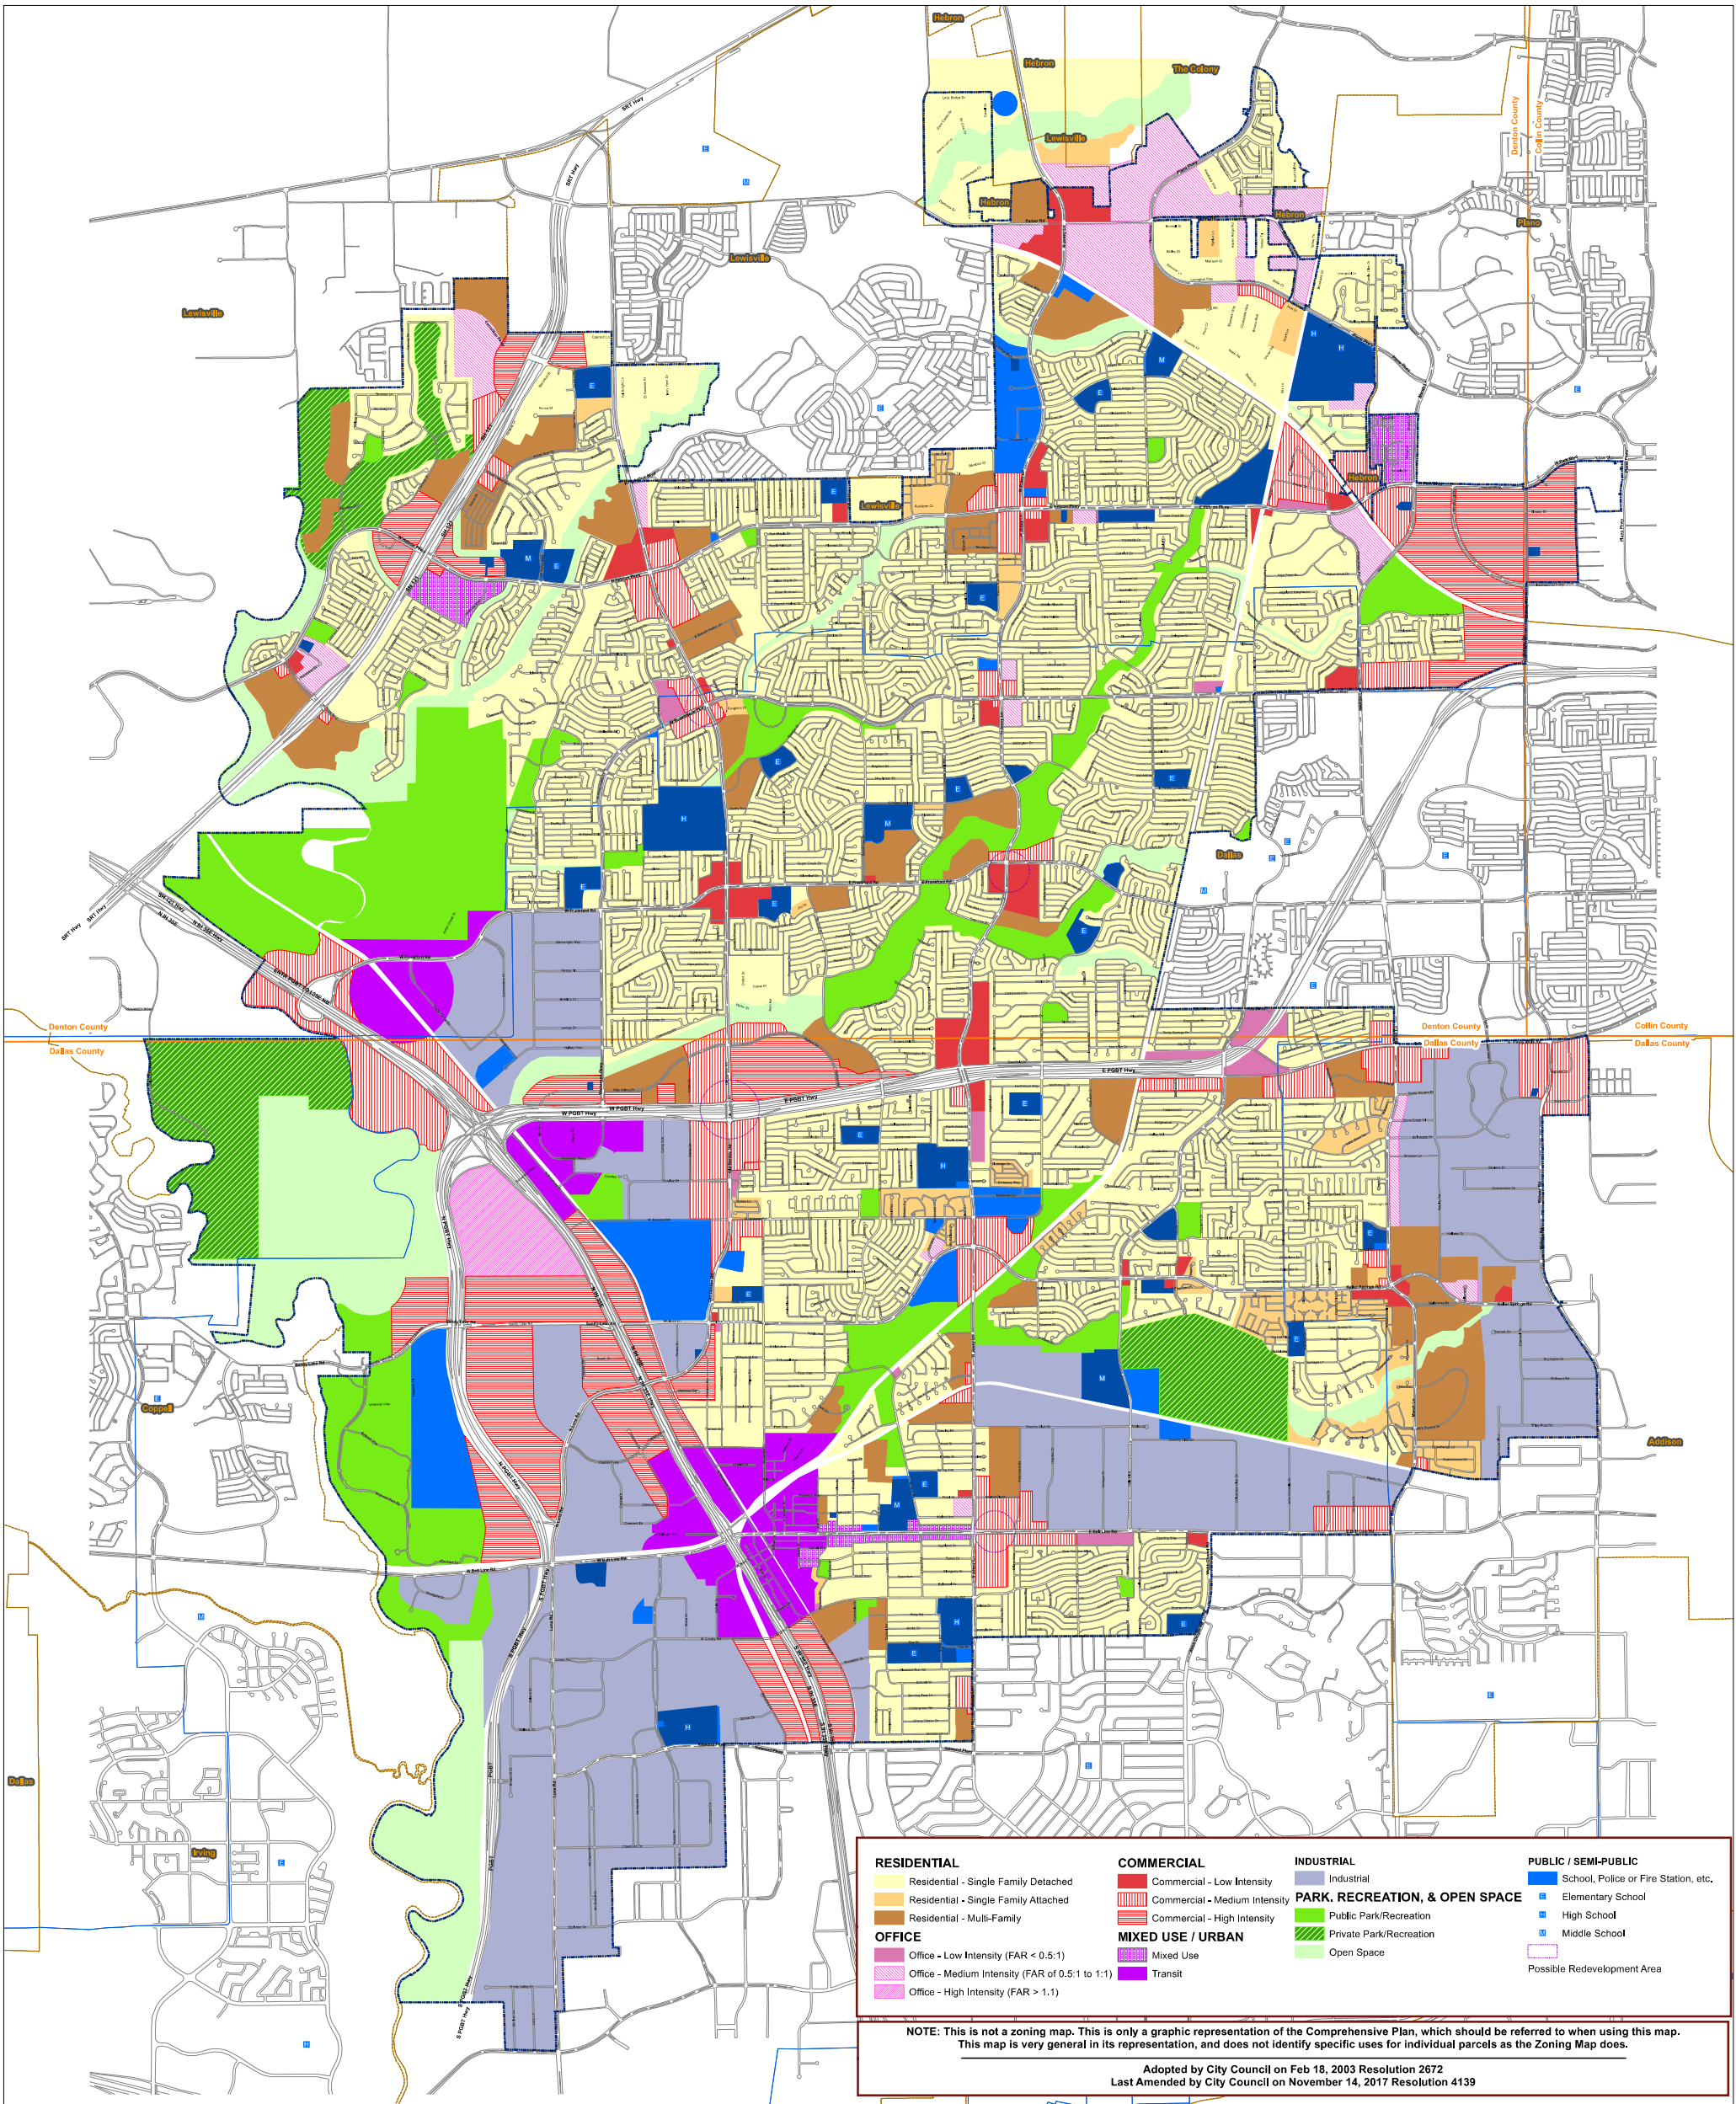

## Future Land Use Map


City of Carrollton, Texas  
Planning Department  
Updated January 1st, 2021

0 0.5 1 2 Miles





# City of Carrollton - Tank Levels at Buildout

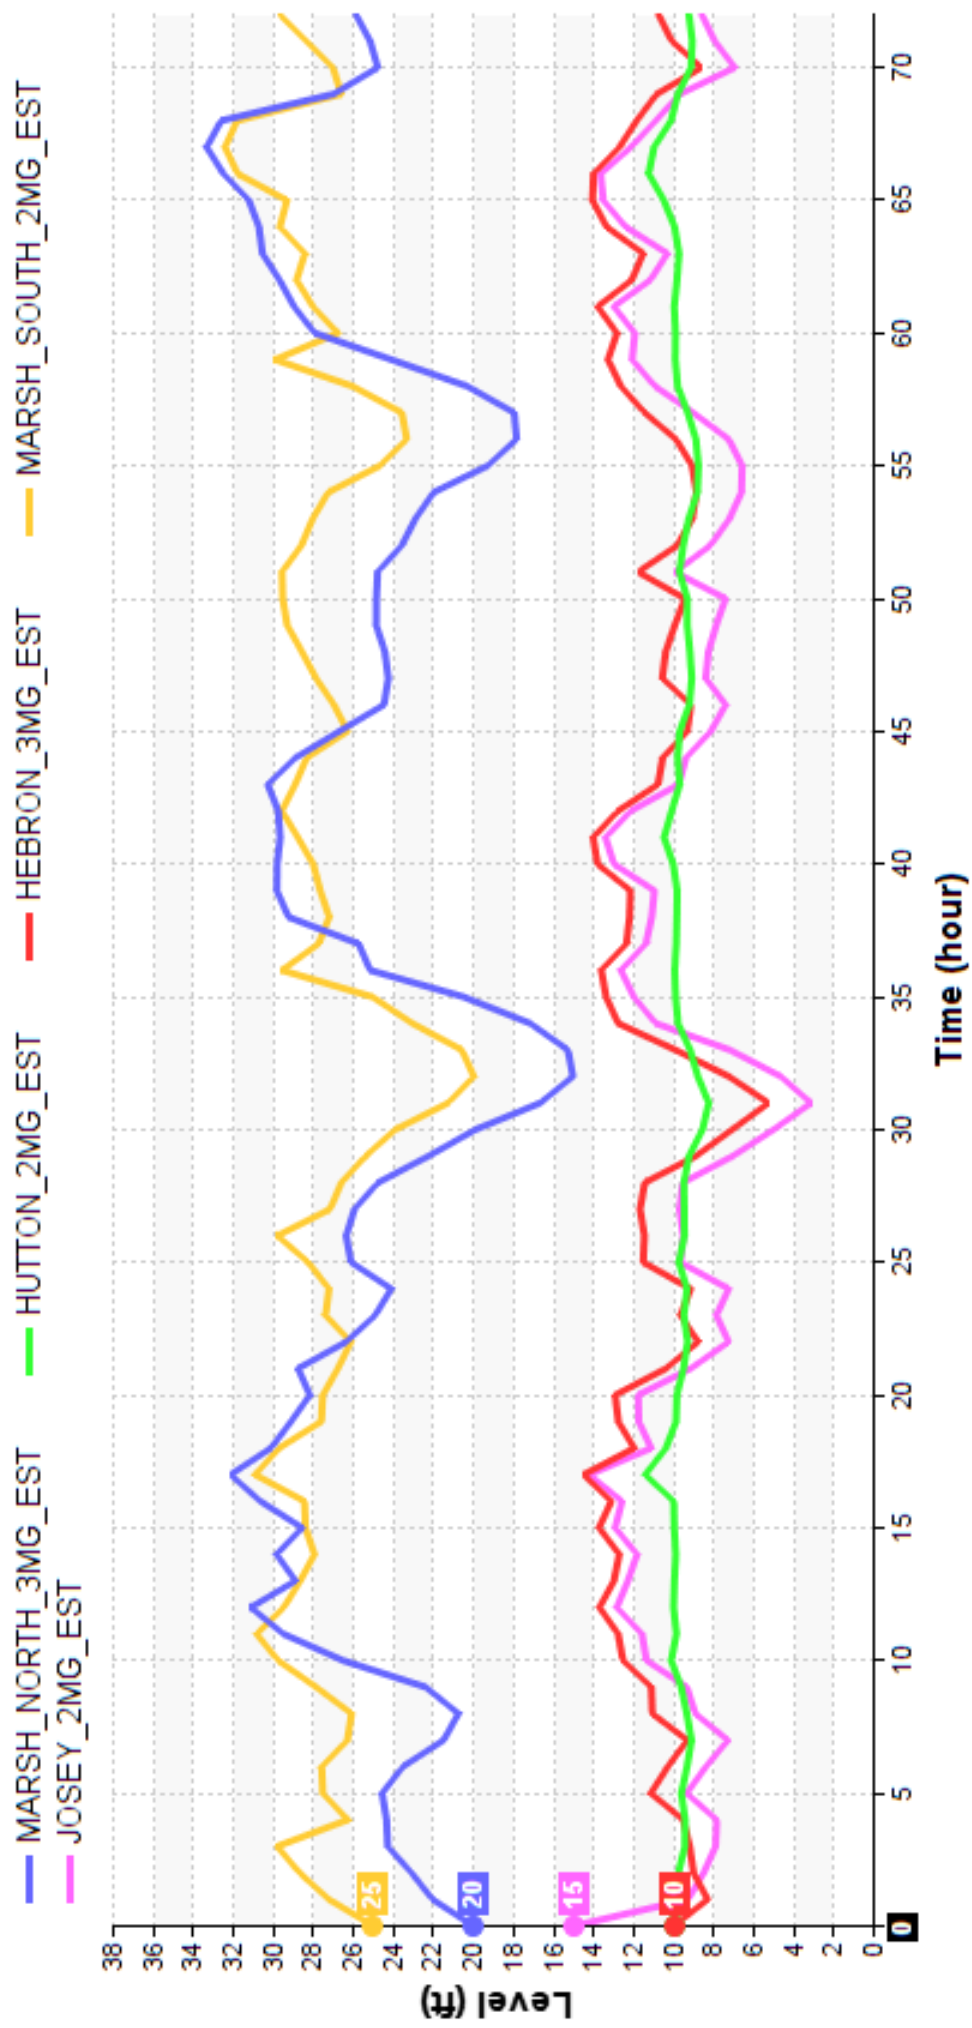



## **2022 WATER DISTRIBUTION STUDY**

### **INPUT DATA**

- ***JUNCTION NODE INPUT***
  - ***PIPE INPUT***
  - ***PUMP INPUT***
  - ***TANK INPUT***

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
1	<input type="checkbox"/>	J-1000	HIGH	558.000	EXISTING
2	<input type="checkbox"/>	J-1001	GOLDEN_BEAR	665.000	EXISTING
3	<input type="checkbox"/>	J-1002	GOLDEN_BEAR	665.000	EXISTING
4	<input type="checkbox"/>	J-1003	GOLDEN_BEAR	635.000	EXISTING
5	<input type="checkbox"/>	J-1004	HIGH	630.000	EXISTING
6	<input type="checkbox"/>	J-1005	HIGH	640.000	EXISTING
7	<input type="checkbox"/>	J-1006	HIGH	653.000	EXISTING
8	<input type="checkbox"/>	J-1007	GOLDEN_BEAR	665.000	EXISTING
9	<input type="checkbox"/>	J-1008	HIGH	530.000	EXISTING
10	<input type="checkbox"/>	J-1009	HIGH	640.000	EXISTING
11	<input type="checkbox"/>	J-101	LOW	450.000	EXISTING
12	<input type="checkbox"/>	J-1010	GOLDEN_BEAR	640.000	EXISTING
13	<input type="checkbox"/>	J-1011	GOLDEN_BEAR	662.000	EXISTING
14	<input type="checkbox"/>	J-1012	HIGH	610.000	EXISTING
15	<input type="checkbox"/>	J-1013	MEDIUM	480.000	EXISTING
16	<input type="checkbox"/>	J-1014	MEDIUM	475.000	EXISTING
17	<input type="checkbox"/>	J-1015	HIGH	550.000	EXISTING
18	<input type="checkbox"/>	J-1016	HIGH	530.500	EXISTING
19	<input type="checkbox"/>	J-1017	MEDIUM	509.000	EXISTING
20	<input type="checkbox"/>	J-1018	MEDIUM	500.000	EXISTING
21	<input type="checkbox"/>	J-1019	LOW	449.000	EXISTING
22	<input type="checkbox"/>	J-102	MEDIUM	505.000	EXISTING
23	<input type="checkbox"/>	J-1020	MEDIUM	455.000	EXISTING
24	<input type="checkbox"/>	J-1021	MEDIUM	453.000	EXISTING
25	<input type="checkbox"/>	J-1022	LOW	450.000	EXISTING
26	<input type="checkbox"/>	J-1023	MEDIUM	460.000	EXISTING
27	<input type="checkbox"/>	J-1024	MEDIUM	465.000	EXISTING
28	<input type="checkbox"/>	J-1025	MEDIUM	460.000	EXISTING
29	<input type="checkbox"/>	J-1026	MEDIUM	465.000	EXISTING
30	<input type="checkbox"/>	J-1027	MEDIUM	475.000	EXISTING
31	<input type="checkbox"/>	J-1028	MEDIUM	470.000	EXISTING
32	<input type="checkbox"/>	J-1029	MEDIUM	510.000	EXISTING
33	<input type="checkbox"/>	J-103	MEDIUM	535.000	EXISTING
34	<input type="checkbox"/>	J-1030	MEDIUM	561.000	EXISTING
35	<input type="checkbox"/>	J-1031	MEDIUM	550.000	EXISTING
36	<input type="checkbox"/>	J-1032	MEDIUM	540.000	EXISTING
37	<input type="checkbox"/>	J-1033	MEDIUM	534.000	EXISTING
38	<input type="checkbox"/>	J-1034	MEDIUM	540.000	EXISTING
39	<input type="checkbox"/>	J-1035	MEDIUM	545.000	EXISTING
40	<input type="checkbox"/>	J-1036	MEDIUM	560.000	EXISTING
41	<input type="checkbox"/>	J-1037	MEDIUM	560.000	EXISTING
42	<input type="checkbox"/>	J-1038	MEDIUM	560.000	EXISTING
43	<input type="checkbox"/>	J-1039	MEDIUM	561.000	EXISTING
44	<input type="checkbox"/>	J-1041	HIGH	565.000	EXISTING
45	<input type="checkbox"/>	J-1043	LOW	450.000	EXISTING
46	<input type="checkbox"/>	J-1044	MEDIUM	455.000	EXISTING
47	<input type="checkbox"/>	J-1045	MEDIUM	500.000	EXISTING
48	<input type="checkbox"/>	J-1046	MEDIUM	455.000	EXISTING
49	<input type="checkbox"/>	J-1047	MEDIUM	535.000	EXISTING
50	<input type="checkbox"/>	J-116	MIDWAY	650.000	EXISTING
51	<input type="checkbox"/>	J-121	MIDWAY	636.330	EXISTING
52	<input type="checkbox"/>	J-122	MIDWAY	636.330	EXISTING
53	<input type="checkbox"/>	J-125	MIDWAY	650.000	EXISTING
54	<input type="checkbox"/>	J-127	HIGH	650.000	EXISTING
55	<input type="checkbox"/>	J-128	HIGH	636.330	EXISTING
56	<input type="checkbox"/>	J-129	MIDWAY	630.000	EXISTING
57	<input type="checkbox"/>	J-130	MEDIUM	450.000	EXISTING
58	<input type="checkbox"/>	J-131	MEDIUM	450.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
59	<input type="checkbox"/>	J-132	HIGH	540.000	EXISTING
60	<input type="checkbox"/>	J-133	HIGH	522.000	EXISTING
61	<input type="checkbox"/>	J-134	HIGH	533.000	EXISTING
62	<input type="checkbox"/>	J-137	HIGH	543.000	EXISTING
63	<input type="checkbox"/>	J-138	LOW	442.000	EXISTING
64	<input type="checkbox"/>	J-139	HIGH	515.000	EXISTING
65	<input type="checkbox"/>	J-140	HIGH	615.000	EXISTING
66	<input type="checkbox"/>	J-141	HIGH	600.000	EXISTING
67	<input type="checkbox"/>	J-142	HIGH	640.000	EXISTING
68	<input type="checkbox"/>	J-143	HIGH	630.000	EXISTING
69	<input type="checkbox"/>	J-144	HIGH	605.000	EXISTING
70	<input type="checkbox"/>	J-145	HIGH	580.000	EXISTING
71	<input type="checkbox"/>	J-146	HIGH	615.000	EXISTING
72	<input type="checkbox"/>	J-147	HIGH	620.000	EXISTING
73	<input type="checkbox"/>	J-148	HIGH	575.000	EXISTING
74	<input type="checkbox"/>	J-149	HIGH	562.000	EXISTING
75	<input type="checkbox"/>	J-150	MIDWAY	655.000	EXISTING
76	<input type="checkbox"/>	J-151	MEDIUM	542.000	EXISTING
77	<input type="checkbox"/>	J-152	MEDIUM	542.000	EXISTING
78	<input type="checkbox"/>	J-153	HIGH	510.000	EXISTING
79	<input type="checkbox"/>	J-154	HIGH	510.000	EXISTING
80	<input type="checkbox"/>	J-155	HIGH	525.000	EXISTING
81	<input type="checkbox"/>	J-156	MEDIUM	535.000	EXISTING
82	<input type="checkbox"/>	J-157	MEDIUM	545.000	EXISTING
83	<input type="checkbox"/>	J-158	MEDIUM	548.000	EXISTING
84	<input type="checkbox"/>	J-159	HIGH	552.000	EXISTING
85	<input type="checkbox"/>	J-160	MEDIUM	535.000	EXISTING
86	<input type="checkbox"/>	J-161	MEDIUM	500.000	EXISTING
87	<input type="checkbox"/>	J-162	MEDIUM	535.000	EXISTING
88	<input type="checkbox"/>	J-163	MEDIUM	535.000	EXISTING
89	<input type="checkbox"/>	J-164	MEDIUM	545.000	EXISTING
90	<input type="checkbox"/>	J-165	HIGH	537.000	EXISTING
91	<input type="checkbox"/>	J-200	LOW	450.000	EXISTING
92	<input type="checkbox"/>	J-2001	GOLDEN_BEAR	628.000	EXISTING
93	<input type="checkbox"/>	J-2002	HIGH	628.000	EXISTING
94	<input type="checkbox"/>	J-2003	GOLDEN_BEAR	633.000	EXISTING
95	<input type="checkbox"/>	J-201	LOW	450.000	EXISTING
96	<input type="checkbox"/>	J-2019	HIGH	570.000	EXISTING
97	<input type="checkbox"/>	J-202	LOW	440.000	EXISTING
98	<input type="checkbox"/>	J-2020	HIGH	570.000	EXISTING
99	<input type="checkbox"/>	J-2021	HIGH	605.000	EXISTING
100	<input type="checkbox"/>	J-2022	HIGH	590.000	EXISTING
101	<input type="checkbox"/>	J-203	LOW	437.000	EXISTING
102	<input type="checkbox"/>	J-204	LOW	435.000	EXISTING
103	<input type="checkbox"/>	J-205	MEDIUM	490.000	EXISTING
104	<input type="checkbox"/>	J-207	LOW	435.000	EXISTING
105	<input type="checkbox"/>	J-208	LOW	435.000	EXISTING
106	<input type="checkbox"/>	J-209	LOW	432.000	EXISTING
107	<input type="checkbox"/>	J-210	LOW	432.000	EXISTING
108	<input type="checkbox"/>	J-211	LOW	432.000	EXISTING
109	<input type="checkbox"/>	J-212	LOW	435.000	EXISTING
110	<input type="checkbox"/>	J-213	LOW	435.000	EXISTING
111	<input type="checkbox"/>	J-214	LOW	432.000	EXISTING
112	<input type="checkbox"/>	J-215	LOW	435.000	EXISTING
113	<input type="checkbox"/>	J-216	LOW	435.000	EXISTING
114	<input type="checkbox"/>	J-217	LOW	435.000	EXISTING
115	<input type="checkbox"/>	J-218	LOW	435.000	EXISTING
116	<input type="checkbox"/>	J-219	LOW	437.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
117	<input type="checkbox"/>	J-220	LOW	435.000	EXISTING
118	<input type="checkbox"/>	J-221	LOW	435.000	EXISTING
119	<input type="checkbox"/>	J-222	LOW	435.000	EXISTING
120	<input type="checkbox"/>	J-223	LOW	435.000	EXISTING
121	<input type="checkbox"/>	J-224	LOW	435.000	EXISTING
122	<input type="checkbox"/>	J-225	LOW	435.000	EXISTING
123	<input type="checkbox"/>	J-226	LOW	435.000	EXISTING
124	<input type="checkbox"/>	J-227	LOW	435.000	EXISTING
125	<input type="checkbox"/>	J-228	LOW	435.000	EXISTING
126	<input type="checkbox"/>	J-229	LOW	435.000	EXISTING
127	<input type="checkbox"/>	J-230	LOW	436.000	EXISTING
128	<input type="checkbox"/>	J-231	LOW	436.000	EXISTING
129	<input type="checkbox"/>	J-232	LOW	436.000	EXISTING
130	<input type="checkbox"/>	J-233	LOW	436.000	EXISTING
131	<input type="checkbox"/>	J-234	LOW	436.000	EXISTING
132	<input type="checkbox"/>	J-235	LOW	436.000	EXISTING
133	<input type="checkbox"/>	J-236	LOW	436.000	EXISTING
134	<input type="checkbox"/>	J-237	LOW	436.000	EXISTING
135	<input type="checkbox"/>	J-238	LOW	440.000	EXISTING
136	<input type="checkbox"/>	J-239	LOW	435.000	EXISTING
137	<input type="checkbox"/>	J-240	LOW	445.000	EXISTING
138	<input type="checkbox"/>	J-241	LOW	450.000	EXISTING
139	<input type="checkbox"/>	J-243	LOW	450.000	EXISTING
140	<input type="checkbox"/>	J-244	LOW	445.000	EXISTING
141	<input type="checkbox"/>	J-245	LOW	440.000	EXISTING
142	<input type="checkbox"/>	J-246	LOW	437.000	EXISTING
143	<input type="checkbox"/>	J-248	MEDIUM	521.000	EXISTING
144	<input type="checkbox"/>	J-250	MEDIUM	510.000	EXISTING
145	<input type="checkbox"/>	J-251	MEDIUM	545.000	EXISTING
146	<input type="checkbox"/>	J-252	MEDIUM	537.000	EXISTING
147	<input type="checkbox"/>	J-253	HIGH	550.000	EXISTING
148	<input type="checkbox"/>	J-254	HIGH	555.000	EXISTING
149	<input type="checkbox"/>	J-255	HIGH	560.000	EXISTING
150	<input type="checkbox"/>	J-256	HIGH	585.000	EXISTING
151	<input type="checkbox"/>	J-257	HIGH	572.000	EXISTING
152	<input type="checkbox"/>	J-258	HIGH	568.000	EXISTING
153	<input type="checkbox"/>	J-259	HIGH	627.000	EXISTING
154	<input type="checkbox"/>	J-260	HIGH	635.000	EXISTING
155	<input type="checkbox"/>	J-262	HIGH	630.000	EXISTING
156	<input type="checkbox"/>	J-263	HIGH	603.000	EXISTING
157	<input type="checkbox"/>	J-264	HIGH	600.000	EXISTING
158	<input type="checkbox"/>	J-264B	HIGH	628.000	EXISTING
159	<input type="checkbox"/>	J-265	HIGH	610.000	EXISTING
160	<input type="checkbox"/>	J-266	HIGH	590.000	EXISTING
161	<input type="checkbox"/>	J-267	HIGH	567.000	EXISTING
162	<input type="checkbox"/>	J-268	HIGH	587.000	EXISTING
163	<input type="checkbox"/>	J-269	HIGH	555.000	EXISTING
164	<input type="checkbox"/>	J-270	HIGH	583.000	EXISTING
165	<input type="checkbox"/>	J-271	HIGH	590.000	EXISTING
166	<input type="checkbox"/>	J-272	GOLDEN_BEAR	640.000	EXISTING
167	<input type="checkbox"/>	J-272B	GOLDEN_BEAR	638.000	EXISTING
168	<input type="checkbox"/>	J-273	GOLDEN_BEAR	665.000	EXISTING
169	<input type="checkbox"/>	J-274	GOLDEN_BEAR	660.000	EXISTING
170	<input type="checkbox"/>	J-275	GOLDEN_BEAR	672.000	EXISTING
171	<input type="checkbox"/>	J-276	GOLDEN_BEAR	670.000	EXISTING
172	<input type="checkbox"/>	J-277	GOLDEN_BEAR	673.000	EXISTING
173	<input type="checkbox"/>	J-279	GOLDEN_BEAR	640.000	EXISTING
174	<input type="checkbox"/>	J-280	HIGH	633.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
175	<input type="checkbox"/>	J-284A	HIGH	622.000	EXISTING
176	<input type="checkbox"/>	J-284B	GOLDEN_BEAR	630.000	EXISTING
177	<input type="checkbox"/>	J-284C	HIGH	620.000	EXISTING
178	<input type="checkbox"/>	J-284D	GOLDEN_BEAR	622.000	EXISTING
179	<input type="checkbox"/>	J-285	HIGH	630.000	EXISTING
180	<input type="checkbox"/>	J-286	LOW	450.000	EXISTING
181	<input type="checkbox"/>	J-287	LOW	449.000	EXISTING
182	<input type="checkbox"/>	J-289	MEDIUM	528.000	EXISTING
183	<input type="checkbox"/>	J-290	MEDIUM	512.000	EXISTING
184	<input type="checkbox"/>	J-291	MEDIUM	510.000	EXISTING
185	<input type="checkbox"/>	J-293	MEDIUM	520.000	EXISTING
186	<input type="checkbox"/>	J-294	MEDIUM	536.000	EXISTING
187	<input type="checkbox"/>	J-295	MEDIUM	537.000	EXISTING
188	<input type="checkbox"/>	J-296	MEDIUM	538.000	EXISTING
189	<input type="checkbox"/>	J-297	MEDIUM	543.000	EXISTING
190	<input type="checkbox"/>	J-298	MEDIUM	539.000	EXISTING
191	<input type="checkbox"/>	J-300	HIGH	537.000	EXISTING
192	<input type="checkbox"/>	J-301	MEDIUM	455.000	EXISTING
193	<input type="checkbox"/>	J-302	LOW	449.000	EXISTING
194	<input type="checkbox"/>	J-303	LOW	447.000	EXISTING
195	<input type="checkbox"/>	J-305	LOW	445.000	EXISTING
196	<input type="checkbox"/>	J-306	LOW	450.000	EXISTING
197	<input type="checkbox"/>	J-308	HIGH	540.000	EXISTING
198	<input type="checkbox"/>	J-309	MEDIUM	510.000	EXISTING
199	<input type="checkbox"/>	J-310	MEDIUM	535.000	EXISTING
200	<input type="checkbox"/>	J-311	MEDIUM	531.000	EXISTING
201	<input type="checkbox"/>	J-312	MEDIUM	492.000	EXISTING
202	<input type="checkbox"/>	J-314	MEDIUM	530.000	EXISTING
203	<input type="checkbox"/>	J-315	MEDIUM	530.000	EXISTING
204	<input type="checkbox"/>	J-316	MEDIUM	540.000	EXISTING
205	<input type="checkbox"/>	J-317	MEDIUM	520.000	EXISTING
206	<input type="checkbox"/>	J-318	MEDIUM	527.000	EXISTING
207	<input type="checkbox"/>	J-319	MEDIUM	480.000	EXISTING
208	<input type="checkbox"/>	J-320	MEDIUM	480.000	EXISTING
209	<input type="checkbox"/>	J-321	MEDIUM	542.000	EXISTING
210	<input type="checkbox"/>	J-322	MEDIUM	528.000	EXISTING
211	<input type="checkbox"/>	J-323	MEDIUM	530.000	EXISTING
212	<input type="checkbox"/>	J-324	MEDIUM	527.000	EXISTING
213	<input type="checkbox"/>	J-325	MEDIUM	465.000	EXISTING
214	<input type="checkbox"/>	J-326	MEDIUM	453.000	EXISTING
215	<input type="checkbox"/>	J-327	MEDIUM	450.000	EXISTING
216	<input type="checkbox"/>	J-328	MEDIUM	449.000	EXISTING
217	<input type="checkbox"/>	J-329	MEDIUM	445.000	EXISTING
218	<input type="checkbox"/>	J-33	HIGH	533.500	EXISTING
219	<input type="checkbox"/>	J-330	MEDIUM	453.000	EXISTING
220	<input type="checkbox"/>	J-331	MEDIUM	450.000	EXISTING
221	<input type="checkbox"/>	J-332	MEDIUM	449.000	EXISTING
222	<input type="checkbox"/>	J-333	MEDIUM	452.000	EXISTING
223	<input type="checkbox"/>	J-334	MEDIUM	500.000	EXISTING
224	<input type="checkbox"/>	J-335	MEDIUM	455.000	EXISTING
225	<input type="checkbox"/>	J-336	MEDIUM	462.000	EXISTING
226	<input type="checkbox"/>	J-337	MEDIUM	493.000	EXISTING
227	<input type="checkbox"/>	J-338	MEDIUM	475.000	EXISTING
228	<input type="checkbox"/>	J-339	MEDIUM	465.000	EXISTING
229	<input type="checkbox"/>	J-341	MEDIUM	451.000	EXISTING
230	<input type="checkbox"/>	J-342	MEDIUM	452.000	EXISTING
231	<input type="checkbox"/>	J-343	MEDIUM	470.000	EXISTING
232	<input type="checkbox"/>	J-344	MEDIUM	500.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
233	<input type="checkbox"/>	J-345	MEDIUM	468.000	EXISTING
234	<input type="checkbox"/>	J-346	MEDIUM	480.000	EXISTING
235	<input type="checkbox"/>	J-347	MEDIUM	460.000	EXISTING
236	<input type="checkbox"/>	J-348	MEDIUM	460.000	EXISTING
237	<input type="checkbox"/>	J-349	MEDIUM	458.000	EXISTING
238	<input type="checkbox"/>	J-350	MEDIUM	460.000	EXISTING
239	<input type="checkbox"/>	J-351	MEDIUM	455.000	EXISTING
240	<input type="checkbox"/>	J-352	MEDIUM	451.000	EXISTING
241	<input type="checkbox"/>	J-353	MEDIUM	450.000	EXISTING
242	<input type="checkbox"/>	J-354	MEDIUM	452.000	EXISTING
243	<input type="checkbox"/>	J-355	MEDIUM	452.000	EXISTING
244	<input type="checkbox"/>	J-356	MEDIUM	452.000	EXISTING
245	<input type="checkbox"/>	J-357	MEDIUM	453.000	EXISTING
246	<input type="checkbox"/>	J-358	MEDIUM	451.000	EXISTING
247	<input type="checkbox"/>	J-359	MEDIUM	458.000	EXISTING
248	<input type="checkbox"/>	J-361	MEDIUM	454.000	EXISTING
249	<input type="checkbox"/>	J-362	MEDIUM	451.000	EXISTING
250	<input type="checkbox"/>	J-363	MEDIUM	458.000	EXISTING
251	<input type="checkbox"/>	J-364	MEDIUM	515.000	EXISTING
252	<input type="checkbox"/>	J-365	MEDIUM	460.000	EXISTING
253	<input type="checkbox"/>	J-366	MEDIUM	480.000	EXISTING
254	<input type="checkbox"/>	J-367	MEDIUM	495.000	EXISTING
255	<input type="checkbox"/>	J-368	MEDIUM	515.000	EXISTING
256	<input type="checkbox"/>	J-369	MEDIUM	530.000	EXISTING
257	<input type="checkbox"/>	J-370	MEDIUM	510.000	EXISTING
258	<input type="checkbox"/>	J-372	MEDIUM	457.000	EXISTING
259	<input type="checkbox"/>	J-373	MEDIUM	451.000	EXISTING
260	<input type="checkbox"/>	J-374	MEDIUM	453.000	EXISTING
261	<input type="checkbox"/>	J-375	MEDIUM	451.000	EXISTING
262	<input type="checkbox"/>	J-380	MEDIUM	460.000	EXISTING
263	<input type="checkbox"/>	J-381	MEDIUM	500.000	EXISTING
264	<input type="checkbox"/>	J-383	MEDIUM	512.000	EXISTING
265	<input type="checkbox"/>	J-384	MEDIUM	453.000	EXISTING
266	<input type="checkbox"/>	J-386	HIGH	535.000	EXISTING
267	<input type="checkbox"/>	J-387	HIGH	550.000	EXISTING
268	<input type="checkbox"/>	J-390	HIGH	547.000	EXISTING
269	<input type="checkbox"/>	J-391	HIGH	530.000	EXISTING
270	<input type="checkbox"/>	J-392	MEDIUM	520.000	EXISTING
271	<input type="checkbox"/>	J-393	MEDIUM	527.000	EXISTING
272	<input type="checkbox"/>	J-394	HIGH	547.000	EXISTING
273	<input type="checkbox"/>	J-397	HIGH	540.000	EXISTING
274	<input type="checkbox"/>	J-400	MEDIUM	540.000	EXISTING
275	<input type="checkbox"/>	J-402	MEDIUM	480.000	EXISTING
276	<input type="checkbox"/>	J-403	MEDIUM	471.000	EXISTING
277	<input type="checkbox"/>	J-404	MEDIUM	455.000	EXISTING
278	<input type="checkbox"/>	J-406	GOLDEN_BEAR	657.000	EXISTING
279	<input type="checkbox"/>	J-407	LOW	450.000	EXISTING
280	<input type="checkbox"/>	J-408	LOW	450.000	EXISTING
281	<input type="checkbox"/>	J-409	LOW	440.000	EXISTING
282	<input type="checkbox"/>	J-413	MEDIUM	540.000	EXISTING
283	<input type="checkbox"/>	J-418	HIGH	540.000	EXISTING
284	<input type="checkbox"/>	J-419	HIGH	560.000	EXISTING
285	<input type="checkbox"/>	J-420	HIGH	570.000	EXISTING
286	<input type="checkbox"/>	J-421	HIGH	570.000	EXISTING
287	<input type="checkbox"/>	J-422	HIGH	550.000	EXISTING
288	<input type="checkbox"/>	J-423	HIGH	580.000	EXISTING
289	<input type="checkbox"/>	J-424	HIGH	580.000	EXISTING
290	<input type="checkbox"/>	J-431	HIGH	575.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
291	<input type="checkbox"/>	J-433	HIGH	575.000	EXISTING
292	<input type="checkbox"/>	J-435	HIGH	575.000	EXISTING
293	<input type="checkbox"/>	J-439	HIGH	590.000	EXISTING
294	<input type="checkbox"/>	J-441	HIGH	590.000	EXISTING
295	<input type="checkbox"/>	J-442	MIDWAY	643.000	EXISTING
296	<input type="checkbox"/>	J-443	MIDWAY	645.000	EXISTING
297	<input type="checkbox"/>	J-444	MIDWAY	668.000	EXISTING
298	<input type="checkbox"/>	J-445	MIDWAY	693.000	EXISTING
299	<input type="checkbox"/>	J-446	MIDWAY	663.000	EXISTING
300	<input type="checkbox"/>	J-447	MIDWAY	665.000	EXISTING
301	<input type="checkbox"/>	J-449	HIGH	580.000	EXISTING
302	<input type="checkbox"/>	J-450	HIGH	572.000	EXISTING
303	<input type="checkbox"/>	J-451	MEDIUM	515.000	EXISTING
304	<input type="checkbox"/>	J-452	MEDIUM	532.000	EXISTING
305	<input type="checkbox"/>	J-454	MEDIUM	550.000	EXISTING
306	<input type="checkbox"/>	J-455	MEDIUM	500.000	EXISTING
307	<input type="checkbox"/>	J-458	MEDIUM	530.000	EXISTING
308	<input type="checkbox"/>	J-459	MEDIUM	530.000	EXISTING
309	<input type="checkbox"/>	J-46	HIGH	533.500	EXISTING
310	<input type="checkbox"/>	J-460	MEDIUM	517.000	EXISTING
311	<input type="checkbox"/>	J-461	MEDIUM	527.000	EXISTING
312	<input type="checkbox"/>	J-464	MEDIUM	500.000	EXISTING
313	<input type="checkbox"/>	J-465	MEDIUM	500.000	EXISTING
314	<input type="checkbox"/>	J-466	LOW	436.000	EXISTING
315	<input type="checkbox"/>	J-467	LOW	445.000	EXISTING
316	<input type="checkbox"/>	J-469	LOW	447.000	EXISTING
317	<input type="checkbox"/>	J-470	MEDIUM	452.000	EXISTING
318	<input type="checkbox"/>	J-471	MEDIUM	450.000	EXISTING
319	<input type="checkbox"/>	J-472	MEDIUM	450.000	EXISTING
320	<input type="checkbox"/>	J-473	MEDIUM	451.000	EXISTING
321	<input type="checkbox"/>	J-474	MEDIUM	495.000	EXISTING
322	<input type="checkbox"/>	J-475	MEDIUM	500.000	EXISTING
323	<input type="checkbox"/>	J-476	MEDIUM	490.000	EXISTING
324	<input type="checkbox"/>	J-478	MEDIUM	510.000	EXISTING
325	<input type="checkbox"/>	J-479	HIGH	650.000	EXISTING
326	<input type="checkbox"/>	J-480	HIGH	627.000	EXISTING
327	<input type="checkbox"/>	J-481	MEDIUM	510.000	EXISTING
328	<input type="checkbox"/>	J-482	MEDIUM	520.000	EXISTING
329	<input type="checkbox"/>	J-483	MEDIUM	500.000	EXISTING
330	<input type="checkbox"/>	J-485	MEDIUM	542.000	EXISTING
331	<input type="checkbox"/>	J-487	MEDIUM	535.000	EXISTING
332	<input type="checkbox"/>	J-488	MEDIUM	536.000	EXISTING
333	<input type="checkbox"/>	J-489	MIDWAY	710.000	EXISTING
334	<input type="checkbox"/>	J-490	MEDIUM	530.000	EXISTING
335	<input type="checkbox"/>	J-497	MEDIUM	527.000	EXISTING
336	<input type="checkbox"/>	J-500	MEDIUM	505.000	EXISTING
337	<input type="checkbox"/>	J-501	MEDIUM	445.000	EXISTING
338	<input type="checkbox"/>	J-502	HIGH	650.000	EXISTING
339	<input type="checkbox"/>	J-503	HIGH	610.000	EXISTING
340	<input type="checkbox"/>	J-504	HIGH	630.000	EXISTING
341	<input type="checkbox"/>	J-509	MEDIUM	500.000	EXISTING
342	<input type="checkbox"/>	J-511	MEDIUM	500.000	EXISTING
343	<input type="checkbox"/>	J-512	MEDIUM	520.000	EXISTING
344	<input type="checkbox"/>	J-513	MEDIUM	515.000	EXISTING
345	<input type="checkbox"/>	J-514	MEDIUM	523.000	EXISTING
346	<input type="checkbox"/>	J-515	MEDIUM	505.000	EXISTING
347	<input type="checkbox"/>	J-516	HIGH	508.000	EXISTING
348	<input type="checkbox"/>	J-517	HIGH	520.000	EXISTING



DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
349	<input type="checkbox"/>	J-518	HIGH	530.000	EXISTING
350	<input type="checkbox"/>	J-519	HIGH	540.000	EXISTING
351	<input type="checkbox"/>	J-520	HIGH	540.000	EXISTING
352	<input type="checkbox"/>	J-521	HIGH	530.000	EXISTING
353	<input type="checkbox"/>	J-522	HIGH	530.000	EXISTING
354	<input type="checkbox"/>	J-523	HIGH	528.000	EXISTING
355	<input type="checkbox"/>	J-524	HIGH	530.000	EXISTING
356	<input type="checkbox"/>	J-527	HIGH	610.000	EXISTING
357	<input type="checkbox"/>	J-528	MEDIUM	460.000	EXISTING
358	<input type="checkbox"/>	J-531	MEDIUM	475.000	EXISTING
359	<input type="checkbox"/>	J-532	MEDIUM	500.000	EXISTING
360	<input type="checkbox"/>	J-533	MEDIUM	505.000	EXISTING
361	<input type="checkbox"/>	J-538	MEDIUM	490.000	EXISTING
362	<input type="checkbox"/>	J-540	MEDIUM	500.000	EXISTING
363	<input type="checkbox"/>	J-541	MEDIUM	500.000	EXISTING
364	<input type="checkbox"/>	J-543	MEDIUM	520.000	EXISTING
365	<input type="checkbox"/>	J-545	MEDIUM	500.000	EXISTING
366	<input type="checkbox"/>	J-546	MEDIUM	500.000	EXISTING
367	<input type="checkbox"/>	J-547	MEDIUM	535.000	EXISTING
368	<input type="checkbox"/>	J-548	HIGH	542.000	EXISTING
369	<input type="checkbox"/>	J-549	HIGH	565.000	EXISTING
370	<input type="checkbox"/>	J-550	HIGH	565.000	EXISTING
371	<input type="checkbox"/>	J-551	HIGH	550.000	EXISTING
372	<input type="checkbox"/>	J-551B	HIGH	550.000	EXISTING
373	<input type="checkbox"/>	J-552	HIGH	565.000	EXISTING
374	<input type="checkbox"/>	J-554	MEDIUM	550.000	EXISTING
375	<input type="checkbox"/>	J-555	MEDIUM	530.000	EXISTING
376	<input type="checkbox"/>	J-556	MEDIUM	510.000	EXISTING
377	<input type="checkbox"/>	J-557	MEDIUM	530.000	EXISTING
378	<input type="checkbox"/>	J-558	MEDIUM	508.000	EXISTING
379	<input type="checkbox"/>	J-559	MEDIUM	535.000	EXISTING
380	<input type="checkbox"/>	J-560	MEDIUM	510.000	EXISTING
381	<input type="checkbox"/>	J-561	MEDIUM	480.000	EXISTING
382	<input type="checkbox"/>	J-564	MEDIUM	535.000	EXISTING
383	<input type="checkbox"/>	J-565	MEDIUM	527.000	EXISTING
384	<input type="checkbox"/>	J-566	MEDIUM	510.000	EXISTING
385	<input type="checkbox"/>	J-567	HIGH	580.000	EXISTING
386	<input type="checkbox"/>	J-570	HIGH	590.000	EXISTING
387	<input type="checkbox"/>	J-571	HIGH	608.000	EXISTING
388	<input type="checkbox"/>	J-572	HIGH	585.000	EXISTING
389	<input type="checkbox"/>	J-574	HIGH	560.000	EXISTING
390	<input type="checkbox"/>	J-576	HIGH	565.000	EXISTING
391	<input type="checkbox"/>	J-577	HIGH	560.000	EXISTING
392	<input type="checkbox"/>	J-578	HIGH	530.000	EXISTING
393	<input type="checkbox"/>	J-579	HIGH	550.000	EXISTING
394	<input type="checkbox"/>	J-581	HIGH	555.000	EXISTING
395	<input type="checkbox"/>	J-582	HIGH	555.000	EXISTING
396	<input type="checkbox"/>	J-584	HIGH	572.000	EXISTING
397	<input type="checkbox"/>	J-585	HIGH	585.000	EXISTING
398	<input type="checkbox"/>	J-587	HIGH	615.000	EXISTING
399	<input type="checkbox"/>	J-588	HIGH	640.000	EXISTING
400	<input type="checkbox"/>	J-589	HIGH	520.000	EXISTING
401	<input type="checkbox"/>	J-590	HIGH	550.000	EXISTING
402	<input type="checkbox"/>	J-593	MEDIUM	542.000	EXISTING
403	<input type="checkbox"/>	J-594	MEDIUM	490.000	EXISTING
404	<input type="checkbox"/>	J-595	MEDIUM	495.000	EXISTING
405	<input type="checkbox"/>	J-596	MEDIUM	490.000	EXISTING
406	<input type="checkbox"/>	J-600	MEDIUM	500.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
407	<input type="checkbox"/>	J-601	MEDIUM	525.000	EXISTING
408	<input type="checkbox"/>	J-602	MEDIUM	531.000	EXISTING
409	<input type="checkbox"/>	J-606	HIGH	550.000	EXISTING
410	<input type="checkbox"/>	J-610	HIGH	558.000	EXISTING
411	<input type="checkbox"/>	J-611	HIGH	563.000	EXISTING
412	<input type="checkbox"/>	J-613	HIGH	540.000	EXISTING
413	<input type="checkbox"/>	J-614	MEDIUM	535.000	EXISTING
414	<input type="checkbox"/>	J-617	HIGH	562.000	EXISTING
415	<input type="checkbox"/>	J-618	HIGH	550.000	EXISTING
416	<input type="checkbox"/>	J-619	HIGH	510.000	EXISTING
417	<input type="checkbox"/>	J-622	MEDIUM	540.000	EXISTING
418	<input type="checkbox"/>	J-623	HIGH	535.000	EXISTING
419	<input type="checkbox"/>	J-624	HIGH	540.000	EXISTING
420	<input type="checkbox"/>	J-626	HIGH	508.000	EXISTING
421	<input type="checkbox"/>	J-631	HIGH	610.000	EXISTING
422	<input type="checkbox"/>	J-633	HIGH	615.000	EXISTING
423	<input type="checkbox"/>	J-640	HIGH	620.000	EXISTING
424	<input type="checkbox"/>	J-641	HIGH	568.000	EXISTING
425	<input type="checkbox"/>	J-643	HIGH	620.000	EXISTING
426	<input type="checkbox"/>	J-644	MIDWAY	595.000	EXISTING
427	<input type="checkbox"/>	J-648	HIGH	605.000	EXISTING
428	<input type="checkbox"/>	J-650	HIGH	580.000	EXISTING
429	<input type="checkbox"/>	J-654	HIGH	600.000	EXISTING
430	<input type="checkbox"/>	J-655	HIGH	615.000	EXISTING
431	<input type="checkbox"/>	J-656	HIGH	600.000	EXISTING
432	<input type="checkbox"/>	J-657	HIGH	550.000	EXISTING
433	<input type="checkbox"/>	J-658	HIGH	552.000	EXISTING
434	<input type="checkbox"/>	J-659	MEDIUM	530.000	EXISTING
435	<input type="checkbox"/>	J-660	MEDIUM	525.000	EXISTING
436	<input type="checkbox"/>	J-661	MEDIUM	510.000	EXISTING
437	<input type="checkbox"/>	J-662	HIGH	535.000	EXISTING
438	<input type="checkbox"/>	J-663	MEDIUM	530.000	EXISTING
439	<input type="checkbox"/>	J-665	LOW	449.000	EXISTING
440	<input type="checkbox"/>	J-666	LOW	450.000	EXISTING
441	<input type="checkbox"/>	J-667	MEDIUM	495.000	EXISTING
442	<input type="checkbox"/>	J-668	MEDIUM	492.000	EXISTING
443	<input type="checkbox"/>	J-669	MEDIUM	495.000	EXISTING
444	<input type="checkbox"/>	J-670	HIGH	615.000	EXISTING
445	<input type="checkbox"/>	J-672	MEDIUM	451.000	EXISTING
446	<input type="checkbox"/>	J-675	MEDIUM	455.000	EXISTING
447	<input type="checkbox"/>	J-676	MEDIUM	530.000	EXISTING
448	<input type="checkbox"/>	J-677	MEDIUM	530.000	EXISTING
449	<input type="checkbox"/>	J-678	MEDIUM	540.000	EXISTING
450	<input type="checkbox"/>	J-679	MEDIUM	530.000	EXISTING
451	<input type="checkbox"/>	J-681	HIGH	567.000	EXISTING
452	<input type="checkbox"/>	J-682	MIDWAY	652.000	EXISTING
453	<input type="checkbox"/>	J-684	HIGH	590.000	EXISTING
454	<input type="checkbox"/>	J-685	HIGH	593.000	EXISTING
455	<input type="checkbox"/>	J-686	HIGH	595.000	EXISTING
456	<input type="checkbox"/>	J-687	HIGH	565.000	EXISTING
457	<input type="checkbox"/>	J-688	MEDIUM	515.000	EXISTING
458	<input type="checkbox"/>	J-690	MEDIUM	520.000	EXISTING
459	<input type="checkbox"/>	J-691	MEDIUM	518.000	EXISTING
460	<input type="checkbox"/>	J-692	MEDIUM	515.000	EXISTING
461	<input type="checkbox"/>	J-693	MEDIUM	518.000	EXISTING
462	<input type="checkbox"/>	J-694	MEDIUM	525.000	EXISTING
463	<input type="checkbox"/>	J-695	MEDIUM	540.000	EXISTING
464	<input type="checkbox"/>	J-696	MEDIUM	550.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
465	<input type="checkbox"/>	J-697	MEDIUM	538.000	EXISTING
466	<input type="checkbox"/>	J-698	MEDIUM	530.000	EXISTING
467	<input type="checkbox"/>	J-699	MEDIUM	530.000	EXISTING
468	<input type="checkbox"/>	J-70	HIGH	530.500	EXISTING
469	<input type="checkbox"/>	J-700	MEDIUM	545.000	EXISTING
470	<input type="checkbox"/>	J-701	MEDIUM	456.000	EXISTING
471	<input type="checkbox"/>	J-702	MEDIUM	525.000	EXISTING
472	<input type="checkbox"/>	J-703	MEDIUM	525.000	EXISTING
473	<input type="checkbox"/>	J-704	MEDIUM	510.000	EXISTING
474	<input type="checkbox"/>	J-705	MEDIUM	510.000	EXISTING
475	<input type="checkbox"/>	J-707	MEDIUM	475.000	EXISTING
476	<input type="checkbox"/>	J-708	MEDIUM	535.000	EXISTING
477	<input type="checkbox"/>	J-709	MEDIUM	485.000	EXISTING
478	<input type="checkbox"/>	J-710	MEDIUM	460.000	EXISTING
479	<input type="checkbox"/>	J-711	LOW	440.000	EXISTING
480	<input type="checkbox"/>	J-712	LOW	449.000	EXISTING
481	<input type="checkbox"/>	J-713	MEDIUM	514.000	EXISTING
482	<input type="checkbox"/>	J-714	MEDIUM	495.000	EXISTING
483	<input type="checkbox"/>	J-715	LOW	450.000	EXISTING
484	<input type="checkbox"/>	J-716	MEDIUM	455.000	EXISTING
485	<input type="checkbox"/>	J-717	MEDIUM	460.000	EXISTING
486	<input type="checkbox"/>	J-718	MEDIUM	470.000	EXISTING
487	<input type="checkbox"/>	J-719	MEDIUM	520.000	EXISTING
488	<input type="checkbox"/>	J-720	MEDIUM	456.000	EXISTING
489	<input type="checkbox"/>	J-721	MEDIUM	500.000	EXISTING
490	<input type="checkbox"/>	J-723	MEDIUM	457.000	EXISTING
491	<input type="checkbox"/>	J-724	MEDIUM	455.000	EXISTING
492	<input type="checkbox"/>	J-725	MEDIUM	475.000	EXISTING
493	<input type="checkbox"/>	J-726	MEDIUM	503.000	EXISTING
494	<input type="checkbox"/>	J-727	MEDIUM	450.000	EXISTING
495	<input type="checkbox"/>	J-727B	MEDIUM	445.000	EXISTING
496	<input type="checkbox"/>	J-728	MEDIUM	495.000	EXISTING
497	<input type="checkbox"/>	J-729	MEDIUM	505.000	EXISTING
498	<input type="checkbox"/>	J-730	MEDIUM	500.000	EXISTING
499	<input type="checkbox"/>	J-731	MEDIUM	500.000	EXISTING
500	<input type="checkbox"/>	J-732	LOW	470.000	EXISTING
501	<input type="checkbox"/>	J-733	MEDIUM	449.000	EXISTING
502	<input type="checkbox"/>	J-734	MEDIUM	430.000	EXISTING
503	<input type="checkbox"/>	J-735	MEDIUM	500.000	EXISTING
504	<input type="checkbox"/>	J-736	MEDIUM	520.000	EXISTING
505	<input type="checkbox"/>	J-737	HIGH	620.000	EXISTING
506	<input type="checkbox"/>	J-738	MEDIUM	517.000	EXISTING
507	<input type="checkbox"/>	J-739	MEDIUM	500.000	EXISTING
508	<input type="checkbox"/>	J-740	MEDIUM	510.000	EXISTING
509	<input type="checkbox"/>	J-741	MEDIUM	520.000	EXISTING
510	<input type="checkbox"/>	J-742	HIGH	575.000	EXISTING
511	<input type="checkbox"/>	J-743	HIGH	570.000	EXISTING
512	<input type="checkbox"/>	J-744	HIGH	568.000	EXISTING
513	<input type="checkbox"/>	J-745	HIGH	630.000	EXISTING
514	<input type="checkbox"/>	J-746	HIGH	600.000	EXISTING
515	<input type="checkbox"/>	J-747	HIGH	550.000	EXISTING
516	<input type="checkbox"/>	J-748	HIGH	560.000	EXISTING
517	<input type="checkbox"/>	J-749	HIGH	550.000	EXISTING
518	<input type="checkbox"/>	J-750	HIGH	606.000	EXISTING
519	<input type="checkbox"/>	J-751	HIGH	645.000	EXISTING
520	<input type="checkbox"/>	J-752	HIGH	552.000	EXISTING
521	<input type="checkbox"/>	J-753	HIGH	565.000	EXISTING
522	<input type="checkbox"/>	J-754	MEDIUM	520.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
523	<input type="checkbox"/>	J-755	MIDWAY	640.000	EXISTING
524	<input type="checkbox"/>	J-756	MEDIUM	517.000	EXISTING
525	<input type="checkbox"/>	J-757	MEDIUM	535.000	EXISTING
526	<input type="checkbox"/>	J-758	MEDIUM	510.000	EXISTING
527	<input type="checkbox"/>	J-759	MEDIUM	480.000	EXISTING
528	<input type="checkbox"/>	J-760	MEDIUM	530.000	EXISTING
529	<input type="checkbox"/>	J-761	MEDIUM	523.000	EXISTING
530	<input type="checkbox"/>	J-762	MEDIUM	520.000	EXISTING
531	<input type="checkbox"/>	J-763	MEDIUM	530.000	EXISTING
532	<input type="checkbox"/>	J-764	MEDIUM	475.000	EXISTING
533	<input type="checkbox"/>	J-765	MEDIUM	480.000	EXISTING
534	<input type="checkbox"/>	J-766	MEDIUM	520.000	EXISTING
535	<input type="checkbox"/>	J-767	MEDIUM	495.000	EXISTING
536	<input type="checkbox"/>	J-768	MEDIUM	480.000	EXISTING
537	<input type="checkbox"/>	J-769	MEDIUM	495.000	EXISTING
538	<input type="checkbox"/>	J-770	MEDIUM	510.000	EXISTING
539	<input type="checkbox"/>	J-771	MEDIUM	512.000	EXISTING
540	<input type="checkbox"/>	J-772	MEDIUM	503.000	EXISTING
541	<input type="checkbox"/>	J-773	HIGH	580.000	EXISTING
542	<input type="checkbox"/>	J-774	MEDIUM	507.000	EXISTING
543	<input type="checkbox"/>	J-775	HIGH	525.000	EXISTING
544	<input type="checkbox"/>	J-776	HIGH	575.000	EXISTING
545	<input type="checkbox"/>	J-777	MEDIUM	535.000	EXISTING
546	<input type="checkbox"/>	J-778	HIGH	595.000	EXISTING
547	<input type="checkbox"/>	J-779	MEDIUM	538.000	EXISTING
548	<input type="checkbox"/>	J-780	MEDIUM	462.000	EXISTING
549	<input type="checkbox"/>	J-781	MEDIUM	490.000	EXISTING
550	<input type="checkbox"/>	J-782	HIGH	585.000	EXISTING
551	<input type="checkbox"/>	J-783	MEDIUM	465.000	EXISTING
552	<input type="checkbox"/>	J-784	MEDIUM	465.000	EXISTING
553	<input type="checkbox"/>	J-785	HIGH	510.000	EXISTING
554	<input type="checkbox"/>	J-786	HIGH	530.000	EXISTING
555	<input type="checkbox"/>	J-787	MEDIUM	510.000	EXISTING
556	<input type="checkbox"/>	J-788	HIGH	530.000	EXISTING
557	<input type="checkbox"/>	J-789	HIGH	570.000	EXISTING
558	<input type="checkbox"/>	J-79	HIGH	560.000	EXISTING
559	<input type="checkbox"/>	J-790	HIGH	550.000	EXISTING
560	<input type="checkbox"/>	J-791	HIGH	580.000	EXISTING
561	<input type="checkbox"/>	J-793	HIGH	618.000	EXISTING
562	<input type="checkbox"/>	J-794	HIGH	630.000	EXISTING
563	<input type="checkbox"/>	J-798	MEDIUM	455.000	EXISTING
564	<input type="checkbox"/>	J-799	MEDIUM	505.000	EXISTING
565	<input type="checkbox"/>	J-800	LOW	455.000	EXISTING
566	<input type="checkbox"/>	J-802	MIDWAY	655.000	EXISTING
567	<input type="checkbox"/>	J-803	MIDWAY	651.000	EXISTING
568	<input type="checkbox"/>	J-804	MEDIUM	500.000	EXISTING
569	<input type="checkbox"/>	J-806	MEDIUM	505.000	EXISTING
570	<input type="checkbox"/>	J-807	HIGH	552.000	EXISTING
571	<input type="checkbox"/>	J-808	MEDIUM	468.000	EXISTING
572	<input type="checkbox"/>	J-809	MEDIUM	465.000	EXISTING
573	<input type="checkbox"/>	J-810	MEDIUM	463.000	EXISTING
574	<input type="checkbox"/>	J-812	MEDIUM	530.000	EXISTING
575	<input type="checkbox"/>	J-813	LOW	449.000	EXISTING
576	<input type="checkbox"/>	J-814	MEDIUM	480.000	EXISTING
577	<input type="checkbox"/>	J-816	LOW	449.000	EXISTING
578	<input type="checkbox"/>	J-819	MEDIUM	505.000	EXISTING
579	<input type="checkbox"/>	J-820	MEDIUM	487.000	EXISTING
580	<input type="checkbox"/>	J-821	MEDIUM	510.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
581	<input type="checkbox"/>	J-822	MEDIUM	474.000	EXISTING
582	<input type="checkbox"/>	J-823	MEDIUM	495.000	EXISTING
583	<input type="checkbox"/>	J-825	MEDIUM	520.000	EXISTING
584	<input type="checkbox"/>	J-834	HIGH	640.000	EXISTING
585	<input type="checkbox"/>	J-861	LOW	437.000	EXISTING
586	<input type="checkbox"/>	J-862	LOW	436.000	EXISTING
587	<input type="checkbox"/>	J-863	LOW	435.000	EXISTING
588	<input type="checkbox"/>	J-864	LOW	435.000	EXISTING
589	<input type="checkbox"/>	J-869	MEDIUM	449.000	EXISTING
590	<input type="checkbox"/>	J-870	MEDIUM	470.000	EXISTING
591	<input type="checkbox"/>	J-872	MEDIUM	480.000	EXISTING
592	<input type="checkbox"/>	J-876	MEDIUM	460.000	EXISTING
593	<input type="checkbox"/>	J-879	MEDIUM	538.000	EXISTING
594	<input type="checkbox"/>	J-880	MEDIUM	495.000	EXISTING
595	<input type="checkbox"/>	J-881	HIGH	550.000	EXISTING
596	<input type="checkbox"/>	J-882	HIGH	550.000	EXISTING
597	<input type="checkbox"/>	J-883	HIGH	520.000	EXISTING
598	<input type="checkbox"/>	J-884	HIGH	555.000	EXISTING
599	<input type="checkbox"/>	J-885	HIGH	590.000	EXISTING
600	<input type="checkbox"/>	J-886	HIGH	560.000	EXISTING
601	<input type="checkbox"/>	J-887	HIGH	555.000	EXISTING
602	<input type="checkbox"/>	J-890	MEDIUM	505.000	EXISTING
603	<input type="checkbox"/>	J-891	HIGH	550.000	EXISTING
604	<input type="checkbox"/>	J-900	MEDIUM	450.000	EXISTING
605	<input type="checkbox"/>	J-901	MEDIUM	535.000	EXISTING
606	<input type="checkbox"/>	J-902	MEDIUM	530.000	EXISTING
607	<input type="checkbox"/>	J-903	MEDIUM	530.000	EXISTING
608	<input type="checkbox"/>	J-904	MEDIUM	515.000	EXISTING
609	<input type="checkbox"/>	J-905	MEDIUM	510.000	EXISTING
610	<input type="checkbox"/>	J-906	MEDIUM	500.000	EXISTING
611	<input type="checkbox"/>	J-907	MEDIUM	490.000	EXISTING
612	<input type="checkbox"/>	J-908	MEDIUM	470.000	EXISTING
613	<input type="checkbox"/>	J-909	MEDIUM	505.000	EXISTING
614	<input type="checkbox"/>	J-91	MIDWAY	675.000	EXISTING
615	<input type="checkbox"/>	J-910	MEDIUM	490.000	EXISTING
616	<input type="checkbox"/>	J-911	MEDIUM	485.000	EXISTING
617	<input type="checkbox"/>	J-915	MEDIUM	475.000	EXISTING
618	<input type="checkbox"/>	J-916	MEDIUM	533.000	EXISTING
619	<input type="checkbox"/>	J-917	MEDIUM	480.000	EXISTING
620	<input type="checkbox"/>	J-918	MEDIUM	523.000	EXISTING
621	<input type="checkbox"/>	J-92	HIGH	565.000	EXISTING
622	<input type="checkbox"/>	J-924	MEDIUM	450.000	EXISTING
623	<input type="checkbox"/>	J-927	MEDIUM	451.000	EXISTING
624	<input type="checkbox"/>	J-928	MEDIUM	451.000	EXISTING
625	<input type="checkbox"/>	J-929	MEDIUM	450.000	EXISTING
626	<input type="checkbox"/>	J-93	HIGH	565.000	EXISTING
627	<input type="checkbox"/>	J-930	MEDIUM	451.000	EXISTING
628	<input type="checkbox"/>	J-931	MEDIUM	510.000	EXISTING
629	<input type="checkbox"/>	J-932	MEDIUM	520.000	EXISTING
630	<input type="checkbox"/>	J-933	MEDIUM	520.000	EXISTING
631	<input type="checkbox"/>	J-934	HIGH	575.000	EXISTING
632	<input type="checkbox"/>	J-935	HIGH	640.000	EXISTING
633	<input type="checkbox"/>	J-938	HIGH	582.000	EXISTING
634	<input type="checkbox"/>	J-939	MIDWAY	645.000	EXISTING
635	<input type="checkbox"/>	J-940	MIDWAY	595.000	EXISTING
636	<input type="checkbox"/>	J-945	LOW	440.000	EXISTING
637	<input type="checkbox"/>	J-946	MEDIUM	455.000	EXISTING
638	<input type="checkbox"/>	J-947	MEDIUM	449.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
639	<input type="checkbox"/>	J-948	MEDIUM	449.000	EXISTING
640	<input type="checkbox"/>	J-949	MEDIUM	455.000	EXISTING
641	<input type="checkbox"/>	J-95	MEDIUM	455.000	EXISTING
642	<input type="checkbox"/>	J-950	LOW	448.000	EXISTING
643	<input type="checkbox"/>	J-953	MEDIUM	525.000	EXISTING
644	<input type="checkbox"/>	J-954	HIGH	560.000	EXISTING
645	<input type="checkbox"/>	J-955	MEDIUM	475.000	EXISTING
646	<input type="checkbox"/>	J-957	MEDIUM	451.000	EXISTING
647	<input type="checkbox"/>	J-958	MEDIUM	515.000	EXISTING
648	<input type="checkbox"/>	J-96	LOW	448.000	EXISTING
649	<input type="checkbox"/>	J-962	MEDIUM	535.000	EXISTING
650	<input type="checkbox"/>	J-964	MEDIUM	515.000	EXISTING
651	<input type="checkbox"/>	J-965	MEDIUM	520.000	EXISTING
652	<input type="checkbox"/>	J-966	MEDIUM	530.000	EXISTING
653	<input type="checkbox"/>	J-967	MEDIUM	519.000	EXISTING
654	<input type="checkbox"/>	J-968	MEDIUM	535.000	EXISTING
655	<input type="checkbox"/>	J-969	MEDIUM	530.000	EXISTING
656	<input type="checkbox"/>	J-970	MEDIUM	460.000	EXISTING
657	<input type="checkbox"/>	J-971	MEDIUM	482.000	EXISTING
658	<input type="checkbox"/>	J-972	HIGH	569.000	EXISTING
659	<input type="checkbox"/>	J-973	HIGH	545.000	EXISTING
660	<input type="checkbox"/>	J-974	HIGH	563.000	EXISTING
661	<input type="checkbox"/>	J-975	MEDIUM	530.000	EXISTING
662	<input type="checkbox"/>	J-976	LOW	445.000	EXISTING
663	<input type="checkbox"/>	J-977	LOW	435.000	EXISTING
664	<input type="checkbox"/>	J-978	MEDIUM	535.000	EXISTING
665	<input type="checkbox"/>	J-979	MEDIUM	468.000	EXISTING
666	<input type="checkbox"/>	J-980	MEDIUM	455.000	EXISTING
667	<input type="checkbox"/>	J-981	HIGH	590.000	EXISTING
668	<input type="checkbox"/>	J-982	HIGH	625.000	EXISTING
669	<input type="checkbox"/>	J-983	MEDIUM	532.000	EXISTING
670	<input type="checkbox"/>	J-984	MEDIUM	509.000	EXISTING
671	<input type="checkbox"/>	J-986	MEDIUM	512.000	EXISTING
672	<input type="checkbox"/>	J-987	MEDIUM	531.000	EXISTING
673	<input type="checkbox"/>	J-988	MEDIUM	515.000	EXISTING
674	<input type="checkbox"/>	J-989	MEDIUM	520.000	EXISTING
675	<input type="checkbox"/>	J-99	MEDIUM	500.000	EXISTING
676	<input type="checkbox"/>	J-990	MEDIUM	520.000	EXISTING
677	<input type="checkbox"/>	J-991	MEDIUM	495.000	EXISTING
678	<input type="checkbox"/>	J-992	MEDIUM	485.000	EXISTING
679	<input type="checkbox"/>	J-993	MEDIUM	480.000	EXISTING
680	<input type="checkbox"/>	J-994	MEDIUM	475.000	EXISTING
681	<input type="checkbox"/>	J-995	HIGH	615.000	EXISTING
682	<input type="checkbox"/>	J-999	MEDIUM	453.000	EXISTING
683	<input type="checkbox"/>	J9000	HIGH	550.000	EXISTING
684	<input type="checkbox"/>	J9002	HIGH	540.000	EXISTING
685	<input type="checkbox"/>	J9004	MEDIUM	548.000	EXISTING
686	<input type="checkbox"/>	J9006	MEDIUM	538.000	EXISTING
687	<input type="checkbox"/>	J9008	HIGH	528.000	EXISTING
688	<input type="checkbox"/>	J9010	HIGH	600.000	EXISTING
689	<input type="checkbox"/>	J9012	HIGH	506.000	EXISTING
690	<input type="checkbox"/>	J9016	HIGH	561.000	EXISTING
691	<input type="checkbox"/>	J9018	HIGH	534.000	EXISTING
692	<input type="checkbox"/>	J9022	MIDWAY	639.000	EXISTING
693	<input type="checkbox"/>	J9024	MIDWAY	606.000	EXISTING
694	<input type="checkbox"/>	J9026	MIDWAY	595.000	EXISTING
695	<input type="checkbox"/>	J9028	HIGH	598.000	EXISTING
696	<input type="checkbox"/>	J9030	HIGH	608.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
697	<input type="checkbox"/>	J9032	MIDWAY	630.000	EXISTING
698	<input type="checkbox"/>	J9034	MIDWAY	644.000	EXISTING
699	<input type="checkbox"/>	J9036	MIDWAY	654.000	EXISTING
700	<input type="checkbox"/>	J9038	MIDWAY	652.000	EXISTING
701	<input type="checkbox"/>	J9040	HIGH	588.000	EXISTING
702	<input type="checkbox"/>	J9042	HIGH	590.000	EXISTING
703	<input type="checkbox"/>	J9044	HIGH	586.000	EXISTING
704	<input type="checkbox"/>	J9046	HIGH	560.000	EXISTING
705	<input type="checkbox"/>	J9048	LOW	434.000	EXISTING
706	<input type="checkbox"/>	J9050	MEDIUM	513.000	EXISTING
707	<input type="checkbox"/>	J9052	MEDIUM	456.000	EXISTING
708	<input type="checkbox"/>	J9054	HIGH	576.000	EXISTING
709	<input type="checkbox"/>	J9056	MIDWAY	595.000	EXISTING
710	<input type="checkbox"/>	J9058	HIGH	600.000	EXISTING
711	<input type="checkbox"/>	J9060	MIDWAY	640.000	EXISTING
712	<input type="checkbox"/>	J9062	MEDIUM	460.000	EXISTING
713	<input type="checkbox"/>	J9072	GOLDEN_BEAR	626.828	EXISTING
714	<input type="checkbox"/>	J9084	MIDWAY	651.815	EXISTING
715	<input type="checkbox"/>	J9090	HIGH	616.800	EXISTING
716	<input type="checkbox"/>	J9098	MEDIUM	528.576	EXISTING
717	<input type="checkbox"/>	J9100	MEDIUM	528.741	EXISTING
718	<input type="checkbox"/>	J9102	MEDIUM	530.000	EXISTING
719	<input type="checkbox"/>	J9106	MEDIUM	518.305	EXISTING
720	<input type="checkbox"/>	J9108	MIDWAY	641.513	EXISTING
721	<input type="checkbox"/>	J9110	HIGH	615.000	EXISTING
722	<input type="checkbox"/>	J9118	MIDWAY	633.208	EXISTING
723	<input type="checkbox"/>	J9120	MIDWAY	616.000	EXISTING
724	<input type="checkbox"/>	J9122	MIDWAY	616.800	EXISTING
725	<input type="checkbox"/>	J9124	MIDWAY	613.500	EXISTING
726	<input type="checkbox"/>	J9126	MIDWAY	604.000	EXISTING
727	<input type="checkbox"/>	J9128	MIDWAY	610.000	EXISTING
728	<input type="checkbox"/>	J9130	MIDWAY	610.000	EXISTING
729	<input type="checkbox"/>	J9132	MIDWAY	636.500	EXISTING
730	<input type="checkbox"/>	J9134	MIDWAY	626.600	EXISTING
731	<input type="checkbox"/>	J9136	MIDWAY	604.000	EXISTING
732	<input type="checkbox"/>	J9138	MIDWAY	633.200	EXISTING
733	<input type="checkbox"/>	J9140	MIDWAY	646.610	EXISTING
734	<input type="checkbox"/>	J9142	MIDWAY	639.800	EXISTING
735	<input type="checkbox"/>	J9144	MIDWAY	649.281	EXISTING
736	<input type="checkbox"/>	J9146	MIDWAY	643.000	EXISTING
737	<input type="checkbox"/>	J9148	MIDWAY	647.998	EXISTING
738	<input type="checkbox"/>	J9150	MIDWAY	652.860	EXISTING
739	<input type="checkbox"/>	J9152	MIDWAY	651.475	EXISTING
740	<input type="checkbox"/>	J9154	MIDWAY	649.600	EXISTING
741	<input type="checkbox"/>	J9156	MIDWAY	617.738	EXISTING
742	<input type="checkbox"/>	J9158	MIDWAY	623.400	EXISTING
743	<input type="checkbox"/>	J9160	MIDWAY	653.217	EXISTING
744	<input type="checkbox"/>	J9162	MIDWAY	653.602	EXISTING
745	<input type="checkbox"/>	J9164	MIDWAY	652.756	EXISTING
746	<input type="checkbox"/>	J9166	MIDWAY	656.200	EXISTING
747	<input type="checkbox"/>	J9168	MIDWAY	653.342	EXISTING
748	<input type="checkbox"/>	J9170	MIDWAY	644.785	EXISTING
749	<input type="checkbox"/>	J9172	MIDWAY	643.000	EXISTING
750	<input type="checkbox"/>	J9174	MIDWAY	650.509	EXISTING
751	<input type="checkbox"/>	J9176	MIDWAY	656.200	EXISTING
752	<input type="checkbox"/>	J9178	MIDWAY	656.400	EXISTING
753	<input type="checkbox"/>	J9180	MIDWAY	659.400	EXISTING
754	<input type="checkbox"/>	J9182	MIDWAY	660.000	EXISTING

DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
755	<input type="checkbox"/>	J9184	MIDWAY	659.400	EXISTING
756	<input type="checkbox"/>	J9186	MIDWAY	666.000	EXISTING
757	<input type="checkbox"/>	J9188	MIDWAY	666.000	EXISTING
758	<input type="checkbox"/>	J9190	MIDWAY	666.719	EXISTING
759	<input type="checkbox"/>	J9192	MIDWAY	681.008	EXISTING
760	<input type="checkbox"/>	J9194	MIDWAY	679.100	EXISTING
761	<input type="checkbox"/>	J9196	MIDWAY	666.000	EXISTING
762	<input type="checkbox"/>	J9198	MIDWAY	672.600	EXISTING
763	<input type="checkbox"/>	J9200	MIDWAY	686.448	EXISTING
764	<input type="checkbox"/>	J9202	MIDWAY	685.700	EXISTING
765	<input type="checkbox"/>	J9204	MIDWAY	692.300	EXISTING
766	<input type="checkbox"/>	J9206	MIDWAY	689.000	EXISTING
767	<input type="checkbox"/>	J9208	MIDWAY	692.300	EXISTING
768	<input type="checkbox"/>	J9210	MIDWAY	691.427	EXISTING
769	<input type="checkbox"/>	J9212	MIDWAY	698.800	EXISTING
770	<input type="checkbox"/>	J9214	MIDWAY	695.500	EXISTING
771	<input type="checkbox"/>	J9216	MIDWAY	695.372	EXISTING
772	<input type="checkbox"/>	J9218	MIDWAY	666.542	EXISTING
773	<input type="checkbox"/>	J9220	MIDWAY	675.900	EXISTING
774	<input type="checkbox"/>	J9222	MIDWAY	669.300	EXISTING
775	<input type="checkbox"/>	J9224	MIDWAY	670.067	EXISTING
776	<input type="checkbox"/>	J9226	MIDWAY	675.900	EXISTING
777	<input type="checkbox"/>	J9228	MIDWAY	695.500	EXISTING
778	<input type="checkbox"/>	J9230	MIDWAY	672.423	EXISTING
779	<input type="checkbox"/>	J9234	MIDWAY	701.102	EXISTING
780	<input type="checkbox"/>	J9236	MIDWAY	664.660	EXISTING
781	<input type="checkbox"/>	J9238	MIDWAY	666.000	EXISTING
782	<input type="checkbox"/>	J9240	MIDWAY	665.687	EXISTING
783	<input type="checkbox"/>	J9242	MIDWAY	679.100	EXISTING
784	<input type="checkbox"/>	J9244	MIDWAY	669.770	EXISTING
785	<input type="checkbox"/>	J9246	MIDWAY	670.620	EXISTING
786	<input type="checkbox"/>	J9248	MIDWAY	694.325	EXISTING
787	<input type="checkbox"/>	J9250	MIDWAY	696.105	EXISTING
788	<input type="checkbox"/>	J9252	MIDWAY	705.345	EXISTING
789	<input type="checkbox"/>	J9254	MIDWAY	702.100	EXISTING
790	<input type="checkbox"/>	J9256	MIDWAY	702.100	EXISTING
791	<input type="checkbox"/>	J9258	MIDWAY	708.000	EXISTING
792	<input type="checkbox"/>	J9260	MIDWAY	705.688	EXISTING
793	<input type="checkbox"/>	J9262	MIDWAY	708.700	EXISTING
794	<input type="checkbox"/>	J9264	MIDWAY	708.700	EXISTING
795	<input type="checkbox"/>	J9266	MIDWAY	708.000	EXISTING
796	<input type="checkbox"/>	J9268	MIDWAY	707.000	EXISTING
797	<input type="checkbox"/>	J9270	MIDWAY	708.000	EXISTING
798	<input type="checkbox"/>	J9272	MIDWAY	708.000	EXISTING
799	<input type="checkbox"/>	J9274	MIDWAY	705.000	EXISTING
800	<input type="checkbox"/>	J9276	MIDWAY	704.000	EXISTING
801	<input type="checkbox"/>	J9278	MIDWAY	704.000	EXISTING
802	<input type="checkbox"/>	J9280	MIDWAY	705.000	EXISTING
803	<input type="checkbox"/>	J9282	MIDWAY	708.000	EXISTING
804	<input type="checkbox"/>	J9284	MIDWAY	702.100	EXISTING
805	<input type="checkbox"/>	J9286	MIDWAY	698.800	EXISTING
806	<input type="checkbox"/>	J9288	MIDWAY	704.500	EXISTING
807	<input type="checkbox"/>	J9290	MIDWAY	704.500	EXISTING
808	<input type="checkbox"/>	J9292	MIDWAY	711.900	EXISTING
809	<input type="checkbox"/>	J9294	MIDWAY	649.600	EXISTING
810	<input type="checkbox"/>	J9296	MIDWAY	643.000	EXISTING
811	<input type="checkbox"/>	J9298	MIDWAY	653.372	EXISTING
812	<input type="checkbox"/>	J9300	MIDWAY	636.500	EXISTING



DB Table - 'Junction Information'

		ID (Char)	Zone (Char)	Elevation (ft)	MODEL_YEAR (Char)
813	<input type="checkbox"/>	J9302	MIDWAY	652.900	EXISTING
814	<input type="checkbox"/>	J9304	MIDWAY	639.800	EXISTING
815	<input type="checkbox"/>	J9306	MIDWAY	643.000	EXISTING
816	<input type="checkbox"/>	J9310	MIDWAY	649.600	EXISTING
817	<input type="checkbox"/>	J9312	MIDWAY	652.900	EXISTING
818	<input type="checkbox"/>	J9314	MIDWAY	652.900	EXISTING
819	<input type="checkbox"/>	J9316	MIDWAY	649.600	EXISTING
820	<input type="checkbox"/>	J9318	MIDWAY	659.400	EXISTING
821	<input type="checkbox"/>	J9320	MIDWAY	659.400	EXISTING
822	<input type="checkbox"/>	J9322	MIDWAY	659.400	EXISTING
823	<input type="checkbox"/>	J9324	MIDWAY	649.400	EXISTING
824	<input type="checkbox"/>	J9326	MIDWAY	652.900	EXISTING
825	<input type="checkbox"/>	J9328	MIDWAY	652.800	EXISTING
826	<input type="checkbox"/>	J9330	MIDWAY	656.200	EXISTING
827	<input type="checkbox"/>	J9332	MIDWAY	659.400	EXISTING
828	<input type="checkbox"/>	J9334	MIDWAY	659.400	EXISTING
829	<input type="checkbox"/>	J9336	MIDWAY	652.900	EXISTING
830	<input type="checkbox"/>	J9338	MIDWAY	649.600	EXISTING
831	<input type="checkbox"/>	J9340	MIDWAY	649.600	EXISTING
832	<input type="checkbox"/>	J9342	MIDWAY	643.000	EXISTING
833	<input type="checkbox"/>	J9344	MIDWAY	626.600	EXISTING
834	<input type="checkbox"/>	J9346	MIDWAY	633.200	EXISTING
835	<input type="checkbox"/>	J9348	MIDWAY	643.000	EXISTING
836	<input type="checkbox"/>	J9350	MIDWAY	652.900	EXISTING
837	<input type="checkbox"/>	J9352	MIDWAY	652.900	EXISTING
838	<input type="checkbox"/>	J9354	MIDWAY	649.600	EXISTING
839	<input type="checkbox"/>	J9356	MIDWAY	626.600	EXISTING
840	<input type="checkbox"/>	J9358	MIDWAY	639.800	EXISTING
841	<input type="checkbox"/>	J9360	MIDWAY	643.000	EXISTING
842	<input type="checkbox"/>	J9362	MIDWAY	629.900	EXISTING
843	<input type="checkbox"/>	J9364	MIDWAY	643.000	EXISTING
844	<input type="checkbox"/>	J9366	MIDWAY	629.900	EXISTING
845	<input type="checkbox"/>	J9368	MIDWAY	646.300	EXISTING
846	<input type="checkbox"/>	J9370	MIDWAY	633.200	EXISTING
847	<input type="checkbox"/>	J9372	MIDWAY	652.900	EXISTING
848	<input type="checkbox"/>	J9374	MIDWAY	639.800	EXISTING
849	<input type="checkbox"/>	J9376	MIDWAY	639.800	EXISTING
850	<input type="checkbox"/>	J9378	MIDWAY	643.000	EXISTING
851	<input type="checkbox"/>	J9380	MIDWAY	646.472	EXISTING
852	<input type="checkbox"/>	J9390	MIDWAY	622.994	EXISTING
853	<input type="checkbox"/>	J9394	MIDWAY	608.502	EXISTING
854	<input type="checkbox"/>	J9396	MIDWAY	603.934	EXISTING

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
1	J-1000	
2	J-1001	0.016
3	J-1002	0.002
4	J-1003	0.027
5	J-1004	
6	J-1005	0.037
7	J-1006	0.017
8	J-1007	0.005
9	J-1008	
10	J-1009	0.045
11	J-101	0.028
12	J-1010	0.008
13	J-1011	0.025
14	J-1012	
15	J-1013	0.015
16	J-1014	0.005
17	J-1015	0.082
18	J-1016	0.194
19	J-1017	0.036
20	J-1018	0.037
21	J-1019	0.007
22	J-102	0.055
23	J-1020	0.009
24	J-1021	0.004
25	J-1022	0.004
26	J-1023	0.041
27	J-1024	0.072
28	J-1025	0.104
29	J-1026	0.010
30	J-1027	0.009
31	J-1028	0.124
32	J-1029	0.181
33	J-103	0.036
34	J-1030	0.013
35	J-1031	0.020
36	J-1032	0.013
37	J-1033	0.015
38	J-1034	0.003
39	J-1035	0.007
40	J-1036	0.003
41	J-1037	0.021
42	J-1038	0.026
43	J-1039	0.001
44	J-1041	0.082
45	J-1043	0.108
46	J-1044	0.095
47	J-1045	0.012
48	J-1046	0.173
49	J-1047	0.038

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *		ID (Char)	Demand 1 (mgd)
50	<input type="checkbox"/>	J-116	
51	<input type="checkbox"/>	J-121	
52	<input type="checkbox"/>	J-122	
53	<input type="checkbox"/>	J-125	
54	<input type="checkbox"/>	J-127	
55	<input type="checkbox"/>	J-128	
56	<input type="checkbox"/>	J-129	0.015
57	<input type="checkbox"/>	J-130	0.048
58	<input type="checkbox"/>	J-131	0.098
59	<input type="checkbox"/>	J-132	0.018
60	<input type="checkbox"/>	J-133	0.028
61	<input type="checkbox"/>	J-134	0.035
62	<input type="checkbox"/>	J-137	0.090
63	<input type="checkbox"/>	J-138	0.084
64	<input type="checkbox"/>	J-139	0.042
65	<input type="checkbox"/>	J-140	0.022
66	<input type="checkbox"/>	J-141	
67	<input type="checkbox"/>	J-142	0.022
68	<input type="checkbox"/>	J-143	0.014
69	<input type="checkbox"/>	J-144	0.013
70	<input type="checkbox"/>	J-145	0.048
71	<input type="checkbox"/>	J-146	0.020
72	<input type="checkbox"/>	J-147	0.045
73	<input type="checkbox"/>	J-148	0.060
74	<input type="checkbox"/>	J-149	0.018
75	<input type="checkbox"/>	J-150	0.026
76	<input type="checkbox"/>	J-151	0.061
77	<input type="checkbox"/>	J-152	0.003
78	<input type="checkbox"/>	J-153	0.002
79	<input type="checkbox"/>	J-154	
80	<input type="checkbox"/>	J-155	0.043
81	<input type="checkbox"/>	J-156	0.022
82	<input type="checkbox"/>	J-157	0.010
83	<input type="checkbox"/>	J-158	0.018
84	<input type="checkbox"/>	J-159	0.122
85	<input type="checkbox"/>	J-160	0.004
86	<input type="checkbox"/>	J-161	0.247
87	<input type="checkbox"/>	J-162	
88	<input type="checkbox"/>	J-163	0.051
89	<input type="checkbox"/>	J-164	0.060
90	<input type="checkbox"/>	J-165	0.017
91	<input type="checkbox"/>	J-200	0.007
92	<input type="checkbox"/>	J-2001	
93	<input type="checkbox"/>	J-2002	0.001
94	<input type="checkbox"/>	J-2003	0.003
95	<input type="checkbox"/>	J-201	0.009
96	<input type="checkbox"/>	J-2019	0.058
97	<input type="checkbox"/>	J-202	0.007
98	<input type="checkbox"/>	J-2020	0.524

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *		ID (Char)	Demand 1 (mgd)
99	<input type="checkbox"/>	J-2021	0.245
100	<input type="checkbox"/>	J-2022	0.238
101	<input type="checkbox"/>	J-203	0.008
102	<input type="checkbox"/>	J-204	0.024
103	<input type="checkbox"/>	J-205	
104	<input type="checkbox"/>	J-207	0.062
105	<input type="checkbox"/>	J-208	0.027
106	<input type="checkbox"/>	J-209	0.033
107	<input type="checkbox"/>	J-210	0.048
108	<input type="checkbox"/>	J-211	0.031
109	<input type="checkbox"/>	J-212	0.018
110	<input type="checkbox"/>	J-213	0.026
111	<input type="checkbox"/>	J-214	0.030
112	<input type="checkbox"/>	J-215	0.012
113	<input type="checkbox"/>	J-216	0.016
114	<input type="checkbox"/>	J-217	0.013
115	<input type="checkbox"/>	J-218	0.007
116	<input type="checkbox"/>	J-219	0.010
117	<input type="checkbox"/>	J-220	0.014
118	<input type="checkbox"/>	J-221	0.023
119	<input type="checkbox"/>	J-222	0.009
120	<input type="checkbox"/>	J-223	0.024
121	<input type="checkbox"/>	J-224	0.007
122	<input type="checkbox"/>	J-225	0.005
123	<input type="checkbox"/>	J-226	0.010
124	<input type="checkbox"/>	J-227	0.035
125	<input type="checkbox"/>	J-228	0.030
126	<input type="checkbox"/>	J-229	0.009
127	<input type="checkbox"/>	J-230	0.027
128	<input type="checkbox"/>	J-231	0.013
129	<input type="checkbox"/>	J-232	0.014
130	<input type="checkbox"/>	J-233	0.050
131	<input type="checkbox"/>	J-234	0.009
132	<input type="checkbox"/>	J-235	0.015
133	<input type="checkbox"/>	J-236	0.002
134	<input type="checkbox"/>	J-237	0.005
135	<input type="checkbox"/>	J-238	0.027
136	<input type="checkbox"/>	J-239	0.010
137	<input type="checkbox"/>	J-240	0.012
138	<input type="checkbox"/>	J-241	0.003
139	<input type="checkbox"/>	J-243	0.009
140	<input type="checkbox"/>	J-244	0.033
141	<input type="checkbox"/>	J-245	0.052
142	<input type="checkbox"/>	J-246	0.020
143	<input type="checkbox"/>	J-248	0.025
144	<input type="checkbox"/>	J-250	0.050
145	<input type="checkbox"/>	J-251	
146	<input type="checkbox"/>	J-252	0.010
147	<input type="checkbox"/>	J-253	0.110

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *		ID (Char)	Demand 1 (mgd)
148	<input type="checkbox"/>	J-254	0.038
149	<input type="checkbox"/>	J-255	0.039
150	<input type="checkbox"/>	J-256	0.014
151	<input type="checkbox"/>	J-257	0.084
152	<input type="checkbox"/>	J-258	0.075
153	<input type="checkbox"/>	J-259	0.040
154	<input type="checkbox"/>	J-260	0.031
155	<input type="checkbox"/>	J-262	0.014
156	<input type="checkbox"/>	J-263	0.017
157	<input type="checkbox"/>	J-264	0.231
158	<input type="checkbox"/>	J-264B	
159	<input type="checkbox"/>	J-265	0.355
160	<input type="checkbox"/>	J-266	0.224
161	<input type="checkbox"/>	J-267	0.011
162	<input type="checkbox"/>	J-268	0.043
163	<input type="checkbox"/>	J-269	0.041
164	<input type="checkbox"/>	J-270	0.127
165	<input type="checkbox"/>	J-271	
166	<input type="checkbox"/>	J-272	0.019
167	<input type="checkbox"/>	J-272B	0.004
168	<input type="checkbox"/>	J-273	0.065
169	<input type="checkbox"/>	J-274	0.148
170	<input type="checkbox"/>	J-275	0.009
171	<input type="checkbox"/>	J-276	0.039
172	<input type="checkbox"/>	J-277	0.019
173	<input type="checkbox"/>	J-279	0.066
174	<input type="checkbox"/>	J-280	0.033
175	<input type="checkbox"/>	J-284A	0.001
176	<input type="checkbox"/>	J-284B	0.021
177	<input type="checkbox"/>	J-284C	0.024
178	<input type="checkbox"/>	J-284D	0.003
179	<input type="checkbox"/>	J-285	0.125
180	<input type="checkbox"/>	J-286	0.026
181	<input type="checkbox"/>	J-287	0.140
182	<input type="checkbox"/>	J-289	0.036
183	<input type="checkbox"/>	J-290	0.111
184	<input type="checkbox"/>	J-291	0.029
185	<input type="checkbox"/>	J-293	0.046
186	<input type="checkbox"/>	J-294	0.038
187	<input type="checkbox"/>	J-295	0.018
188	<input type="checkbox"/>	J-296	0.024
189	<input type="checkbox"/>	J-297	0.026
190	<input type="checkbox"/>	J-298	0.018
191	<input type="checkbox"/>	J-300	
192	<input type="checkbox"/>	J-301	0.036
193	<input type="checkbox"/>	J-302	0.054
194	<input type="checkbox"/>	J-303	0.067
195	<input type="checkbox"/>	J-305	0.076
196	<input type="checkbox"/>	J-306	0.053

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
197	J-308	0.050
198	J-309	0.019
199	J-310	0.065
200	J-311	0.031
201	J-312	0.065
202	J-314	0.013
203	J-315	0.148
204	J-316	0.046
205	J-317	0.025
206	J-318	0.028
207	J-319	0.026
208	J-320	0.120
209	J-321	0.060
210	J-322	0.035
211	J-323	0.016
212	J-324	0.031
213	J-325	0.014
214	J-326	0.005
215	J-327	0.799
216	J-328	0.314
217	J-329	0.041
218	J-33	
219	J-330	0.089
220	J-331	0.048
221	J-332	0.071
222	J-333	0.007
223	J-334	0.053
224	J-335	0.015
225	J-336	0.016
226	J-337	0.018
227	J-338	0.000
228	J-339	0.010
229	J-341	0.510
230	J-342	0.195
231	J-343	0.037
232	J-344	0.018
233	J-345	0.074
234	J-346	0.028
235	J-347	0.004
236	J-348	0.007
237	J-349	0.009
238	J-350	0.013
239	J-351	0.006
240	J-352	0.060
241	J-353	0.045
242	J-354	0.006
243	J-355	0.018
244	J-356	0.017
245	J-357	0.019

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
246	J-358	0.005
247	J-359	0.069
248	J-361	0.033
249	J-362	0.037
250	J-363	0.748
251	J-364	0.024
252	J-365	0.067
253	J-366	0.019
254	J-367	0.071
255	J-368	0.060
256	J-369	0.036
257	J-370	0.034
258	J-372	0.050
259	J-373	0.222
260	J-374	0.303
261	J-375	0.219
262	J-380	0.202
263	J-381	0.035
264	J-383	0.026
265	J-384	0.060
266	J-386	0.188
267	J-387	0.124
268	J-390	0.129
269	J-391	0.227
270	J-392	0.022
271	J-393	0.161
272	J-394	0.039
273	J-397	0.046
274	J-400	0.067
275	J-402	0.011
276	J-403	0.150
277	J-404	0.277
278	J-406	0.004
279	J-407	0.049
280	J-408	0.030
281	J-409	0.302
282	J-413	0.035
283	J-418	0.128
284	J-419	0.070
285	J-420	0.045
286	J-421	0.043
287	J-422	0.152
288	J-423	0.099
289	J-424	0.123
290	J-431	0.086
291	J-433	0.019
292	J-435	0.138
293	J-439	0.099
294	J-441	0.010

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
295	J-442	0.168
296	J-443	0.047
297	J-444	0.241
298	J-445	0.403
299	J-446	0.104
300	J-447	0.103
301	J-449	0.127
302	J-450	0.121
303	J-451	0.110
304	J-452	0.092
305	J-454	0.064
306	J-455	0.101
307	J-458	0.089
308	J-459	0.014
309	J-46	0.007
310	J-460	0.144
311	J-461	0.187
312	J-464	0.030
313	J-465	0.037
314	J-466	0.012
315	J-467	0.019
316	J-469	0.163
317	J-470	0.015
318	J-471	0.073
319	J-472	
320	J-473	
321	J-474	0.068
322	J-475	0.075
323	J-476	0.087
324	J-478	0.081
325	J-479	0.013
326	J-480	0.006
327	J-481	0.016
328	J-482	0.031
329	J-483	0.034
330	J-485	0.059
331	J-487	0.113
332	J-488	0.060
333	J-489	0.577
334	J-490	0.081
335	J-497	0.035
336	J-500	0.108
337	J-501	0.009
338	J-502	0.033
339	J-503	0.063
340	J-504	0.037
341	J-509	0.051
342	J-511	0.061
343	J-512	0.087



DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
344	J-513	0.058
345	J-514	0.132
346	J-515	0.002
347	J-516	0.035
348	J-517	0.093
349	J-518	0.189
350	J-519	0.094
351	J-520	0.092
352	J-521	0.189
353	J-522	0.201
354	J-523	0.227
355	J-524	0.065
356	J-527	
357	J-528	0.005
358	J-531	0.008
359	J-532	0.043
360	J-533	0.028
361	J-538	0.001
362	J-540	0.021
363	J-541	0.019
364	J-543	0.042
365	J-545	0.006
366	J-546	0.150
367	J-547	0.089
368	J-548	0.007
369	J-549	0.130
370	J-550	0.050
371	J-551	0.036
372	J-551B	0.043
373	J-552	0.006
374	J-554	0.041
375	J-555	0.044
376	J-556	0.029
377	J-557	0.027
378	J-558	0.024
379	J-559	0.040
380	J-560	0.042
381	J-561	0.018
382	J-564	0.008
383	J-565	0.005
384	J-566	
385	J-567	0.241
386	J-570	0.113
387	J-571	0.015
388	J-572	
389	J-574	0.464
390	J-576	0.147
391	J-577	0.145
392	J-578	0.013

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET *		ID (Char)	Demand 1 (mgd)
393	<input type="checkbox"/>	J-579	0.059
394	<input type="checkbox"/>	J-581	0.053
395	<input type="checkbox"/>	J-582	0.029
396	<input type="checkbox"/>	J-584	0.006
397	<input type="checkbox"/>	J-585	
398	<input type="checkbox"/>	J-587	0.008
399	<input type="checkbox"/>	J-588	0.071
400	<input type="checkbox"/>	J-589	0.041
401	<input type="checkbox"/>	J-590	0.116
402	<input type="checkbox"/>	J-593	0.004
403	<input type="checkbox"/>	J-594	0.002
404	<input type="checkbox"/>	J-595	0.011
405	<input type="checkbox"/>	J-596	0.070
406	<input type="checkbox"/>	J-600	0.015
407	<input type="checkbox"/>	J-601	0.044
408	<input type="checkbox"/>	J-602	0.017
409	<input type="checkbox"/>	J-606	0.198
410	<input type="checkbox"/>	J-610	0.066
411	<input type="checkbox"/>	J-611	0.058
412	<input type="checkbox"/>	J-613	0.048
413	<input type="checkbox"/>	J-614	0.034
414	<input type="checkbox"/>	J-617	0.064
415	<input type="checkbox"/>	J-618	0.082
416	<input type="checkbox"/>	J-619	0.026
417	<input type="checkbox"/>	J-622	0.038
418	<input type="checkbox"/>	J-623	0.010
419	<input type="checkbox"/>	J-624	0.026
420	<input type="checkbox"/>	J-626	0.102
421	<input type="checkbox"/>	J-631	0.045
422	<input type="checkbox"/>	J-633	0.014
423	<input type="checkbox"/>	J-640	0.029
424	<input type="checkbox"/>	J-641	0.046
425	<input type="checkbox"/>	J-643	0.012
426	<input type="checkbox"/>	J-644	0.003
427	<input type="checkbox"/>	J-648	0.794
428	<input type="checkbox"/>	J-650	0.061
429	<input type="checkbox"/>	J-654	0.100
430	<input type="checkbox"/>	J-655	0.013
431	<input type="checkbox"/>	J-656	0.352
432	<input type="checkbox"/>	J-657	0.079
433	<input type="checkbox"/>	J-658	0.114
434	<input type="checkbox"/>	J-659	0.004
435	<input type="checkbox"/>	J-660	0.007
436	<input type="checkbox"/>	J-661	0.012
437	<input type="checkbox"/>	J-662	0.009
438	<input type="checkbox"/>	J-663	0.001
439	<input type="checkbox"/>	J-665	0.248
440	<input type="checkbox"/>	J-666	0.152
441	<input type="checkbox"/>	J-667	0.086

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *		ID (Char)	Demand 1 (mgd)
442	<input type="checkbox"/>	J-668	0.154
443	<input type="checkbox"/>	J-669	0.039
444	<input type="checkbox"/>	J-670	0.125
445	<input type="checkbox"/>	J-672	0.018
446	<input type="checkbox"/>	J-675	0.003
447	<input type="checkbox"/>	J-676	0.045
448	<input type="checkbox"/>	J-677	0.075
449	<input type="checkbox"/>	J-678	0.053
450	<input type="checkbox"/>	J-679	0.079
451	<input type="checkbox"/>	J-681	0.266
452	<input type="checkbox"/>	J-682	0.013
453	<input type="checkbox"/>	J-684	0.209
454	<input type="checkbox"/>	J-685	0.147
455	<input type="checkbox"/>	J-686	0.116
456	<input type="checkbox"/>	J-687	0.110
457	<input type="checkbox"/>	J-688	0.051
458	<input type="checkbox"/>	J-690	0.071
459	<input type="checkbox"/>	J-691	0.117
460	<input type="checkbox"/>	J-692	0.055
461	<input type="checkbox"/>	J-693	0.057
462	<input type="checkbox"/>	J-694	0.033
463	<input type="checkbox"/>	J-695	0.034
464	<input type="checkbox"/>	J-696	0.047
465	<input type="checkbox"/>	J-697	0.032
466	<input type="checkbox"/>	J-698	0.022
467	<input type="checkbox"/>	J-699	0.112
468	<input type="checkbox"/>	J-70	0.032
469	<input type="checkbox"/>	J-700	0.057
470	<input type="checkbox"/>	J-701	0.028
471	<input type="checkbox"/>	J-702	0.047
472	<input type="checkbox"/>	J-703	0.192
473	<input type="checkbox"/>	J-704	0.157
474	<input type="checkbox"/>	J-705	0.112
475	<input type="checkbox"/>	J-707	0.094
476	<input type="checkbox"/>	J-708	0.082
477	<input type="checkbox"/>	J-709	0.107
478	<input type="checkbox"/>	J-710	0.006
479	<input type="checkbox"/>	J-711	0.065
480	<input type="checkbox"/>	J-712	0.002
481	<input type="checkbox"/>	J-713	0.083
482	<input type="checkbox"/>	J-714	0.080
483	<input type="checkbox"/>	J-715	0.018
484	<input type="checkbox"/>	J-716	0.016
485	<input type="checkbox"/>	J-717	0.022
486	<input type="checkbox"/>	J-718	0.045
487	<input type="checkbox"/>	J-719	0.030
488	<input type="checkbox"/>	J-720	0.093
489	<input type="checkbox"/>	J-721	0.045
490	<input type="checkbox"/>	J-723	0.032

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
491	J-724	0.022
492	J-725	0.034
493	J-726	0.013
494	J-727	0.069
495	J-727B	0.020
496	J-728	0.027
497	J-729	0.065
498	J-730	0.072
499	J-731	0.027
500	J-732	0.003
501	J-733	0.009
502	J-734	0.163
503	J-735	0.021
504	J-736	0.042
505	J-737	0.009
506	J-738	0.062
507	J-739	0.019
508	J-740	0.110
509	J-741	0.011
510	J-742	0.068
511	J-743	0.084
512	J-744	0.077
513	J-745	0.048
514	J-746	0.030
515	J-747	0.074
516	J-748	0.036
517	J-749	0.128
518	J-750	0.088
519	J-751	0.020
520	J-752	0.360
521	J-753	0.062
522	J-754	0.094
523	J-755	0.028
524	J-756	0.040
525	J-757	0.094
526	J-758	0.048
527	J-759	0.082
528	J-760	0.021
529	J-761	0.195
530	J-762	0.044
531	J-763	0.029
532	J-764	0.007
533	J-765	0.062
534	J-766	0.083
535	J-767	0.108
536	J-768	0.231
537	J-769	0.049
538	J-770	0.129
539	J-771	0.121

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
540	J-772	0.061
541	J-773	0.161
542	J-774	0.025
543	J-775	0.028
544	J-776	0.153
545	J-777	0.040
546	J-778	0.277
547	J-779	0.048
548	J-780	0.027
549	J-781	0.003
550	J-782	0.099
551	J-783	0.082
552	J-784	0.137
553	J-785	0.070
554	J-786	0.127
555	J-787	0.012
556	J-788	0.131
557	J-789	0.366
558	J-79	0.013
559	J-790	0.073
560	J-791	0.061
561	J-793	0.028
562	J-794	0.040
563	J-798	0.153
564	J-799	0.061
565	J-800	0.028
566	J-802	0.219
567	J-803	0.022
568	J-804	0.005
569	J-806	0.033
570	J-807	0.121
571	J-808	0.016
572	J-809	0.061
573	J-810	0.078
574	J-812	0.071
575	J-813	0.004
576	J-814	0.051
577	J-816	0.034
578	J-819	0.061
579	J-820	0.126
580	J-821	0.072
581	J-822	0.063
582	J-823	0.054
583	J-825	0.154
584	J-834	0.001
585	J-861	0.004
586	J-862	
587	J-863	0.010
588	J-864	0.009

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
589	J-869	0.212
590	J-870	0.053
591	J-872	0.280
592	J-876	0.042
593	J-879	0.092
594	J-880	0.054
595	J-881	0.057
596	J-882	0.078
597	J-883	0.017
598	J-884	0.074
599	J-885	0.031
600	J-886	0.039
601	J-887	0.046
602	J-890	0.037
603	J-891	0.103
604	J-900	0.015
605	J9000	0.075
606	J9002	0.033
607	J9004	0.049
608	J9006	0.005
609	J9008	0.096
610	J-901	0.031
611	J9010	
612	J9012	0.014
613	J9016	0.003
614	J9018	0.064
615	J-902	0.005
616	J9022	0.334
617	J9024	
618	J9026	0.001
619	J9028	0.025
620	J-903	0.001
621	J9030	0.006
622	J9032	0.013
623	J9034	0.033
624	J9036	0.013
625	J9038	0.049
626	J-904	0.087
627	J9040	0.041
628	J9042	0.003
629	J9044	0.050
630	J9046	0.144
631	J9048	0.005
632	J-905	0.047
633	J9050	0.044
634	J9052	0.012
635	J9054	0.035
636	J9056	
637	J9058	0.031

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
638	J-906	0.067
639	J9060	
640	J9062	0.003
641	J-907	0.032
642	J9072	
643	J-908	0.034
644	J9084	
645	J-909	0.024
646	J9090	
647	J9098	
648	J-91	0.037
649	J-910	0.016
650	J9100	
651	J9102	
652	J9106	
653	J9108	
654	J-911	0.026
655	J9110	
656	J9118	
657	J9120	
658	J9122	
659	J9124	
660	J9126	
661	J9128	
662	J9130	
663	J9132	
664	J9134	
665	J9136	
666	J9138	
667	J9140	
668	J9142	
669	J9144	
670	J9146	
671	J9148	
672	J-915	0.048
673	J9150	
674	J9152	
675	J9154	
676	J9156	
677	J9158	
678	J-916	0.027
679	J9160	
680	J9162	
681	J9164	
682	J9166	
683	J9168	
684	J-917	0.067
685	J9170	
686	J9172	

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
687	J9174	
688	J9176	
689	J9178	
690	J-918	0.056
691	J9180	
692	J9182	
693	J9184	
694	J9186	
695	J9188	
696	J9190	
697	J9192	
698	J9194	
699	J9196	
700	J9198	
701	J-92	
702	J9200	
703	J9202	
704	J9204	
705	J9206	
706	J9208	
707	J9210	
708	J9212	
709	J9214	
710	J9216	
711	J9218	
712	J9220	
713	J9222	
714	J9224	
715	J9226	
716	J9228	
717	J9230	
718	J9234	
719	J9236	
720	J9238	
721	J-924	0.011
722	J9240	
723	J9242	
724	J9244	
725	J9246	
726	J9248	
727	J9250	
728	J9252	
729	J9254	
730	J9256	
731	J9258	
732	J9260	
733	J9262	
734	J9264	
735	J9266	



DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *	ID (Char)	Demand 1 (mgd)
736	J9268	
737	J-927	0.054
738	J9270	
739	J9272	
740	J9274	
741	J9276	
742	J9278	
743	J-928	0.052
744	J9280	
745	J9282	
746	J9284	
747	J9286	
748	J9288	
749	J-929	0.008
750	J9290	
751	J9292	
752	J9294	
753	J9296	
754	J9298	
755	J-93	0.019
756	J-930	0.001
757	J9300	
758	J9302	
759	J9304	
760	J9306	
761	J-931	0.025
762	J9310	
763	J9312	
764	J9314	
765	J9316	
766	J9318	
767	J-932	0.066
768	J9320	
769	J9322	
770	J9324	
771	J9326	
772	J9328	
773	J-933	0.091
774	J9330	
775	J9332	
776	J9334	
777	J9336	
778	J9338	
779	J-934	0.029
780	J9340	
781	J9342	
782	J9344	
783	J9346	
784	J9348	

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET * *		ID (Char)	Demand 1 (mgd)
785	<input type="checkbox"/>	J-935	0.008
786	<input type="checkbox"/>	J9350	
787	<input type="checkbox"/>	J9352	
788	<input type="checkbox"/>	J9354	
789	<input type="checkbox"/>	J9356	
790	<input type="checkbox"/>	J9358	
791	<input type="checkbox"/>	J9360	
792	<input type="checkbox"/>	J9362	
793	<input type="checkbox"/>	J9364	
794	<input type="checkbox"/>	J9366	
795	<input type="checkbox"/>	J9368	
796	<input type="checkbox"/>	J9370	
797	<input type="checkbox"/>	J9372	
798	<input type="checkbox"/>	J9374	
799	<input type="checkbox"/>	J9376	
800	<input type="checkbox"/>	J9378	
801	<input type="checkbox"/>	J-938	
802	<input type="checkbox"/>	J9380	
803	<input type="checkbox"/>	J-939	
804	<input type="checkbox"/>	J9390	
805	<input type="checkbox"/>	J9394	
806	<input type="checkbox"/>	J9396	
807	<input type="checkbox"/>	J-940	
808	<input type="checkbox"/>	J-945	0.054
809	<input type="checkbox"/>	J-946	0.014
810	<input type="checkbox"/>	J-947	0.055
811	<input type="checkbox"/>	J-948	0.001
812	<input type="checkbox"/>	J-949	0.008
813	<input type="checkbox"/>	J-95	0.058
814	<input type="checkbox"/>	J-950	0.016
815	<input type="checkbox"/>	J-953	0.007
816	<input type="checkbox"/>	J-954	0.068
817	<input type="checkbox"/>	J-955	0.017
818	<input type="checkbox"/>	J-957	0.048
819	<input type="checkbox"/>	J-958	0.091
820	<input type="checkbox"/>	J-96	0.047
821	<input type="checkbox"/>	J-962	0.039
822	<input type="checkbox"/>	J-964	0.043
823	<input type="checkbox"/>	J-965	0.039
824	<input type="checkbox"/>	J-966	0.024
825	<input type="checkbox"/>	J-967	0.073
826	<input type="checkbox"/>	J-968	0.224
827	<input type="checkbox"/>	J-969	0.084
828	<input type="checkbox"/>	J-970	0.126
829	<input type="checkbox"/>	J-971	0.041
830	<input type="checkbox"/>	J-972	0.078
831	<input type="checkbox"/>	J-973	0.089
832	<input type="checkbox"/>	J-974	0.159
833	<input type="checkbox"/>	J-975	0.017

DB Table - 'Junction Demand'

EXISTING_DEMAND_SET *		ID (Char)	Demand 1 (mgd)
834	<input type="checkbox"/>	J-976	0.020
835	<input type="checkbox"/>	J-977	0.009
836	<input type="checkbox"/>	J-978	0.051
837	<input type="checkbox"/>	J-979	
838	<input type="checkbox"/>	J-980	0.067
839	<input type="checkbox"/>	J-981	0.017
840	<input type="checkbox"/>	J-982	0.060
841	<input type="checkbox"/>	J-983	0.005
842	<input type="checkbox"/>	J-984	0.003
843	<input type="checkbox"/>	J-986	0.146
844	<input type="checkbox"/>	J-987	0.201
845	<input type="checkbox"/>	J-988	
846	<input type="checkbox"/>	J-989	0.025
847	<input type="checkbox"/>	J-99	0.036
848	<input type="checkbox"/>	J-990	0.009
849	<input type="checkbox"/>	J-991	
850	<input type="checkbox"/>	J-992	0.003
851	<input type="checkbox"/>	J-993	0.090
852	<input type="checkbox"/>	J-994	0.008
853	<input type="checkbox"/>	J-995	0.086
854	<input type="checkbox"/>	J-999	0.062

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1	BB_FUTURE_PUMP_4_(D	268.255	12.000	120.000
2	BB_FUTURE_PUMP_4_(U	268.255	20.000	125.000
3	BB_PMP1_D	266.201	12.000	120.000
4	BB_PMP1_U	266.201	20.000	125.000
5	BB_PMP2_D	267.297	12.000	120.000
6	BB_PMP2_U	267.297	20.000	125.000
7	BB_PMP3_D	267.171	12.000	120.000
8	BB_PMP3_U	267.171	20.000	125.000
9	BROADWAY_PRV_D	59.637	16.000	150.000
10	BROADWAY_PRV_U	59.637	16.000	150.000
11	CC_PMP_3-MZ_D	11.510	8.000	110.000
12	CC_PMP_3-MZ_U	11.510	8.000	110.000
13	CC_PMP_4-HZ1_D	11.485	8.000	110.000
14	CC_PMP_4-HZ1_U	11.485	8.000	110.000
15	CC_PMP_5-HZ1_D	11.485	8.000	110.000
16	CC_PMP_5-HZ1_U	11.485	8.000	110.000
17	CC_PMP_6-HZ1_D	11.485	8.000	110.000
18	CC_PMP_6-HZ1_U	11.485	8.000	110.000
19	CC_PMP_7-HZ2_D	11.840	14.000	120.000
20	CC_PMP_7-HZ2_U	11.840	16.000	120.000
21	CC_PMP_8-HZ2_D	11.840	14.000	120.000
22	CC_PMP_8-HZ2_U	11.840	16.000	120.000
23	CC_PMP_9-HZ2_(STBY_D	11.840	14.000	120.000
24	CC_PMP_9-HZ2_(STBY_U	11.840	16.000	120.000
25	DC_FUTURE_PMP8_(ST_D	129.825	24.000	125.000
26	DC_FUTURE_PMP8_(ST_U	129.825	42.000	135.000
27	DC_PMP1_D	129.510	24.000	125.000
28	DC_PMP1_U	129.510	42.000	135.000
29	DC_PMP2_D	129.790	16.000	120.000
30	DC_PMP2_U	129.790	42.000	135.000
31	DC_PMP3_D	129.730	12.000	120.000
32	DC_PMP3_U	129.730	36.000	130.000
33	DC_PMP4_D	130.305	12.000	120.000
34	DC_PMP4_U	130.305	36.000	130.000
35	DC_PMP5_D	129.870	12.000	120.000
36	DC_PMP5_U	129.870	36.000	130.000
37	DC_PMP6_D	129.790	12.000	120.000
38	DC_PMP6_U	129.790	36.000	130.000
39	DC_PMP7_D	129.750	16.000	120.000
40	DC_PMP7_U	129.750	42.000	135.000
41	DC_PRV_D	91.110	18.000	150.000
42	DC_PRV_U	91.110	18.000	150.000
43	FCV-1_D	224.610	16.000	150.000
44	FCV-1_U	224.610	16.000	150.000
45	FCV-4_D	1,328.553	24.000	150.000
46	FCV-4_U	1,328.553	24.000	130.000
47	GOLDEN_BEAR_PMP-1_D	13.450	12.000	125.000
48	GOLDEN_BEAR_PMP-1_U	13.450	12.000	125.000
49	GOLDEN_BEAR_PMP-2_D	13.450	12.000	125.000
50	GOLDEN_BEAR_PMP-2_U	13.450	12.000	125.000
51	MN_PMP1_D	11.141	12.000	120.000
52	MN_PMP1_U	8.039	12.000	120.000
53	MN_PMP2_D	12.438	12.000	120.000
54	MN_PMP2_U	6.349	12.000	120.000
55	MN_PMP3_D	10.902	12.000	120.000
56	MN_PMP3_U	7.748	12.000	120.000
57	MN_PMP_FUTURE_D	9.933	12.000	120.000
58	MN_PMP_FUTURE_U	8.245	12.000	120.000
59	P-10	12.000	10.000	110.000
60	P-1001	1,786.594	8.000	110.000
61	P-1002	1,135.454	8.000	110.000
62	P-1003	3,135.209	8.000	110.000
63	P-1006	35.296	8.000	110.000
64	P-1007	661.865	8.000	110.000
65	P-1010A	178.023	8.000	110.000
66	P-1010B	638.936	8.000	110.000
67	P-1010C	1,142.794	6.000	110.000
68	P-1011	702.621	8.000	110.000
69	P-1012	2,231.309	8.000	110.000
70	P-1014	408.954	8.000	110.000
71	P-1017	26.473	8.000	110.000
72	P-1018	1,293.106	8.000	110.000
73	P-1019	914.390	8.000	110.000
74	P-1020	1,142.338	8.000	110.000
75	P-1021	1,250.945	8.000	110.000
76	P-1024	713.377	8.000	110.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
77	P-1026A	566.082	12.000	120.000
78	P-1026B	402.511	12.000	120.000
79	P-1027	508.818	12.000	120.000
80	P-1028	309.823	12.000	120.000
81	P-1029	1,780.563	12.000	120.000
82	P-103	408.590	12.000	120.000
83	P-1030	383.463	12.000	120.000
84	P-1032	650.568	12.000	120.000
85	P-1033	884.865	6.000	110.000
86	P-1034	885.311	6.000	110.000
87	P-1035	1,316.121	8.000	110.000
88	P-1037	1,271.930	8.000	110.000
89	P-1038	330.957	16.000	120.000
90	P-1039	695.473	16.000	120.000
91	P-104	1,030.222	12.000	120.000
92	P-1041	2,342.903	8.000	110.000
93	P-1043	561.495	8.000	110.000
94	P-1045	3,304.400	8.000	110.000
95	P-1046	1,857.952	12.000	120.000
96	P-1047	2,059.925	24.000	125.000
97	P-1048	911.685	24.000	125.000
98	P-1049	431.806	24.000	125.000
99	P-1050	1,060.081	8.000	110.000
100	P-1051	941.102	8.000	110.000
101	P-1052	311.837	12.000	120.000
102	P-1053	863.627	8.000	110.000
103	P-1054	1,053.467	8.000	110.000
104	P-1055	2,531.382	8.000	110.000
105	P-1056	882.564	8.000	110.000
106	P-1057	110.250	24.000	125.000
107	P-1058	440.601	12.000	120.000
108	P-1059	636.645	16.000	120.000
109	P-1060	296.675	12.000	120.000
110	P-1061	1,043.487	12.000	120.000
111	P-1062	1,010.610	24.000	125.000
112	P-1063	619.284	12.000	120.000
113	P-1064	183.487	24.000	125.000
114	P-1065	1,265.052	24.000	125.000
115	P-1066	625.419	12.000	120.000
116	P-1067	273.405	6.000	110.000
117	P-1068	1,274.765	6.000	110.000
118	P-1069	108.366	12.000	120.000
119	P-1070	162.015	12.000	120.000
120	P-1071	893.023	12.000	120.000
121	P-1072	668.010	12.000	120.000
122	P-1073	979.296	6.000	110.000
123	P-1074	1,810.342	8.000	110.000
124	P-1075	1,719.017	12.000	120.000
125	P-1076	278.289	12.000	120.000
126	P-1079	212.167	8.000	110.000
127	P-108	149.830	42.000	135.000
128	P-1080	348.292	8.000	110.000
129	P-1081	264.405	8.000	110.000
130	P-1082	890.662	12.000	120.000
131	P-1083	792.167	12.000	120.000
132	P-1084	407.329	12.000	120.000
133	P-1085	75.040	42.000	135.000
134	P-1086	75.040	42.000	135.000
135	P-1087	80.220	42.000	135.000
136	P-1088	1,507.309	12.000	120.000
137	P-1089	75.310	42.000	135.000
138	P-1090	77.630	42.000	135.000
139	P-1091	80.220	42.000	135.000
140	P-1092	142.460	36.000	130.000
141	P-1093	141.830	36.000	130.000
142	P-1094	141.830	24.000	125.000
143	P-1095	141.830	24.000	125.000
144	P-1096	141.830	24.000	125.000
145	P-1097	141.830	24.000	125.000
146	P-1098	141.831	36.000	130.000
147	P-1099	141.830	36.000	130.000
148	P-11	12.000	10.000	110.000
149	P-110	1,072.286	12.000	120.000
150	P-1100	3,046.368	8.000	110.000
151	P-1101	1,302.487	12.000	120.000
152	P-1102	887.924	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
153	P-1103	346.400	12.000	120.000
154	P-112	149.833	42.000	135.000
155	P-1120	75.240	42.000	135.000
156	P-1121	74.580	42.000	135.000
157	P-1122	80.488	42.000	135.000
158	P-1123	615.368	24.000	125.000
159	P-1124	74.790	42.000	135.000
160	P-1125	78.150	42.000	135.000
161	P-1126	80.220	42.000	135.000
162	P-1127	1,151.004	24.000	125.000
163	P-1128	106.505	12.000	120.000
164	P-1129	1,707.022	12.000	120.000
165	P-1130	1,329.802	8.000	110.000
166	P-1131	593.246	12.000	120.000
167	P-1132	77.575	16.000	120.000
168	P-1133	816.850	16.000	120.000
169	P-1134	1,385.448	12.000	120.000
170	P-1135	606.111	12.000	120.000
171	P-1136	2,703.641	12.000	120.000
172	P-1137	911.546	8.000	110.000
173	P-1138	634.097	8.000	110.000
174	P-1139	959.131	12.000	120.000
175	P-114	482.574	12.000	120.000
176	P-1140	413.438	8.000	110.000
177	P-1141	2,808.874	8.000	110.000
178	P-1143	1,623.041	8.000	110.000
179	P-1144	3,499.739	8.000	110.000
180	P-1145	2,472.474	8.000	110.000
181	P-1146	264.376	6.000	110.000
182	P-1147	1,665.692	8.000	110.000
183	P-115	1,136.681	12.000	120.000
184	P-1150	2,802.616	8.000	110.000
185	P-1151	2,810.162	8.000	110.000
186	P-1152	2,930.687	8.000	110.000
187	P-1155	900.437	24.000	125.000
188	P-1155A	847.031	24.000	125.000
189	P-1155B	1,277.064	24.000	125.000
190	P-1156	3,457.790	8.000	110.000
191	P-1157	1,266.361	8.000	110.000
192	P-1158	443.637	8.000	110.000
193	P-1159	1,302.861	8.000	110.000
194	P-1160	1,470.996	8.000	110.000
195	P-1161	2,482.266	8.000	110.000
196	P-1162	539.145	8.000	110.000
197	P-1163	461.631	8.000	110.000
198	P-1164	515.848	8.000	110.000
199	P-1165	1,292.926	8.000	110.000
200	P-1166	532.173	12.000	120.000
201	P-1167	936.047	12.000	120.000
202	P-1168	892.359	8.000	110.000
203	P-1169	326.955	8.000	110.000
204	P-1170	1,096.237	8.000	110.000
205	P-1171	2,939.871	8.000	110.000
206	P-1172	606.116	8.000	110.000
207	P-1173	893.103	6.000	110.000
208	P-1174	711.441	8.000	110.000
209	P-1175	1,699.555	8.000	110.000
210	P-1176	599.445	8.000	110.000
211	P-1177	1,978.820	12.000	120.000
212	P-1179	1,314.762	8.000	110.000
213	P-1180	281.437	24.000	125.000
214	P-1181	838.275	24.000	125.000
215	P-1182	1,052.282	8.000	110.000
216	P-1183	322.666	8.000	110.000
217	P-1184	290.684	8.000	110.000
218	P-1185	580.361	12.000	120.000
219	P-1189	470.396	12.000	120.000
220	P-1190	1,724.431	8.000	110.000
221	P-1191	1,001.172	6.000	110.000
222	P-1192	495.782	12.000	120.000
223	P-1193	1,334.480	12.000	120.000
224	P-1194	457.703	12.000	120.000
225	P-1195	3,077.099	8.000	110.000
226	P-1196	931.304	6.000	110.000
227	P-1197	921.084	8.000	110.000
228	P-1198	213.141	24.000	125.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
229	P-1199	213.190	24.000	125.000
230	P-12	12.000	24.000	125.000
231	P-1200	223.958	24.000	125.000
232	P-1204	214.911	30.000	130.000
233	P-1205	210.840	30.000	130.000
234	P-1206	225.200	30.000	130.000
235	P-1216	840.382	16.000	120.000
236	P-1217	577.458	12.000	120.000
237	P-1218	350.609	8.000	110.000
238	P-1219	368.109	8.000	110.000
239	P-1220	259.429	8.000	110.000
240	P-1221	1,201.836	18.000	120.000
241	P-1222	715.118	18.000	120.000
242	P-1223	532.611	18.000	120.000
243	P-1224	771.760	18.000	120.000
244	P-1225	1,594.159	18.000	120.000
245	P-1226	428.116	18.000	120.000
246	P-1227	645.173	18.000	120.000
247	P-1228	916.263	16.000	120.000
248	P-1229	305.220	18.000	120.000
249	P-1230	667.472	24.000	125.000
250	P-1231	399.822	24.000	125.000
251	P-1232	844.206	18.000	120.000
252	P-1238	914.512	18.000	120.000
253	P-1239	1,153.711	18.000	120.000
254	P-1240	893.173	8.000	110.000
255	P-1241	298.707	8.000	110.000
256	P-1242	681.288	8.000	110.000
257	P-1243	757.654	12.000	120.000
258	P-1244	494.041	12.000	120.000
259	P-1245	4,772.181	12.000	120.000
260	P-1246	1,113.089	8.000	110.000
261	P-1247	735.536	8.000	110.000
262	P-1248	2,723.980	8.000	110.000
263	P-1249	4,621.488	12.000	120.000
264	P-1255	592.382	16.000	120.000
265	P-1256	807.345	16.000	120.000
266	P-1260	1,145.813	8.000	110.000
267	P-1261	859.371	8.000	110.000
268	P-1262	1,068.715	16.000	120.000
269	P-1263	1,101.258	16.000	120.000
270	P-1264	130.902	12.000	120.000
271	P-1265	872.575	8.000	110.000
272	P-1266	942.785	8.000	110.000
273	P-1267	861.228	12.000	120.000
274	P-1269	1,284.473	8.000	110.000
275	P-1270	1,610.156	12.000	120.000
276	P-1273	568.788	8.000	110.000
277	P-1274	701.478	20.000	125.000
278	P-1275	89.721	20.000	125.000
279	P-1277A	1,095.780	8.000	110.000
280	P-1277B	523.975	8.000	110.000
281	P-1281	595.471	24.000	125.000
282	P-1282	254.180	24.000	125.000
283	P-1283	874.447	8.000	110.000
284	P-1285	624.092	18.000	120.000
285	P-1288	886.217	18.000	120.000
286	P-1291	188.378	24.000	125.000
287	P-13	12.000	24.000	125.000
288	P-1300	908.305	16.000	120.000
289	P-1301	1,723.193	8.000	110.000
290	P-1302	1,072.141	8.000	110.000
291	P-1303	565.573	16.000	120.000
292	P-1304	554.494	12.000	120.000
293	P-1305	52.008	8.000	110.000
294	P-1306	1,191.940	8.000	110.000
295	P-1308	250.967	12.000	120.000
296	P-1309	336.103	8.000	110.000
297	P-1311	150.369	8.000	110.000
298	P-1315	684.726	12.000	120.000
299	P-1316	125.299	12.000	120.000
300	P-1317A	842.869	8.000	110.000
301	P-1317B	1,450.090	8.000	110.000
302	P-1318A	486.638	12.000	120.000
303	P-1318B	163.802	12.000	120.000
304	P-1319	1,835.355	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
305	P-1320	2,030.375	8.000	110.000
306	P-1321	123.541	8.000	110.000
307	P-1323A	676.023	24.000	125.000
308	P-1323B	1,176.406	24.000	125.000
309	P-1324A	1,138.893	8.000	110.000
310	P-1324B	671.839	8.000	110.000
311	P-1325	442.825	12.000	120.000
312	P-1326	236.466	12.000	120.000
313	P-1327	2,291.105	8.000	110.000
314	P-1328	2,553.138	12.000	120.000
315	P-1329A	1,583.144	8.000	110.000
316	P-1329B	851.113	8.000	110.000
317	P-1330	1,503.138	12.000	120.000
318	P-1334	2,447.793	24.000	125.000
319	P-1335	2,100.422	8.000	110.000
320	P-1339	2,369.615	12.000	120.000
321	P-1340	1,040.478	24.000	125.000
322	P-1342	841.893	8.000	110.000
323	P-1343	960.820	8.000	110.000
324	P-1344	3,175.781	8.000	110.000
325	P-1345A	816.715	12.000	120.000
326	P-1347	902.526	12.000	120.000
327	P-135	451.264	8.000	110.000
328	P-1350	1,825.217	8.000	110.000
329	P-1351	2,629.046	8.000	110.000
330	P-1353	1,472.302	6.000	110.000
331	P-1354B	115.132	12.000	120.000
332	P-1354C	1,014.294	12.000	120.000
333	P-1354D	155.860	12.000	120.000
334	P-1355	2,967.134	8.000	110.000
335	P-1358	1,099.585	8.000	120.000
336	P-1359	1,588.343	8.000	120.000
337	P-1360	1,871.048	8.000	110.000
338	P-1361	900.448	12.000	120.000
339	P-1363	1,577.217	6.000	110.000
340	P-1364	1,430.193	8.000	110.000
341	P-1365	1,381.220	8.000	110.000
342	P-1366	2,030.258	24.000	125.000
343	P-1367	2,002.343	12.000	120.000
344	P-1368	1,690.995	24.000	125.000
345	P-1369	816.822	24.000	125.000
346	P-137	77.699	36.000	125.000
347	P-1370	455.860	24.000	125.000
348	P-1371	663.700	8.000	110.000
349	P-1372	1,862.803	12.000	120.000
350	P-1373	319.094	24.000	125.000
351	P-1374	3,006.919	8.000	110.000
352	P-1375	1,459.273	24.000	125.000
353	P-1377	352.672	12.000	120.000
354	P-1378	2,227.706	12.000	120.000
355	P-1379	3,181.866	8.000	110.000
356	P-1380	798.258	20.000	125.000
357	P-1381A	1,134.488	8.000	110.000
358	P-1381B	1,132.974	8.000	110.000
359	P-1381C	1,089.969	8.000	110.000
360	P-1382	1,413.722	20.000	125.000
361	P-1384	1,335.572	12.000	120.000
362	P-1385	622.899	8.000	110.000
363	P-1386	1,618.224	12.000	120.000
364	P-1387	2,128.064	8.000	110.000
365	P-1388	817.987	8.000	110.000
366	P-1389	2,765.590	8.000	110.000
367	P-139	462.210	30.000	130.000
368	P-1390	1,913.233	8.000	110.000
369	P-1392	1,160.619	24.000	125.000
370	P-1393	884.502	24.000	125.000
371	P-1394	2,732.790	12.000	120.000
372	P-1396	1,771.601	12.000	120.000
373	P-1397	2,722.843	8.000	110.000
374	P-1398	2,787.421	24.000	130.000
375	P-1399	1,377.393	12.000	120.000
376	P-14	12.000	24.000	125.000
377	P-140	93.096	8.000	110.000
378	P-1400	788.353	24.000	125.000
379	P-1401	1,142.702	12.000	120.000
380	P-1402	528.405	12.000	120.000



DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
381	P-1403	2,933.741	8.000	110.000
382	P-1406	1,574.654	12.000	110.000
383	P-1408	1,309.446	24.000	125.000
384	P-1409	1,465.217	8.000	110.000
385	P-141	170.338	16.000	120.000
386	P-1410	964.947	12.000	120.000
387	P-1411A	1,092.156	20.000	125.000
388	P-1411B	1,186.067	20.000	125.000
389	P-1411C	1,896.495	20.000	125.000
390	P-1411D	907.972	20.000	125.000
391	P-1411E	344.101	20.000	125.000
392	P-1412	1,005.389	20.000	125.000
393	P-1413	723.038	24.000	125.000
394	P-1414	364.662	12.000	120.000
395	P-1415	2,798.586	12.000	120.000
396	P-1417	3,538.845	8.000	110.000
397	P-1419	1,683.596	8.000	110.000
398	P-142	127.201	30.000	130.000
399	P-1420	1,364.110	24.000	125.000
400	P-1421	1,590.426	8.000	110.000
401	P-1422	3,784.483	8.000	110.000
402	P-1423	1,488.562	12.000	120.000
403	P-1424	1,063.232	18.000	120.000
404	P-1425	1,429.070	18.000	120.000
405	P-1430	3,169.560	8.000	110.000
406	P-1431	1,590.686	8.000	110.000
407	P-1432	2,077.471	8.000	110.000
408	P-1433	1,202.988	8.000	110.000
409	P-1434	967.441	12.000	120.000
410	P-1435	1,236.143	12.000	120.000
411	P-1437	2,025.532	8.000	110.000
412	P-1438	1,150.817	12.000	120.000
413	P-1439	750.678	8.000	110.000
414	P-144	144.540	20.000	125.000
415	P-1442	785.788	12.000	120.000
416	P-1443	945.892	8.000	110.000
417	P-1444	570.572	12.000	120.000
418	P-1445	1,344.888	12.000	120.000
419	P-1446	980.974	24.000	125.000
420	P-1447	1,492.270	24.000	125.000
421	P-1449	2,655.135	8.000	110.000
422	P-1450	782.391	12.000	120.000
423	P-1453	1,108.072	12.000	120.000
424	P-1454	811.706	16.000	120.000
425	P-1455	1,660.273	8.000	110.000
426	P-1456	129.609	8.000	110.000
427	P-1457	1,670.546	12.000	120.000
428	P-1458	1,476.173	12.000	120.000
429	P-1459	1,181.670	12.000	120.000
430	P-1460	702.160	12.000	120.000
431	P-1461	1,430.696	12.000	120.000
432	P-1462	1,475.681	24.000	125.000
433	P-1463	804.153	24.000	125.000
434	P-1464	535.405	24.000	125.000
435	P-1465	527.590	24.000	125.000
436	P-1466	1,337.172	8.000	110.000
437	P-1467	278.466	24.000	125.000
438	P-1468	427.581	24.000	125.000
439	P-1472	1,572.095	8.000	110.000
440	P-1473	1,145.591	8.000	110.000
441	P-1474	503.289	8.000	110.000
442	P-1475	1,441.945	12.000	120.000
443	P-1476	574.206	6.000	110.000
444	P-1477	1,522.571	8.000	110.000
445	P-1478	341.332	12.000	120.000
446	P-1479	718.240	12.000	120.000
447	P-148	345.040	24.000	125.000
448	P-1481	844.534	24.000	125.000
449	P-1482	1,057.953	8.000	110.000
450	P-1483	2,450.662	8.000	110.000
451	P-1484	561.865	36.000	130.000
452	P-1485	471.352	36.000	130.000
453	P-1486	867.506	12.000	120.000
454	P-1487	181.056	12.000	120.000
455	P-1488	2,104.915	8.000	110.000
456	P-1489	1,254.906	36.000	130.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
457	P-149	995.441	24.000	125.000
458	P-1490	2,251.502	36.000	130.000
459	P-1491	917.480	8.000	110.000
460	P-1492	418.670	8.000	110.000
461	P-1493	1,957.333	8.000	110.000
462	P-1494	1,503.589	12.000	120.000
463	P-1495	2,354.615	24.000	125.000
464	P-1496	1,504.554	24.000	125.000
465	P-1497	295.781	8.000	110.000
466	P-1499	112.083	30.000	130.000
467	P-1500	915.874	8.000	110.000
468	P-1501	124.697	18.000	120.000
469	P-1506	480.905	24.000	125.000
470	P-1507	975.848	24.000	125.000
471	P-1509	824.261	8.000	110.000
472	P-1510	686.892	12.000	120.000
473	P-1511	1,513.268	8.000	110.000
474	P-1512	1,946.870	12.000	120.000
475	P-1512A	1,064.678	24.000	125.000
476	P-1512B	835.187	24.000	125.000
477	P-1513	1,965.712	12.000	120.000
478	P-1514	721.035	12.000	120.000
479	P-1515	1,032.542	12.000	120.000
480	P-1516	352.197	8.000	110.000
481	P-1517	2,724.883	12.000	120.000
482	P-1518	2,654.341	24.000	125.000
483	P-1519	3,245.071	24.000	125.000
484	P-1520	1,199.692	12.000	120.000
485	P-1521	1,849.011	8.000	110.000
486	P-1522	2,975.059	12.000	120.000
487	P-1523	455.080	12.000	120.000
488	P-1525	640.236	12.000	120.000
489	P-1527	2,717.077	8.000	110.000
490	P-1529	984.733	8.000	110.000
491	P-1530	820.036	8.000	110.000
492	P-1531	1,019.707	8.000	110.000
493	P-1532	1,520.513	8.000	110.000
494	P-1533	1,457.199	12.000	120.000
495	P-1535	1,362.617	8.000	110.000
496	P-1536	525.398	8.000	110.000
497	P-1538	610.624	12.000	120.000
498	P-154	143.950	20.000	125.000
499	P-1540	277.387	12.000	120.000
500	P-1542	511.633	16.000	125.000
501	P-1543	1,994.129	16.000	125.000
502	P-1546	1,291.914	8.000	110.000
503	P-1547	1,389.719	8.000	110.000
504	P-1549	1,052.861	12.000	120.000
505	P-156	144.281	20.000	125.000
506	P-1568	532.235	20.000	125.000
507	P-1569	450.420	20.000	125.000
508	P-159	74.294	42.000	135.000
509	P-16	29.260	30.000	130.000
510	P-160	67.500	42.000	135.000
511	P-162	53.780	24.000	125.000
512	P-163	35.997	24.000	125.000
513	P-164	632.066	24.000	125.000
514	P-165	48.000	24.000	125.000
515	P-167	150.364	42.000	135.000
516	P-168	166.108	42.000	135.000
517	P-171	324.650	30.000	130.000
518	P-172	335.870	30.000	130.000
519	P-173	343.310	30.000	130.000
520	P-176	329.111	30.000	130.000
521	P-177	312.622	12.000	120.000
522	P-178	257.278	8.000	110.000
523	P-179A	469.828	24.000	125.000
524	P-18	116.193	30.000	130.000
525	P-185	463.941	24.000	125.000
526	P-186	1,278.641	12.000	120.000
527	P-187A	259.085	12.000	120.000
528	P-187B	321.811	12.000	120.000
529	P-188A	342.260	24.000	125.000
530	P-190	584.260	8.000	110.000
531	P-191	151.912	16.000	120.000
532	P-192	1,404.524	8.000	110.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
533	P-194	343.923	20.000	125.000
534	P-195	7,440.851	24.000	125.000
535	P-196	1,038.489	36.000	130.000
536	P-197	109.400	30.000	130.000
537	P-197B	143.468	24.000	125.000
538	P-198	809.856	16.000	120.000
539	P-200	504.191	12.000	120.000
540	P-201	2,152.923	12.000	120.000
541	P-2013	283.637	24.000	125.000
542	P-2014	569.337	24.000	125.000
543	P-2016	501.282	8.000	110.000
544	P-2017	749.888	8.000	110.000
545	P-202	494.934	12.000	120.000
546	P-2024	1,144.500	30.000	130.000
547	P-203	491.318	12.000	120.000
548	P-204	1,615.162	12.000	120.000
549	P-206	1,636.315	12.000	120.000
550	P-207	669.802	18.000	120.000
551	P-208	2,612.491	36.000	130.000
552	P-210	851.760	12.000	120.000
553	P-211	2,014.779	12.000	120.000
554	P-212	809.356	12.000	120.000
555	P-213	2,025.267	12.000	120.000
556	P-214	1,124.529	12.000	120.000
557	P-215	1,050.051	12.000	120.000
558	P-216	1,617.990	12.000	120.000
559	P-217	1,691.632	12.000	120.000
560	P-218	1,571.615	12.000	120.000
561	P-219	1,730.911	12.000	120.000
562	P-220	1,143.091	36.000	130.000
563	P-221	1,927.662	12.000	120.000
564	P-223	2,213.279	12.000	120.000
565	P-225	843.025	12.000	120.000
566	P-227	490.701	16.000	120.000
567	P-228	1,276.254	12.000	120.000
568	P-229	2,090.026	12.000	120.000
569	P-230	627.427	16.000	120.000
570	P-231	771.541	12.000	120.000
571	P-232	446.100	12.000	120.000
572	P-233	1,917.592	8.000	110.000
573	P-234	1,885.488	24.000	125.000
574	P-235	606.105	12.000	120.000
575	P-236	601.245	12.000	120.000
576	P-237	1,902.478	12.000	100.000
577	P-238	594.343	12.000	120.000
578	P-239	2,389.273	24.000	125.000
579	P-240	1,248.802	12.000	120.000
580	P-241	878.985	12.000	120.000
581	P-242	1,830.249	12.000	120.000
582	P-243	2,610.080	8.000	110.000
583	P-244	1,781.559	8.000	110.000
584	P-245	412.152	12.000	120.000
585	P-246	1,803.743	8.000	110.000
586	P-246A	986.961	8.000	110.000
587	P-246B	2,701.159	8.000	120.000
588	P-247	1,617.096	12.000	120.000
589	P-249	406.698	12.000	120.000
590	P-250	1,739.037	12.000	120.000
591	P-251	1,399.065	12.000	120.000
592	P-252	3,739.932	8.000	110.000
593	P-253	313.276	12.000	120.000
594	P-254	1,415.469	12.000	120.000
595	P-256A	1,560.863	12.000	120.000
596	P-256B	3,155.761	12.000	120.000
597	P-257	1,762.646	12.000	120.000
598	P-258	1,561.810	12.000	120.000
599	P-259	2,580.016	12.000	120.000
600	P-260	1,638.754	12.000	120.000
601	P-261B	643.243	12.000	120.000
602	P-262	847.612	12.000	120.000
603	P-266	1,852.056	12.000	120.000
604	P-267	124.920	12.000	120.000
605	P-270A	965.935	8.000	110.000
606	P-270B	1,980.285	8.000	110.000
607	P-271	1,027.521	12.000	120.000
608	P-272	2,880.069	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
609	P-273	1,662.242	12.000	120.000
610	P-274	5.983	16.000	120.000
611	P-275	2,424.150	12.000	120.000
612	P-276	783.440	12.000	120.000
613	P-277	1,274.384	12.000	120.000
614	P-278	1,006.443	12.000	120.000
615	P-279	6.631	12.000	120.000
616	P-280	1,278.296	12.000	120.000
617	P-281	2,177.487	12.000	120.000
618	P-282	678.011	12.000	120.000
619	P-283	2,144.630	12.000	120.000
620	P-284	1,438.089	12.000	120.000
621	P-285	5.976	16.000	120.000
622	P-286	1,861.995	12.000	120.000
623	P-287	50.058	18.000	120.000
624	P-288	170.924	18.000	120.000
625	P-289	767.607	12.000	120.000
626	P-290	5.828	16.000	120.000
627	P-291	6.351	12.000	120.000
628	P-292	1,804.002	12.000	120.000
629	P-293	1,058.879	12.000	120.000
630	P-294	1,038.283	12.000	120.000
631	P-295	679.874	12.000	120.000
632	P-297	1,076.787	12.000	120.000
633	P-298	969.541	12.000	120.000
634	P-299	640.475	20.000	125.000
635	P-3001	20.003	12.000	120.000
636	P-3002	10.000	20.000	125.000
637	P-3003	16.000	12.000	120.000
638	P-3006	16.000	12.000	120.000
639	P-3009	10.000	14.000	120.000
640	P-301	1,759.891	12.000	120.000
641	P-3012	469.335	12.000	120.000
642	P-3013	26.831	12.000	120.000
643	P-302	775.488	12.000	120.000
644	P-303	675.401	12.000	120.000
645	P-304	530.423	12.000	120.000
646	P-305	3,308.091	12.000	120.000
647	P-306	710.393	12.000	120.000
648	P-307	6.385	16.000	120.000
649	P-308	5.981	16.000	120.000
650	P-309A	1,063.834	12.000	120.000
651	P-309B	144.462	12.000	120.000
652	P-310	6.291	12.000	120.000
653	P-311	4.978	16.000	120.000
654	P-312A	462.523	12.000	120.000
655	P-312B	382.578	12.000	120.000
656	P-314	139.022	12.000	120.000
657	P-315	1,601.316	12.000	120.000
658	P-317	1,068.884	12.000	120.000
659	P-318	1,593.564	12.000	120.000
660	P-322	2,680.305	12.000	120.000
661	P-323	21.550	16.000	120.000
662	P-324	2,574.129	12.000	120.000
663	P-325	784.429	12.000	120.000
664	P-326	2,146.036	12.000	120.000
665	P-327	585.941	12.000	120.000
666	P-328	2,539.516	12.000	120.000
667	P-33	12.000	12.000	120.000
668	P-330	3,733.377	12.000	120.000
669	P-331	3,076.807	12.000	120.000
670	P-333	158.038	16.000	120.000
671	P-334	2,958.375	12.000	120.000
672	P-335	19.357	16.000	120.000
673	P-336	304.927	16.000	120.000
674	P-337	1,316.970	12.000	120.000
675	P-338	938.423	12.000	120.000
676	P-339	2,341.779	12.000	120.000
677	P-34	12.000	24.000	125.000
678	P-340	226.709	16.000	120.000
679	P-341	90.202	8.000	110.000
680	P-342	994.867	12.000	120.000
681	P-343	999.384	12.000	120.000
682	P-344	1,341.130	12.000	120.000
683	P-345	17.753	16.000	120.000
684	P-346	242.035	16.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
685	P-347	1,362.000	12.000	120.000
686	P-348	1,283.607	24.000	125.000
687	P-349	2,063.365	12.000	120.000
688	P-351	85.704	18.000	120.000
689	P-352	1,692.521	12.000	120.000
690	P-353	79.889	30.000	130.000
691	P-354	1,998.722	12.000	120.000
692	P-355	1,543.123	12.000	120.000
693	P-356	2,596.452	12.000	120.000
694	P-357	4,388.678	12.000	120.000
695	P-359	1,093.037	12.000	120.000
696	P-360	2,526.150	12.000	120.000
697	P-361	935.906	12.000	120.000
698	P-362	830.238	12.000	120.000
699	P-363	965.916	12.000	120.000
700	P-364	651.483	12.000	120.000
701	P-365	303.750	24.000	125.000
702	P-366	11.238	24.000	125.000
703	P-367	1,655.282	12.000	120.000
704	P-368	225.755	16.000	120.000
705	P-370	955.978	12.000	120.000
706	P-371	747.075	12.000	120.000
707	P-372	839.737	12.000	120.000
708	P-373	1,000.480	12.000	120.000
709	P-374	706.428	12.000	120.000
710	P-375	732.151	12.000	120.000
711	P-376	712.165	12.000	120.000
712	P-377	726.826	12.000	120.000
713	P-378	503.114	12.000	120.000
714	P-380	1,705.766	12.000	120.000
715	P-381	499.149	12.000	120.000
716	P-382	730.793	12.000	120.000
717	P-383	714.728	12.000	120.000
718	P-384	722.803	12.000	120.000
719	P-385	733.680	12.000	120.000
720	P-386	1,713.484	12.000	120.000
721	P-387	1,710.617	12.000	120.000
722	P-388	1,708.217	12.000	120.000
723	P-389	1,707.135	12.000	120.000
724	P-391	771.309	12.000	120.000
725	P-392	1,731.160	12.000	120.000
726	P-393	1,348.672	18.000	120.000
727	P-394	1,852.552	12.000	120.000
728	P-395	1,175.045	12.000	120.000
729	P-396	1,377.842	12.000	120.000
730	P-397	1,520.412	12.000	120.000
731	P-398	5,416.222	12.000	120.000
732	P-399	2,099.055	12.000	120.000
733	P-40	196.562	16.000	120.000
734	P-400	1,392.333	12.000	120.000
735	P-402	2,358.501	12.000	120.000
736	P-403	1,028.360	12.000	120.000
737	P-404	1,631.464	12.000	120.000
738	P-406	1,498.122	12.000	120.000
739	P-407	761.861	8.000	110.000
740	P-408	1,761.042	12.000	120.000
741	P-409	1,669.637	12.000	120.000
742	P-41	36.617	16.000	120.000
743	P-410	1,580.324	8.000	110.000
744	P-411	536.205	16.000	120.000
745	P-412	143.942	20.000	125.000
746	P-413	5.876	12.000	120.000
747	P-414	2,494.532	8.000	120.000
748	P-415	2,173.782	12.000	120.000
749	P-416	1,569.317	24.000	125.000
750	P-418A	2,318.668	12.000	120.000
751	P-418B	1,204.448	12.000	120.000
752	P-419	579.103	12.000	120.000
753	P-420	1,821.207	12.000	120.000
754	P-422_CV	92.067	8.000	110.000
755	P-423A	1,026.621	12.000	120.000
756	P-423B	791.478	12.000	120.000
757	P-424	1,508.701	12.000	120.000
758	P-425	1,250.895	12.000	120.000
759	P-426	1,133.252	12.000	120.000
760	P-427	376.776	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
761	P-428	1,373.515	24.000	125.000
762	P-430	180.913	12.000	120.000
763	P-431	170.251	12.000	120.000
764	P-434	970.659	12.000	120.000
765	P-435	1,061.730	12.000	120.000
766	P-436	425.917	12.000	120.000
767	P-437	1,624.942	12.000	120.000
768	P-438	392.488	8.000	110.000
769	P-439	1,501.285	12.000	120.000
770	P-440	2,432.180	24.000	125.000
771	P-441	3,144.499	24.000	125.000
772	P-442	1,144.715	12.000	120.000
773	P-443	1,314.877	12.000	120.000
774	P-444A	1,381.388	12.000	120.000
775	P-444B	367.047	12.000	120.000
776	P-445A	2,164.502	12.000	120.000
777	P-445B	1,348.098	12.000	120.000
778	P-446	978.791	12.000	120.000
779	P-447	1,660.762	12.000	120.000
780	P-448	2,339.264	12.000	120.000
781	P-449	1,866.032	12.000	120.000
782	P-450	1,205.936	12.000	120.000
783	P-451	3,504.506	12.000	120.000
784	P-452	1,289.676	24.000	125.000
785	P-453	19.992	16.000	120.000
786	P-454	759.777	30.000	130.000
787	P-456	86.697	12.000	120.000
788	P-458	206.830	24.000	125.000
789	P-459	1,493.463	36.000	130.000
790	P-460	1,186.624	12.000	120.000
791	P-461	937.809	12.000	120.000
792	P-462	367.257	12.000	120.000
793	P-463	1,730.217	12.000	120.000
794	P-464	947.563	12.000	120.000
795	P-465	586.725	12.000	120.000
796	P-466	1,782.040	8.000	120.000
797	P-467	3,553.312	36.000	130.000
798	P-468	1,415.910	12.000	120.000
799	P-469	2,729.288	6.000	110.000
800	P-470	1,368.278	12.000	120.000
801	P-471	160.930	12.000	120.000
802	P-474	1,482.102	24.000	125.000
803	P-475	1,974.113	12.000	120.000
804	P-480	625.694	24.000	125.000
805	P-481	1,100.405	24.000	125.000
806	P-482	898.066	12.000	120.000
807	P-483	243.242	12.000	120.000
808	P-484	134.221	12.000	120.000
809	P-485	785.824	12.000	120.000
810	P-487	859.711	12.000	120.000
811	P-488	942.529	12.000	120.000
812	P-493	746.193	12.000	120.000
813	P-494	1,689.067	12.000	120.000
814	P-496	529.813	12.000	120.000
815	P-497	781.721	12.000	120.000
816	P-498	996.970	12.000	120.000
817	P-499	754.207	12.000	120.000
818	P-500	1,393.657	12.000	120.000
819	P-502	1,559.267	12.000	120.000
820	P-503	1,600.901	12.000	120.000
821	P-504	477.107	12.000	120.000
822	P-505	655.701	12.000	120.000
823	P-506	507.763	12.000	120.000
824	P-507	765.633	12.000	120.000
825	P-508	1,552.157	12.000	120.000
826	P-510	439.729	12.000	120.000
827	P-512	1,203.761	12.000	120.000
828	P-513	448.197	12.000	120.000
829	P-514	484.327	12.000	120.000
830	P-522	2,145.666	8.000	120.000
831	P-523	2,937.637	12.000	120.000
832	P-524	1,722.594	8.000	110.000
833	P-526	1,246.992	12.000	120.000
834	P-528	1,667.775	12.000	120.000
835	P-529	1,561.691	12.000	120.000
836	P-530	1,011.665	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
837	P-531	1,318.014	12.000	120.000
838	P-540	1,292.920	8.000	110.000
839	P-542	2,127.710	8.000	110.000
840	P-543	2,037.479	8.000	110.000
841	P-544	216.193	8.000	110.000
842	P-545	1,680.522	12.000	120.000
843	P-547	2,981.165	12.000	120.000
844	P-548	1,580.187	12.000	120.000
845	P-549	1,782.610	8.000	110.000
846	P-550	1,684.855	12.000	120.000
847	P-551	1,134.822	12.000	120.000
848	P-552	1,789.059	8.000	110.000
849	P-557	1,479.690	8.000	110.000
850	P-559	2,174.853	8.000	110.000
851	P-563	2,689.011	8.000	110.000
852	P-564	2,754.107	8.000	110.000
853	P-565	2,972.572	8.000	110.000
854	P-566	1,999.992	24.000	125.000
855	P-568	715.983	8.000	110.000
856	P-569	2,253.145	8.000	110.000
857	P-571	1,826.117	8.000	110.000
858	P-572	576.272	8.000	110.000
859	P-573	1,101.771	8.000	110.000
860	P-574	1,273.486	8.000	110.000
861	P-575	1,121.266	8.000	110.000
862	P-580	449.265	24.000	125.000
863	P-584	824.161	24.000	125.000
864	P-585	1,538.641	24.000	125.000
865	P-595	298.134	24.000	125.000
866	P-599	797.303	24.000	125.000
867	P-6	12.000	10.000	110.000
868	P-600	267.602	24.000	125.000
869	P-601	2,063.314	24.000	125.000
870	P-602	1,389.813	24.000	125.000
871	P-603	670.257	24.000	125.000
872	P-604	1,501.242	24.000	125.000
873	P-605	158.290	24.000	125.000
874	P-607	160.290	24.000	125.000
875	P-612	1,113.055	24.000	125.000
876	P-613	1,180.638	24.000	125.000
877	P-614	767.740	24.000	125.000
878	P-615	1,059.195	24.000	125.000
879	P-616	1,984.469	18.000	120.000
880	P-617	657.976	24.000	125.000
881	P-618A	1,148.358	24.000	125.000
882	P-618B	1,240.846	24.000	125.000
883	P-622	1,298.927	24.000	125.000
884	P-628	771.611	8.000	110.000
885	P-629	1,394.709	20.000	125.000
886	P-63	12.000	24.000	125.000
887	P-631	1,002.270	20.000	125.000
888	P-632	1,258.631	20.000	125.000
889	P-635	713.800	20.000	125.000
890	P-636	511.803	20.000	125.000
891	P-637	500.719	20.000	125.000
892	P-64	41.651	24.000	100.000
893	P-640	1,316.733	24.000	125.000
894	P-642	486.962	24.000	125.000
895	P-649	1,217.422	8.000	110.000
896	P-650	775.714	8.000	110.000
897	P-654	2,266.466	12.000	120.000
898	P-661	1,738.000	12.000	120.000
899	P-662	666.596	12.000	120.000
900	P-663	298.904	12.000	120.000
901	P-668	1,826.353	20.000	125.000
902	P-669	557.254	12.000	120.000
903	P-67	21.831	16.000	120.000
904	P-671	1,105.463	12.000	120.000
905	P-675	1,581.314	24.000	125.000
906	P-68	40.064	16.000	120.000
907	P-685	655.549	8.000	110.000
908	P-686	469.395	24.000	125.000
909	P-689	1,360.587	24.000	130.000
910	P-69	49.850	16.000	120.000
911	P-704	2,644.010	24.000	125.000
912	P-706	1,010.669	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
913	P-71	75.633	16.000	120.000
914	P-716	798.901	12.000	120.000
915	P-717	1,003.666	12.000	120.000
916	P-72	86.822	16.000	120.000
917	P-723	655.954	16.000	120.000
918	P-724	1,394.110	16.000	120.000
919	P-726	1,487.844	16.000	120.000
920	P-727	1,021.116	16.000	120.000
921	P-728	1,109.781	16.000	120.000
922	P-729	1,352.380	16.000	120.000
923	P-730	610.360	16.000	120.000
924	P-731	1,198.844	16.000	120.000
925	P-732	726.955	20.000	125.000
926	P-733	837.739	20.000	125.000
927	P-734	789.099	20.000	125.000
928	P-735	2,464.626	24.000	125.000
929	P-736	1,868.667	12.000	120.000
930	P-737	635.235	24.000	125.000
931	P-740	580.099	20.000	125.000
932	P-741	525.302	24.000	125.000
933	P-745	1,251.597	24.000	125.000
934	P-746	642.921	8.000	110.000
935	P-747	1,289.597	24.000	125.000
936	P-749	612.147	16.000	120.000
937	P-750	1,380.668	16.000	120.000
938	P-751	1,563.960	16.000	120.000
939	P-752	466.726	16.000	120.000
940	P-753	627.015	12.000	120.000
941	P-755	779.275	16.000	120.000
942	P-756	367.777	16.000	120.000
943	P-759	844.647	8.000	110.000
944	P-76	9.290	48.000	135.000
945	P-761	974.169	8.000	110.000
946	P-763	2,586.471	8.000	110.000
947	P-764	1,091.605	16.000	120.000
948	P-765	1,008.924	16.000	120.000
949	P-766	826.535	16.000	120.000
950	P-767	2,188.495	16.000	120.000
951	P-768	1,451.464	10.000	110.000
952	P-769	1,527.367	12.000	120.000
953	P-774	1,208.308	12.000	120.000
954	P-78	9.100	48.000	135.000
955	P-780	3,787.390	8.000	110.000
956	P-781	3,149.961	12.000	120.000
957	P-782	1,180.881	8.000	110.000
958	P-783	2,205.265	8.000	110.000
959	P-784	1,542.663	8.000	110.000
960	P-785	2,973.542	8.000	110.000
961	P-789	2,330.014	8.000	110.000
962	P-791	2,365.800	12.000	120.000
963	P-792	595.176	12.000	120.000
964	P-793	934.021	8.000	110.000
965	P-794	7,803.528	8.000	110.000
966	P-795	987.274	8.000	110.000
967	P-796	1,511.297	8.000	110.000
968	P-798	2,403.603	8.000	110.000
969	P-799	1,528.640	8.000	110.000
970	P-801	3,619.685	8.000	110.000
971	P-802	1,895.428	8.000	110.000
972	P-803	2,082.381	8.000	110.000
973	P-808	1,692.554	8.000	110.000
974	P-809	1,760.954	8.000	110.000
975	P-810	487.460	8.000	110.000
976	P-811	1,400.401	8.000	110.000
977	P-812	3,191.039	8.000	110.000
978	P-813	2,434.204	8.000	110.000
979	P-814	1,220.592	8.000	110.000
980	P-815	1,201.563	8.000	110.000
981	P-816	1,202.706	8.000	110.000
982	P-817	2,330.392	8.000	110.000
983	P-818	692.468	8.000	110.000
984	P-821	1,473.414	8.000	110.000
985	P-823	982.129	24.000	125.000
986	P-824	881.913	8.000	110.000
987	P-827	1,543.285	8.000	110.000
988	P-830	3,068.973	8.000	110.000



DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
989	P-832	2,236.297	8.000	110.000
990	P-833	2,705.927	8.000	110.000
991	P-834	1,050.081	8.000	110.000
992	P-835	1,601.946	8.000	110.000
993	P-838	724.803	12.000	120.000
994	P-840	1,228.344	12.000	120.000
995	P-841	1,503.350	12.000	120.000
996	P-842	2,193.981	12.000	120.000
997	P-844A	655.329	8.000	110.000
998	P-844B	626.146	8.000	110.000
999	P-845	1,149.918	8.000	110.000
1000	P-846	1,939.819	8.000	110.000
1001	P-847	1,965.938	8.000	110.000
1002	P-848	705.756	8.000	110.000
1003	P-849	812.897	8.000	110.000
1004	P-85	17.710	36.000	130.000
1005	P-850	1,030.482	8.000	110.000
1006	P-854	2,252.590	12.000	120.000
1007	P-855	1,104.630	12.000	120.000
1008	P-859	586.430	8.000	110.000
1009	P-86	18.450	36.000	130.000
1010	P-860	536.126	8.000	110.000
1011	P-861	622.797	8.000	110.000
1012	P-862	1,566.234	8.000	110.000
1013	P-863A	1,090.264	6.000	110.000
1014	P-863B	653.638	6.000	110.000
1015	P-864	1,456.737	6.000	110.000
1016	P-865	1,520.671	6.000	110.000
1017	P-866	1,846.295	6.000	110.000
1018	P-868	1,090.449	12.000	120.000
1019	P-869	2,355.975	6.000	110.000
1020	P-870	828.867	6.000	110.000
1021	P-871	866.896	6.000	110.000
1022	P-872	1,554.428	12.000	120.000
1023	P-873	666.263	12.000	120.000
1024	P-874	1,336.764	12.000	120.000
1025	P-875	1,181.261	12.000	120.000
1026	P-876	482.714	12.000	120.000
1027	P-879	832.038	12.000	120.000
1028	P-880	754.360	12.000	120.000
1029	P-881	772.714	16.000	120.000
1030	P-882	839.081	16.000	120.000
1031	P-883	1,879.752	16.000	120.000
1032	P-885	1,209.471	16.000	120.000
1033	P-886	1,224.541	8.000	110.000
1034	P-887	1,390.011	8.000	110.000
1035	P-888	709.122	8.000	110.000
1036	P-889	1,853.479	8.000	110.000
1037	P-890	798.216	8.000	110.000
1038	P-891	661.142	24.000	125.000
1039	P-893	1,300.217	8.000	110.000
1040	P-897	1,917.286	8.000	110.000
1041	P-898	1,215.396	8.000	110.000
1042	P-899	1,063.733	8.000	110.000
1043	P-9	12.000	10.000	110.000
1044	P-900	821.808	8.000	110.000
1045	P-901	2,662.579	8.000	110.000
1046	P-902	1,396.346	8.000	110.000
1047	P-906	1,447.138	8.000	110.000
1048	P-908	2,099.811	8.000	110.000
1049	P-909	639.432	24.000	125.000
1050	P-91	17.800	48.000	135.000
1051	P-910	855.003	24.000	125.000
1052	P-911	1,726.427	8.000	110.000
1053	P-912	2,170.486	12.000	120.000
1054	P-913	1,722.854	12.000	120.000
1055	P-916	1,256.892	8.000	110.000
1056	P-917	1,254.531	8.000	110.000
1057	P-918	185.455	8.000	110.000
1058	P-919	1,341.190	8.000	110.000
1059	P-920	915.093	8.000	110.000
1060	P-921	598.590	12.000	120.000
1061	P-922	1,508.171	12.000	120.000
1062	P-923	1,098.668	8.000	110.000
1063	P-924	1,588.625	8.000	110.000
1064	P-927	869.585	6.000	110.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1065	P-928	1,210.158	6.000	110.000
1066	P-929	1,439.852	6.000	110.000
1067	P-930	1,252.069	8.000	110.000
1068	P-931	934.764	8.000	110.000
1069	P-932	1,456.811	8.000	110.000
1070	P-933	1,243.522	8.000	110.000
1071	P-935	933.978	8.000	110.000
1072	P-936	1,242.886	8.000	110.000
1073	P-937	1,154.438	8.000	110.000
1074	P-938	847.929	8.000	110.000
1075	P-940	1,026.506	12.000	110.000
1076	P-941	1,436.927	12.000	110.000
1077	P-942	169.833	12.000	120.000
1078	P-943	352.385	8.000	110.000
1079	P-944	979.570	8.000	110.000
1080	P-945	768.894	8.000	110.000
1081	P-946	1,678.590	8.000	110.000
1082	P-947	913.899	12.000	120.000
1083	P-948	673.114	12.000	120.000
1084	P-949	1,559.607	8.000	110.000
1085	P-950	2,955.821	8.000	110.000
1086	P-951	329.431	8.000	110.000
1087	P-952	679.989	8.000	110.000
1088	P-953	1,096.884	12.000	110.000
1089	P-956	1,568.030	8.000	110.000
1090	P-959	1,155.505	8.000	110.000
1091	P-963	545.697	8.000	110.000
1092	P-964	1,221.910	12.000	110.000
1093	P-969	878.533	8.000	110.000
1094	P-970	917.345	8.000	110.000
1095	P-971	1,508.094	8.000	110.000
1096	P-972	1,193.965	8.000	110.000
1097	P-975	635.782	8.000	110.000
1098	P-976	1,028.897	8.000	110.000
1099	P-977	2,736.808	8.000	110.000
1100	P-978	1,973.379	8.000	110.000
1101	P-979	970.578	8.000	110.000
1102	P-981	809.208	8.000	110.000
1103	P-983	1,569.465	8.000	110.000
1104	P-986	879.009	8.000	110.000
1105	P-993	2,053.617	24.000	125.000
1106	P-994	1,559.964	12.000	110.000
1107	P-995	1,753.225	12.000	110.000
1108	P-996	1,078.879	12.000	120.000
1109	P-997	894.696	12.000	120.000
1110	P-998	1,286.653	12.000	110.000
1111	P-999	1,850.687	8.000	110.000
1112	P1542	421.213	30.000	130.000
1113	P1544	282.502	24.000	120.000
1114	P1550	657.858	12.000	130.000
1115	P1552	57.623	30.000	130.000
1116	P1554	188.643	24.000	125.000
1117	P1568	77.236	16.000	120.000
1118	P1572	104.427	30.000	135.000
1119	P1574	353.762	8.000	110.000
1120	P1576	529.851	12.000	120.000
1121	P1578	2,090.659	8.000	110.000
1122	P1580	2,098.825	12.000	120.000
1123	P1582	296.823	8.000	110.000
1124	P1584	644.987	6.000	100.000
1125	P1588	1,464.405	8.000	100.000
1126	P1590	69.315	12.000	100.000
1127	P1592	124.356	30.000	130.000
1128	P1594	68.839	4.000	100.000
1129	P1596	60.305	6.000	100.000
1130	P1598	74.945	10.000	100.000
1131	P1600	720.194	12.000	120.000
1132	P1602	520.328	12.000	100.000
1133	P1604	371.460	8.000	100.000
1134	P1606	179.433	12.000	120.000
1135	P1608	179.433	12.000	100.000
1136	P1610	507.524	18.000	100.000
1137	P1612	88.547	36.000	125.000
1138	P1614	93.067	24.000	125.000
1139	P1616	113.173	20.000	125.000
1140	P1618	597.954	12.000	100.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1141	P1620	390.779	8.000	110.000
1142	P1622	1,215.892	8.000	110.000
1143	P1624	2,182.421	8.000	120.000
1144	P1626	97.980	8.000	110.000
1145	P1628	219.964	18.000	120.000
1146	P1630	165.339	8.000	100.000
1147	P1632	190.064	8.000	100.000
1148	P1634	258.645	8.000	110.000
1149	P1640	625.325	8.000	110.000
1150	P1642	219.088	12.000	100.000
1151	P1644	852.746	8.000	100.000
1152	P1646	155.098	8.000	110.000
1153	P1648	378.816	8.000	110.000
1154	P1650	323.698	8.000	110.000
1155	P1652	317.081	8.000	110.000
1156	P1654	673.832	8.000	100.000
1157	P1656	374.671	8.000	100.000
1158	P1658	839.690	8.000	110.000
1159	P1660	432.797	24.000	125.000
1160	P1662	606.479	12.000	100.000
1161	P1664	166.974	12.000	100.000
1162	P1666	1,564.865	12.000	100.000
1163	P1668	1,031.445	8.000	110.000
1164	P1670	1,804.069	24.000	100.000
1165	P1672	2,243.685	12.000	100.000
1166	P1674	1,744.969	8.000	100.000
1167	P1676	477.636	12.000	100.000
1168	P1678	1,749.107	12.000	100.000
1169	P1680	4,394.161	12.000	100.000
1170	P1682	446.135	8.000	110.000
1171	P1684	1,630.527	12.000	100.000
1172	P1686	534.025	12.000	120.000
1173	P1688	2,758.683	12.000	100.000
1174	P1690	2,997.332	12.000	100.000
1175	P1692	1,818.198	12.000	100.000
1176	P1694	2,036.570	20.000	125.000
1177	P1696	2,589.572	12.000	100.000
1178	P1700	66.113	8.000	100.000
1179	P1702	69.926	12.000	100.000
1180	P1704	100.128	12.000	100.000
1181	P1708	11.782	12.000	100.000
1182	P1710	9.734	12.000	100.000
1183	P1712	73.555	8.000	100.000
1184	P1714	73.555	12.000	100.000
1185	P1716	2,196.542	8.000	110.000
1186	P1718	267.198	12.000	100.000
1187	P1720	1,517.090	24.000	125.000
1188	P1722	52.255	42.000	100.000
1189	P1724	398.232	42.000	100.000
1190	P1726	352.238	42.000	100.000
1191	P1728	705.810	24.000	125.000
1192	P1730	188.948	24.000	120.000
1193	P1732	210.697	30.000	120.000
1194	P1734	42.064	12.000	120.000
1195	P1736	61.539	16.000	120.000
1196	P1738	52.949	16.000	120.000
1197	P1740	74.742	42.000	100.000
1198	P1742	77.992	42.000	100.000
1199	P1744	412.571	12.000	120.000
1200	P1746	125.978	12.000	120.000
1201	P1748	41.946	12.000	120.000
1202	P1758	73.370	12.000	120.000
1203	P1760	25.190	12.000	100.000
1204	P1762	30.962	12.000	100.000
1205	P1764	171.434	12.000	120.000
1206	P1770	728.776	8.000	110.000
1207	P1790	509.415	12.000	120.000
1208	P1792	520.322	24.000	125.000
1209	P1796	246.987	24.000	125.000
1210	P1802	368.877	8.000	110.000
1211	P1818	114.116	12.000	120.000
1212	P1820	593.361	8.000	100.000
1213	P1822	32.837	12.000	100.000
1214	P1824	32.439	24.000	125.000
1215	P1826	141.529	24.000	125.000
1216	P1828	2,976.330	30.000	130.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1217	P1830	8,928.214	8.000	110.000
1218	P1836	290.182	8.000	110.000
1219	P1838	362.851	8.000	110.000
1220	P1840	817.733	8.000	110.000
1221	P1842	323.533	8.000	110.000
1222	P1844	424.936	8.000	110.000
1223	P1846	237.512	8.000	110.000
1224	P1848	11.895	8.000	110.000
1225	P1850	242.585	8.000	110.000
1226	P1852	99.456	12.000	120.000
1227	P1854	196.831	12.000	120.000
1228	P1856	123.819	12.000	120.000
1229	P1858	597.809	12.000	120.000
1230	P1860	805.202	12.000	120.000
1231	P1862	304.389	8.000	110.000
1232	P1864	311.522	8.000	110.000
1233	P1866	256.363	8.000	110.000
1234	P1868	514.340	8.000	110.000
1235	P1870	68.812	8.000	110.000
1236	P1872	465.213	6.000	110.000
1237	P1874	476.045	6.000	110.000
1238	P1876	414.195	8.000	110.000
1239	P1878	282.397	8.000	100.000
1240	P1880	300.772	8.000	110.000
1241	P1882	258.177	8.000	110.000
1242	P1884	303.853	8.000	110.000
1243	P1886	1,100.671	8.000	110.000
1244	P1888	357.308	8.000	110.000
1245	P1890	624.043	8.000	110.000
1246	P1892	269.016	6.000	110.000
1247	P1894	1,100.975	8.000	110.000
1248	P1896	161.460	6.000	110.000
1249	P1898	385.828	8.000	110.000
1250	P1900	304.351	8.000	110.000
1251	P1902	264.836	12.000	100.000
1252	P1904	108.313	12.000	120.000
1253	P1906	382.839	6.000	110.000
1254	P1908	772.252	12.000	120.000
1255	P1910	1,110.717	8.000	110.000
1256	P1912	220.335	8.000	110.000
1257	P1914	401.239	8.000	110.000
1258	P1916	11.345	8.000	110.000
1259	P1918	11.202	12.000	120.000
1260	P1920	143.871	8.000	110.000
1261	P1922	676.276	12.000	120.000
1262	P1924	2,006.916	8.000	110.000
1263	P1926	404.462	8.000	110.000
1264	P1928	608.282	8.000	110.000
1265	P1930	330.446	12.000	100.000
1266	P1932	353.251	12.000	120.000
1267	P1934	323.304	12.000	120.000
1268	P1936	110.288	8.000	110.000
1269	P1938	146.430	8.000	110.000
1270	P1940	439.872	8.000	110.000
1271	P1942	394.505	8.000	110.000
1272	P1944	125.265	12.000	120.000
1273	P1946	406.291	12.000	120.000
1274	P1948	109.523	12.000	120.000
1275	P1950	357.489	8.000	110.000
1276	P1952	102.165	12.000	120.000
1277	P1954	422.780	12.000	120.000
1278	P1956	194.686	12.000	120.000
1279	P1958	288.915	12.000	120.000
1280	P1960	2,356.757	8.000	110.000
1281	P1962	93.853	12.000	120.000
1282	P1964	557.518	12.000	120.000
1283	P1966	152.988	12.000	120.000
1284	P1968	698.195	12.000	120.000
1285	P1970	467.467	8.000	110.000
1286	P1972	316.879	8.000	110.000
1287	P1974	116.651	8.000	110.000
1288	P1976	589.889	8.000	110.000
1289	P1978	1,191.564	8.000	110.000
1290	P1980	386.992	8.000	110.000
1291	P1982	1,265.963	12.000	100.000
1292	P1984	161.721	12.000	120.000

DB Table - 'Pipe Modeling'

* BASE *	ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1293	P1986	454.218	12.000	120.000
1294	P1988	182.333	6.000	110.000
1295	P1990	528.357	8.000	110.000
1296	P1992	57.103	12.000	120.000
1297	P1994	2,295.397	8.000	110.000
1298	P1996	294.531	12.000	120.000
1299	P1998	716.832	12.000	120.000
1300	P2000	1,323.341	8.000	110.000
1301	P2002	91.853	12.000	120.000
1302	P2004	521.330	12.000	120.000
1303	P2006	665.771	12.000	120.000
1304	P2008	52.913	12.000	120.000
1305	P2010	42.067	12.000	120.000
1306	P2012	1,242.592	8.000	110.000
1307	P2014	476.326	8.000	110.000
1308	P2016	158.756	8.000	110.000
1309	P2018	282.449	12.000	120.000
1310	P2020	208.042	8.000	110.000
1311	P2022	256.650	12.000	120.000
1312	P2024	971.615	8.000	110.000
1313	P2026	1,481.695	12.000	120.000
1314	P2028	855.404	8.000	110.000
1315	P2030	142.608	8.000	110.000
1316	P2032	347.432	8.000	110.000
1317	P2034	15.761	8.000	110.000
1318	P2036	249.658	8.000	110.000
1319	P2038	551.409	8.000	110.000
1320	P2040	38.876	8.000	110.000
1321	P2042	285.183	8.000	110.000
1322	P2044	388.172	8.000	110.000
1323	P2046	240.982	8.000	110.000
1324	P2048	303.911	8.000	110.000
1325	P2050	272.268	8.000	110.000
1326	P2052	159.492	8.000	110.000
1327	P2054	86.215	12.000	100.000
1328	P2056	12.225	12.000	120.000
1329	P2058	229.140	12.000	120.000
1330	P2060	539.668	12.000	120.000
1331	P2062	147.388	8.000	110.000
1332	P2064	575.038	8.000	110.000
1333	P2066	1,029.479	8.000	110.000
1334	P2068	545.143	12.000	100.000
1335	P2072	66.693	8.000	110.000
1336	P2074	664.216	8.000	110.000
1337	P2076	184.828	8.000	110.000
1338	P2078	552.424	8.000	110.000
1339	P2082	90.509	12.000	120.000
1340	P2084	521.675	12.000	120.000
1341	P2086	41.007	12.000	120.000
1342	P2088	64.281	12.000	120.000
1343	P2090	51.261	12.000	120.000
1344	P2092	265.969	12.000	100.000
1345	P2094	54.810	12.000	100.000
1346	P2096	569.809	8.000	110.000
1347	P2098	942.135	8.000	110.000
1348	P2100	400.451	8.000	110.000
1349	P2102	69.725	8.000	110.000
1350	P2104	22.453	12.000	120.000
1351	P2106	198.134	12.000	120.000
1352	P2108	62.095	12.000	120.000
1353	P2110	216.501	12.000	120.000
1354	P2112	415.598	12.000	120.000
1355	P2114	502.014	12.000	120.000
1356	P2116	157.416	12.000	120.000
1357	P2118	227.189	8.000	110.000
1358	P2120	351.997	8.000	110.000
1359	P2122	45.014	8.000	110.000
1360	P2124	34.553	8.000	110.000
1361	P2126	448.185	8.000	110.000
1362	P2128	260.950	8.000	110.000
1363	P2130	245.002	8.000	110.000
1364	P2132	102.803	8.000	110.000
1365	P2134	320.611	8.000	110.000
1366	P2136	567.562	8.000	110.000
1367	P2138	269.683	8.000	110.000
1368	P2140	561.393	8.000	110.000

DB Table - 'Pipe Modeling'

* BASE *		ID (Char)	Length (ft)	Diameter (in)	Roughness (Double)
1369	<input type="checkbox"/>	P2142	106.212	12.000	100.000
1370	<input type="checkbox"/>	P2144	102.865	12.000	100.000
1371	<input type="checkbox"/>	P2146	101.705	8.000	110.000
1372	<input type="checkbox"/>	P2148	178.597	8.000	110.000
1373	<input type="checkbox"/>	P2150	177.403	8.000	110.000
1374	<input type="checkbox"/>	P2152	181.542	8.000	110.000
1375	<input type="checkbox"/>	P2154	177.610	8.000	110.000
1376	<input type="checkbox"/>	P2156	369.002	8.000	110.000
1377	<input type="checkbox"/>	P2158	180.336	8.000	110.000
1378	<input type="checkbox"/>	P2160	181.154	8.000	110.000
1379	<input type="checkbox"/>	P2162	180.633	8.000	110.000
1380	<input type="checkbox"/>	P2164	182.591	8.000	110.000
1381	<input type="checkbox"/>	P2166	177.472	8.000	110.000
1382	<input type="checkbox"/>	P2168	166.698	8.000	110.000
1383	<input type="checkbox"/>	P2170	209.780	8.000	110.000
1384	<input type="checkbox"/>	P2172	220.369	8.000	110.000
1385	<input type="checkbox"/>	P2174	196.309	8.000	110.000
1386	<input type="checkbox"/>	P2176	83.595	6.000	110.000
1387	<input type="checkbox"/>	P2178	64.489	18.000	120.000
1388	<input type="checkbox"/>	P2180	5.632	30.000	130.000
1389	<input type="checkbox"/>	P2182	5.840	30.000	130.000
1390	<input type="checkbox"/>	P2184	11.396	24.000	125.000
1391	<input type="checkbox"/>	P2186	11.241	24.000	125.000
1392	<input type="checkbox"/>	P2188	15.859	24.000	125.000
1393	<input type="checkbox"/>	P2190	215.444	8.000	110.000
1394	<input type="checkbox"/>	P2194	176.931	8.000	110.000
1395	<input type="checkbox"/>	P2196	578.681	24.000	125.000
1396	<input type="checkbox"/>	P2198	114.398	8.000	110.000
1397	<input type="checkbox"/>	P2200	110.618	8.000	110.000
1398	<input type="checkbox"/>	P2202	140.310	12.000	100.000
1399	<input type="checkbox"/>	P2204	58.733	12.000	120.000
1400	<input type="checkbox"/>	P2206	57.412	12.000	100.000
1401	<input type="checkbox"/>	PRV-3_D	163.141	24.000	150.000
1402	<input type="checkbox"/>	PRV-3_U	163.141	24.000	150.000

DB Table - 'Pump Modeling'

* BASE *	ID (Char)	Type (Int)	Elevation (ft)	Constant Power (hp)
1	BB_FUTURE_PUMP_4_(ST	3: Multiple Point Curve	560.000	
2	BB_PMP1	0: Constant Power Input	560.000	150.000
3	BB_PMP2	0: Constant Power Input	560.000	150.000
4	BB_PMP3	0: Constant Power Input	560.000	155.000
5	CC_PMP_3-MZ	0: Constant Power Input	533.500	100.000
6	CC_PMP_4-HZ1	0: Constant Power Input	533.500	110.000
7	CC_PMP_5-HZ1	0: Constant Power Input	533.500	110.000
8	CC_PMP_6-HZ1	0: Constant Power Input	533.500	230.000
9	CC_PMP_7-HZ2	0: Constant Power Input	533.500	260.000
10	CC_PMP_8-HZ2	0: Constant Power Input	533.500	260.000
11	CC_PMP_9-HZ2_(STBY)	0: Constant Power Input	530.500	260.000
12	DC_PMP1	0: Constant Power Input	474.570	40.000
13	DC_PMP2	3: Multiple Point Curve	474.570	275.000
14	DC_PMP3	3: Multiple Point Curve	474.500	200.000
15	DC_PMP4	3: Multiple Point Curve	474.500	200.000
16	DC_PMP5	3: Multiple Point Curve	474.500	200.000
17	DC_PMP6	3: Multiple Point Curve	474.500	200.000
18	DC_PMP7	3: Multiple Point Curve	474.570	275.000
19	DC_PMP8_STBY	3: Multiple Point Curve	474.570	400.000
20	GOLDEN_BEAR_PMP-1	3: Multiple Point Curve	623.000	10.000
21	GOLDEN_BEAR_PMP-2_(S	3: Multiple Point Curve	623.000	8.000
22	MN_PMP1	3: Multiple Point Curve	637.500	75.000
23	MN_PMP2	3: Multiple Point Curve	637.500	75.000
24	MN_PMP3	3: Multiple Point Curve	637.500	75.000
25	MN_PMP_FUTURE	3: Multiple Point Curve	637.500	75.000

DB Table - 'Tank Modeling'

* BASE *		ID (Char)	Type (Int)
1	<input type="checkbox"/>	BB_GSR	0: Cylindrical
2	<input type="checkbox"/>	CC_GSR	0: Cylindrical
3	<input type="checkbox"/>	DC_GSR	0: Cylindrical
4	<input type="checkbox"/>	GB_PNEUMATIC_TANK	0: Cylindrical
5	<input type="checkbox"/>	HEBRON_3MG_EST	1: Variable Area
6	<input type="checkbox"/>	HUTTON_2MG_EST	1: Variable Area
7	<input type="checkbox"/>	JOSEY_2MG_EST	0: Cylindrical
8	<input type="checkbox"/>	MARSH_NORTH_3MG_EST	1: Variable Area
9	<input type="checkbox"/>	MARSH_SOUTH_2MG_EST	1: Variable Area



DB Table - 'Tank Modeling'

* BASE *		ID (Char)	Elevation (ft)	Minimum Level (ft)
1	<input type="checkbox"/>	BB_GSR	540.250	0.000
2	<input type="checkbox"/>	CC_GSR	530.000	0.000
3	<input type="checkbox"/>	DC_GSR	458.000	0.000
4	<input type="checkbox"/>	GB_PNEUMATIC_TANK	756.000	0.000
5	<input type="checkbox"/>	HEBRON_3MG_EST	659.000	0.000
6	<input type="checkbox"/>	HUTTON_2MG_EST	600.000	0.000
7	<input type="checkbox"/>	JOSEY_2MG_EST	659.000	0.000
8	<input type="checkbox"/>	MARSH_NORTH_3MG_EST	730.000	0.000
9	<input type="checkbox"/>	MARSH_SOUTH_2MG_EST	730.000	0.000

DB Table - 'Tank Modeling'

* BASE *		ID (Char)	Maximum Level (ft)	Initial Level (ft)
1	<input type="checkbox"/>	BB_GSR	42.000	29.000
2	<input type="checkbox"/>	CC_GSR	62.000	40.000
3	<input type="checkbox"/>	DC_GSR	23.000	16.000
4	<input type="checkbox"/>	GB_PNEUMATIC_TANK	9.000	6.000
5	<input type="checkbox"/>	HEBRON_3MG_EST	40.000	10.000
6	<input type="checkbox"/>	HUTTON_2MG_EST	40.000	10.000
7	<input type="checkbox"/>	JOSEY_2MG_EST	40.000	15.000
8	<input type="checkbox"/>	MARSH_NORTH_3MG_EST	40.000	20.000
9	<input type="checkbox"/>	MARSH_SOUTH_2MG_EST	40.000	25.000



## **2022 WATER DISTRIBUTION STUDY**

### **OUTPUT DATA**

- *JUNCTION NODE RESULTS*
  - *PIPE RESULTS*

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
1	<input type="checkbox"/>	J-1000	88.742	67:00	82.241	32:00	85.996	6.500
2	<input type="checkbox"/>	J-1001	43.228	16:00	41.472	31:00	42.678	1.757
3	<input type="checkbox"/>	J-1002	43.228	16:00	41.467	31:00	42.676	1.761
4	<input type="checkbox"/>	J-1003	56.206	16:00	54.515	31:00	55.685	1.691
5	<input type="checkbox"/>	J-1004	57.253	67:00	50.635	31:00	54.270	6.617
6	<input type="checkbox"/>	J-1005	53.143	67:00	47.489	32:00	50.743	5.653
7	<input type="checkbox"/>	J-1006	47.511	67:00	41.583	32:00	44.943	5.928
8	<input type="checkbox"/>	J-1007	43.228	16:00	41.467	31:00	42.676	1.761
9	<input type="checkbox"/>	J-1008	80.627	35:00	71.340	30:00	77.108	9.287
10	<input type="checkbox"/>	J-1009	53.150	67:00	47.447	32:00	50.724	5.703
11	<input type="checkbox"/>	J-101	70.595	16:00	68.491	30:00	69.397	2.104
12	<input type="checkbox"/>	J-1010	54.039	16:00	52.278	31:00	53.486	1.761
13	<input type="checkbox"/>	J-1011	44.525	16:00	42.763	31:00	43.972	1.762
14	<input type="checkbox"/>	J-1012	67.784	61:00	59.374	31:00	64.089	8.410
15	<input type="checkbox"/>	J-1013	81.802	16:00	60.999	30:00	73.137	20.803
16	<input type="checkbox"/>	J-1014	83.964	16:00	63.165	30:00	75.300	20.799
17	<input type="checkbox"/>	J-1015	99.675	61:00	90.765	45:00	94.661	8.911
18	<input type="checkbox"/>	J-1016	101.929	61:00	93.649	31:00	98.333	8.280
19	<input type="checkbox"/>	J-1017	69.265	16:00	48.498	30:00	60.611	20.767
20	<input type="checkbox"/>	J-1018	73.175	16:00	52.518	30:00	64.573	20.658
21	<input type="checkbox"/>	J-1019	70.276	16:00	69.410	30:00	69.543	0.866
22	<input type="checkbox"/>	J-102	72.330	65:00	67.382	31:00	70.321	4.948
23	<input type="checkbox"/>	J-1020	100.154	33:00	90.618	00:00	94.536	9.536
24	<input type="checkbox"/>	J-1021	101.028	33:00	91.484	00:00	95.403	9.544
25	<input type="checkbox"/>	J-1022	69.827	16:00	68.547	30:00	69.037	1.280
26	<input type="checkbox"/>	J-1023	92.099	65:00	88.116	31:00	90.556	3.983
27	<input type="checkbox"/>	J-1024	89.916	65:00	85.522	31:00	88.150	4.394
28	<input type="checkbox"/>	J-1025	92.074	65:00	87.520	30:00	90.253	4.554
29	<input type="checkbox"/>	J-1026	89.912	65:00	85.361	30:00	88.092	4.551
30	<input type="checkbox"/>	J-1027	85.590	65:00	81.149	30:00	83.808	4.441
31	<input type="checkbox"/>	J-1028	87.753	65:00	83.326	30:00	85.975	4.427
32	<input type="checkbox"/>	J-1029	70.440	65:00	65.505	30:00	68.490	4.935
33	<input type="checkbox"/>	J-103	59.357	65:00	54.381	31:00	57.333	4.975
34	<input type="checkbox"/>	J-1030	88.108	66:00	80.182	32:00	84.787	7.927
35	<input type="checkbox"/>	J-1031	92.861	66:00	84.933	32:00	89.539	7.928
36	<input type="checkbox"/>	J-1032	97.183	66:00	89.255	32:00	93.861	7.929
37	<input type="checkbox"/>	J-1033	99.772	66:00	91.843	32:00	96.449	7.929
38	<input type="checkbox"/>	J-1034	97.178	66:00	89.249	32:00	93.855	7.929
39	<input type="checkbox"/>	J-1035	55.463	17:00	51.579	31:00	54.002	3.884
40	<input type="checkbox"/>	J-1036	88.542	66:00	80.616	32:00	85.221	7.926
41	<input type="checkbox"/>	J-1037	88.553	66:00	80.632	32:00	85.235	7.921
42	<input type="checkbox"/>	J-1038	88.547	66:00	80.622	32:00	85.227	7.925
43	<input type="checkbox"/>	J-1039	88.108	66:00	80.182	32:00	84.787	7.927
44	<input type="checkbox"/>	J-1041	86.342	66:00	78.379	32:00	82.995	7.963
45	<input type="checkbox"/>	J-1043	69.823	16:00	64.533	30:00	67.556	5.290
46	<input type="checkbox"/>	J-1044	92.632	16:00	75.478	30:00	85.541	17.154
47	<input type="checkbox"/>	J-1045	72.994	16:00	53.883	30:00	65.073	19.110
48	<input type="checkbox"/>	J-1046	92.447	16:00	73.382	30:00	84.549	19.066
49	<input type="checkbox"/>	J-1047	59.322	65:00	52.585	30:00	56.660	6.737
50	<input type="checkbox"/>	J-116	89.100	16:00	77.017	00:00	84.727	12.083

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
51	<input type="checkbox"/>	J-121	54.806	67:00	46.912	32:00	51.372	7.895
52	<input type="checkbox"/>	J-122	55.007	67:00	47.099	32:00	51.564	7.908
53	<input type="checkbox"/>	J-125	89.005	16:00	77.013	00:00	84.620	11.992
54	<input type="checkbox"/>	J-127	49.091	67:00	41.205	32:00	45.662	7.886
55	<input type="checkbox"/>	J-128	55.008	67:00	47.105	32:00	51.570	7.902
56	<input type="checkbox"/>	J-129	97.446	16:00	84.685	00:00	92.110	12.761
57	<input type="checkbox"/>	J-130	100.010	33:00	91.282	69:00	95.228	8.727
58	<input type="checkbox"/>	J-131	101.886	33:00	92.771	00:00	96.593	9.115
59	<input type="checkbox"/>	J-132	97.104	66:00	88.894	31:00	93.641	8.210
60	<input type="checkbox"/>	J-133	104.928	66:00	96.920	32:00	101.550	8.007
61	<input type="checkbox"/>	J-134	100.200	66:00	92.261	32:00	96.870	7.939
62	<input type="checkbox"/>	J-137	95.806	66:00	87.618	31:00	92.351	8.188
63	<input type="checkbox"/>	J-138	73.304	16:00	72.238	30:00	72.540	1.067
64	<input type="checkbox"/>	J-139	107.937	66:00	99.854	31:00	104.524	8.083
65	<input type="checkbox"/>	J-140	64.149	67:00	56.502	32:00	60.874	7.647
66	<input type="checkbox"/>	J-141	70.794	67:00	63.003	32:00	67.530	7.791
67	<input type="checkbox"/>	J-142	53.406	67:00	45.691	32:00	50.137	7.715
68	<input type="checkbox"/>	J-143	57.692	67:00	50.015	32:00	54.420	7.677
69	<input type="checkbox"/>	J-144	68.521	67:00	60.825	32:00	65.252	7.696
70	<input type="checkbox"/>	J-145	79.236	67:00	71.615	32:00	75.972	7.622
71	<input type="checkbox"/>	J-146	64.107	67:00	56.479	32:00	60.839	7.628
72	<input type="checkbox"/>	J-147	61.944	67:00	54.314	32:00	58.675	7.630
73	<input type="checkbox"/>	J-148	81.409	67:00	73.785	32:00	78.156	7.624
74	<input type="checkbox"/>	J-149	87.019	67:00	79.417	32:00	83.770	7.602
75	<input type="checkbox"/>	J-150	86.262	16:00	74.887	00:00	82.000	11.376
76	<input type="checkbox"/>	J-151	56.426	65:00	52.023	31:00	54.702	4.404
77	<input type="checkbox"/>	J-152	56.436	65:00	52.052	31:00	54.719	4.383
78	<input type="checkbox"/>	J-153	109.283	66:00	100.522	31:00	105.556	8.761
79	<input type="checkbox"/>	J-154	70.233	65:00	65.395	31:00	68.288	4.838
80	<input type="checkbox"/>	J-155	102.798	66:00	94.047	31:00	99.075	8.750
81	<input type="checkbox"/>	J-156	59.340	65:00	53.769	30:00	57.066	5.571
82	<input type="checkbox"/>	J-157	54.994	65:00	48.288	30:00	52.343	6.706
83	<input type="checkbox"/>	J-158	53.697	65:00	46.988	30:00	51.045	6.708
84	<input type="checkbox"/>	J-159	91.338	67:00	85.551	32:00	88.916	5.787
85	<input type="checkbox"/>	J-160	59.319	65:00	52.583	30:00	56.658	6.737
86	<input type="checkbox"/>	J-161	74.552	65:00	69.646	31:00	72.578	4.905
87	<input type="checkbox"/>	J-162	59.319	65:00	52.583	30:00	56.658	6.736
88	<input type="checkbox"/>	J-163	59.332	65:00	52.754	30:00	56.726	6.578
89	<input type="checkbox"/>	J-164	55.038	65:00	49.340	30:00	52.732	5.698
90	<input type="checkbox"/>	J-165	97.823	67:00	91.322	32:00	95.077	6.501
91	<input type="checkbox"/>	J-200	69.909	16:00	68.343	30:00	69.004	1.565
92	<input type="checkbox"/>	J-2001	59.242	16:00	57.660	22:00	58.780	1.582
93	<input type="checkbox"/>	J-2002	58.266	67:00	50.581	32:00	54.565	7.685
94	<input type="checkbox"/>	J-2003	57.076	16:00	55.462	22:00	56.590	1.614
95	<input type="checkbox"/>	J-201	69.909	16:00	68.344	30:00	69.004	1.565
96	<input type="checkbox"/>	J-2019	87.794	61:00	78.571	31:00	83.218	9.223
97	<input type="checkbox"/>	J-202	74.233	16:00	72.670	30:00	73.329	1.563
98	<input type="checkbox"/>	J-2020	87.167	61:00	77.996	31:00	82.736	9.171
99	<input type="checkbox"/>	J-2021	71.197	61:00	62.307	31:00	67.051	8.891
100	<input type="checkbox"/>	J-2022	77.319	61:00	68.595	31:00	73.317	8.724

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
101	<input type="checkbox"/>	J-203	75.530	16:00	73.965	30:00	74.625	1.565
102	<input type="checkbox"/>	J-204	76.395	16:00	74.830	30:00	75.490	1.565
103	<input type="checkbox"/>	J-205	81.151	33:00	76.057	00:00	78.487	5.094
104	<input type="checkbox"/>	J-207	76.395	16:00	74.847	30:00	75.496	1.548
105	<input type="checkbox"/>	J-208	76.396	16:00	74.852	30:00	75.498	1.544
106	<input type="checkbox"/>	J-209	77.696	16:00	76.178	30:00	76.807	1.518
107	<input type="checkbox"/>	J-210	77.692	16:00	76.176	30:00	76.804	1.515
108	<input type="checkbox"/>	J-211	77.715	16:00	76.186	30:00	76.817	1.529
109	<input type="checkbox"/>	J-212	76.427	16:00	74.890	30:00	75.522	1.537
110	<input type="checkbox"/>	J-213	76.429	16:00	74.890	30:00	75.523	1.540
111	<input type="checkbox"/>	J-214	77.730	16:00	76.192	30:00	76.824	1.538
112	<input type="checkbox"/>	J-215	76.382	16:00	74.925	30:00	75.518	1.457
113	<input type="checkbox"/>	J-216	76.397	16:00	74.917	30:00	75.521	1.480
114	<input type="checkbox"/>	J-217	76.422	16:00	74.915	30:00	75.531	1.508
115	<input type="checkbox"/>	J-218	76.441	16:00	74.915	30:00	75.539	1.527
116	<input type="checkbox"/>	J-219	75.498	16:00	74.084	30:00	74.653	1.414
117	<input type="checkbox"/>	J-220	76.355	16:00	74.959	30:00	75.518	1.396
118	<input type="checkbox"/>	J-221	76.350	16:00	74.959	30:00	75.520	1.391
119	<input type="checkbox"/>	J-222	76.350	16:00	74.958	30:00	75.524	1.392
120	<input type="checkbox"/>	J-223	76.349	16:00	74.963	30:00	75.521	1.386
121	<input type="checkbox"/>	J-224	76.350	16:00	74.961	30:00	75.520	1.389
122	<input type="checkbox"/>	J-225	76.351	16:00	74.970	30:00	75.519	1.380
123	<input type="checkbox"/>	J-226	76.346	16:00	74.982	30:00	75.519	1.364
124	<input type="checkbox"/>	J-227	76.422	16:00	74.920	30:00	75.535	1.502
125	<input type="checkbox"/>	J-228	76.353	16:00	74.960	30:00	75.517	1.394
126	<input type="checkbox"/>	J-229	76.348	16:00	74.975	30:00	75.518	1.373
127	<input type="checkbox"/>	J-230	76.005	16:00	74.490	30:00	75.113	1.515
128	<input type="checkbox"/>	J-231	76.130	16:00	74.485	30:00	75.158	1.645
129	<input type="checkbox"/>	J-232	76.152	16:00	74.485	30:00	75.166	1.666
130	<input type="checkbox"/>	J-233	76.198	16:00	74.486	30:00	75.188	1.712
131	<input type="checkbox"/>	J-234	76.145	16:00	74.484	30:00	75.162	1.662
132	<input type="checkbox"/>	J-235	76.182	16:00	74.484	30:00	75.178	1.698
133	<input type="checkbox"/>	J-236	76.117	16:00	74.484	30:00	75.151	1.633
134	<input type="checkbox"/>	J-237	76.140	16:00	74.485	30:00	75.162	1.655
135	<input type="checkbox"/>	J-238	74.233	16:00	72.774	30:00	73.371	1.459
136	<input type="checkbox"/>	J-239	76.348	16:00	74.956	30:00	75.528	1.392
137	<input type="checkbox"/>	J-240	71.949	16:00	70.699	30:00	71.198	1.250
138	<input type="checkbox"/>	J-241	69.827	16:00	68.538	30:00	69.037	1.289
139	<input type="checkbox"/>	J-243	69.806	16:00	68.538	30:00	69.035	1.268
140	<input type="checkbox"/>	J-244	72.011	16:00	70.705	30:00	71.197	1.306
141	<input type="checkbox"/>	J-245	74.661	16:00	72.773	30:00	73.562	1.888
142	<input type="checkbox"/>	J-246	75.750	16:00	74.051	30:00	74.745	1.698
143	<input type="checkbox"/>	J-248	64.132	16:00	44.094	30:00	55.793	20.039
144	<input type="checkbox"/>	J-250	68.991	16:00	48.986	30:00	60.694	20.005
145	<input type="checkbox"/>	J-252	57.328	16:00	37.848	30:00	49.236	19.480
146	<input type="checkbox"/>	J-253	92.532	59:00	87.440	31:00	90.351	5.092
147	<input type="checkbox"/>	J-254	89.756	67:00	84.080	31:00	87.436	5.676
148	<input type="checkbox"/>	J-255	87.495	67:00	81.464	31:00	84.976	6.031
149	<input type="checkbox"/>	J-256	76.641	67:00	70.442	31:00	74.011	6.198
150	<input type="checkbox"/>	J-257	82.277	67:00	76.141	31:00	79.696	6.136

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
151	<input type="checkbox"/>	J-258	84.011	67:00	77.891	31:00	81.440	6.120
152	<input type="checkbox"/>	J-259	58.486	67:00	52.100	31:00	55.668	6.386
153	<input type="checkbox"/>	J-260	55.034	67:00	48.633	31:00	52.202	6.401
154	<input type="checkbox"/>	J-262	57.237	67:00	50.779	31:00	54.362	6.458
155	<input type="checkbox"/>	J-263	68.922	67:00	62.593	31:00	66.101	6.329
156	<input type="checkbox"/>	J-264	70.211	67:00	63.620	31:00	67.248	6.591
157	<input type="checkbox"/>	J-264B	58.105	67:00	51.509	31:00	55.139	6.596
158	<input type="checkbox"/>	J-265	65.957	67:00	59.247	31:00	62.879	6.710
159	<input type="checkbox"/>	J-266	74.678	67:00	68.951	32:00	72.214	5.727
160	<input type="checkbox"/>	J-267	84.547	67:00	78.462	32:00	81.849	6.085
161	<input type="checkbox"/>	J-268	75.753	67:00	69.458	31:00	73.048	6.295
162	<input type="checkbox"/>	J-269	89.568	67:00	83.331	31:00	86.881	6.236
163	<input type="checkbox"/>	J-270	77.605	67:00	71.811	32:00	75.094	5.795
164	<input type="checkbox"/>	J-271	74.695	67:00	69.067	32:00	72.294	5.628
165	<input type="checkbox"/>	J-272	54.043	16:00	52.342	31:00	53.518	1.701
166	<input type="checkbox"/>	J-272B	54.908	16:00	53.208	31:00	54.383	1.700
167	<input type="checkbox"/>	J-273	43.228	16:00	41.457	31:00	42.671	1.771
168	<input type="checkbox"/>	J-274	45.389	16:00	43.609	31:00	44.828	1.780
169	<input type="checkbox"/>	J-275	40.200	16:00	38.423	31:00	39.640	1.777
170	<input type="checkbox"/>	J-276	41.065	16:00	39.286	31:00	40.504	1.779
171	<input type="checkbox"/>	J-277	39.768	16:00	38.001	31:00	39.213	1.767
172	<input type="checkbox"/>	J-279	54.041	16:00	52.310	31:00	53.502	1.731
173	<input type="checkbox"/>	J-280	56.126	67:00	49.213	32:00	52.920	6.913
174	<input type="checkbox"/>	J-284A	60.842	67:00	53.328	32:00	57.249	7.514
175	<input type="checkbox"/>	J-284B	58.372	16:00	56.745	31:00	57.880	1.628
176	<input type="checkbox"/>	J-284C	61.700	67:00	54.249	32:00	58.146	7.452
177	<input type="checkbox"/>	J-284D	61.834	16:00	60.235	22:00	61.360	1.599
178	<input type="checkbox"/>	J-285	57.480	67:00	51.817	32:00	55.079	5.663
179	<input type="checkbox"/>	J-286	69.909	16:00	68.449	30:00	69.047	1.460
180	<input type="checkbox"/>	J-287	70.265	16:00	69.013	30:00	69.468	1.252
181	<input type="checkbox"/>	J-289	61.145	16:00	41.805	30:00	53.104	19.340
182	<input type="checkbox"/>	J-290	68.242	16:00	50.269	30:00	60.807	17.973
183	<input type="checkbox"/>	J-291	69.636	16:00	60.260	30:00	65.846	9.376
184	<input type="checkbox"/>	J-293	64.728	16:00	45.845	30:00	56.901	18.882
185	<input type="checkbox"/>	J-294	57.759	16:00	38.346	30:00	49.686	19.413
186	<input type="checkbox"/>	J-295	57.341	16:00	37.963	30:00	49.298	19.378
187	<input type="checkbox"/>	J-296	56.928	16:00	37.794	30:00	48.993	19.134
188	<input type="checkbox"/>	J-297	54.766	16:00	35.633	30:00	46.832	19.133
189	<input type="checkbox"/>	J-298	56.478	16:00	37.107	30:00	48.439	19.371
190	<input type="checkbox"/>	J-300	101.456	59:00	95.587	04:00	98.688	5.869
191	<input type="checkbox"/>	J-301	93.082	16:00	78.967	30:00	87.350	14.115
192	<input type="checkbox"/>	J-302	70.276	16:00	69.200	30:00	69.509	1.077
193	<input type="checkbox"/>	J-303	71.141	16:00	70.064	30:00	70.374	1.077
194	<input type="checkbox"/>	J-305	72.006	16:00	70.888	30:00	71.226	1.118
195	<input type="checkbox"/>	J-306	69.842	16:00	68.722	30:00	69.020	1.120
196	<input type="checkbox"/>	J-308	57.250	65:00	52.258	31:00	55.227	4.992
197	<input type="checkbox"/>	J-309	70.235	65:00	65.425	31:00	68.305	4.810
198	<input type="checkbox"/>	J-310	59.436	65:00	54.799	31:00	57.594	4.636
199	<input type="checkbox"/>	J-311	61.180	65:00	56.779	31:00	59.461	4.402
200	<input type="checkbox"/>	J-312	78.121	65:00	73.903	31:00	76.443	4.218

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
201	<input type="checkbox"/>	J-314	61.749	65:00	57.770	31:00	60.153	3.979
202	<input type="checkbox"/>	J-315	61.749	65:00	57.756	31:00	60.146	3.993
203	<input type="checkbox"/>	J-316	57.427	65:00	53.439	31:00	55.828	3.988
204	<input type="checkbox"/>	J-317	66.494	33:00	62.486	30:00	64.677	4.009
205	<input type="checkbox"/>	J-318	66.039	33:00	60.017	00:00	62.805	6.021
206	<input type="checkbox"/>	J-319	83.552	33:00	79.370	30:00	81.794	4.182
207	<input type="checkbox"/>	J-320	83.545	33:00	79.405	30:00	81.805	4.140
208	<input type="checkbox"/>	J-321	57.790	33:00	53.999	31:00	55.640	3.791
209	<input type="checkbox"/>	J-322	62.477	66:00	58.188	31:00	60.880	4.290
210	<input type="checkbox"/>	J-323	61.610	65:00	57.244	31:00	59.933	4.366
211	<input type="checkbox"/>	J-324	65.096	33:00	59.911	00:00	62.285	5.185
212	<input type="checkbox"/>	J-325	91.321	33:00	85.683	30:00	88.426	5.638
213	<input type="checkbox"/>	J-326	96.508	33:00	89.983	30:00	93.324	6.525
214	<input type="checkbox"/>	J-327	97.718	33:00	88.750	30:00	93.761	8.968
215	<input type="checkbox"/>	J-328	98.151	33:00	88.533	30:00	93.984	9.618
216	<input type="checkbox"/>	J-329	99.918	33:00	90.007	30:00	95.638	9.911
217	<input type="checkbox"/>	J-33	58.876	16:00	39.777	30:00	50.957	19.099
218	<input type="checkbox"/>	J-330	96.592	33:00	86.687	30:00	92.241	9.906
219	<input type="checkbox"/>	J-331	99.983	33:00	91.263	69:00	95.211	8.721
220	<input type="checkbox"/>	J-332	102.348	33:00	93.232	00:00	97.066	9.115
221	<input type="checkbox"/>	J-333	101.062	33:00	92.098	00:00	95.930	8.965
222	<input type="checkbox"/>	J-334	80.891	33:00	71.564	00:00	75.692	9.327
223	<input type="checkbox"/>	J-335	99.641	33:00	90.811	00:00	94.619	8.830
224	<input type="checkbox"/>	J-336	96.509	33:00	87.797	00:00	91.582	8.713
225	<input type="checkbox"/>	J-337	83.028	33:00	74.669	00:00	78.413	8.359
226	<input type="checkbox"/>	J-338	90.536	33:00	82.221	00:00	85.865	8.315
227	<input type="checkbox"/>	J-339	94.710	33:00	86.402	00:00	89.996	8.308
228	<input type="checkbox"/>	J-341	99.268	33:00	90.631	69:00	94.600	8.637
229	<input type="checkbox"/>	J-342	98.843	33:00	90.205	69:00	94.177	8.639
230	<input type="checkbox"/>	J-343	93.083	33:00	84.424	00:00	88.213	8.659
231	<input type="checkbox"/>	J-344	80.389	33:00	71.564	00:00	75.480	8.825
232	<input type="checkbox"/>	J-345	93.862	33:00	85.292	00:00	89.062	8.570
233	<input type="checkbox"/>	J-346	88.822	33:00	80.226	00:00	84.061	8.596
234	<input type="checkbox"/>	J-347	93.553	33:00	87.367	30:00	90.448	6.186
235	<input type="checkbox"/>	J-348	93.630	33:00	87.190	69:00	90.408	6.440
236	<input type="checkbox"/>	J-349	94.579	33:00	87.966	69:00	91.266	6.613
237	<input type="checkbox"/>	J-350	93.844	33:00	87.068	69:00	90.414	6.776
238	<input type="checkbox"/>	J-351	96.212	33:00	89.232	69:00	92.629	6.980
239	<input type="checkbox"/>	J-352	99.363	33:00	91.216	69:00	94.839	8.147
240	<input type="checkbox"/>	J-353	98.069	33:00	91.102	69:00	94.601	6.967
241	<input type="checkbox"/>	J-354	97.204	33:00	90.416	69:00	93.800	6.788
242	<input type="checkbox"/>	J-355	97.160	33:00	90.523	69:00	93.825	6.636
243	<input type="checkbox"/>	J-356	97.089	33:00	90.559	30:00	93.828	6.530
244	<input type="checkbox"/>	J-357	96.582	33:00	90.122	30:00	93.386	6.460
245	<input type="checkbox"/>	J-358	97.427	33:00	89.196	30:00	93.642	8.231
246	<input type="checkbox"/>	J-359	94.374	33:00	85.980	30:00	90.549	8.393
247	<input type="checkbox"/>	J-361	96.075	33:00	87.496	30:00	92.203	8.579
248	<input type="checkbox"/>	J-362	97.369	33:00	88.791	30:00	93.499	8.578
249	<input type="checkbox"/>	J-363	94.159	33:00	83.309	30:00	89.633	10.850
250	<input type="checkbox"/>	J-364	69.364	33:00	64.839	30:00	67.018	4.525



Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
251	<input type="checkbox"/>	J-365	92.992	33:00	88.175	30:00	90.613	4.817
252	<input type="checkbox"/>	J-366	84.345	33:00	79.573	30:00	81.980	4.772
253	<input type="checkbox"/>	J-367	77.864	33:00	72.976	30:00	75.460	4.888
254	<input type="checkbox"/>	J-368	69.353	33:00	65.065	31:00	67.098	4.288
255	<input type="checkbox"/>	J-369	62.165	33:00	58.336	31:00	60.510	3.829
256	<input type="checkbox"/>	J-370	70.685	33:00	66.736	31:00	69.019	3.949
257	<input type="checkbox"/>	J-372	93.389	65:00	89.264	31:00	91.768	4.125
258	<input type="checkbox"/>	J-373	95.972	65:00	91.487	30:00	94.181	4.485
259	<input type="checkbox"/>	J-374	95.106	65:00	90.569	30:00	93.299	4.537
260	<input type="checkbox"/>	J-375	95.968	65:00	91.412	30:00	94.150	4.556
261	<input type="checkbox"/>	J-380	92.074	65:00	87.519	30:00	90.254	4.556
262	<input type="checkbox"/>	J-381	74.775	65:00	70.161	30:00	72.935	4.614
263	<input type="checkbox"/>	J-383	69.586	65:00	64.972	30:00	67.745	4.614
264	<input type="checkbox"/>	J-384	95.110	65:00	90.809	31:00	93.391	4.302
265	<input type="checkbox"/>	J-386	98.971	66:00	90.766	31:00	95.485	8.205
266	<input type="checkbox"/>	J-387	92.183	66:00	84.061	31:00	88.719	8.122
267	<input type="checkbox"/>	J-390	93.300	66:00	84.612	31:00	89.602	8.688
268	<input type="checkbox"/>	J-391	100.632	66:00	91.845	31:00	96.895	8.787
269	<input type="checkbox"/>	J-392	65.938	65:00	61.533	31:00	64.214	4.405
270	<input type="checkbox"/>	J-393	62.911	65:00	58.507	31:00	61.187	4.404
271	<input type="checkbox"/>	J-394	93.294	66:00	84.601	31:00	89.594	8.692
272	<input type="checkbox"/>	J-397	96.310	66:00	87.550	31:00	92.583	8.760
273	<input type="checkbox"/>	J-400	57.258	65:00	52.474	31:00	55.364	4.784
274	<input type="checkbox"/>	J-402	87.623	33:00	80.211	00:00	83.432	7.412
275	<input type="checkbox"/>	J-403	91.500	33:00	83.838	00:00	87.161	7.661
276	<input type="checkbox"/>	J-404	97.884	33:00	90.166	69:00	93.481	7.718
277	<input type="checkbox"/>	J-406	46.688	16:00	44.932	31:00	46.138	1.756
278	<input type="checkbox"/>	J-407	69.841	16:00	67.187	30:00	68.541	2.654
279	<input type="checkbox"/>	J-408	69.839	16:00	66.989	30:00	68.469	2.850
280	<input type="checkbox"/>	J-409	74.155	16:00	69.823	30:00	72.249	4.332
281	<input type="checkbox"/>	J-413	57.157	65:00	50.473	30:00	54.513	6.683
282	<input type="checkbox"/>	J-418	96.840	66:00	88.618	31:00	93.346	8.222
283	<input type="checkbox"/>	J-419	88.198	66:00	79.979	31:00	84.703	8.219
284	<input type="checkbox"/>	J-420	83.885	66:00	75.687	31:00	80.396	8.197
285	<input type="checkbox"/>	J-421	83.887	66:00	75.706	31:00	80.404	8.181
286	<input type="checkbox"/>	J-422	92.535	66:00	84.341	31:00	89.046	8.194
287	<input type="checkbox"/>	J-423	79.680	66:00	71.655	32:00	76.283	8.025
288	<input type="checkbox"/>	J-424	79.772	66:00	71.846	32:00	76.456	7.925
289	<input type="checkbox"/>	J-431	83.030	61:00	74.976	31:00	79.471	8.055
290	<input type="checkbox"/>	J-433	82.977	61:00	74.925	31:00	79.430	8.053
291	<input type="checkbox"/>	J-435	83.656	61:00	75.447	31:00	79.906	8.209
292	<input type="checkbox"/>	J-439	75.413	66:00	67.488	32:00	72.085	7.925
293	<input type="checkbox"/>	J-441	75.400	66:00	67.488	32:00	72.089	7.912
294	<input type="checkbox"/>	J-442	91.963	16:00	80.034	00:00	87.553	11.929
295	<input type="checkbox"/>	J-443	90.420	16:00	79.203	00:00	86.158	11.217
296	<input type="checkbox"/>	J-444	79.896	16:00	69.301	00:00	75.788	10.595
297	<input type="checkbox"/>	J-445	68.185	65:00	58.627	00:00	64.418	9.558
298	<input type="checkbox"/>	J-446	82.203	16:00	71.446	00:00	78.056	10.757
299	<input type="checkbox"/>	J-447	81.233	16:00	70.599	00:00	77.129	10.633
300	<input type="checkbox"/>	J-449	79.806	66:00	71.960	32:00	76.535	7.846

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
301	<input type="checkbox"/>	J-450	83.315	66:00	75.497	32:00	80.059	7.818
302	<input type="checkbox"/>	J-451	68.340	17:00	64.249	31:00	66.807	4.091
303	<input type="checkbox"/>	J-452	60.988	17:00	56.898	31:00	59.456	4.090
304	<input type="checkbox"/>	J-454	54.913	33:00	50.532	00:00	52.368	4.381
305	<input type="checkbox"/>	J-455	77.310	33:00	72.121	00:00	74.361	5.189
306	<input type="checkbox"/>	J-458	64.364	33:00	59.206	00:00	61.446	5.158
307	<input type="checkbox"/>	J-459	64.345	33:00	59.323	00:00	61.457	5.023
308	<input type="checkbox"/>	J-46	103.007	59:00	97.118	04:00	100.232	5.889
309	<input type="checkbox"/>	J-460	66.061	16:00	47.707	30:00	58.466	18.353
310	<input type="checkbox"/>	J-461	61.719	16:00	42.882	30:00	53.926	18.836
311	<input type="checkbox"/>	J-464	73.960	16:00	64.254	30:00	70.051	9.706
312	<input type="checkbox"/>	J-465	73.960	16:00	64.344	30:00	70.084	9.616
313	<input type="checkbox"/>	J-466	75.930	16:00	74.515	30:00	75.085	1.415
314	<input type="checkbox"/>	J-467	71.870	66:00	70.693	30:00	71.201	1.177
315	<input type="checkbox"/>	J-469	71.138	16:00	69.935	30:00	70.339	1.203
316	<input type="checkbox"/>	J-470	94.222	16:00	79.117	30:00	88.046	15.105
317	<input type="checkbox"/>	J-471	95.041	16:00	79.657	30:00	88.738	15.384
318	<input type="checkbox"/>	J-472	94.863	16:00	78.401	30:00	88.069	16.462
319	<input type="checkbox"/>	J-473	94.357	16:00	77.330	30:00	87.308	17.027
320	<input type="checkbox"/>	J-474	76.661	65:00	71.888	31:00	74.745	4.773
321	<input type="checkbox"/>	J-475	74.499	65:00	69.726	31:00	72.583	4.773
322	<input type="checkbox"/>	J-476	78.824	65:00	74.068	31:00	76.917	4.756
323	<input type="checkbox"/>	J-478	70.178	65:00	65.481	31:00	68.303	4.697
324	<input type="checkbox"/>	J-479	48.789	67:00	42.358	32:00	45.891	6.431
325	<input type="checkbox"/>	J-480	58.758	67:00	53.111	32:00	56.360	5.647
326	<input type="checkbox"/>	J-481	70.197	65:00	65.452	31:00	68.317	4.746
327	<input type="checkbox"/>	J-482	65.873	65:00	61.124	31:00	63.991	4.749
328	<input type="checkbox"/>	J-483	74.571	65:00	70.420	31:00	73.017	4.151
329	<input type="checkbox"/>	J-485	55.158	16:00	35.170	30:00	46.871	19.989
330	<input type="checkbox"/>	J-487	58.184	16:00	38.175	30:00	49.888	20.009
331	<input type="checkbox"/>	J-488	57.751	16:00	37.741	30:00	49.454	20.010
332	<input type="checkbox"/>	J-489	60.484	65:00	51.479	00:00	56.939	9.005
333	<input type="checkbox"/>	J-490	60.346	16:00	40.384	30:00	52.067	19.962
334	<input type="checkbox"/>	J-497	61.538	16:00	41.731	30:00	53.275	19.807
335	<input type="checkbox"/>	J-500	70.711	16:00	51.193	30:00	62.476	19.518
336	<input type="checkbox"/>	J-501	96.154	16:00	77.966	30:00	88.558	18.188
337	<input type="checkbox"/>	J-502	48.560	67:00	42.144	31:00	45.715	6.417
338	<input type="checkbox"/>	J-503	65.851	67:00	59.454	31:00	63.024	6.397
339	<input type="checkbox"/>	J-504	57.275	67:00	50.618	31:00	54.263	6.658
340	<input type="checkbox"/>	J-509	73.178	16:00	54.613	30:00	65.503	18.565
341	<input type="checkbox"/>	J-511	72.733	16:00	53.692	30:00	64.805	19.041
342	<input type="checkbox"/>	J-512	68.656	33:00	63.461	00:00	65.698	5.194
343	<input type="checkbox"/>	J-513	73.517	33:00	65.330	00:00	68.958	8.187
344	<input type="checkbox"/>	J-514	71.571	33:00	61.699	00:00	66.165	9.872
345	<input type="checkbox"/>	J-515	72.340	65:00	67.624	31:00	70.455	4.716
346	<input type="checkbox"/>	J-516	110.424	59:00	105.746	31:00	108.537	4.679
347	<input type="checkbox"/>	J-517	105.008	67:00	99.906	31:00	102.967	5.102
348	<input type="checkbox"/>	J-518	100.465	67:00	94.736	31:00	98.082	5.728
349	<input type="checkbox"/>	J-519	96.133	67:00	90.343	31:00	93.670	5.790
350	<input type="checkbox"/>	J-520	96.095	67:00	90.069	31:00	93.557	6.026

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
351	<input type="checkbox"/>	J-521	100.470	67:00	94.753	31:00	98.084	5.717
352	<input type="checkbox"/>	J-522	100.859	67:00	95.954	32:00	98.871	4.905
353	<input type="checkbox"/>	J-523	101.591	67:00	96.312	32:00	99.396	5.278
354	<input type="checkbox"/>	J-524	100.692	67:00	95.164	32:00	98.363	5.528
355	<input type="checkbox"/>	J-527	66.107	67:00	60.476	32:00	63.717	5.631
356	<input type="checkbox"/>	J-528	98.117	33:00	88.518	00:00	92.510	9.600
357	<input type="checkbox"/>	J-531	92.732	33:00	82.392	00:00	87.021	10.340
358	<input type="checkbox"/>	J-532	78.210	33:00	72.117	00:00	74.758	6.093
359	<input type="checkbox"/>	J-533	77.858	33:00	69.670	00:00	73.299	8.188
360	<input type="checkbox"/>	J-538	78.830	65:00	74.192	31:00	76.987	4.638
361	<input type="checkbox"/>	J-540	74.567	65:00	70.379	31:00	73.011	4.188
362	<input type="checkbox"/>	J-541	74.582	66:00	70.352	31:00	73.008	4.230
363	<input type="checkbox"/>	J-543	66.508	00:00	61.640	31:00	64.363	4.868
364	<input type="checkbox"/>	J-545	74.584	65:00	70.200	31:00	72.888	4.384
365	<input type="checkbox"/>	J-546	74.584	65:00	70.193	31:00	72.881	4.391
366	<input type="checkbox"/>	J-547	59.453	65:00	55.049	31:00	57.729	4.404
367	<input type="checkbox"/>	J-548	96.256	66:00	88.266	32:00	92.887	7.990
368	<input type="checkbox"/>	J-549	86.317	66:00	78.330	32:00	82.951	7.987
369	<input type="checkbox"/>	J-550	86.333	66:00	78.360	32:00	82.978	7.973
370	<input type="checkbox"/>	J-551	92.853	66:00	84.924	32:00	89.530	7.928
371	<input type="checkbox"/>	J-551B	92.849	66:00	84.916	32:00	89.523	7.933
372	<input type="checkbox"/>	J-552	86.372	66:00	78.461	32:00	83.063	7.911
373	<input type="checkbox"/>	J-554	53.303	17:00	49.417	31:00	51.841	3.886
374	<input type="checkbox"/>	J-555	61.958	17:00	58.068	31:00	60.493	3.889
375	<input type="checkbox"/>	J-556	70.615	17:00	66.724	31:00	69.147	3.891
376	<input type="checkbox"/>	J-557	61.980	17:00	58.089	31:00	60.509	3.891
377	<input type="checkbox"/>	J-558	71.337	65:00	67.678	31:00	70.037	3.659
378	<input type="checkbox"/>	J-559	59.684	65:00	56.111	31:00	58.385	3.573
379	<input type="checkbox"/>	J-560	70.489	65:00	66.748	31:00	69.083	3.741
380	<input type="checkbox"/>	J-561	83.458	65:00	79.626	31:00	81.999	3.832
381	<input type="checkbox"/>	J-564	59.831	33:00	56.371	31:00	58.486	3.460
382	<input type="checkbox"/>	J-565	63.618	33:00	60.002	31:00	62.014	3.616
383	<input type="checkbox"/>	J-566	71.533	33:00	67.423	00:00	69.442	4.110
384	<input type="checkbox"/>	J-567	84.058	61:00	74.801	31:00	79.352	9.256
385	<input type="checkbox"/>	J-570	77.121	61:00	68.505	31:00	73.205	8.616
386	<input type="checkbox"/>	J-571	68.687	61:00	60.214	31:00	64.955	8.473
387	<input type="checkbox"/>	J-572	78.647	61:00	70.427	31:00	75.030	8.220
388	<input type="checkbox"/>	J-574	94.948	61:00	86.040	31:00	89.954	8.908
389	<input type="checkbox"/>	J-576	92.307	61:00	83.655	31:00	87.516	8.652
390	<input type="checkbox"/>	J-577	93.395	61:00	84.771	31:00	88.826	8.624
391	<input type="checkbox"/>	J-578	105.689	61:00	97.121	31:00	101.278	8.568
392	<input type="checkbox"/>	J-579	96.324	61:00	87.834	31:00	92.087	8.490
393	<input type="checkbox"/>	J-581	90.494	66:00	82.601	32:00	87.192	7.893
394	<input type="checkbox"/>	J-582	90.477	66:00	82.596	32:00	87.180	7.881
395	<input type="checkbox"/>	J-584	83.093	66:00	75.240	32:00	79.817	7.853
396	<input type="checkbox"/>	J-585	77.364	66:00	69.551	32:00	74.100	7.813
397	<input type="checkbox"/>	J-587	64.286	67:00	56.461	32:00	60.972	7.824
398	<input type="checkbox"/>	J-588	53.430	67:00	45.542	32:00	50.016	7.888
399	<input type="checkbox"/>	J-589	110.541	61:00	101.681	31:00	105.899	8.860
400	<input type="checkbox"/>	J-590	98.233	61:00	89.254	31:00	93.411	8.980

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
401	<input type="checkbox"/>	J-593	56.483	65:00	52.201	31:00	54.803	4.282
402	<input type="checkbox"/>	J-594	79.058	65:00	75.139	31:00	77.505	3.918
403	<input type="checkbox"/>	J-595	77.531	33:00	73.870	31:00	75.805	3.661
404	<input type="checkbox"/>	J-596	80.500	33:00	76.078	00:00	78.243	4.422
405	<input type="checkbox"/>	J-600	74.821	65:00	71.113	31:00	73.418	3.707
406	<input type="checkbox"/>	J-601	64.013	65:00	60.322	31:00	62.613	3.690
407	<input type="checkbox"/>	J-602	61.420	65:00	57.743	31:00	60.024	3.677
408	<input type="checkbox"/>	J-606	92.222	66:00	84.028	31:00	88.733	8.194
409	<input type="checkbox"/>	J-610	88.684	66:00	80.879	32:00	85.327	7.804
410	<input type="checkbox"/>	J-611	86.518	67:00	78.871	32:00	83.251	7.647
411	<input type="checkbox"/>	J-613	96.617	67:00	91.355	32:00	94.463	5.262
412	<input type="checkbox"/>	J-614	59.318	65:00	52.609	30:00	56.666	6.709
413	<input type="checkbox"/>	J-617	87.012	67:00	80.967	32:00	84.472	6.045
414	<input type="checkbox"/>	J-618	92.201	67:00	85.151	32:00	89.208	7.050
415	<input type="checkbox"/>	J-619	110.532	59:00	106.340	32:00	108.654	4.192
416	<input type="checkbox"/>	J-622	57.190	65:00	52.083	31:00	55.096	5.106
417	<input type="checkbox"/>	J-623	98.941	67:00	94.452	32:00	97.187	4.488
418	<input type="checkbox"/>	J-624	96.741	67:00	92.084	32:00	94.900	4.658
419	<input type="checkbox"/>	J-626	110.764	59:00	106.580	32:00	109.113	4.184
420	<input type="checkbox"/>	J-631	66.103	67:00	60.691	32:00	63.840	5.412
421	<input type="checkbox"/>	J-633	63.942	67:00	58.379	32:00	61.589	5.563
422	<input type="checkbox"/>	J-640	61.954	67:00	54.453	32:00	58.755	7.501
423	<input type="checkbox"/>	J-641	84.421	67:00	77.050	32:00	81.290	7.371
424	<input type="checkbox"/>	J-643	61.963	67:00	54.418	32:00	58.741	7.545
425	<input type="checkbox"/>	J-644	112.695	16:00	100.616	00:00	108.118	12.079
426	<input type="checkbox"/>	J-648	67.289	66:00	56.796	30:00	63.283	10.493
427	<input type="checkbox"/>	J-650	78.752	67:00	72.454	31:00	76.048	6.298
428	<input type="checkbox"/>	J-654	70.406	67:00	64.920	32:00	68.095	5.486
429	<input type="checkbox"/>	J-655	63.940	67:00	58.458	32:00	61.632	5.481
430	<input type="checkbox"/>	J-656	70.501	67:00	64.802	32:00	68.101	5.699
431	<input type="checkbox"/>	J-657	92.157	67:00	86.446	32:00	89.760	5.712
432	<input type="checkbox"/>	J-658	91.339	67:00	85.612	32:00	88.946	5.726
433	<input type="checkbox"/>	J-659	60.391	16:00	41.314	30:00	52.481	19.077
434	<input type="checkbox"/>	J-660	62.555	16:00	43.501	30:00	54.655	19.054
435	<input type="checkbox"/>	J-661	69.379	16:00	55.809	30:00	63.812	13.570
436	<input type="checkbox"/>	J-662	58.228	16:00	39.129	30:00	50.308	19.099
437	<input type="checkbox"/>	J-663	60.390	16:00	41.300	30:00	52.474	19.091
438	<input type="checkbox"/>	J-665	70.261	16:00	66.371	30:00	68.469	3.890
439	<input type="checkbox"/>	J-666	69.823	16:00	64.506	30:00	67.549	5.318
440	<input type="checkbox"/>	J-667	81.616	33:00	73.766	00:00	77.242	7.850
441	<input type="checkbox"/>	J-668	82.240	33:00	75.214	00:00	78.297	7.026
442	<input type="checkbox"/>	J-669	80.190	33:00	74.023	00:00	76.692	6.167
443	<input type="checkbox"/>	J-670	63.650	67:00	57.308	31:00	60.865	6.342
444	<input type="checkbox"/>	J-672	95.969	65:00	91.466	30:00	94.168	4.502
445	<input type="checkbox"/>	J-675	100.207	33:00	90.647	00:00	94.603	9.560
446	<input type="checkbox"/>	J-676	61.872	17:00	57.811	31:00	60.347	4.061
447	<input type="checkbox"/>	J-677	61.814	17:00	57.614	31:00	60.238	4.200
448	<input type="checkbox"/>	J-678	57.490	17:00	53.289	31:00	55.914	4.201
449	<input type="checkbox"/>	J-679	61.877	17:00	57.755	31:00	60.320	4.122
450	<input type="checkbox"/>	J-681	85.322	66:00	77.092	31:00	81.839	8.230

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
451	<input type="checkbox"/>	J-682	88.017	16:00	76.158	00:00	83.669	11.859
452	<input type="checkbox"/>	J-684	76.345	61:00	68.002	31:00	72.692	8.343
453	<input type="checkbox"/>	J-685	74.456	61:00	66.303	31:00	70.985	8.153
454	<input type="checkbox"/>	J-686	73.616	61:00	65.440	31:00	70.130	8.176
455	<input type="checkbox"/>	J-687	86.261	66:00	77.922	31:00	82.746	8.339
456	<input type="checkbox"/>	J-688	68.288	65:00	64.532	31:00	66.904	3.756
457	<input type="checkbox"/>	J-690	65.879	65:00	60.459	30:00	63.680	5.419
458	<input type="checkbox"/>	J-691	66.739	65:00	61.230	30:00	64.508	5.508
459	<input type="checkbox"/>	J-692	67.998	65:00	61.781	30:00	65.518	6.218
460	<input type="checkbox"/>	J-693	66.677	65:00	59.983	30:00	64.030	6.694
461	<input type="checkbox"/>	J-694	63.645	65:00	56.905	30:00	60.982	6.740
462	<input type="checkbox"/>	J-695	57.203	65:00	51.524	30:00	54.905	5.679
463	<input type="checkbox"/>	J-696	52.861	65:00	46.637	30:00	50.378	6.224
464	<input type="checkbox"/>	J-697	58.036	65:00	51.496	30:00	55.443	6.540
465	<input type="checkbox"/>	J-698	61.483	65:00	54.745	30:00	58.821	6.738
466	<input type="checkbox"/>	J-699	61.481	65:00	54.741	30:00	58.818	6.739
467	<input type="checkbox"/>	J-70	103.560	59:00	98.231	04:00	101.034	5.329
468	<input type="checkbox"/>	J-700	55.004	65:00	48.501	30:00	52.422	6.503
469	<input type="checkbox"/>	J-701	93.817	65:00	89.583	31:00	92.135	4.233
470	<input type="checkbox"/>	J-702	63.711	65:00	58.937	31:00	61.819	4.774
471	<input type="checkbox"/>	J-703	63.965	65:00	59.492	30:00	62.166	4.473
472	<input type="checkbox"/>	J-704	70.137	65:00	63.600	30:00	67.542	6.537
473	<input type="checkbox"/>	J-705	70.128	65:00	63.328	30:00	67.445	6.799
474	<input type="checkbox"/>	J-707	85.525	65:00	81.490	31:00	83.904	4.035
475	<input type="checkbox"/>	J-708	61.878	33:00	56.796	00:00	58.962	5.082
476	<input type="checkbox"/>	J-709	80.456	16:00	70.701	30:00	76.529	9.754
477	<input type="checkbox"/>	J-710	98.207	33:00	88.563	00:00	92.608	9.644
478	<input type="checkbox"/>	J-711	74.276	16:00	72.767	30:00	73.382	1.509
479	<input type="checkbox"/>	J-712	70.342	16:00	68.891	30:00	69.481	1.451
480	<input type="checkbox"/>	J-713	67.146	16:00	46.840	30:00	58.695	20.306
481	<input type="checkbox"/>	J-714	75.327	16:00	54.551	30:00	66.671	20.777
482	<input type="checkbox"/>	J-715	70.257	16:00	68.431	30:00	69.183	1.826
483	<input type="checkbox"/>	J-716	95.156	33:00	90.288	30:00	92.761	4.868
484	<input type="checkbox"/>	J-717	92.992	33:00	88.172	30:00	90.612	4.820
485	<input type="checkbox"/>	J-718	91.489	33:00	84.536	00:00	87.583	6.953
486	<input type="checkbox"/>	J-719	66.128	65:00	61.580	30:00	64.309	4.548
487	<input type="checkbox"/>	J-720	93.815	65:00	89.549	31:00	92.115	4.266
488	<input type="checkbox"/>	J-721	76.437	33:00	71.098	30:00	73.506	5.339
489	<input type="checkbox"/>	J-723	97.681	33:00	87.819	69:00	92.186	9.862
490	<input type="checkbox"/>	J-724	100.189	33:00	90.637	00:00	94.581	9.552
491	<input type="checkbox"/>	J-725	59.807	16:00	57.686	30:00	58.602	2.122
492	<input type="checkbox"/>	J-726	71.856	16:00	51.091	30:00	63.203	20.765
493	<input type="checkbox"/>	J-727	86.701	16:00	72.731	30:00	80.646	13.970
494	<input type="checkbox"/>	J-727B	95.322	16:00	77.204	30:00	87.753	18.118
495	<input type="checkbox"/>	J-728	75.318	16:00	54.502	30:00	66.648	20.816
496	<input type="checkbox"/>	J-729	70.985	16:00	50.262	30:00	62.345	20.723
497	<input type="checkbox"/>	J-730	74.476	65:00	69.686	31:00	72.538	4.790
498	<input type="checkbox"/>	J-731	73.569	16:00	59.074	30:00	67.639	14.495
499	<input type="checkbox"/>	J-732	61.946	16:00	59.843	30:00	60.749	2.103
500	<input type="checkbox"/>	J-733	95.003	16:00	76.883	30:00	87.446	18.120

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
501	<input type="checkbox"/>	J-734	102.861	16:00	84.662	30:00	95.261	18.199
502	<input type="checkbox"/>	J-735	73.037	16:00	53.883	30:00	65.089	19.154
503	<input type="checkbox"/>	J-736	64.483	16:00	45.260	30:00	56.506	19.223
504	<input type="checkbox"/>	J-737	63.450	61:00	54.961	31:00	59.718	8.489
505	<input type="checkbox"/>	J-738	70.401	33:00	64.236	00:00	67.008	6.166
506	<input type="checkbox"/>	J-739	74.771	65:00	70.033	30:00	72.888	4.738
507	<input type="checkbox"/>	J-740	70.444	65:00	65.633	30:00	68.537	4.811
508	<input type="checkbox"/>	J-741	66.169	65:00	62.559	31:00	64.847	3.611
509	<input type="checkbox"/>	J-742	81.768	66:00	73.533	31:00	78.268	8.234
510	<input type="checkbox"/>	J-743	83.982	66:00	75.792	31:00	80.504	8.190
511	<input type="checkbox"/>	J-744	85.032	66:00	77.112	32:00	81.719	7.920
512	<input type="checkbox"/>	J-745	59.125	61:00	50.636	31:00	55.394	8.489
513	<input type="checkbox"/>	J-746	74.881	61:00	65.435	31:00	70.198	9.445
514	<input type="checkbox"/>	J-747	95.591	61:00	86.619	31:00	91.284	8.973
515	<input type="checkbox"/>	J-748	89.862	61:00	81.248	31:00	85.975	8.613
516	<input type="checkbox"/>	J-749	95.916	61:00	86.789	31:00	91.478	9.126
517	<input type="checkbox"/>	J-750	69.518	61:00	61.025	31:00	65.783	8.493
518	<input type="checkbox"/>	J-751	52.619	61:00	44.148	31:00	48.899	8.471
519	<input type="checkbox"/>	J-752	91.292	66:00	82.771	31:00	87.664	8.521
520	<input type="checkbox"/>	J-753	86.323	66:00	78.340	32:00	82.960	7.983
521	<input type="checkbox"/>	J-754	65.941	65:00	61.530	31:00	64.202	4.411
522	<input type="checkbox"/>	J-755	92.782	16:00	81.368	00:00	88.509	11.414
523	<input type="checkbox"/>	J-756	67.305	65:00	62.985	31:00	65.578	4.321
524	<input type="checkbox"/>	J-757	59.510	65:00	55.142	31:00	57.763	4.368
525	<input type="checkbox"/>	J-758	70.729	33:00	66.651	30:00	68.936	4.078
526	<input type="checkbox"/>	J-759	84.306	33:00	80.094	30:00	82.150	4.212
527	<input type="checkbox"/>	J-760	62.808	33:00	58.696	30:00	60.622	4.111
528	<input type="checkbox"/>	J-761	66.390	33:00	61.682	00:00	63.896	4.708
529	<input type="checkbox"/>	J-762	66.084	65:00	62.149	31:00	64.518	3.934
530	<input type="checkbox"/>	J-763	62.246	33:00	58.109	30:00	60.349	4.136
531	<input type="checkbox"/>	J-764	86.933	33:00	82.486	00:00	84.616	4.447
532	<input type="checkbox"/>	J-765	85.341	33:00	80.310	00:00	82.638	5.031
533	<input type="checkbox"/>	J-766	66.407	33:00	62.125	30:00	64.548	4.282
534	<input type="checkbox"/>	J-767	76.798	65:00	72.422	31:00	75.056	4.376
535	<input type="checkbox"/>	J-768	83.547	33:00	78.916	30:00	81.643	4.631
536	<input type="checkbox"/>	J-769	77.228	33:00	72.730	30:00	75.281	4.497
537	<input type="checkbox"/>	J-770	70.680	33:00	66.425	30:00	68.845	4.255
538	<input type="checkbox"/>	J-771	70.442	33:00	65.497	30:00	68.038	4.946
539	<input type="checkbox"/>	J-772	74.980	33:00	70.006	30:00	72.230	4.974
540	<input type="checkbox"/>	J-773	83.784	61:00	74.345	31:00	79.054	9.439
541	<input type="checkbox"/>	J-774	71.489	65:00	65.877	30:00	69.220	5.611
542	<input type="checkbox"/>	J-775	63.739	65:00	58.789	31:00	61.737	4.950
543	<input type="checkbox"/>	J-776	87.161	61:00	78.023	31:00	82.322	9.138
544	<input type="checkbox"/>	J-777	59.318	65:00	52.583	30:00	56.658	6.736
545	<input type="checkbox"/>	J-778	76.750	61:00	67.338	31:00	72.138	9.412
546	<input type="checkbox"/>	J-779	58.055	65:00	52.962	31:00	55.968	5.093
547	<input type="checkbox"/>	J-780	91.214	65:00	86.824	31:00	89.449	4.389
548	<input type="checkbox"/>	J-781	79.102	65:00	74.604	30:00	77.300	4.498
549	<input type="checkbox"/>	J-782	76.802	67:00	71.179	32:00	74.399	5.624
550	<input type="checkbox"/>	J-783	89.914	65:00	85.506	31:00	88.147	4.407

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
551	<input type="checkbox"/>	J-784	89.912	65:00	85.467	31:00	88.124	4.445
552	<input type="checkbox"/>	J-785	109.713	67:00	105.241	32:00	107.962	4.472
553	<input type="checkbox"/>	J-786	100.747	67:00	95.398	32:00	98.526	5.349
554	<input type="checkbox"/>	J-787	70.441	65:00	65.535	30:00	68.501	4.906
555	<input type="checkbox"/>	J-788	100.692	67:00	95.214	32:00	98.384	5.477
556	<input type="checkbox"/>	J-789	83.220	67:00	77.346	32:00	80.690	5.874
557	<input type="checkbox"/>	J-79	88.533	66:00	80.617	32:00	85.221	7.915
558	<input type="checkbox"/>	J-790	92.030	67:00	86.393	32:00	89.645	5.637
559	<input type="checkbox"/>	J-791	79.141	67:00	73.167	32:00	76.632	5.974
560	<input type="checkbox"/>	J-793	62.673	67:00	56.903	32:00	60.232	5.771
561	<input type="checkbox"/>	J-794	57.482	67:00	51.817	32:00	55.080	5.665
562	<input type="checkbox"/>	J-798	94.224	33:00	90.179	30:00	92.580	4.045
563	<input type="checkbox"/>	J-799	72.749	33:00	68.761	30:00	71.051	3.988
564	<input type="checkbox"/>	J-800	68.321	16:00	66.296	30:00	67.149	2.026
565	<input type="checkbox"/>	J-802	86.604	16:00	73.653	00:00	81.056	12.951
566	<input type="checkbox"/>	J-803	88.351	16:00	75.504	00:00	82.919	12.847
567	<input type="checkbox"/>	J-804	73.152	16:00	52.391	30:00	64.500	20.761
568	<input type="checkbox"/>	J-806	70.862	16:00	51.760	30:00	62.941	19.102
569	<input type="checkbox"/>	J-807	91.143	66:00	83.244	31:00	87.740	7.899
570	<input type="checkbox"/>	J-808	90.420	33:00	84.944	69:00	87.361	5.476
571	<input type="checkbox"/>	J-809	91.923	33:00	86.241	69:00	88.694	5.682
572	<input type="checkbox"/>	J-810	93.138	33:00	87.167	00:00	89.698	5.971
573	<input type="checkbox"/>	J-812	60.378	16:00	41.137	30:00	52.395	19.241
574	<input type="checkbox"/>	J-813	70.260	16:00	68.993	30:00	69.469	1.266
575	<input type="checkbox"/>	J-814	83.796	33:00	76.949	30:00	80.680	6.847
576	<input type="checkbox"/>	J-816	70.845	16:00	68.891	30:00	69.715	1.954
577	<input type="checkbox"/>	J-819	72.364	65:00	67.871	31:00	70.607	4.493
578	<input type="checkbox"/>	J-820	83.697	33:00	77.266	00:00	80.109	6.431
579	<input type="checkbox"/>	J-821	73.967	33:00	67.285	00:00	70.208	6.682
580	<input type="checkbox"/>	J-822	90.371	33:00	82.854	00:00	86.164	7.517
581	<input type="checkbox"/>	J-823	81.698	33:00	73.810	00:00	77.354	7.888
582	<input type="checkbox"/>	J-825	66.158	65:00	62.316	31:00	64.707	3.842
583	<input type="checkbox"/>	J-834	53.420	67:00	45.517	32:00	49.981	7.903
584	<input type="checkbox"/>	J-861	75.498	16:00	74.084	30:00	74.653	1.414
585	<input type="checkbox"/>	J-862	75.950	16:00	74.506	30:00	75.098	1.444
586	<input type="checkbox"/>	J-863	76.350	16:00	74.957	30:00	75.524	1.392
587	<input type="checkbox"/>	J-864	76.373	16:00	74.943	30:00	75.528	1.429
588	<input type="checkbox"/>	J-869	95.016	16:00	76.803	30:00	87.426	18.214
589	<input type="checkbox"/>	J-870	86.608	16:00	72.500	30:00	80.882	14.109
590	<input type="checkbox"/>	J-872	82.559	16:00	70.386	30:00	77.675	12.173
591	<input type="checkbox"/>	J-876	94.611	33:00	84.213	69:00	89.290	10.398
592	<input type="checkbox"/>	J-879	58.314	65:00	54.395	31:00	56.785	3.920
593	<input type="checkbox"/>	J-880	76.897	65:00	72.973	31:00	75.339	3.924
594	<input type="checkbox"/>	J-881	92.685	66:00	83.941	31:00	89.011	8.744
595	<input type="checkbox"/>	J-882	92.739	66:00	84.302	31:00	89.186	8.438
596	<input type="checkbox"/>	J-883	105.658	66:00	96.911	31:00	101.982	8.747
597	<input type="checkbox"/>	J-884	90.425	66:00	82.343	32:00	86.983	8.082
598	<input type="checkbox"/>	J-885	75.388	66:00	67.480	32:00	72.079	7.908
599	<input type="checkbox"/>	J-886	88.040	66:00	79.811	31:00	84.538	8.229
600	<input type="checkbox"/>	J-887	90.171	66:00	81.942	31:00	86.668	8.229



Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
601	<input type="checkbox"/>	J-890	72.720	33:00	68.784	31:00	71.073	3.936
602	<input type="checkbox"/>	J-891	100.173	61:00	91.102	45:00	95.138	9.072
603	<input type="checkbox"/>	J-900	96.403	65:00	91.969	30:00	94.624	4.434
604	<input type="checkbox"/>	J9000	91.999	66:00	83.819	31:00	88.486	8.180
605	<input type="checkbox"/>	J9002	96.310	66:00	87.549	31:00	92.583	8.761
606	<input type="checkbox"/>	J9004	53.888	65:00	49.583	31:00	52.193	4.305
607	<input type="checkbox"/>	J9006	58.220	65:00	53.969	31:00	56.529	4.252
608	<input type="checkbox"/>	J9008	102.220	66:00	93.650	31:00	98.614	8.571
609	<input type="checkbox"/>	J-901	59.749	17:00	55.682	31:00	58.209	4.068
610	<input type="checkbox"/>	J9010	74.588	61:00	65.176	31:00	69.976	9.412
611	<input type="checkbox"/>	J9012	112.330	59:00	108.141	32:00	110.429	4.189
612	<input type="checkbox"/>	J9016	94.441	61:00	85.522	31:00	89.457	8.919
613	<input type="checkbox"/>	J9018	104.890	61:00	95.901	31:00	100.114	8.989
614	<input type="checkbox"/>	J-902	61.964	17:00	57.982	31:00	60.450	3.982
615	<input type="checkbox"/>	J9022	54.361	66:00	46.257	32:00	50.965	8.104
616	<input type="checkbox"/>	J9024	68.041	67:00	60.409	32:00	64.771	7.632
617	<input type="checkbox"/>	J9026	112.683	16:00	100.535	00:00	108.029	12.148
618	<input type="checkbox"/>	J9028	71.472	67:00	63.932	32:00	68.252	7.541
619	<input type="checkbox"/>	J-903	62.003	17:00	58.085	31:00	60.509	3.918
620	<input type="checkbox"/>	J9030	67.163	67:00	59.578	32:00	63.919	7.584
621	<input type="checkbox"/>	J9032	97.465	16:00	84.816	00:00	92.254	12.649
622	<input type="checkbox"/>	J9034	91.392	16:00	78.632	00:00	86.057	12.761
623	<input type="checkbox"/>	J9036	87.059	16:00	74.243	00:00	81.662	12.816
624	<input type="checkbox"/>	J9038	87.922	16:00	75.098	00:00	82.516	12.824
625	<input type="checkbox"/>	J-904	69.387	33:00	64.728	30:00	66.986	4.659
626	<input type="checkbox"/>	J9040	75.779	67:00	68.301	32:00	72.594	7.478
627	<input type="checkbox"/>	J9042	74.917	67:00	67.471	32:00	71.747	7.446
628	<input type="checkbox"/>	J9044	76.644	67:00	69.199	32:00	73.475	7.445
629	<input type="checkbox"/>	J9046	87.517	66:00	81.638	31:00	85.109	5.878
630	<input type="checkbox"/>	J9048	76.786	16:00	75.392	30:00	75.950	1.394
631	<input type="checkbox"/>	J-905	71.590	33:00	66.759	30:00	69.111	4.830
632	<input type="checkbox"/>	J9050	68.900	65:00	64.143	31:00	67.015	4.757
633	<input type="checkbox"/>	J9052	95.210	33:00	85.190	30:00	90.866	10.020
634	<input type="checkbox"/>	J9054	82.098	61:00	74.173	31:00	78.700	7.925
635	<input type="checkbox"/>	J9056	112.693	16:00	100.602	00:00	108.102	12.091
636	<input type="checkbox"/>	J9058	70.794	67:00	63.003	32:00	67.531	7.791
637	<input type="checkbox"/>	J-906	76.004	33:00	70.843	30:00	73.369	5.161
638	<input type="checkbox"/>	J9060	53.487	67:00	45.669	32:00	50.200	7.818
639	<input type="checkbox"/>	J9062	98.356	33:00	88.637	00:00	92.763	9.719
640	<input type="checkbox"/>	J-907	80.355	33:00	75.114	30:00	77.679	5.241
641	<input type="checkbox"/>	J9072	59.749	16:00	58.170	22:00	59.290	1.579
642	<input type="checkbox"/>	J-908	89.046	33:00	83.689	30:00	86.308	5.358
643	<input type="checkbox"/>	J9084	87.998	16:00	75.146	00:00	82.561	12.852
644	<input type="checkbox"/>	J-909	73.748	33:00	69.565	00:00	71.610	4.182
645	<input type="checkbox"/>	J9090	63.339	67:00	55.831	32:00	60.136	7.507
646	<input type="checkbox"/>	J9098	62.730	33:00	59.008	31:00	61.081	3.723
647	<input type="checkbox"/>	J-91	76.900	16:00	66.298	00:00	72.811	10.601
648	<input type="checkbox"/>	J-910	80.261	33:00	76.043	00:00	78.099	4.218
649	<input type="checkbox"/>	J9100	62.154	65:00	57.860	31:00	60.545	4.294
650	<input type="checkbox"/>	J9102	61.610	65:00	57.269	31:00	59.960	4.340



Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
651	<input type="checkbox"/>	J9106	66.897	65:00	63.213	31:00	65.511	3.684
652	<input type="checkbox"/>	J9108	92.671	16:00	80.688	00:00	88.301	11.983
653	<input type="checkbox"/>	J-911	82.439	33:00	78.200	00:00	80.263	4.240
654	<input type="checkbox"/>	J9110	64.116	67:00	56.484	32:00	60.847	7.632
655	<input type="checkbox"/>	J9118	96.071	16:00	83.385	00:00	90.819	12.686
656	<input type="checkbox"/>	J9120	103.513	16:00	90.827	00:00	98.260	12.686
657	<input type="checkbox"/>	J9122	63.339	67:00	55.831	32:00	60.136	7.508
658	<input type="checkbox"/>	J9124	64.765	67:00	57.259	32:00	61.564	7.506
659	<input type="checkbox"/>	J9126	68.874	67:00	61.367	32:00	65.672	7.507
660	<input type="checkbox"/>	J9128	66.279	67:00	58.772	32:00	63.077	7.507
661	<input type="checkbox"/>	J9130	66.279	67:00	58.772	32:00	63.077	7.507
662	<input type="checkbox"/>	J9132	94.636	16:00	81.875	00:00	89.300	12.761
663	<input type="checkbox"/>	J9134	59.101	67:00	51.594	32:00	55.899	7.507
664	<input type="checkbox"/>	J9136	68.874	67:00	61.367	32:00	65.672	7.507
665	<input type="checkbox"/>	J9138	96.063	16:00	83.301	00:00	90.726	12.761
666	<input type="checkbox"/>	J9140	90.260	16:00	77.479	00:00	84.902	12.781
667	<input type="checkbox"/>	J9142	93.205	16:00	80.424	00:00	87.847	12.781
668	<input type="checkbox"/>	J9144	89.102	16:00	76.299	00:00	83.720	12.803
669	<input type="checkbox"/>	J9146	91.818	16:00	79.015	00:00	86.436	12.803
670	<input type="checkbox"/>	J9148	89.664	16:00	76.908	00:00	84.334	12.756
671	<input type="checkbox"/>	J-915	92.630	33:00	82.390	00:00	86.969	10.240
672	<input type="checkbox"/>	J9150	87.552	16:00	74.738	00:00	82.158	12.814
673	<input type="checkbox"/>	J9152	88.155	16:00	75.364	00:00	82.786	12.791
674	<input type="checkbox"/>	J9154	88.966	16:00	76.175	00:00	83.597	12.791
675	<input type="checkbox"/>	J9156	102.798	16:00	90.336	00:00	97.795	12.462
676	<input type="checkbox"/>	J9158	100.350	16:00	87.888	00:00	95.346	12.462
677	<input type="checkbox"/>	J-916	60.725	33:00	57.031	31:00	59.213	3.694
678	<input type="checkbox"/>	J9160	87.390	16:00	74.530	00:00	81.944	12.860
679	<input type="checkbox"/>	J9162	87.221	16:00	74.340	00:00	81.752	12.880
680	<input type="checkbox"/>	J9164	87.590	16:00	74.733	00:00	82.147	12.857
681	<input type="checkbox"/>	J9166	86.101	16:00	73.243	00:00	80.657	12.858
682	<input type="checkbox"/>	J9168	87.333	16:00	74.452	00:00	81.864	12.880
683	<input type="checkbox"/>	J-917	83.593	33:00	79.629	31:00	81.948	3.964
684	<input type="checkbox"/>	J9170	90.586	16:00	79.292	00:00	86.308	11.294
685	<input type="checkbox"/>	J9172	91.358	16:00	80.064	00:00	87.080	11.294
686	<input type="checkbox"/>	J9174	87.879	16:00	76.833	00:00	83.659	11.046
687	<input type="checkbox"/>	J9176	85.161	16:00	74.391	00:00	81.010	10.770
688	<input type="checkbox"/>	J9178	85.075	16:00	74.305	00:00	80.923	10.770
689	<input type="checkbox"/>	J-918	64.867	65:00	61.020	31:00	63.355	3.847
690	<input type="checkbox"/>	J9180	83.685	16:00	73.014	00:00	79.558	10.670
691	<input type="checkbox"/>	J9182	83.362	16:00	72.760	00:00	79.253	10.603
692	<input type="checkbox"/>	J9184	84.006	16:00	72.993	00:00	79.815	11.013
693	<input type="checkbox"/>	J9186	80.810	16:00	70.163	00:00	76.697	10.647
694	<input type="checkbox"/>	J9188	80.867	16:00	70.154	00:00	76.734	10.713
695	<input type="checkbox"/>	J9190	80.473	16:00	69.855	00:00	76.368	10.618
696	<input type="checkbox"/>	J9192	73.670	65:00	63.782	00:00	69.803	9.888
697	<input type="checkbox"/>	J9194	74.473	65:00	64.609	00:00	70.614	9.864
698	<input type="checkbox"/>	J9196	80.138	65:00	70.274	00:00	76.278	9.864
699	<input type="checkbox"/>	J9198	77.284	65:00	67.420	00:00	73.424	9.864
700	<input type="checkbox"/>	J-92	86.371	66:00	78.455	32:00	83.059	7.915

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
701	<input type="checkbox"/>	J9200	71.212	65:00	61.440	00:00	67.381	9.772
702	<input type="checkbox"/>	J9202	71.539	65:00	61.763	00:00	67.706	9.775
703	<input type="checkbox"/>	J9204	68.685	65:00	58.909	00:00	64.852	9.775
704	<input type="checkbox"/>	J9206	70.112	65:00	60.336	00:00	66.279	9.775
705	<input type="checkbox"/>	J9208	68.685	65:00	58.909	00:00	64.852	9.775
706	<input type="checkbox"/>	J9210	68.912	65:00	59.302	00:00	65.129	9.610
707	<input type="checkbox"/>	J9212	65.723	65:00	56.114	00:00	61.941	9.610
708	<input type="checkbox"/>	J9214	67.103	65:00	57.546	00:00	63.337	9.557
709	<input type="checkbox"/>	J9216	67.084	65:00	57.670	00:00	63.373	9.414
710	<input type="checkbox"/>	J9218	80.550	16:00	69.933	00:00	76.444	10.617
711	<input type="checkbox"/>	J9220	76.359	16:00	65.914	00:00	72.305	10.445
712	<input type="checkbox"/>	J9222	79.217	16:00	68.765	00:00	75.161	10.452
713	<input type="checkbox"/>	J9224	78.893	16:00	68.428	00:00	74.831	10.465
714	<input type="checkbox"/>	J9226	76.363	16:00	65.911	00:00	72.307	10.452
715	<input type="checkbox"/>	J9228	67.387	65:00	57.564	00:00	63.546	9.822
716	<input type="checkbox"/>	J9230	77.452	65:00	67.487	00:00	73.562	9.965
717	<input type="checkbox"/>	J9234	64.390	65:00	55.391	00:00	60.837	8.999
718	<input type="checkbox"/>	J9236	81.398	16:00	70.743	00:00	77.287	10.655
719	<input type="checkbox"/>	J9238	80.818	16:00	70.164	00:00	76.708	10.655
720	<input type="checkbox"/>	J-924	96.402	65:00	91.919	30:00	94.607	4.483
721	<input type="checkbox"/>	J9240	80.929	16:00	70.302	00:00	76.824	10.626
722	<input type="checkbox"/>	J9242	75.128	16:00	64.502	00:00	71.024	10.626
723	<input type="checkbox"/>	J9244	79.162	16:00	68.551	00:00	75.066	10.611
724	<input type="checkbox"/>	J9246	78.793	16:00	68.187	00:00	74.698	10.606
725	<input type="checkbox"/>	J9248	67.950	65:00	58.090	00:00	64.119	9.860
726	<input type="checkbox"/>	J9250	66.527	65:00	57.488	00:00	62.975	9.039
727	<input type="checkbox"/>	J9252	62.427	65:00	53.618	00:00	58.949	8.809
728	<input type="checkbox"/>	J9254	63.946	65:00	54.972	00:00	60.402	8.975
729	<input type="checkbox"/>	J9256	61.522	65:00	57.284	00:00	59.709	4.238
730	<input type="checkbox"/>	J9258	58.795	65:00	54.897	00:00	57.107	3.898
731	<input type="checkbox"/>	J9260	62.249	65:00	53.493	00:00	58.790	8.755
732	<input type="checkbox"/>	J9262	58.936	65:00	54.160	00:00	56.928	4.777
733	<input type="checkbox"/>	J9264	58.704	65:00	54.388	00:00	56.863	4.316
734	<input type="checkbox"/>	J9266	59.006	65:00	54.690	00:00	57.166	4.316
735	<input type="checkbox"/>	J9268	58.683	65:00	55.860	00:00	57.387	2.823
736	<input type="checkbox"/>	J-927	95.968	65:00	91.439	30:00	94.158	4.529
737	<input type="checkbox"/>	J9270	58.244	65:00	55.435	00:00	56.953	2.809
738	<input type="checkbox"/>	J9272	58.219	65:00	55.459	00:00	56.946	2.760
739	<input type="checkbox"/>	J9274	59.389	65:00	56.879	00:00	58.207	2.510
740	<input type="checkbox"/>	J9276	58.822	15:00	57.528	32:00	58.354	1.294
741	<input type="checkbox"/>	J9278	59.345	65:00	57.549	32:00	58.506	1.795
742	<input type="checkbox"/>	J-928	95.967	65:00	91.416	30:00	94.150	4.551
743	<input type="checkbox"/>	J9280	59.322	65:00	56.945	00:00	58.188	2.377
744	<input type="checkbox"/>	J9282	58.013	65:00	55.659	00:00	56.888	2.355
745	<input type="checkbox"/>	J9284	60.331	65:00	58.377	32:00	59.374	1.953
746	<input type="checkbox"/>	J9286	61.758	65:00	59.804	32:00	60.801	1.953
747	<input type="checkbox"/>	J9288	58.606	15:00	57.312	32:00	58.138	1.294
748	<input type="checkbox"/>	J-929	96.401	65:00	91.866	30:00	94.589	4.535
749	<input type="checkbox"/>	J9290	58.606	15:00	57.312	32:00	58.138	1.294
750	<input type="checkbox"/>	J9292	59.663	65:00	50.658	00:00	56.117	9.005

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
751	<input type="checkbox"/>	J9294	88.631	16:00	77.218	00:00	84.359	11.413
752	<input type="checkbox"/>	J9296	91.696	16:00	80.062	00:00	87.387	11.634
753	<input type="checkbox"/>	J9298	87.210	16:00	75.577	00:00	82.902	11.634
754	<input type="checkbox"/>	J-93	86.371	66:00	78.455	32:00	83.059	7.915
755	<input type="checkbox"/>	J-930	95.968	65:00	91.434	30:00	94.157	4.534
756	<input type="checkbox"/>	J9300	94.839	16:00	82.856	00:00	90.469	11.983
757	<input type="checkbox"/>	J9302	87.204	16:00	75.790	00:00	82.931	11.414
758	<input type="checkbox"/>	J9304	92.868	16:00	81.455	00:00	88.596	11.414
759	<input type="checkbox"/>	J9306	91.485	16:00	80.071	00:00	87.212	11.414
760	<input type="checkbox"/>	J-931	70.763	33:00	66.750	31:00	69.027	4.013
761	<input type="checkbox"/>	J9310	88.631	16:00	77.218	00:00	84.359	11.413
762	<input type="checkbox"/>	J9312	87.204	16:00	75.790	00:00	82.931	11.414
763	<input type="checkbox"/>	J9314	87.204	16:00	75.791	00:00	82.931	11.413
764	<input type="checkbox"/>	J9316	88.631	16:00	77.218	00:00	84.359	11.413
765	<input type="checkbox"/>	J9318	84.393	16:00	72.980	00:00	80.121	11.413
766	<input type="checkbox"/>	J-932	66.551	33:00	62.474	31:00	64.726	4.077
767	<input type="checkbox"/>	J9320	84.393	16:00	72.980	00:00	80.121	11.413
768	<input type="checkbox"/>	J9322	84.393	16:00	72.980	00:00	80.121	11.413
769	<input type="checkbox"/>	J9324	88.717	16:00	77.304	00:00	84.445	11.413
770	<input type="checkbox"/>	J9326	87.204	16:00	75.791	00:00	82.931	11.413
771	<input type="checkbox"/>	J9328	87.247	16:00	75.834	00:00	82.975	11.413
772	<input type="checkbox"/>	J-933	66.819	33:00	62.752	31:00	64.872	4.067
773	<input type="checkbox"/>	J9330	85.777	16:00	74.364	00:00	81.504	11.413
774	<input type="checkbox"/>	J9332	84.393	16:00	72.980	00:00	80.121	11.413
775	<input type="checkbox"/>	J9334	84.393	16:00	72.980	00:00	80.121	11.413
776	<input type="checkbox"/>	J9336	87.204	16:00	75.791	00:00	82.931	11.413
777	<input type="checkbox"/>	J9338	88.631	16:00	77.218	00:00	84.359	11.413
778	<input type="checkbox"/>	J-934	83.567	61:00	75.379	31:00	79.844	8.188
779	<input type="checkbox"/>	J9340	88.631	16:00	77.218	00:00	84.359	11.413
780	<input type="checkbox"/>	J9342	91.485	16:00	80.072	00:00	87.213	11.413
781	<input type="checkbox"/>	J9344	98.577	16:00	87.164	00:00	94.304	11.413
782	<input type="checkbox"/>	J9346	95.723	16:00	84.310	00:00	91.450	11.413
783	<input type="checkbox"/>	J9348	91.485	16:00	80.072	00:00	87.213	11.413
784	<input type="checkbox"/>	J-935	54.656	61:00	46.278	31:00	50.998	8.378
785	<input type="checkbox"/>	J9350	87.204	16:00	75.791	00:00	82.931	11.413
786	<input type="checkbox"/>	J9352	87.204	16:00	75.791	00:00	82.931	11.413
787	<input type="checkbox"/>	J9356	98.577	16:00	87.164	00:00	94.304	11.413
788	<input type="checkbox"/>	J9358	92.869	16:00	81.455	00:00	88.596	11.413
789	<input type="checkbox"/>	J9360	91.485	16:00	80.072	00:00	87.213	11.413
790	<input type="checkbox"/>	J9362	97.150	16:00	85.737	00:00	92.877	11.413
791	<input type="checkbox"/>	J9364	91.485	16:00	80.072	00:00	87.213	11.413
792	<input type="checkbox"/>	J9366	97.150	16:00	85.737	00:00	92.877	11.413
793	<input type="checkbox"/>	J9368	90.058	16:00	78.645	00:00	85.786	11.413
794	<input type="checkbox"/>	J9370	95.723	16:00	84.310	00:00	91.450	11.413
795	<input type="checkbox"/>	J9372	87.204	16:00	75.791	00:00	82.931	11.413
796	<input type="checkbox"/>	J9374	92.869	16:00	81.455	00:00	88.596	11.413
797	<input type="checkbox"/>	J9376	92.869	16:00	81.455	00:00	88.596	11.413
798	<input type="checkbox"/>	J9378	91.485	16:00	80.072	00:00	87.213	11.413
799	<input type="checkbox"/>	J-938	78.697	66:00	70.871	32:00	75.429	7.826
800	<input type="checkbox"/>	J9380	90.547	16:00	78.543	00:00	86.174	12.005

Test Report Print Title

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
801	<input type="checkbox"/>	J-939	91.168	16:00	79.180	00:00	86.797	11.988
802	<input type="checkbox"/>	J9390	100.476	16:00	87.715	00:00	95.140	12.761
803	<input type="checkbox"/>	J9394	106.814	16:00	94.479	00:00	101.952	12.335
804	<input type="checkbox"/>	J9396	68.918	67:00	61.347	32:00	65.681	7.570
805	<input type="checkbox"/>	J-940	72.785	67:00	65.199	32:00	69.540	7.586
806	<input type="checkbox"/>	J-945	74.365	16:00	72.755	30:00	73.405	1.611
807	<input type="checkbox"/>	J-946	100.188	33:00	90.638	00:00	94.583	9.550
808	<input type="checkbox"/>	J-947	102.742	33:00	93.218	00:00	97.145	9.524
809	<input type="checkbox"/>	J-948	102.717	33:00	93.213	00:00	97.129	9.504
810	<input type="checkbox"/>	J-949	100.149	33:00	90.618	00:00	94.535	9.531
811	<input type="checkbox"/>	J-95	100.192	33:00	90.637	00:00	94.580	9.556
812	<input type="checkbox"/>	J-950	70.708	16:00	69.695	30:00	69.923	1.013
813	<input type="checkbox"/>	J-953	64.627	33:00	60.948	31:00	62.911	3.679
814	<input type="checkbox"/>	J-954	87.736	67:00	82.072	32:00	85.348	5.664
815	<input type="checkbox"/>	J-955	87.395	33:00	82.556	00:00	84.889	4.839
816	<input type="checkbox"/>	J-957	95.970	65:00	91.417	30:00	94.158	4.553
817	<input type="checkbox"/>	J-958	71.706	33:00	65.188	00:00	68.173	6.518
818	<input type="checkbox"/>	J-96	70.709	16:00	69.965	30:00	70.018	0.744
819	<input type="checkbox"/>	J-962	59.320	65:00	52.724	30:00	56.705	6.596
820	<input type="checkbox"/>	J-964	67.973	65:00	61.627	30:00	65.441	6.346
821	<input type="checkbox"/>	J-965	65.811	65:00	59.528	30:00	63.300	6.284
822	<input type="checkbox"/>	J-966	61.504	65:00	56.035	30:00	59.264	5.469
823	<input type="checkbox"/>	J-967	65.056	16:00	44.963	30:00	56.700	20.092
824	<input type="checkbox"/>	J-968	58.157	16:00	38.078	30:00	49.819	20.079
825	<input type="checkbox"/>	J-969	60.349	16:00	40.574	30:00	52.143	19.775
826	<input type="checkbox"/>	J-970	90.424	16:00	71.700	30:00	82.683	18.725
827	<input type="checkbox"/>	J-971	83.208	33:00	79.907	31:00	81.566	3.301
828	<input type="checkbox"/>	J-972	83.989	67:00	76.425	32:00	80.755	7.564
829	<input type="checkbox"/>	J-973	94.153	66:00	85.431	31:00	90.442	8.723
830	<input type="checkbox"/>	J-974	87.441	61:00	79.539	32:00	84.105	7.901
831	<input type="checkbox"/>	J-975	61.610	65:00	57.275	31:00	59.965	4.335
832	<input type="checkbox"/>	J-976	72.006	16:00	70.931	30:00	71.240	1.075
833	<input type="checkbox"/>	J-977	76.598	16:00	74.916	30:00	75.603	1.682
834	<input type="checkbox"/>	J-978	58.167	16:00	38.761	30:00	50.090	19.406
835	<input type="checkbox"/>	J-979	95.144	33:00	85.301	00:00	89.565	9.843
836	<input type="checkbox"/>	J-980	97.429	33:00	89.501	69:00	93.082	7.928
837	<input type="checkbox"/>	J-981	74.920	67:00	67.454	32:00	71.740	7.466
838	<input type="checkbox"/>	J-982	59.796	67:00	52.274	32:00	56.586	7.522
839	<input type="checkbox"/>	J-983	61.250	33:00	57.731	31:00	59.808	3.518
840	<input type="checkbox"/>	J-984	70.922	65:00	67.239	31:00	69.535	3.683
841	<input type="checkbox"/>	J-986	69.678	33:00	65.959	31:00	68.247	3.719
842	<input type="checkbox"/>	J-987	61.405	65:00	57.721	31:00	60.020	3.684
843	<input type="checkbox"/>	J-988	68.328	65:00	64.645	31:00	66.941	3.683
844	<input type="checkbox"/>	J-989	66.741	33:00	62.742	31:00	64.868	3.999
845	<input type="checkbox"/>	J-99	81.637	33:00	71.642	00:00	76.175	9.995
846	<input type="checkbox"/>	J-990	66.950	33:00	63.152	31:00	65.089	3.798
847	<input type="checkbox"/>	J-991	78.878	33:00	73.901	00:00	76.286	4.977
848	<input type="checkbox"/>	J-992	82.564	33:00	78.247	00:00	80.372	4.317
849	<input type="checkbox"/>	J-993	85.781	33:00	80.366	00:00	82.919	5.416
850	<input type="checkbox"/>	J-994	87.737	33:00	82.500	00:00	84.947	5.237

		ID	Max.Value (psi)	Max.Time (hrs.)	Min.Value (psi)	Min.Time (hrs.)	Average (psi)	Difference (psi)
851	<input type="checkbox"/>	J-995	63.938	67:00	58.521	32:00	61.666	5.417
852	<input type="checkbox"/>	J-999	96.465	33:00	88.858	30:00	92.940	7.608

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1	<input type="checkbox"/>	P-301	0.267	30:00	0.052	16:00	0.148	0.215
2	<input type="checkbox"/>	P-302	0.142	30:00	0.028	16:00	0.079	0.115
3	<input type="checkbox"/>	P-303	0.081	30:00	0.016	16:00	0.045	0.065
4	<input type="checkbox"/>	P-304	0.055	30:00	0.011	16:00	0.030	0.044
5	<input type="checkbox"/>	P-305	0.058	30:00	0.011	16:00	0.032	0.047
6	<input type="checkbox"/>	P-306	0.152	30:00	0.029	16:00	0.084	0.123
7	<input type="checkbox"/>	P-443	0.043	30:00	0.008	16:00	0.024	0.035
8	<input type="checkbox"/>	P-446	0.208	30:00	0.040	16:00	0.115	0.168
9	<input type="checkbox"/>	P-1325	0.034	30:00	0.007	16:00	0.019	0.027
10	<input type="checkbox"/>	P-1319	0.267	30:00	0.052	16:00	0.148	0.215
11	<input type="checkbox"/>	P-309A	0.465	30:00	0.090	16:00	0.258	0.375
12	<input type="checkbox"/>	P-1318A	0.393	30:00	0.076	16:00	0.218	0.317
13	<input type="checkbox"/>	P-3012	0.470	30:00	0.091	16:00	0.261	0.379
14	<input type="checkbox"/>	P-3013	0.399	30:00	0.077	16:00	0.221	0.322
15	<input type="checkbox"/>	P-445B	0.030	30:00	0.006	16:00	0.016	0.024
16	<input type="checkbox"/>	P-445A	0.138	30:00	0.027	16:00	0.077	0.111
17	<input type="checkbox"/>	P-1345A	0.110	30:00	0.021	16:00	0.061	0.089
18	<input type="checkbox"/>	P-1317A	0.041	30:00	0.008	16:00	0.023	0.033
19	<input type="checkbox"/>	P-1317B	0.089	30:00	0.017	16:00	0.049	0.072
20	<input type="checkbox"/>	P-1030	0.139	30:00	0.027	16:00	0.077	0.112
21	<input type="checkbox"/>	P-1354B	0.025	30:00	0.005	16:00	0.014	0.020
22	<input type="checkbox"/>	P-1354C	0.015	30:00	0.003	16:00	0.008	0.012
23	<input type="checkbox"/>	P-444A	0.076	30:00	0.015	16:00	0.042	0.061
24	<input type="checkbox"/>	P-444B	0.171	30:00	0.033	16:00	0.095	0.138
25	<input type="checkbox"/>	P-1043	0.050	30:00	0.010	16:00	0.028	0.041
26	<input type="checkbox"/>	P1744	0.399	30:00	0.077	16:00	0.221	0.322
27	<input type="checkbox"/>	P1746	2.716	10:00	0.027	42:00	1.703	2.689
28	<input type="checkbox"/>	P1758	0.470	30:00	0.091	16:00	0.261	0.379
29	<input type="checkbox"/>	P-277	1.250	30:00	0.552	15:00	0.911	0.697
30	<input type="checkbox"/>	P-278	0.856	00:00	0.362	67:00	0.622	0.494
31	<input type="checkbox"/>	P-280	0.415	35:00	0.040	68:00	0.229	0.374
32	<input type="checkbox"/>	P-281	0.306	35:00	0.120	18:00	0.215	0.185
33	<input type="checkbox"/>	P-282	0.520	35:00	0.208	18:00	0.368	0.312
34	<input type="checkbox"/>	P-283	0.340	35:00	0.051	68:00	0.195	0.289
35	<input type="checkbox"/>	P-284	0.146	35:00	0.049	68:00	0.098	0.097
36	<input type="checkbox"/>	P-286	0.222	68:00	0.004	51:00	0.072	0.217
37	<input type="checkbox"/>	P-289	0.549	30:00	0.024	16:00	0.286	0.525
38	<input type="checkbox"/>	P-292	1.224	30:00	0.009	16:00	0.645	1.214
39	<input type="checkbox"/>	P-293	0.868	30:00	0.022	16:00	0.431	0.846
40	<input type="checkbox"/>	P-294	1.148	30:00	0.029	16:00	0.581	1.119
41	<input type="checkbox"/>	P-295	0.749	35:00	0.069	68:00	0.411	0.679
42	<input type="checkbox"/>	P-297	1.237	30:00	0.028	16:00	0.583	1.208
43	<input type="checkbox"/>	P-298	1.093	30:00	0.047	16:00	0.516	1.046
44	<input type="checkbox"/>	P-299	2.775	30:00	0.098	16:00	1.450	2.677
45	<input type="checkbox"/>	P-330	1.448	30:00	0.597	65:00	1.021	0.852
46	<input type="checkbox"/>	P-420	0.826	37:00	0.218	68:00	0.441	0.607
47	<input type="checkbox"/>	P-424	0.371	30:00	0.093	16:00	0.209	0.278
48	<input type="checkbox"/>	P-427	0.272	37:00	0.107	34:00	0.159	0.165
49	<input type="checkbox"/>	P-442	0.521	35:00	0.000	62:00	0.257	0.521
50	<input type="checkbox"/>	P-460	0.127	38:00	0.025	08:00	0.072	0.102
51	<input type="checkbox"/>	P-461	0.231	30:00	0.064	35:00	0.142	0.167
52	<input type="checkbox"/>	P-462	0.297	30:00	0.022	35:00	0.147	0.275
53	<input type="checkbox"/>	P-463	0.107	30:00	0.001	16:00	0.058	0.106
54	<input type="checkbox"/>	P-464	0.829	30:00	0.390	13:00	0.543	0.440
55	<input type="checkbox"/>	P-465	1.007	30:00	0.436	15:00	0.641	0.571
56	<input type="checkbox"/>	P-487	0.484	35:00	0.001	68:00	0.298	0.482
57	<input type="checkbox"/>	P-510	1.633	28:00	0.111	59:00	1.046	1.522

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
58	<input type="checkbox"/>	P-512	1.761	35:00	0.068	59:00	0.791	1.693
59	<input type="checkbox"/>	P-545	0.270	68:00	0.003	45:00	0.071	0.268
60	<input type="checkbox"/>	P-547	0.355	68:00	0.002	09:00	0.129	0.353
61	<input type="checkbox"/>	P-548	0.313	68:00	0.001	72:00	0.066	0.312
62	<input type="checkbox"/>	P-549	0.072	25:00	0.002	27:00	0.026	0.070
63	<input type="checkbox"/>	P-550	0.397	68:00	0.000	31:00	0.113	0.396
64	<input type="checkbox"/>	P-551	0.584	35:00	0.007	58:00	0.225	0.577
65	<input type="checkbox"/>	P-552	0.260	30:00	0.003	16:00	0.139	0.256
66	<input type="checkbox"/>	P-568	0.408	30:00	0.150	10:00	0.274	0.258
67	<input type="checkbox"/>	P-569	0.241	00:00	0.105	10:00	0.181	0.136
68	<input type="checkbox"/>	P-571	0.171	30:00	0.002	16:00	0.075	0.168
69	<input type="checkbox"/>	P-572	0.149	68:00	0.000	32:00	0.040	0.149
70	<input type="checkbox"/>	P-573	0.194	35:00	0.018	68:00	0.094	0.176
71	<input type="checkbox"/>	P-574	0.529	30:00	0.108	16:00	0.291	0.421
72	<input type="checkbox"/>	P-575	0.337	30:00	0.033	16:00	0.196	0.304
73	<input type="checkbox"/>	P-580	2.897	03:00	0.011	18:00	1.231	2.887
74	<input type="checkbox"/>	P-604	0.693	61:00	0.396	67:00	0.528	0.297
75	<input type="checkbox"/>	P-629	3.771	35:00	0.162	68:00	2.252	3.609
76	<input type="checkbox"/>	P-635	6.517	35:00	3.910	12:00	5.481	2.607
77	<input type="checkbox"/>	P-637	6.405	35:00	3.501	68:00	5.198	2.904
78	<input type="checkbox"/>	P-640	3.260	35:00	0.000	21:00	1.227	3.259
79	<input type="checkbox"/>	P-642	3.700	35:00	0.009	27:00	1.282	3.692
80	<input type="checkbox"/>	P-649	0.281	35:00	0.035	68:00	0.180	0.246
81	<input type="checkbox"/>	P-650	0.299	35:00	0.100	68:00	0.221	0.199
82	<input type="checkbox"/>	P-668	4.173	35:00	1.528	68:00	3.026	2.645
83	<input type="checkbox"/>	P-671	0.852	68:00	0.008	57:00	0.360	0.843
84	<input type="checkbox"/>	P-686	5.423	00:00	1.708	38:00	3.730	3.715
85	<input type="checkbox"/>	P-689	5.893	00:00	1.644	03:00	4.230	4.249
86	<input type="checkbox"/>	P-704	2.795	01:00	0.089	18:00	1.571	2.706
87	<input type="checkbox"/>	P-706	1.235	68:00	0.014	40:00	0.533	1.221
88	<input type="checkbox"/>	P-716	0.463	35:00	0.045	37:00	0.231	0.418
89	<input type="checkbox"/>	P-717	0.397	35:00	0.002	62:00	0.147	0.395
90	<input type="checkbox"/>	P-740	3.868	30:00	0.145	16:00	1.963	3.723
91	<input type="checkbox"/>	P-741	4.851	30:00	0.162	16:00	2.426	4.689
92	<input type="checkbox"/>	P-745	1.983	16:00	0.022	68:00	1.135	1.961
93	<input type="checkbox"/>	P-747	2.192	16:00	0.218	10:00	1.320	1.974
94	<input type="checkbox"/>	P-769	0.471	68:00	0.001	06:00	0.117	0.470
95	<input type="checkbox"/>	P-789	0.256	68:00	0.004	62:00	0.106	0.252
96	<input type="checkbox"/>	P-791	0.781	30:00	0.485	12:00	0.660	0.296
97	<input type="checkbox"/>	P-792	0.269	35:00	0.010	22:00	0.125	0.259
98	<input type="checkbox"/>	P-793	0.330	35:00	0.162	12:00	0.251	0.168
99	<input type="checkbox"/>	P-794	0.120	35:00	0.052	14:00	0.079	0.068
100	<input type="checkbox"/>	P-889	0.106	35:00	0.004	45:00	0.041	0.101
101	<input type="checkbox"/>	P-890	0.140	61:00	0.083	67:00	0.109	0.057
102	<input type="checkbox"/>	P-891	3.673	35:00	0.026	45:00	1.809	3.647
103	<input type="checkbox"/>	P-893	0.291	30:00	0.130	16:00	0.193	0.161
104	<input type="checkbox"/>	P-897	0.331	30:00	0.155	16:00	0.246	0.176
105	<input type="checkbox"/>	P-898	0.457	35:00	0.210	68:00	0.350	0.247
106	<input type="checkbox"/>	P-899	0.440	35:00	0.152	68:00	0.314	0.288
107	<input type="checkbox"/>	P-636	6.130	35:00	3.487	68:00	5.030	2.643
108	<input type="checkbox"/>	P-900	0.265	35:00	0.071	68:00	0.179	0.194
109	<input type="checkbox"/>	P-901	0.377	30:00	0.218	16:00	0.306	0.159
110	<input type="checkbox"/>	P-902	0.343	35:00	0.000	53:00	0.140	0.343
111	<input type="checkbox"/>	P-906	0.449	30:00	0.197	13:00	0.287	0.251
112	<input type="checkbox"/>	P-908	0.210	30:00	0.123	67:00	0.165	0.087
113	<input type="checkbox"/>	P-909	1.110	30:00	0.611	13:00	0.823	0.498
114	<input type="checkbox"/>	P-910	1.447	30:00	0.724	13:00	1.007	0.723

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
115	<input type="checkbox"/>	P-911	0.225	30:00	0.037	16:00	0.122	0.188
116	<input type="checkbox"/>	P-947	0.304	30:00	0.039	16:00	0.168	0.265
117	<input type="checkbox"/>	P-963	0.371	30:00	0.025	16:00	0.192	0.346
118	<input type="checkbox"/>	P-964	0.802	30:00	0.005	58:00	0.368	0.797
119	<input type="checkbox"/>	P-969	0.124	38:00	0.023	10:00	0.071	0.101
120	<input type="checkbox"/>	P-970	0.302	54:00	0.055	16:00	0.197	0.248
121	<input type="checkbox"/>	P-971	0.341	30:00	0.143	10:00	0.255	0.198
122	<input type="checkbox"/>	P-972	0.227	35:00	0.022	68:00	0.128	0.205
123	<input type="checkbox"/>	P-975	0.283	35:00	0.057	44:00	0.166	0.226
124	<input type="checkbox"/>	P-976	0.111	50:00	0.001	67:00	0.045	0.110
125	<input type="checkbox"/>	P-977	0.172	68:00	0.005	47:00	0.071	0.168
126	<input type="checkbox"/>	P-978	0.280	30:00	0.014	65:00	0.141	0.266
127	<input type="checkbox"/>	P-979	0.177	54:00	0.001	64:00	0.082	0.177
128	<input type="checkbox"/>	P-981	0.379	30:00	0.109	10:00	0.227	0.270
129	<input type="checkbox"/>	P-983	0.130	38:00	0.003	00:00	0.057	0.127
130	<input type="checkbox"/>	P-986	0.171	55:00	0.005	22:00	0.086	0.166
131	<input type="checkbox"/>	P-1018	0.491	30:00	0.008	61:00	0.238	0.483
132	<input type="checkbox"/>	P-1041	0.219	30:00	0.111	37:00	0.171	0.108
133	<input type="checkbox"/>	P-1045	0.140	35:00	0.003	23:00	0.053	0.137
134	<input type="checkbox"/>	P-1057	1.932	16:00	0.001	51:00	0.743	1.931
135	<input type="checkbox"/>	P-1059	2.956	35:00	0.085	45:00	1.503	2.871
136	<input type="checkbox"/>	P-1173	0.133	30:00	0.026	16:00	0.074	0.107
137	<input type="checkbox"/>	P-1175	0.173	30:00	0.033	16:00	0.096	0.139
138	<input type="checkbox"/>	P-1176	0.030	30:00	0.006	16:00	0.017	0.024
139	<input type="checkbox"/>	P-1179	0.167	30:00	0.028	35:00	0.095	0.140
140	<input type="checkbox"/>	P-1180	3.554	35:00	0.009	18:00	1.318	3.544
141	<input type="checkbox"/>	P-1181	3.534	35:00	0.017	07:00	1.255	3.517
142	<input type="checkbox"/>	P-1182	0.301	30:00	0.005	35:00	0.168	0.295
143	<input type="checkbox"/>	P-1273	0.528	30:00	0.261	16:00	0.401	0.267
144	<input type="checkbox"/>	P-1274	4.657	35:00	2.019	68:00	3.529	2.637
145	<input type="checkbox"/>	P-1275	5.370	35:00	2.383	68:00	4.094	2.987
146	<input type="checkbox"/>	P-1281	6.401	35:00	0.071	17:00	2.308	6.331
147	<input type="checkbox"/>	P-1282	6.828	35:00	0.001	17:00	2.481	6.827
148	<input type="checkbox"/>	P-1283	0.427	35:00	0.006	54:00	0.185	0.421
149	<input type="checkbox"/>	P-1339	0.345	33:00	0.000	60:00	0.160	0.345
150	<input type="checkbox"/>	P-1340	3.481	03:00	0.111	17:00	1.578	3.370
151	<input type="checkbox"/>	P-1342	0.199	38:00	0.002	03:00	0.111	0.197
152	<input type="checkbox"/>	P-1343	0.166	68:00	0.002	03:00	0.066	0.164
153	<input type="checkbox"/>	P-1344	0.175	29:00	0.000	72:00	0.053	0.174
154	<input type="checkbox"/>	P-1355	0.139	35:00	0.021	68:00	0.088	0.118
155	<input type="checkbox"/>	P-1374	0.038	30:00	0.001	15:00	0.020	0.037
156	<input type="checkbox"/>	P-1377	0.424	30:00	0.061	16:00	0.232	0.363
157	<input type="checkbox"/>	P-1379	0.190	35:00	0.082	14:00	0.126	0.107
158	<input type="checkbox"/>	P-1380	7.086	33:00	4.356	12:00	6.029	2.730
159	<input type="checkbox"/>	P-1382	6.153	35:00	3.150	68:00	4.893	3.003
160	<input type="checkbox"/>	P-1384	0.965	35:00	0.457	68:00	0.744	0.508
161	<input type="checkbox"/>	P-1385	0.323	35:00	0.069	68:00	0.208	0.253
162	<input type="checkbox"/>	P-1389	0.141	10:00	0.002	12:00	0.072	0.139
163	<input type="checkbox"/>	P-1396	0.380	68:00	0.002	65:00	0.093	0.378
164	<input type="checkbox"/>	P-1397	0.263	22:00	0.109	03:00	0.197	0.153
165	<input type="checkbox"/>	P-1398	5.513	00:00	1.301	03:00	3.932	4.212
166	<input type="checkbox"/>	P-1183	0.454	61:00	0.218	12:00	0.295	0.237
167	<input type="checkbox"/>	P-1185	0.430	61:00	0.183	12:00	0.257	0.247
168	<input type="checkbox"/>	P-1184	0.400	61:00	0.124	45:00	0.211	0.277
169	<input type="checkbox"/>	P-1406	0.250	61:00	0.020	68:00	0.108	0.229
170	<input type="checkbox"/>	P-1408	3.464	35:00	0.001	22:00	1.564	3.463
171	<input type="checkbox"/>	P-1410	0.274	35:00	0.161	12:00	0.227	0.112



Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
172	<input type="checkbox"/>	P-1412	3.725	35:00	0.327	68:00	2.137	3.398
173	<input type="checkbox"/>	P-1417	0.200	30:00	0.002	41:00	0.098	0.198
174	<input type="checkbox"/>	P-1419	0.144	30:00	0.004	67:00	0.083	0.140
175	<input type="checkbox"/>	P-1420	3.655	68:00	0.010	50:00	1.214	3.644
176	<input type="checkbox"/>	P-1421	0.140	30:00	0.003	41:00	0.060	0.137
177	<input type="checkbox"/>	P-1431	0.772	30:00	0.146	16:00	0.426	0.625
178	<input type="checkbox"/>	P-1432	0.661	30:00	0.131	16:00	0.368	0.530
179	<input type="checkbox"/>	P-1462	2.700	35:00	0.022	22:00	1.068	2.678
180	<input type="checkbox"/>	P-1463	2.656	35:00	0.058	04:00	1.007	2.598
181	<input type="checkbox"/>	P-1464	2.744	35:00	0.038	04:00	1.022	2.706
182	<input type="checkbox"/>	P-1465	2.565	35:00	0.025	04:00	0.966	2.540
183	<input type="checkbox"/>	P-1466	0.128	35:00	0.002	04:00	0.048	0.125
184	<input type="checkbox"/>	P-1506	4.231	58:00	0.022	53:00	1.385	4.209
185	<input type="checkbox"/>	P-1507	3.760	03:00	0.007	17:00	1.633	3.753
186	<input type="checkbox"/>	P-1518	3.330	56:00	0.010	11:00	1.842	3.320
187	<input type="checkbox"/>	P-1519	3.308	56:00	0.021	11:00	1.831	3.287
188	<input type="checkbox"/>	P-1542	0.000	00:00	0.000	00:00	0.000	0.000
189	<input type="checkbox"/>	P-1543	0.031	30:00	0.006	16:00	0.017	0.025
190	<input type="checkbox"/>	P-40	0.000	00:00	0.000	00:00	0.000	0.000
191	<input type="checkbox"/>	P-71	0.000	00:00	0.000	00:00	0.000	0.000
192	<input type="checkbox"/>	P-1569	6.367	30:00	3.587	16:00	5.137	2.780
193	<input type="checkbox"/>	P-1568	5.133	30:00	2.928	16:00	4.166	2.205
194	<input type="checkbox"/>	P-139	12.090	00:00	5.101	68:00	8.693	6.990
195	<input type="checkbox"/>	P-141	1.448	30:00	0.597	65:00	1.021	0.852
196	<input type="checkbox"/>	P-142	12.090	00:00	5.101	68:00	8.693	6.990
197	<input type="checkbox"/>	P-179A	2.378	30:00	0.427	16:00	1.197	1.951
198	<input type="checkbox"/>	P-194	0.058	30:00	0.011	16:00	0.032	0.047
199	<input type="checkbox"/>	P-195	0.023	30:00	0.004	16:00	0.013	0.019
200	<input type="checkbox"/>	P-333	3.143	68:00	0.000	00:00	2.977	3.143
201	<input type="checkbox"/>	P-348	6.889	35:00	0.022	18:00	2.431	6.867
202	<input type="checkbox"/>	P-353	10.115	35:00	0.108	31:00	3.080	10.007
203	<input type="checkbox"/>	P-365	6.857	35:00	0.029	51:00	2.402	6.828
204	<input type="checkbox"/>	P-366	6.857	35:00	0.029	51:00	2.402	6.828
205	<input type="checkbox"/>	P-393	3.259	35:00	0.096	29:00	1.083	3.163
206	<input type="checkbox"/>	P-454	11.817	00:00	4.666	68:00	8.420	7.151
207	<input type="checkbox"/>	P-557	0.471	30:00	0.167	65:00	0.309	0.304
208	<input type="checkbox"/>	P-469	0.154	30:00	0.003	61:00	0.075	0.151
209	<input type="checkbox"/>	P-468	0.375	68:00	0.000	32:00	0.126	0.374
210	<input type="checkbox"/>	P-475	0.700	35:00	0.317	68:00	0.535	0.383
211	<input type="checkbox"/>	P-466	0.382	35:00	0.016	69:00	0.200	0.366
212	<input type="checkbox"/>	P-1409	0.248	30:00	0.118	16:00	0.190	0.130
213	<input type="checkbox"/>	P-1065	3.604	03:00	0.054	17:00	1.600	3.550
214	<input type="checkbox"/>	P-1327	0.264	68:00	0.000	24:00	0.098	0.264
215	<input type="checkbox"/>	P-1378	0.804	30:00	0.324	15:00	0.497	0.480
216	<input type="checkbox"/>	P-912	0.689	61:00	0.391	67:00	0.521	0.298
217	<input type="checkbox"/>	P-1415	0.289	37:00	0.000	24:00	0.101	0.289
218	<input type="checkbox"/>	P-419	0.017	30:00	0.003	16:00	0.009	0.014
219	<input type="checkbox"/>	P-1330	0.099	68:00	0.000	31:00	0.028	0.099
220	<input type="checkbox"/>	P-315	1.255	35:00	0.038	58:00	0.550	1.217
221	<input type="checkbox"/>	P-628	0.394	35:00	0.201	12:00	0.300	0.193
222	<input type="checkbox"/>	P-1277B	0.216	35:00	0.003	68:00	0.120	0.213
223	<input type="checkbox"/>	P-273	0.653	30:00	0.314	16:00	0.492	0.339
224	<input type="checkbox"/>	P-275	0.395	33:00	0.193	68:00	0.331	0.202
225	<input type="checkbox"/>	P-631	5.233	32:00	3.066	68:00	4.435	2.168
226	<input type="checkbox"/>	P-632	5.441	31:00	3.309	68:00	4.588	2.132
227	<input type="checkbox"/>	P-331	0.374	35:00	0.144	68:00	0.301	0.230
228	<input type="checkbox"/>	P-334	0.695	31:00	0.414	68:00	0.585	0.282

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
229	P-798	0.150	30:00	0.025	16:00	0.082	0.125
230	P-799	0.146	30:00	0.035	16:00	0.083	0.111
231	P-1174	0.274	30:00	0.053	16:00	0.152	0.221
232	P-1512	0.361	30:00	0.104	16:00	0.212	0.257
233	P-1513	0.094	30:00	0.002	16:00	0.047	0.092
234	P-1517	0.306	30:00	0.059	16:00	0.170	0.247
235	P-1530	0.264	61:00	0.001	29:00	0.110	0.263
236	P-1531	0.107	61:00	0.000	54:00	0.042	0.107
237	P-1535	0.143	61:00	0.001	50:00	0.056	0.142
238	P-1536	0.233	61:00	0.001	23:00	0.089	0.231
239	P-1527	0.230	61:00	0.005	22:00	0.106	0.225
240	P-1516	0.147	34:00	0.004	69:00	0.091	0.144
241	P-1509	0.118	61:00	0.005	59:00	0.047	0.113
242	P-1511	0.099	61:00	0.001	23:00	0.037	0.097
243	P-1521	0.047	35:00	0.000	71:00	0.017	0.047
244	P-1529	0.066	35:00	0.001	71:00	0.024	0.066
245	P-1532	0.097	35:00	0.000	69:00	0.036	0.097
246	P-431	0.064	30:00	0.012	16:00	0.035	0.051
247	P-948	0.612	30:00	0.079	16:00	0.338	0.533
248	P-1546	0.292	30:00	0.012	63:00	0.140	0.280
249	P-1403	0.040	30:00	0.005	16:00	0.022	0.036
250	P-1402	0.186	30:00	0.015	16:00	0.100	0.171
251	P-1549	0.223	30:00	0.025	16:00	0.121	0.198
252	P-239	5.483	00:00	1.839	38:00	3.809	3.644
253	P-234	5.071	00:00	1.483	38:00	3.449	3.588
254	P-675	4.816	00:00	1.281	38:00	3.229	3.535
255	P-1373	3.531	55:00	0.009	66:00	1.953	3.522
256	P-1375	3.363	56:00	0.036	19:00	1.864	3.326
257	P-176	11.785	00:00	4.615	68:00	8.388	7.170
258	P-669	1.143	68:00	0.008	13:00	0.493	1.135
259	P-2016	0.111	68:00	0.000	41:00	0.033	0.111
260	P-2017	0.135	35:00	0.002	60:00	0.044	0.133
261	P-197B	2.436	30:00	0.438	16:00	1.229	1.997
262	P-312A	2.067	27:00	0.122	58:00	1.321	1.945
263	P-312B	1.244	35:00	0.054	58:00	0.539	1.190
264	P-540	0.529	39:00	0.022	58:00	0.309	0.508
265	P-1329B	0.099	68:00	0.000	31:00	0.028	0.099
266	P-1329A	0.099	68:00	0.000	31:00	0.028	0.099
267	P-1323B	1.788	16:00	0.026	05:00	0.649	1.762
268	P-1323A	1.976	35:00	0.009	47:00	0.674	1.967
269	P-1324B	0.599	04:00	0.052	59:00	0.282	0.547
270	P-1017	0.291	03:00	0.017	58:00	0.149	0.274
271	P-1324A	0.458	04:00	0.042	59:00	0.150	0.416
272	P-317	0.508	04:00	0.064	15:00	0.194	0.444
273	P-1354D	0.000	00:00	0.000	00:00	0.000	0.000
274	P-1046	0.130	35:00	0.001	69:00	0.062	0.130
275	P-1277A	0.095	35:00	0.055	12:00	0.079	0.040
276	P-1381A	0.199	30:00	0.037	16:00	0.119	0.162
277	P-1381B	0.097	35:00	0.001	36:00	0.033	0.095
278	P-1381C	0.150	33:00	0.077	12:00	0.118	0.074
279	P-423B	0.156	35:00	0.063	68:00	0.119	0.093
280	P-423A	0.269	30:00	0.132	16:00	0.207	0.136
281	P-1510	0.541	30:00	0.115	16:00	0.304	0.426
282	P-1500	0.159	30:00	0.041	16:00	0.092	0.118
283	P-1411A	3.799	35:00	1.820	68:00	3.117	1.979
284	P-1411D	3.428	35:00	0.502	68:00	2.289	2.925
285	P-1411E	4.216	35:00	0.240	68:00	2.660	3.976

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
286	<input type="checkbox"/>	P-1411C	3.538	35:00	0.893	68:00	2.534	2.645
287	<input type="checkbox"/>	P-1411B	3.773	35:00	1.727	68:00	3.059	2.046
288	<input type="checkbox"/>	P-1123	1.687	30:00	0.796	15:00	1.139	0.891
289	<input type="checkbox"/>	P-1127	2.065	30:00	0.855	16:00	1.340	1.211
290	<input type="checkbox"/>	P-1136	0.231	30:00	0.021	16:00	0.120	0.210
291	<input type="checkbox"/>	FCV-4_U	5.134	35:00	0.441	68:00	3.244	4.693
292	<input type="checkbox"/>	FCV-4_D	5.134	35:00	0.441	68:00	3.244	4.693
293	<input type="checkbox"/>	P1542	10.264	68:00	0.007	03:00	2.704	10.258
294	<input type="checkbox"/>	P1554	6.918	03:00	0.011	39:00	2.188	6.907
295	<input type="checkbox"/>	P1574	0.426	30:00	0.007	38:00	0.203	0.420
296	<input type="checkbox"/>	P1576	0.004	30:00	0.001	16:00	0.002	0.003
297	<input type="checkbox"/>	P1582	0.000	00:00	0.000	00:00	0.000	0.000
298	<input type="checkbox"/>	P1588	0.000	00:00	0.000	00:00	0.000	0.000
299	<input type="checkbox"/>	P1592	11.771	00:00	4.593	68:00	8.374	7.178
300	<input type="checkbox"/>	P1616	4.371	32:00	2.611	68:00	3.702	1.760
301	<input type="checkbox"/>	P1618	1.087	30:00	0.631	16:00	0.889	0.456
302	<input type="checkbox"/>	P1620	0.337	33:00	0.202	68:00	0.286	0.135
303	<input type="checkbox"/>	P1622	0.356	35:00	0.087	68:00	0.230	0.269
304	<input type="checkbox"/>	P1624	0.239	33:00	0.127	12:00	0.192	0.112
305	<input type="checkbox"/>	P1630	0.207	68:00	0.000	16:00	0.078	0.207
306	<input type="checkbox"/>	P1632	0.373	68:00	0.002	71:00	0.121	0.371
307	<input type="checkbox"/>	P1640	0.066	68:00	0.001	25:00	0.024	0.065
308	<input type="checkbox"/>	P1658	0.205	35:00	0.002	54:00	0.071	0.204
309	<input type="checkbox"/>	P1660	2.792	35:00	0.062	22:00	1.061	2.730
310	<input type="checkbox"/>	P1662	0.257	34:00	0.003	44:00	0.129	0.255
311	<input type="checkbox"/>	P1664	0.274	68:00	0.001	59:00	0.087	0.273
312	<input type="checkbox"/>	P1666	0.336	35:00	0.011	13:00	0.137	0.326
313	<input type="checkbox"/>	P1668	0.291	03:00	0.017	58:00	0.149	0.274
314	<input type="checkbox"/>	P1670	1.860	16:00	0.010	04:00	0.812	1.849
315	<input type="checkbox"/>	P1672	0.366	30:00	0.132	10:00	0.251	0.234
316	<input type="checkbox"/>	P1674	0.203	35:00	0.030	03:00	0.107	0.173
317	<input type="checkbox"/>	P1692	0.297	35:00	0.004	68:00	0.200	0.294
318	<input type="checkbox"/>	P1694	3.494	35:00	0.317	45:00	1.916	3.177
319	<input type="checkbox"/>	P1696	0.895	35:00	0.117	68:00	0.609	0.778
320	<input type="checkbox"/>	P1712	0.068	61:00	0.000	29:00	0.028	0.067
321	<input type="checkbox"/>	P1714	0.196	61:00	0.000	29:00	0.082	0.196
322	<input type="checkbox"/>	P1748	1.244	35:00	0.054	58:00	0.538	1.189
323	<input type="checkbox"/>	P1820	0.207	68:00	0.000	16:00	0.078	0.207
324	<input type="checkbox"/>	P1828	11.785	00:00	4.615	68:00	8.388	7.170
325	<input type="checkbox"/>	P2180	3.258	35:00	0.095	29:00	1.083	3.164
326	<input type="checkbox"/>	P2182	6.225	35:00	0.111	20:00	1.805	6.114
327	<input type="checkbox"/>	P-200	0.022	29:00	0.001	16:00	0.012	0.020
328	<input type="checkbox"/>	P-201	0.028	29:00	0.002	16:00	0.015	0.027
329	<input type="checkbox"/>	P-202	0.059	29:00	0.004	16:00	0.032	0.056
330	<input type="checkbox"/>	P-203	0.035	29:00	0.002	16:00	0.019	0.033
331	<input type="checkbox"/>	P-204	0.009	29:00	0.001	16:00	0.005	0.008
332	<input type="checkbox"/>	P-206	0.010	29:00	0.001	16:00	0.005	0.009
333	<input type="checkbox"/>	P-210	0.079	29:00	0.031	16:00	0.048	0.048
334	<input type="checkbox"/>	P-211	0.129	29:00	0.034	16:00	0.075	0.095
335	<input type="checkbox"/>	P-212	0.093	17:00	0.038	31:00	0.056	0.055
336	<input type="checkbox"/>	P-213	0.136	29:00	0.001	65:00	0.068	0.135
337	<input type="checkbox"/>	P-214	0.145	17:00	0.071	56:00	0.095	0.075
338	<input type="checkbox"/>	P-215	0.098	16:00	0.026	31:00	0.052	0.072
339	<input type="checkbox"/>	P-216	0.039	16:00	0.005	31:00	0.018	0.034
340	<input type="checkbox"/>	P-217	0.055	29:00	0.039	24:00	0.044	0.016
341	<input type="checkbox"/>	P-218	0.068	17:00	0.044	04:00	0.051	0.024
342	<input type="checkbox"/>	P-219	0.179	30:00	0.000	58:00	0.077	0.179

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
343	<input type="checkbox"/>	P-221	0.148	29:00	0.002	64:00	0.070	0.145
344	<input type="checkbox"/>	P-223	0.116	29:00	0.046	16:00	0.074	0.070
345	<input type="checkbox"/>	P-225	0.169	29:00	0.106	16:00	0.126	0.063
346	<input type="checkbox"/>	P-228	0.125	17:00	0.000	22:00	0.037	0.124
347	<input type="checkbox"/>	P-229	0.124	17:00	0.002	08:00	0.040	0.122
348	<input type="checkbox"/>	P-230	0.467	17:00	0.002	03:00	0.144	0.465
349	<input type="checkbox"/>	P-231	0.072	17:00	0.003	33:00	0.030	0.069
350	<input type="checkbox"/>	P-232	0.067	30:00	0.000	33:00	0.021	0.067
351	<input type="checkbox"/>	P-235	0.194	16:00	0.001	31:00	0.080	0.192
352	<input type="checkbox"/>	P-236	0.081	17:00	0.000	46:00	0.030	0.081
353	<input type="checkbox"/>	P-238	0.116	30:00	0.002	37:00	0.042	0.114
354	<input type="checkbox"/>	P-240	0.365	16:00	0.019	69:00	0.197	0.346
355	<input type="checkbox"/>	P-241	0.172	16:00	0.003	29:00	0.096	0.168
356	<input type="checkbox"/>	P-242	0.173	16:00	0.018	30:00	0.109	0.155
357	<input type="checkbox"/>	P-245	0.216	16:00	0.078	30:00	0.163	0.138
358	<input type="checkbox"/>	P-247	0.165	16:00	0.011	30:00	0.099	0.154
359	<input type="checkbox"/>	P-249	0.302	16:00	0.003	29:00	0.168	0.299
360	<input type="checkbox"/>	P-250	0.100	30:00	0.000	38:00	0.037	0.099
361	<input type="checkbox"/>	P-251	0.140	17:00	0.032	31:00	0.087	0.108
362	<input type="checkbox"/>	P-253	0.195	16:00	0.015	69:00	0.112	0.181
363	<input type="checkbox"/>	P-257	0.252	16:00	0.007	21:00	0.100	0.245
364	<input type="checkbox"/>	P-258	0.189	16:00	0.000	03:00	0.058	0.189
365	<input type="checkbox"/>	P-260	0.158	16:00	0.007	23:00	0.042	0.151
366	<input type="checkbox"/>	P-262	0.218	17:00	0.006	39:00	0.067	0.212
367	<input type="checkbox"/>	P-267	0.052	17:00	0.039	30:00	0.049	0.014
368	<input type="checkbox"/>	P-318	0.042	17:00	0.001	65:00	0.010	0.041
369	<input type="checkbox"/>	P-448	0.948	29:00	0.059	16:00	0.513	0.889
370	<input type="checkbox"/>	P-449	0.379	29:00	0.024	16:00	0.205	0.355
371	<input type="checkbox"/>	P-450	0.479	29:00	0.030	16:00	0.260	0.449
372	<input type="checkbox"/>	P-451	0.803	29:00	0.050	16:00	0.435	0.752
373	<input type="checkbox"/>	P-499	0.672	16:00	0.007	26:00	0.193	0.664
374	<input type="checkbox"/>	P-500	0.429	17:00	0.002	11:00	0.127	0.427
375	<input type="checkbox"/>	P-502	0.330	30:00	0.034	65:00	0.144	0.296
376	<input type="checkbox"/>	P-723	0.341	16:00	0.004	25:00	0.143	0.337
377	<input type="checkbox"/>	P-724	0.347	17:00	0.009	54:00	0.171	0.338
378	<input type="checkbox"/>	P-726	0.654	16:00	0.065	30:00	0.387	0.589
379	<input type="checkbox"/>	P-727	0.352	16:00	0.081	30:00	0.221	0.271
380	<input type="checkbox"/>	P-728	0.547	16:00	0.060	30:00	0.337	0.487
381	<input type="checkbox"/>	P-729	0.942	16:00	0.249	30:00	0.659	0.693
382	<input type="checkbox"/>	P-730	0.460	30:00	0.003	44:00	0.194	0.457
383	<input type="checkbox"/>	P-731	0.375	17:00	0.015	57:00	0.143	0.361
384	<input type="checkbox"/>	P-732	0.509	30:00	0.000	01:00	0.202	0.509
385	<input type="checkbox"/>	P-733	0.494	30:00	0.017	43:00	0.199	0.477
386	<input type="checkbox"/>	P-734	0.532	30:00	0.018	01:00	0.214	0.515
387	<input type="checkbox"/>	P-735	0.959	30:00	0.006	57:00	0.392	0.953
388	<input type="checkbox"/>	P-736	0.211	17:00	0.002	39:00	0.066	0.209
389	<input type="checkbox"/>	P-737	0.138	30:00	0.002	59:00	0.050	0.136
390	<input type="checkbox"/>	P-761	0.704	30:00	0.039	16:00	0.376	0.664
391	<input type="checkbox"/>	P-763	0.242	29:00	0.017	16:00	0.133	0.225
392	<input type="checkbox"/>	P-841	0.186	16:00	0.004	45:00	0.078	0.181
393	<input type="checkbox"/>	P-842	0.150	16:00	0.002	56:00	0.063	0.148
394	<input type="checkbox"/>	P-845	0.094	16:00	0.042	30:00	0.076	0.053
395	<input type="checkbox"/>	P-846	0.092	16:00	0.008	30:00	0.058	0.084
396	<input type="checkbox"/>	P-847	0.075	30:00	0.005	66:00	0.030	0.069
397	<input type="checkbox"/>	P-848	0.112	31:00	0.002	09:00	0.038	0.109
398	<input type="checkbox"/>	P-859	0.140	16:00	0.003	02:00	0.067	0.138
399	<input type="checkbox"/>	P-860	0.045	29:00	0.000	68:00	0.017	0.044

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
400	P-999	0.088	64:00	0.046	30:00	0.076	0.042
401	P-1001	0.174	16:00	0.019	30:00	0.111	0.156
402	P-1027	0.293	17:00	0.013	25:00	0.099	0.280
403	P-1029	0.374	30:00	0.004	64:00	0.140	0.370
404	P-1037	0.084	16:00	0.004	29:00	0.048	0.080
405	P-1038	1.217	16:00	0.406	30:00	0.898	0.811
406	P-1039	1.310	16:00	0.518	30:00	1.006	0.792
407	P-1128	0.030	29:00	0.002	16:00	0.016	0.028
408	P-1129	0.016	29:00	0.001	16:00	0.009	0.015
409	P-1130	0.006	29:00	0.000	16:00	0.003	0.005
410	P-1131	0.293	16:00	0.000	17:00	0.103	0.292
411	P-1132	0.599	17:00	0.002	06:00	0.181	0.598
412	P-1133	0.506	17:00	0.005	70:00	0.145	0.501
413	P-1134	0.139	16:00	0.006	22:00	0.061	0.133
414	P-1135	0.140	16:00	0.005	23:00	0.061	0.135
415	P-1270	0.100	29:00	0.006	16:00	0.054	0.095
416	P-1301	0.174	16:00	0.043	30:00	0.122	0.131
417	P-1308	0.802	30:00	0.045	16:00	0.429	0.757
418	P-1309	0.000	00:00	0.000	00:00	0.000	0.000
419	P-1400	0.316	30:00	0.078	12:00	0.169	0.238
420	P-1401	0.216	30:00	0.020	16:00	0.107	0.197
421	P-1433	0.047	17:00	0.000	23:00	0.015	0.046
422	P-1434	0.139	16:00	0.010	30:00	0.087	0.130
423	P-1435	0.138	16:00	0.002	29:00	0.078	0.137
424	P-1453	0.125	17:00	0.007	16:00	0.055	0.118
425	P-1454	0.353	16:00	0.005	29:00	0.198	0.348
426	P-186	0.612	30:00	0.007	12:00	0.228	0.604
427	P-227	0.052	29:00	0.003	16:00	0.028	0.049
428	P-440	2.737	30:00	0.058	11:00	1.010	2.680
429	P-441	2.012	30:00	0.048	36:00	0.720	1.964
430	P-452	0.570	30:00	0.131	40:00	0.296	0.439
431	P-244	0.087	16:00	0.002	52:00	0.022	0.086
432	P-1075	0.153	16:00	0.004	27:00	0.056	0.149
433	P-187A	0.843	30:00	0.048	16:00	0.451	0.795
434	P-187B	0.831	30:00	0.047	16:00	0.444	0.784
435	P-1080	0.000	00:00	0.000	00:00	0.000	0.000
436	P-1026B	0.232	17:00	0.011	05:00	0.077	0.221
437	P-1026A	0.228	17:00	0.010	25:00	0.078	0.219
438	P-1144	0.244	30:00	0.012	16:00	0.127	0.232
439	P-1147	0.044	30:00	0.000	16:00	0.019	0.044
440	BROADWAY_PRV_D	1.401	16:00	0.620	30:00	1.113	0.781
441	PRV-3_D	4.279	30:00	0.000	40:00	1.678	4.279
442	P1550	1.069	16:00	0.008	49:00	0.292	1.062
443	P1568	0.000	00:00	0.000	00:00	0.000	0.000
444	P1604	0.168	16:00	0.001	45:00	0.073	0.168
445	P-237	0.010	29:00	0.001	16:00	0.005	0.009
446	P-322	0.947	29:00	0.293	16:00	0.637	0.654
447	P-324	0.570	29:00	0.150	16:00	0.384	0.420
448	P-325	0.332	30:00	0.003	64:00	0.139	0.329
449	P-326	0.410	29:00	0.100	16:00	0.268	0.311
450	P-327	0.038	29:00	0.011	16:00	0.026	0.027
451	P-328	0.369	29:00	0.086	16:00	0.239	0.283
452	P-337	0.541	30:00	0.067	16:00	0.298	0.474
453	P-338	0.768	30:00	0.088	16:00	0.422	0.680
454	P-339	0.749	33:00	0.034	62:00	0.253	0.715
455	P-342	0.216	00:00	0.000	65:00	0.078	0.216
456	P-343	0.133	30:00	0.005	39:00	0.076	0.128

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
457	<input type="checkbox"/>	P-344	0.956	33:00	0.002	17:00	0.423	0.954
458	<input type="checkbox"/>	P-347	0.367	00:00	0.001	34:00	0.079	0.366
459	<input type="checkbox"/>	P-349	1.614	33:00	0.010	67:00	0.733	1.604
460	<input type="checkbox"/>	P-352	0.902	69:00	0.063	33:00	0.450	0.838
461	<input type="checkbox"/>	P-354	0.690	29:00	0.030	33:00	0.342	0.660
462	<input type="checkbox"/>	P-355	0.483	69:00	0.005	57:00	0.226	0.479
463	<input type="checkbox"/>	P-356	0.261	29:00	0.060	65:00	0.160	0.201
464	<input type="checkbox"/>	P-359	0.927	30:00	0.002	16:00	0.397	0.925
465	<input type="checkbox"/>	P-360	0.906	30:00	0.134	16:00	0.503	0.772
466	<input type="checkbox"/>	P-361	0.403	33:00	0.001	67:00	0.121	0.402
467	<input type="checkbox"/>	P-362	0.392	33:00	0.000	45:00	0.112	0.392
468	<input type="checkbox"/>	P-363	1.219	30:00	0.133	16:00	0.666	1.087
469	<input type="checkbox"/>	P-364	1.136	30:00	0.114	16:00	0.617	1.022
470	<input type="checkbox"/>	P-367	0.123	53:00	0.012	16:00	0.073	0.111
471	<input type="checkbox"/>	P-370	1.015	30:00	0.157	16:00	0.565	0.858
472	<input type="checkbox"/>	P-371	0.882	29:00	0.179	66:00	0.536	0.703
473	<input type="checkbox"/>	P-372	0.357	33:00	0.001	66:00	0.134	0.355
474	<input type="checkbox"/>	P-373	0.904	30:00	0.098	16:00	0.481	0.806
475	<input type="checkbox"/>	P-374	1.128	69:00	0.027	11:00	0.475	1.101
476	<input type="checkbox"/>	P-375	0.650	69:00	0.002	50:00	0.246	0.648
477	<input type="checkbox"/>	P-376	0.413	69:00	0.000	40:00	0.125	0.413
478	<input type="checkbox"/>	P-377	0.506	33:00	0.004	45:00	0.143	0.502
479	<input type="checkbox"/>	P-378	0.782	33:00	0.015	17:00	0.333	0.767
480	<input type="checkbox"/>	P-380	0.621	29:00	0.129	16:00	0.367	0.493
481	<input type="checkbox"/>	P-381	0.776	29:00	0.007	33:00	0.380	0.769
482	<input type="checkbox"/>	P-382	0.448	69:00	0.004	65:00	0.188	0.445
483	<input type="checkbox"/>	P-383	0.352	33:00	0.001	34:00	0.093	0.352
484	<input type="checkbox"/>	P-384	0.369	33:00	0.001	61:00	0.114	0.368
485	<input type="checkbox"/>	P-385	0.516	29:00	0.083	16:00	0.313	0.434
486	<input type="checkbox"/>	P-386	0.471	69:00	0.021	33:00	0.237	0.450
487	<input type="checkbox"/>	P-387	0.289	29:00	0.001	16:00	0.151	0.289
488	<input type="checkbox"/>	P-388	0.265	29:00	0.021	16:00	0.146	0.245
489	<input type="checkbox"/>	P-389	0.381	29:00	0.066	16:00	0.219	0.314
490	<input type="checkbox"/>	P-391	0.592	29:00	0.039	16:00	0.316	0.553
491	<input type="checkbox"/>	P-394	0.042	33:00	0.005	66:00	0.022	0.037
492	<input type="checkbox"/>	P-395	0.713	29:00	0.056	16:00	0.380	0.657
493	<input type="checkbox"/>	P-396	0.464	29:00	0.031	16:00	0.247	0.433
494	<input type="checkbox"/>	P-397	0.675	29:00	0.073	16:00	0.365	0.602
495	<input type="checkbox"/>	P-398	0.530	29:00	0.016	16:00	0.284	0.514
496	<input type="checkbox"/>	P-399	0.857	29:00	0.066	16:00	0.464	0.791
497	<input type="checkbox"/>	P-400	1.314	29:00	0.095	16:00	0.701	1.219
498	<input type="checkbox"/>	P-402	0.486	29:00	0.059	16:00	0.292	0.427
499	<input type="checkbox"/>	P-403	0.239	29:00	0.001	16:00	0.120	0.237
500	<input type="checkbox"/>	P-404	0.303	69:00	0.005	64:00	0.137	0.298
501	<input type="checkbox"/>	P-406	0.603	29:00	0.083	16:00	0.331	0.521
502	<input type="checkbox"/>	P-408	0.665	29:00	0.026	16:00	0.344	0.639
503	<input type="checkbox"/>	P-409	0.198	29:00	0.005	64:00	0.097	0.193
504	<input type="checkbox"/>	P-415	0.182	29:00	0.015	16:00	0.100	0.168
505	<input type="checkbox"/>	P-425	0.000	00:00	0.000	00:00	0.000	0.000
506	<input type="checkbox"/>	P-426	0.041	29:00	0.002	16:00	0.022	0.039
507	<input type="checkbox"/>	P-435	1.565	30:00	0.183	16:00	0.877	1.382
508	<input type="checkbox"/>	P-437	0.964	29:00	0.186	66:00	0.585	0.778
509	<input type="checkbox"/>	P-447	0.756	29:00	0.170	66:00	0.467	0.587
510	<input type="checkbox"/>	P-482	1.022	16:00	0.203	00:00	0.891	0.820
511	<input type="checkbox"/>	P-483	1.006	16:00	0.249	00:00	0.846	0.757
512	<input type="checkbox"/>	P-484	1.129	16:00	0.418	30:00	0.830	0.712
513	<input type="checkbox"/>	P-485	0.387	16:00	0.152	00:00	0.290	0.235

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
514	<input type="checkbox"/>	P-488	0.020	29:00	0.002	16:00	0.011	0.018
515	<input type="checkbox"/>	P-493	0.464	00:00	0.002	50:00	0.117	0.463
516	<input type="checkbox"/>	P-494	0.660	29:00	0.109	16:00	0.400	0.551
517	<input type="checkbox"/>	P-497	0.456	69:00	0.002	39:00	0.213	0.454
518	<input type="checkbox"/>	P-503	1.063	29:00	0.361	16:00	0.731	0.702
519	<input type="checkbox"/>	P-505	1.810	29:00	0.626	16:00	1.253	1.184
520	<input type="checkbox"/>	P-506	1.441	29:00	0.445	16:00	0.976	0.996
521	<input type="checkbox"/>	P-507	0.003	29:00	0.000	65:00	0.002	0.003
522	<input type="checkbox"/>	P-508	0.143	29:00	0.009	16:00	0.077	0.134
523	<input type="checkbox"/>	P-513	0.111	29:00	0.010	00:00	0.057	0.101
524	<input type="checkbox"/>	P-514	0.000	00:00	0.000	00:00	0.000	0.000
525	<input type="checkbox"/>	P-522	0.018	66:00	0.001	55:00	0.011	0.017
526	<input type="checkbox"/>	P-523	0.094	29:00	0.023	16:00	0.062	0.071
527	<input type="checkbox"/>	P-524	0.012	69:00	0.002	65:00	0.009	0.010
528	<input type="checkbox"/>	P-526	0.215	29:00	0.054	16:00	0.137	0.162
529	<input type="checkbox"/>	P-528	0.184	29:00	0.001	16:00	0.100	0.183
530	<input type="checkbox"/>	P-563	0.101	29:00	0.002	16:00	0.052	0.099
531	<input type="checkbox"/>	P-564	0.390	33:00	0.016	17:00	0.219	0.375
532	<input type="checkbox"/>	P-565	0.479	33:00	0.035	17:00	0.282	0.445
533	<input type="checkbox"/>	P-566	0.849	29:00	0.052	16:00	0.452	0.797
534	<input type="checkbox"/>	P-584	8.469	33:00	0.341	17:00	4.648	8.128
535	<input type="checkbox"/>	P-585	8.862	33:00	0.056	17:00	5.007	8.806
536	<input type="checkbox"/>	P-599	2.946	00:00	0.003	58:00	0.918	2.943
537	<input type="checkbox"/>	P-600	2.701	00:00	0.006	35:00	0.943	2.695
538	<input type="checkbox"/>	P-601	2.257	00:00	0.001	34:00	0.536	2.256
539	<input type="checkbox"/>	P-602	0.624	33:00	0.003	13:00	0.141	0.621
540	<input type="checkbox"/>	P-1512A	0.791	69:00	0.008	11:00	0.308	0.782
541	<input type="checkbox"/>	P-612	1.025	69:00	0.009	39:00	0.446	1.016
542	<input type="checkbox"/>	P-613	1.233	69:00	0.049	39:00	0.572	1.184
543	<input type="checkbox"/>	P-614	6.878	33:00	0.021	59:00	1.781	6.857
544	<input type="checkbox"/>	P-615	6.597	33:00	0.052	59:00	1.742	6.546
545	<input type="checkbox"/>	P-617	3.892	29:00	0.065	16:00	2.022	3.827
546	<input type="checkbox"/>	P-622	5.228	33:00	0.080	62:00	1.930	5.148
547	<input type="checkbox"/>	P-654	0.843	33:00	0.163	17:00	0.511	0.680
548	<input type="checkbox"/>	P-661	0.371	33:00	0.002	59:00	0.112	0.369
549	<input type="checkbox"/>	P-662	0.382	33:00	0.005	52:00	0.116	0.377
550	<input type="checkbox"/>	P-663	0.412	33:00	0.004	06:00	0.136	0.408
551	<input type="checkbox"/>	P-749	0.477	29:00	0.103	16:00	0.304	0.374
552	<input type="checkbox"/>	P-750	0.908	29:00	0.196	16:00	0.578	0.713
553	<input type="checkbox"/>	P-751	1.565	29:00	0.351	16:00	1.008	1.214
554	<input type="checkbox"/>	P-752	2.491	29:00	0.476	16:00	1.552	2.015
555	<input type="checkbox"/>	P-753	3.666	29:00	0.782	16:00	2.312	2.884
556	<input type="checkbox"/>	P-755	0.240	29:00	0.053	16:00	0.153	0.187
557	<input type="checkbox"/>	P-756	0.469	29:00	0.103	16:00	0.300	0.367
558	<input type="checkbox"/>	P-764	2.113	30:00	0.311	66:00	1.269	1.803
559	<input type="checkbox"/>	P-765	2.975	33:00	0.153	17:00	1.820	2.822
560	<input type="checkbox"/>	P-766	2.552	33:00	0.001	17:00	1.483	2.551
561	<input type="checkbox"/>	P-767	2.608	33:00	0.124	66:00	1.394	2.484
562	<input type="checkbox"/>	P-768	0.534	31:00	0.004	17:00	0.316	0.530
563	<input type="checkbox"/>	P-774	0.012	33:00	0.000	49:00	0.003	0.012
564	<input type="checkbox"/>	P-782	0.221	29:00	0.018	16:00	0.120	0.203
565	<input type="checkbox"/>	P-783	0.137	29:00	0.013	16:00	0.074	0.124
566	<input type="checkbox"/>	P-784	0.009	33:00	0.000	12:00	0.002	0.009
567	<input type="checkbox"/>	P-785	0.100	29:00	0.001	16:00	0.054	0.100
568	<input type="checkbox"/>	P-801	0.279	33:00	0.004	61:00	0.096	0.275
569	<input type="checkbox"/>	P-802	0.190	29:00	0.012	16:00	0.103	0.179
570	<input type="checkbox"/>	P-803	0.184	29:00	0.011	16:00	0.099	0.174

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
571	P-808	0.215	29:00	0.022	16:00	0.117	0.194
572	P-809	0.084	29:00	0.014	16:00	0.046	0.070
573	P-812	0.043	29:00	0.008	16:00	0.025	0.035
574	P-813	0.000	00:00	0.000	00:00	0.000	0.000
575	P-814	0.402	29:00	0.057	16:00	0.223	0.345
576	P-815	0.265	29:00	0.000	16:00	0.143	0.265
577	P-816	0.199	29:00	0.013	16:00	0.110	0.186
578	P-818	0.018	30:00	0.000	40:00	0.008	0.018
579	P-821	0.152	29:00	0.006	16:00	0.083	0.146
580	P-827	0.157	29:00	0.004	16:00	0.084	0.152
581	P-830	0.307	33:00	0.001	37:00	0.091	0.306
582	P-832	0.119	33:00	0.001	01:00	0.055	0.118
583	P-833	0.316	33:00	0.027	17:00	0.186	0.289
584	P-834	0.260	33:00	0.005	67:00	0.110	0.255
585	P-835	0.386	33:00	0.029	17:00	0.235	0.356
586	P-838	1.013	30:00	0.130	16:00	0.529	0.883
587	P-840	0.588	30:00	0.064	16:00	0.294	0.524
588	P-849	0.054	69:00	0.000	56:00	0.020	0.054
589	P-850	0.079	69:00	0.001	65:00	0.033	0.079
590	P-854	0.916	29:00	0.077	16:00	0.503	0.839
591	P-855	0.868	30:00	0.117	16:00	0.495	0.751
592	P-862	1.405	16:00	0.683	30:00	1.147	0.722
593	P-864	0.030	29:00	0.012	16:00	0.020	0.018
594	P-865	0.100	29:00	0.031	16:00	0.068	0.069
595	P-866	0.129	30:00	0.002	43:00	0.049	0.127
596	P-868	3.005	29:00	0.574	16:00	1.855	2.431
597	P-869	0.303	29:00	0.056	16:00	0.186	0.247
598	P-870	0.507	29:00	0.125	16:00	0.324	0.382
599	P-871	0.456	29:00	0.122	16:00	0.297	0.334
600	P-872	0.514	69:00	0.005	57:00	0.248	0.509
601	P-873	3.643	29:00	0.781	16:00	2.300	2.862
602	P-874	1.262	29:00	0.477	16:00	0.894	0.785
603	P-875	0.750	29:00	0.665	16:00	0.706	0.086
604	P-876	0.893	33:00	0.749	69:00	0.821	0.144
605	P-879	0.442	00:00	0.193	30:00	0.316	0.248
606	P-880	0.877	29:00	0.188	16:00	0.537	0.689
607	P-885	2.403	33:00	0.025	00:00	1.356	2.378
608	P-886	0.118	29:00	0.007	16:00	0.064	0.111
609	P-887	0.083	29:00	0.005	16:00	0.045	0.078
610	P-888	0.204	29:00	0.012	16:00	0.110	0.192
611	P-913	0.361	00:00	0.004	32:00	0.084	0.357
612	P-916	0.279	33:00	0.029	17:00	0.141	0.249
613	P-917	0.116	33:00	0.017	66:00	0.054	0.098
614	P-919	0.289	33:00	0.001	66:00	0.108	0.288
615	P-920	0.318	33:00	0.041	17:00	0.183	0.277
616	P-921	1.301	33:00	0.205	66:00	0.779	1.096
617	P-923	0.174	53:00	0.019	16:00	0.098	0.154
618	P-924	0.260	30:00	0.056	00:00	0.167	0.204
619	P-927	0.248	33:00	0.026	00:00	0.153	0.222
620	P-928	0.090	30:00	0.018	16:00	0.052	0.072
621	P-929	0.065	29:00	0.001	64:00	0.031	0.064
622	P-930	0.267	00:00	0.001	52:00	0.066	0.266
623	P-931	0.201	33:00	0.035	66:00	0.107	0.166
624	P-932	0.136	33:00	0.006	21:00	0.051	0.129
625	P-933	0.186	30:00	0.042	00:00	0.109	0.144
626	P-937	0.243	29:00	0.020	16:00	0.122	0.223
627	P-935	0.215	69:00	0.002	09:00	0.073	0.214



Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
628	<input type="checkbox"/>	P-936	0.259	33:00	0.002	67:00	0.097	0.258
629	<input type="checkbox"/>	P-938	0.343	33:00	0.039	00:00	0.215	0.305
630	<input type="checkbox"/>	P-940	0.331	33:00	0.004	01:00	0.148	0.327
631	<input type="checkbox"/>	P-941	0.569	30:00	0.031	00:00	0.332	0.539
632	<input type="checkbox"/>	P-944	0.125	29:00	0.011	00:00	0.071	0.115
633	<input type="checkbox"/>	P-945	0.362	29:00	0.056	16:00	0.203	0.306
634	<input type="checkbox"/>	P-949	0.259	29:00	0.030	16:00	0.142	0.229
635	<input type="checkbox"/>	P-953	0.059	33:00	0.004	00:00	0.029	0.056
636	<input type="checkbox"/>	P-956	0.039	29:00	0.003	16:00	0.020	0.037
637	<input type="checkbox"/>	P-959	0.052	29:00	0.003	16:00	0.027	0.048
638	<input type="checkbox"/>	P-993	1.145	00:00	0.010	32:00	0.262	1.135
639	<input type="checkbox"/>	P-994	0.282	30:00	0.011	16:00	0.154	0.271
640	<input type="checkbox"/>	P-995	0.253	33:00	0.017	17:00	0.114	0.235
641	<input type="checkbox"/>	P-996	0.465	29:00	0.022	16:00	0.238	0.443
642	<input type="checkbox"/>	P-997	1.003	29:00	0.081	16:00	0.564	0.922
643	<input type="checkbox"/>	P-998	0.428	30:00	0.092	00:00	0.265	0.336
644	<input type="checkbox"/>	P-1002	0.069	69:00	0.008	16:00	0.035	0.061
645	<input type="checkbox"/>	P-823	8.536	00:00	0.084	38:00	1.522	8.453
646	<input type="checkbox"/>	P-824	0.430	29:00	0.007	16:00	0.237	0.424
647	<input type="checkbox"/>	P-595	8.121	00:00	0.036	30:00	1.564	8.085
648	<input type="checkbox"/>	P-1003	0.107	30:00	0.013	16:00	0.059	0.094
649	<input type="checkbox"/>	P-1006	0.000	00:00	0.000	00:00	0.000	0.000
650	<input type="checkbox"/>	P-1007	0.056	30:00	0.011	16:00	0.031	0.045
651	<input type="checkbox"/>	P-1010A	0.040	30:00	0.001	43:00	0.015	0.040
652	<input type="checkbox"/>	P-1011	0.077	30:00	0.002	18:00	0.029	0.075
653	<input type="checkbox"/>	P-1012	0.000	00:00	0.000	00:00	0.000	0.000
654	<input type="checkbox"/>	P-1019	0.146	33:00	0.000	20:00	0.041	0.146
655	<input type="checkbox"/>	P-1020	0.157	33:00	0.000	67:00	0.053	0.157
656	<input type="checkbox"/>	P-1021	0.200	33:00	0.031	66:00	0.114	0.169
657	<input type="checkbox"/>	P-1024	0.313	29:00	0.088	16:00	0.214	0.225
658	<input type="checkbox"/>	P-1028	0.000	00:00	0.000	00:00	0.000	0.000
659	<input type="checkbox"/>	P-1032	0.834	30:00	0.042	16:00	0.398	0.792
660	<input type="checkbox"/>	P-1033	0.523	29:00	0.129	16:00	0.332	0.394
661	<input type="checkbox"/>	P-1034	0.428	29:00	0.123	16:00	0.281	0.305
662	<input type="checkbox"/>	P-1047	1.578	29:00	0.096	16:00	0.843	1.482
663	<input type="checkbox"/>	P-1048	6.541	29:00	1.005	16:00	3.862	5.536
664	<input type="checkbox"/>	P-1049	6.201	29:00	0.960	16:00	3.685	5.242
665	<input type="checkbox"/>	P-1050	0.227	29:00	0.021	65:00	0.118	0.207
666	<input type="checkbox"/>	P-1051	0.078	53:00	0.001	16:00	0.042	0.077
667	<input type="checkbox"/>	P-1053	0.208	69:00	0.003	09:00	0.069	0.206
668	<input type="checkbox"/>	P-1054	0.169	33:00	0.002	67:00	0.067	0.167
669	<input type="checkbox"/>	P-1055	0.219	33:00	0.011	00:00	0.136	0.208
670	<input type="checkbox"/>	P-1056	0.331	30:00	0.069	66:00	0.200	0.263
671	<input type="checkbox"/>	P-1060	0.115	29:00	0.004	64:00	0.054	0.111
672	<input type="checkbox"/>	P-434	0.925	69:00	0.020	16:00	0.442	0.905
673	<input type="checkbox"/>	P-881	2.537	30:00	0.390	66:00	1.503	2.147
674	<input type="checkbox"/>	P-882	1.937	33:00	0.065	17:00	1.052	1.873
675	<input type="checkbox"/>	P-1085	19.553	30:00	0.000	00:00	11.675	19.552
676	<input type="checkbox"/>	P-1086	14.443	45:00	0.000	00:00	9.800	14.443
677	<input type="checkbox"/>	P-1087	9.471	45:00	0.000	00:00	5.034	9.470
678	<input type="checkbox"/>	P-1089	7.575	62:00	0.000	00:00	4.143	7.575
679	<input type="checkbox"/>	P-1090	10.400	69:00	0.000	00:00	7.674	10.400
680	<input type="checkbox"/>	P-1091	20.578	30:00	0.000	00:00	12.434	20.577
681	<input type="checkbox"/>	P-1092	0.000	00:00	0.000	00:00	0.000	0.000
682	<input type="checkbox"/>	P-1093	10.229	30:00	0.000	00:00	1.875	10.229
683	<input type="checkbox"/>	P-1094	5.072	69:00	0.000	00:00	4.897	5.072
684	<input type="checkbox"/>	P-1095	5.071	69:00	0.000	00:00	4.758	5.071

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
685	<input type="checkbox"/>	P-1096	5.085	69:00	0.000	00:00	4.288	5.085
686	<input type="checkbox"/>	P-1097	5.086	69:00	0.000	00:00	3.531	5.086
687	<input type="checkbox"/>	P-1098	10.783	45:00	0.000	00:00	4.760	10.783
688	<input type="checkbox"/>	P-1099	0.000	00:00	0.000	00:00	0.000	0.000
689	<input type="checkbox"/>	P-1120	19.643	30:00	0.812	00:00	11.816	18.831
690	<input type="checkbox"/>	P-1121	14.570	45:00	0.812	00:00	9.941	13.758
691	<input type="checkbox"/>	P-1122	9.598	45:00	0.145	42:00	5.177	9.452
692	<input type="checkbox"/>	P-1124	7.513	62:00	0.341	49:00	4.025	7.172
693	<input type="checkbox"/>	P-1125	10.396	69:00	0.812	00:00	7.555	9.584
694	<input type="checkbox"/>	P-1126	20.487	30:00	0.812	00:00	12.316	19.675
695	<input type="checkbox"/>	P-1139	0.102	69:00	0.045	16:00	0.079	0.057
696	<input type="checkbox"/>	P-1146	0.000	00:00	0.000	00:00	0.000	0.000
697	<input type="checkbox"/>	P-1152	0.396	69:00	0.043	57:00	0.214	0.353
698	<input type="checkbox"/>	P-1157	1.092	29:00	0.333	16:00	0.734	0.758
699	<input type="checkbox"/>	P-1158	1.170	29:00	0.338	16:00	0.776	0.832
700	<input type="checkbox"/>	P-1165	0.371	29:00	0.006	16:00	0.191	0.365
701	<input type="checkbox"/>	P-1166	0.373	69:00	0.006	63:00	0.167	0.368
702	<input type="checkbox"/>	P-1168	0.320	69:00	0.001	01:00	0.154	0.318
703	<input type="checkbox"/>	P-1169	0.275	33:00	0.000	55:00	0.046	0.275
704	<input type="checkbox"/>	P-1170	0.238	33:00	0.006	02:00	0.075	0.232
705	<input type="checkbox"/>	P-1190	0.166	33:00	0.002	42:00	0.073	0.163
706	<input type="checkbox"/>	P-1191	0.140	33:00	0.000	51:00	0.042	0.140
707	<input type="checkbox"/>	P-1198	13.402	30:00	8.291	16:00	11.269	5.111
708	<input type="checkbox"/>	P-1199	9.087	45:00	7.778	11:00	8.476	1.309
709	<input type="checkbox"/>	P-1200	4.542	45:00	3.889	11:00	4.238	0.653
710	<input type="checkbox"/>	P-1204	0.000	00:00	0.000	00:00	0.000	0.000
711	<input type="checkbox"/>	P-1205	4.568	30:00	0.000	12:00	2.793	4.568
712	<input type="checkbox"/>	P-1206	8.985	30:00	4.147	16:00	7.031	4.838
713	<input type="checkbox"/>	P-1216	1.187	29:00	0.044	16:00	0.629	1.143
714	<input type="checkbox"/>	P-1217	0.557	29:00	0.037	16:00	0.302	0.520
715	<input type="checkbox"/>	P-1218	0.246	29:00	0.009	16:00	0.132	0.237
716	<input type="checkbox"/>	P-1219	0.303	29:00	0.013	16:00	0.163	0.290
717	<input type="checkbox"/>	P-1220	0.312	29:00	0.013	16:00	0.168	0.299
718	<input type="checkbox"/>	P-1221	2.354	29:00	0.032	16:00	1.231	2.322
719	<input type="checkbox"/>	P-1222	2.158	69:00	0.008	64:00	1.018	2.150
720	<input type="checkbox"/>	P-1223	1.718	69:00	0.048	11:00	0.729	1.670
721	<input type="checkbox"/>	P-1224	1.579	69:00	0.027	35:00	0.650	1.552
722	<input type="checkbox"/>	P-1225	1.503	69:00	0.000	35:00	0.607	1.503
723	<input type="checkbox"/>	P-1226	1.395	69:00	0.002	65:00	0.548	1.394
724	<input type="checkbox"/>	P-1227	1.345	69:00	0.011	65:00	0.520	1.334
725	<input type="checkbox"/>	P-1228	1.290	69:00	0.020	65:00	0.489	1.269
726	<input type="checkbox"/>	P-1229	1.425	33:00	0.017	44:00	0.474	1.408
727	<input type="checkbox"/>	P-1230	1.442	33:00	0.007	44:00	0.488	1.434
728	<input type="checkbox"/>	P-1231	1.453	33:00	0.002	36:00	0.498	1.451
729	<input type="checkbox"/>	P-1232	1.546	33:00	0.019	37:00	0.578	1.527
730	<input type="checkbox"/>	P-1238	2.634	33:00	0.021	00:00	1.541	2.613
731	<input type="checkbox"/>	P-1240	0.307	29:00	0.035	16:00	0.171	0.272
732	<input type="checkbox"/>	P-1241	0.423	33:00	0.004	36:00	0.147	0.419
733	<input type="checkbox"/>	P-1242	0.316	29:00	0.005	64:00	0.154	0.311
734	<input type="checkbox"/>	P-1243	0.509	33:00	0.002	01:00	0.128	0.507
735	<input type="checkbox"/>	P-1244	0.570	29:00	0.110	65:00	0.323	0.460
736	<input type="checkbox"/>	P-1246	0.253	33:00	0.001	40:00	0.067	0.252
737	<input type="checkbox"/>	P-1247	0.238	69:00	0.000	08:00	0.092	0.238
738	<input type="checkbox"/>	P-1255	0.434	29:00	0.003	16:00	0.222	0.431
739	<input type="checkbox"/>	P-1256	0.602	29:00	0.005	16:00	0.312	0.597
740	<input type="checkbox"/>	P-1260	0.048	29:00	0.001	16:00	0.025	0.047
741	<input type="checkbox"/>	P-1261	0.049	29:00	0.005	16:00	0.028	0.045

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
742	P-1262	0.336	29:00	0.011	16:00	0.169	0.326
743	P-1263	0.401	29:00	0.005	16:00	0.205	0.396
744	P-1264	0.063	29:00	0.005	16:00	0.035	0.058
745	P-1265	0.107	33:00	0.001	42:00	0.027	0.106
746	P-1266	0.124	33:00	0.000	00:00	0.051	0.124
747	P-1267	0.801	33:00	0.015	67:00	0.275	0.786
748	P-1269	0.198	29:00	0.042	40:00	0.117	0.156
749	P-1285	1.533	16:00	0.288	00:00	1.372	1.244
750	P-1288	1.492	33:00	0.018	20:00	0.554	1.474
751	P-1291	2.796	35:00	0.065	28:00	1.027	2.731
752	P-1302	0.000	00:00	0.000	00:00	0.000	0.000
753	P-1304	0.454	29:00	0.076	16:00	0.258	0.378
754	P-1305	0.351	29:00	0.070	16:00	0.202	0.281
755	P-1306	0.070	30:00	0.001	71:00	0.025	0.070
756	P-1311	0.583	30:00	0.045	16:00	0.320	0.539
757	P-1315	0.952	33:00	0.104	17:00	0.544	0.847
758	P-1316	3.276	07:00	0.032	00:00	1.900	3.244
759	P-1320	0.449	30:00	0.093	66:00	0.276	0.357
760	P-1321	1.025	30:00	0.184	16:00	0.605	0.841
761	P-922	1.440	33:00	0.188	00:00	0.895	1.252
762	P-1328	0.148	29:00	0.007	16:00	0.079	0.141
763	P-1334	5.428	00:00	0.018	19:00	0.972	5.410
764	P-1335	0.045	00:00	0.005	16:00	0.026	0.040
765	P-1347	0.361	29:00	0.024	16:00	0.187	0.338
766	P-1350	0.065	29:00	0.004	16:00	0.033	0.060
767	P-1353	0.138	29:00	0.009	16:00	0.073	0.129
768	P-1358	0.098	66:00	0.023	30:00	0.074	0.074
769	P-1359	0.121	69:00	0.062	16:00	0.098	0.058
770	P-1360	0.054	00:00	0.035	16:00	0.048	0.019
771	P-1361	0.550	29:00	0.064	16:00	0.318	0.486
772	P-1363	0.082	29:00	0.022	16:00	0.053	0.060
773	P-1364	0.148	69:00	0.041	33:00	0.102	0.106
774	P-1365	0.228	29:00	0.098	16:00	0.167	0.129
775	P-1367	0.343	29:00	0.007	66:00	0.171	0.336
776	P-1366	8.598	33:00	0.467	66:00	4.517	8.130
777	P-1368	8.626	33:00	0.490	66:00	4.556	8.137
778	P-1369	4.622	29:00	0.863	16:00	2.841	3.758
779	P-1370	8.100	00:00	0.003	30:00	1.569	8.096
780	P-1371	0.139	00:00	0.003	41:00	0.032	0.136
781	P-1372	0.433	29:00	0.028	16:00	0.226	0.405
782	P-1386	0.727	33:00	0.020	67:00	0.367	0.707
783	P-1387	0.402	29:00	0.016	16:00	0.215	0.386
784	P-1390	0.039	00:00	0.001	42:00	0.016	0.039
785	P-1392	2.963	00:00	0.009	09:00	0.932	2.954
786	P-1393	3.361	00:00	0.007	65:00	1.255	3.354
787	P-1394	0.639	29:00	0.049	16:00	0.346	0.590
788	P-1399	0.304	29:00	0.018	16:00	0.163	0.286
789	P-1414	0.185	06:00	0.012	00:00	0.162	0.173
790	P-1422	0.214	33:00	0.007	61:00	0.069	0.207
791	P-1423	0.781	33:00	0.004	42:00	0.341	0.777
792	P-1424	1.551	33:00	0.013	37:00	0.582	1.538
793	P-1425	1.935	33:00	0.007	21:00	0.866	1.927
794	P-1430	0.323	30:00	0.062	16:00	0.192	0.261
795	P-1437	0.035	29:00	0.009	16:00	0.022	0.026
796	P-1438	0.230	16:00	0.001	52:00	0.105	0.230
797	P-1439	0.381	29:00	0.038	16:00	0.219	0.343
798	P-1442	0.276	00:00	0.147	33:00	0.209	0.129

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
799	<input type="checkbox"/>	P-1443	0.185	69:00	0.080	16:00	0.142	0.105
800	<input type="checkbox"/>	P-1445	0.356	66:00	0.055	30:00	0.214	0.301
801	<input type="checkbox"/>	P-1455	0.229	06:00	0.114	16:00	0.196	0.114
802	<input type="checkbox"/>	P-1456	0.228	29:00	0.050	16:00	0.146	0.178
803	<input type="checkbox"/>	P-1457	0.777	30:00	0.040	16:00	0.403	0.738
804	<input type="checkbox"/>	P-1458	1.863	29:00	0.283	16:00	1.074	1.580
805	<input type="checkbox"/>	P-1459	1.276	33:00	0.182	66:00	0.706	1.094
806	<input type="checkbox"/>	P-1460	0.643	33:00	0.000	20:00	0.195	0.643
807	<input type="checkbox"/>	P-1461	1.051	30:00	0.153	16:00	0.599	0.899
808	<input type="checkbox"/>	P-1467	5.166	33:00	0.070	13:00	2.040	5.095
809	<input type="checkbox"/>	P-1468	5.469	33:00	0.001	13:00	2.181	5.468
810	<input type="checkbox"/>	P-1472	0.248	07:00	0.048	66:00	0.150	0.200
811	<input type="checkbox"/>	P-1473	0.300	33:00	0.018	00:00	0.153	0.282
812	<input type="checkbox"/>	P-1474	0.135	33:00	0.000	55:00	0.032	0.135
813	<input type="checkbox"/>	P-1475	0.137	33:00	0.001	10:00	0.031	0.136
814	<input type="checkbox"/>	P-1476	0.137	33:00	0.001	10:00	0.031	0.136
815	<input type="checkbox"/>	P-1477	0.297	33:00	0.006	04:00	0.091	0.290
816	<input type="checkbox"/>	P-1478	0.568	33:00	0.001	59:00	0.136	0.567
817	<input type="checkbox"/>	P-1479	0.715	33:00	0.011	41:00	0.215	0.704
818	<input type="checkbox"/>	P-1481	4.270	33:00	0.066	36:00	1.309	4.204
819	<input type="checkbox"/>	P-1482	0.288	29:00	0.042	16:00	0.162	0.246
820	<input type="checkbox"/>	P-1483	0.175	29:00	0.020	16:00	0.095	0.154
821	<input type="checkbox"/>	P-1484	11.237	33:00	0.123	66:00	5.851	11.114
822	<input type="checkbox"/>	P-1485	11.237	33:00	0.123	66:00	5.851	11.114
823	<input type="checkbox"/>	P-1486	1.129	33:00	0.061	17:00	0.598	1.069
824	<input type="checkbox"/>	P-1487	0.904	33:00	0.047	17:00	0.476	0.857
825	<input type="checkbox"/>	P-1489	11.464	33:00	0.100	66:00	5.975	11.364
826	<input type="checkbox"/>	P-1490	11.822	33:00	0.028	66:00	6.275	11.794
827	<input type="checkbox"/>	P-1492	0.353	30:00	0.076	66:00	0.215	0.277
828	<input type="checkbox"/>	P-1493	0.147	30:00	0.032	16:00	0.089	0.115
829	<input type="checkbox"/>	P-1494	0.834	30:00	0.044	16:00	0.437	0.790
830	<input type="checkbox"/>	P-1497	0.688	16:00	0.126	00:00	0.612	0.563
831	<input type="checkbox"/>	P-1499	9.856	33:00	0.084	38:00	2.531	9.772
832	<input type="checkbox"/>	P-1514	1.612	29:00	0.045	16:00	0.836	1.568
833	<input type="checkbox"/>	P-1515	1.497	29:00	0.051	16:00	0.774	1.446
834	<input type="checkbox"/>	P-6	0.000	00:00	0.000	00:00	0.000	0.000
835	<input type="checkbox"/>	P-9	3.092	04:00	2.834	59:00	2.952	0.258
836	<input type="checkbox"/>	P-10	3.092	04:00	2.834	59:00	2.952	0.258
837	<input type="checkbox"/>	P-11	0.000	00:00	0.000	00:00	0.000	0.000
838	<input type="checkbox"/>	P-12	6.184	04:00	5.669	59:00	5.905	0.515
839	<input type="checkbox"/>	P-13	3.092	04:00	2.834	59:00	2.952	0.258
840	<input type="checkbox"/>	P-14	0.000	00:00	0.000	00:00	0.000	0.000
841	<input type="checkbox"/>	P-16	12.090	00:00	5.101	68:00	8.693	6.990
842	<input type="checkbox"/>	P-33	0.000	00:00	0.000	00:00	0.000	0.000
843	<input type="checkbox"/>	P-34	3.092	04:00	2.834	59:00	2.952	0.258
844	<input type="checkbox"/>	P-41	0.226	29:00	0.050	16:00	0.144	0.176
845	<input type="checkbox"/>	P-63	6.184	04:00	5.669	59:00	5.905	0.515
846	<input type="checkbox"/>	P-68	1.461	30:00	0.599	65:00	1.028	0.862
847	<input type="checkbox"/>	P-69	1.461	30:00	0.599	65:00	1.028	0.862
848	<input type="checkbox"/>	P-72	1.461	30:00	0.599	65:00	1.028	0.862
849	<input type="checkbox"/>	P-78	7.336	00:00	0.000	03:00	3.816	7.336
850	<input type="checkbox"/>	P-85	7.336	00:00	0.000	03:00	3.816	7.336
851	<input type="checkbox"/>	P-86	7.336	00:00	0.000	03:00	3.816	7.336
852	<input type="checkbox"/>	P-76	0.000	00:00	0.000	00:00	0.000	0.000
853	<input type="checkbox"/>	P-91	0.000	00:00	0.000	00:00	0.000	0.000
854	<input type="checkbox"/>	P-110	0.182	29:00	0.009	65:00	0.090	0.173
855	<input type="checkbox"/>	P-114	0.245	29:00	0.017	16:00	0.125	0.228

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
856	P-137	6.184	04:00	5.669	59:00	5.905	0.515
857	P-144	0.000	00:00	0.000	00:00	0.000	0.000
858	P-148	4.413	30:00	2.730	16:00	3.711	1.683
859	P-149	4.413	30:00	2.730	16:00	3.711	1.683
860	P-154	4.545	45:00	3.889	11:00	4.238	0.656
861	P-156	4.542	45:00	3.889	11:00	4.238	0.653
862	P-108	4.892	42:00	0.000	00:00	2.260	4.891
863	P-112	4.920	42:00	0.021	39:00	2.245	4.899
864	P-159	20.487	30:00	0.812	00:00	12.316	19.675
865	P-160	19.643	30:00	0.812	00:00	11.816	18.831
866	P-164	3.225	30:00	0.424	66:00	1.843	2.800
867	P-165	11.618	31:00	1.323	17:00	7.083	10.295
868	P-167	20.578	30:00	0.000	00:00	12.434	20.577
869	P-168	19.553	30:00	0.000	00:00	11.675	19.552
870	P-171	8.065	30:00	0.685	00:00	4.752	7.381
871	P-172	0.000	00:00	0.000	00:00	0.000	0.000
872	P-173	8.065	30:00	0.685	00:00	4.752	7.381
873	P-177	0.241	00:00	0.000	01:00	0.074	0.241
874	P-185	6.144	30:00	0.721	16:00	3.138	5.423
875	P-190	0.822	29:00	0.266	16:00	0.554	0.556
876	P-198	1.043	30:00	0.131	00:00	0.645	0.911
877	P-207	1.969	33:00	0.045	66:00	0.979	1.924
878	P-220	15.114	33:00	0.549	17:00	8.705	14.565
879	P-233	0.129	29:00	0.008	16:00	0.068	0.121
880	P-243	0.044	29:00	0.003	16:00	0.023	0.041
881	P-287	0.000	00:00	0.000	00:00	0.000	0.000
882	P-288	2.608	54:00	0.044	00:00	2.425	2.563
883	P-274	0.000	00:00	0.000	00:00	0.000	0.000
884	P-279	0.000	00:00	0.000	00:00	0.000	0.000
885	P-285	0.000	00:00	0.000	00:00	0.000	0.000
886	P-290	0.000	00:00	0.000	00:00	0.000	0.000
887	P-291	0.000	00:00	0.000	00:00	0.000	0.000
888	P-308	0.594	68:00	0.044	00:00	0.553	0.550
889	P-310	0.000	00:00	0.000	00:00	0.000	0.000
890	P-307	0.594	68:00	0.044	00:00	0.553	0.550
891	P-311	0.594	68:00	0.044	00:00	0.553	0.550
892	P-323	3.143	68:00	0.000	00:00	2.977	3.143
893	P-335	0.594	68:00	0.044	00:00	0.553	0.550
894	P-336	1.689	54:00	0.332	00:00	1.420	1.356
895	P-340	1.176	54:00	0.288	00:00	0.868	0.888
896	P-341	0.594	68:00	0.044	00:00	0.553	0.550
897	P-345	2.608	54:00	0.044	00:00	2.425	2.563
898	P-346	2.608	54:00	0.044	00:00	2.425	2.563
899	P-351	3.259	35:00	0.096	29:00	1.083	3.163
900	P-368	0.000	00:00	0.000	00:00	0.000	0.000
901	P-392	0.662	30:00	0.128	16:00	0.367	0.534
902	P-407	0.217	30:00	0.042	16:00	0.120	0.175
903	P-422_CV	0.000	00:00	0.000	00:00	0.000	0.000
904	P-1501	3.529	53:00	0.412	00:00	2.145	3.116
905	P-163	1.394	33:00	0.003	20:00	0.432	1.390
906	P-162	16.420	30:00	0.700	00:00	9.856	15.720
907	P-1239	3.448	53:00	0.364	00:00	2.097	3.084
908	P-412	4.568	30:00	0.000	12:00	2.793	4.568
909	P-413	3.143	68:00	0.000	00:00	2.977	3.143
910	P-411	0.649	29:00	0.133	16:00	0.395	0.516
911	P-414	0.503	29:00	0.091	16:00	0.299	0.412
912	P-1449	0.974	29:00	0.248	16:00	0.623	0.725

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
913	<input type="checkbox"/>	P-197	16.849	31:00	0.464	00:00	10.197	16.385
914	<input type="checkbox"/>	P-196	20.907	31:00	0.352	00:00	12.654	20.555
915	<input type="checkbox"/>	P-1303	0.386	69:00	0.008	50:00	0.125	0.378
916	<input type="checkbox"/>	P-1300	0.350	69:00	0.007	13:00	0.114	0.343
917	<input type="checkbox"/>	P-438	1.230	29:00	0.342	16:00	0.809	0.889
918	<input type="checkbox"/>	P-453	0.000	00:00	0.000	00:00	0.000	0.000
919	<input type="checkbox"/>	P-18	5.454	15:00	4.355	54:00	4.877	1.099
920	<input type="checkbox"/>	P-67	1.461	30:00	0.599	65:00	1.028	0.862
921	<input type="checkbox"/>	P-436	0.631	30:00	0.061	16:00	0.333	0.570
922	<input type="checkbox"/>	P-781	0.406	33:00	0.011	69:00	0.198	0.394
923	<input type="checkbox"/>	P-456	1.008	30:00	0.130	16:00	0.526	0.878
924	<input type="checkbox"/>	P-1447	7.517	30:00	1.143	66:00	4.114	6.375
925	<input type="checkbox"/>	P-428	8.466	33:00	0.741	17:00	5.234	7.725
926	<input type="checkbox"/>	P-1446	8.480	33:00	0.758	17:00	5.254	7.722
927	<input type="checkbox"/>	P-458	7.336	00:00	0.000	03:00	3.816	7.336
928	<input type="checkbox"/>	P-459	13.281	33:00	0.288	17:00	7.189	12.993
929	<input type="checkbox"/>	P-467	14.522	33:00	0.222	17:00	8.139	14.300
930	<input type="checkbox"/>	P-543	0.318	16:00	0.036	53:00	0.208	0.282
931	<input type="checkbox"/>	P-544	0.887	33:00	0.734	69:00	0.811	0.152
932	<input type="checkbox"/>	P-861	1.413	16:00	0.810	30:00	1.215	0.602
933	<input type="checkbox"/>	P-559	0.219	29:00	0.050	16:00	0.144	0.168
934	<input type="checkbox"/>	P-950	0.051	29:00	0.007	65:00	0.028	0.044
935	<input type="checkbox"/>	P-918	0.255	00:00	0.000	64:00	0.093	0.254
936	<input type="checkbox"/>	P-542	0.165	00:00	0.053	30:00	0.141	0.112
937	<input type="checkbox"/>	P-1035	0.062	53:00	0.001	67:00	0.032	0.061
938	<input type="checkbox"/>	P-883	1.652	33:00	0.016	42:00	0.823	1.637
939	<input type="checkbox"/>	P-1547	0.296	33:00	0.000	54:00	0.073	0.296
940	<input type="checkbox"/>	P-208	19.837	31:00	0.256	00:00	11.974	19.581
941	<input type="checkbox"/>	P-1450	1.611	30:00	0.194	16:00	0.829	1.417
942	<input type="checkbox"/>	P-439	1.134	33:00	0.029	66:00	0.486	1.105
943	<input type="checkbox"/>	P-416	5.572	30:00	0.658	16:00	2.853	4.913
944	<input type="checkbox"/>	P-1145	0.270	16:00	0.121	30:00	0.220	0.149
945	<input type="checkbox"/>	P-192	0.106	33:00	0.003	71:00	0.037	0.103
946	<input type="checkbox"/>	P-780	0.243	69:00	0.003	58:00	0.092	0.240
947	<input type="checkbox"/>	P-410	0.034	29:00	0.007	65:00	0.020	0.027
948	<input type="checkbox"/>	P-1245	0.469	29:00	0.103	65:00	0.280	0.367
949	<input type="checkbox"/>	P-1248	0.055	29:00	0.006	16:00	0.028	0.050
950	<input type="checkbox"/>	P-1249	0.121	33:00	0.001	66:00	0.052	0.120
951	<input type="checkbox"/>	P-474	2.635	29:00	0.133	16:00	1.411	2.502
952	<input type="checkbox"/>	P-480	2.223	29:00	0.106	16:00	1.188	2.117
953	<input type="checkbox"/>	P-481	1.725	29:00	0.075	16:00	0.919	1.650
954	<input type="checkbox"/>	P-1491	0.221	30:00	0.048	16:00	0.134	0.173
955	<input type="checkbox"/>	P-1488	0.227	33:00	0.016	17:00	0.125	0.211
956	<input type="checkbox"/>	P-1062	4.021	29:00	0.045	16:00	2.020	3.976
957	<input type="checkbox"/>	P-1063	0.992	29:00	0.053	16:00	0.530	0.939
958	<input type="checkbox"/>	P-1064	5.033	29:00	0.009	16:00	2.560	5.023
959	<input type="checkbox"/>	P-1495	5.235	33:00	0.126	62:00	2.016	5.109
960	<input type="checkbox"/>	P-1496	7.004	33:00	0.147	67:00	3.434	6.857
961	<input type="checkbox"/>	P-529	0.695	29:00	0.173	16:00	0.470	0.521
962	<input type="checkbox"/>	P-530	0.571	30:00	0.021	16:00	0.294	0.550
963	<input type="checkbox"/>	P-531	0.551	29:00	0.107	16:00	0.343	0.444
964	<input type="checkbox"/>	P-1326	0.000	00:00	0.000	00:00	0.000	0.000
965	<input type="checkbox"/>	P-314	1.245	35:00	0.053	58:00	0.539	1.191
966	<input type="checkbox"/>	P-3002	2.716	10:00	0.027	42:00	1.703	2.689
967	<input type="checkbox"/>	P-3003	0.000	00:00	0.000	00:00	0.000	0.000
968	<input type="checkbox"/>	P-3006	2.716	10:00	0.027	42:00	1.703	2.689
969	<input type="checkbox"/>	P-3009	2.716	10:00	0.027	42:00	1.703	2.689

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
970	<input type="checkbox"/>	P-191	4.067	30:00	0.113	00:00	2.460	3.955
971	<input type="checkbox"/>	P-498	0.962	16:00	0.373	30:00	0.695	0.589
972	<input type="checkbox"/>	P-496	0.638	00:00	0.001	71:00	0.228	0.638
973	<input type="checkbox"/>	P-259	0.361	29:00	0.023	16:00	0.196	0.337
974	<input type="checkbox"/>	P-254	0.211	29:00	0.012	16:00	0.113	0.199
975	<input type="checkbox"/>	P-272	0.705	29:00	0.036	16:00	0.376	0.669
976	<input type="checkbox"/>	P-266	0.263	29:00	0.014	16:00	0.141	0.248
977	<input type="checkbox"/>	P-246	0.083	29:00	0.005	16:00	0.045	0.078
978	<input type="checkbox"/>	P-271	0.290	29:00	0.012	16:00	0.153	0.277
979	<input type="checkbox"/>	P-605	2.236	30:00	0.872	16:00	1.430	1.365
980	<input type="checkbox"/>	P-1413	6.664	35:00	0.047	21:00	2.397	6.616
981	<input type="checkbox"/>	P-104	1.038	16:00	0.273	00:00	0.889	0.765
982	<input type="checkbox"/>	P-1523	0.840	16:00	0.175	00:00	0.747	0.665
983	<input type="checkbox"/>	P-603	0.685	33:00	0.007	67:00	0.203	0.678
984	<input type="checkbox"/>	P-607	0.000	00:00	0.000	00:00	0.000	0.000
985	<input type="checkbox"/>	P-470	0.730	33:00	0.013	42:00	0.259	0.716
986	<input type="checkbox"/>	P-471	0.000	00:00	0.000	00:00	0.000	0.000
987	<input type="checkbox"/>	P-1540	0.727	33:00	0.013	66:00	0.256	0.714
988	<input type="checkbox"/>	P-430	0.000	00:00	0.000	00:00	0.000	0.000
989	<input type="checkbox"/>	P-942	0.612	30:00	0.079	16:00	0.338	0.533
990	<input type="checkbox"/>	P-1520	0.724	29:00	0.045	16:00	0.384	0.679
991	<input type="checkbox"/>	P-1525	0.701	29:00	0.044	16:00	0.371	0.657
992	<input type="checkbox"/>	P-1533	0.669	29:00	0.042	16:00	0.353	0.627
993	<input type="checkbox"/>	P-1538	0.488	29:00	0.031	16:00	0.257	0.457
994	<input type="checkbox"/>	P-115	0.045	29:00	0.002	16:00	0.025	0.042
995	<input type="checkbox"/>	P-685	0.013	00:00	0.000	16:00	0.007	0.013
996	<input type="checkbox"/>	P-746	0.447	29:00	0.028	16:00	0.235	0.419
997	<input type="checkbox"/>	P-952	0.029	33:00	0.001	39:00	0.011	0.028
998	<input type="checkbox"/>	P-943	0.630	30:00	0.071	16:00	0.347	0.559
999	<input type="checkbox"/>	P-946	0.285	30:00	0.028	16:00	0.157	0.257
1000	<input type="checkbox"/>	P-1351	0.117	00:00	0.008	33:00	0.057	0.110
1001	<input type="checkbox"/>	P-817	0.050	29:00	0.007	33:00	0.029	0.043
1002	<input type="checkbox"/>	P-759	0.123	29:00	0.007	16:00	0.066	0.115
1003	<input type="checkbox"/>	P-1388	0.276	29:00	0.017	16:00	0.147	0.259
1004	<input type="checkbox"/>	P-951	0.032	33:00	0.000	32:00	0.008	0.031
1005	<input type="checkbox"/>	P-795	0.238	29:00	0.031	16:00	0.133	0.207
1006	<input type="checkbox"/>	P-796	0.055	29:00	0.001	16:00	0.030	0.054
1007	<input type="checkbox"/>	P-135	0.198	29:00	0.024	16:00	0.112	0.174
1008	<input type="checkbox"/>	P-140	0.032	33:00	0.000	32:00	0.008	0.031
1009	<input type="checkbox"/>	P-810	0.107	33:00	0.007	17:00	0.048	0.100
1010	<input type="checkbox"/>	P-811	0.303	29:00	0.005	16:00	0.166	0.298
1011	<input type="checkbox"/>	P-616	2.893	33:00	0.015	59:00	0.760	2.878
1012	<input type="checkbox"/>	P-2013	5.626	33:00	0.092	21:00	2.323	5.534
1013	<input type="checkbox"/>	P-2014	4.100	33:00	0.024	44:00	1.199	4.076
1014	<input type="checkbox"/>	P-2024	8.989	30:00	5.561	16:00	7.558	3.428
1015	<input type="checkbox"/>	P-3001	2.716	10:00	0.027	42:00	1.703	2.689
1016	<input type="checkbox"/>	P-309B	0.000	00:00	0.000	00:00	0.000	0.000
1017	<input type="checkbox"/>	P-1318B	0.000	00:00	0.000	00:00	0.000	0.000
1018	<input type="checkbox"/>	P-1014	0.000	00:00	0.000	00:00	0.000	0.000
1019	<input type="checkbox"/>	P-178	0.421	35:00	0.002	27:00	0.154	0.419
1020	<input type="checkbox"/>	P-103	0.041	30:00	0.008	16:00	0.023	0.033
1021	<input type="checkbox"/>	P-863B	0.020	29:00	0.000	09:00	0.009	0.020
1022	<input type="checkbox"/>	P-863A	0.030	29:00	0.001	65:00	0.015	0.029
1023	<input type="checkbox"/>	P-1067	0.018	29:00	0.000	66:00	0.008	0.018
1024	<input type="checkbox"/>	P-1068	0.028	29:00	0.002	40:00	0.013	0.026
1025	<input type="checkbox"/>	P-844A	0.297	29:00	0.068	16:00	0.192	0.230
1026	<input type="checkbox"/>	P-844B	0.171	29:00	0.043	16:00	0.114	0.128

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1027	<input type="checkbox"/>	P-1010B	0.030	66:00	0.014	30:00	0.023	0.016
1028	<input type="checkbox"/>	P-1010C	0.058	29:00	0.020	16:00	0.041	0.037
1029	<input type="checkbox"/>	P-1073	0.031	30:00	0.001	68:00	0.013	0.030
1030	<input type="checkbox"/>	P-1074	0.028	66:00	0.000	55:00	0.015	0.028
1031	<input type="checkbox"/>	P-357	1.172	29:00	0.194	16:00	0.673	0.978
1032	<input type="checkbox"/>	P-188A	5.153	30:00	0.296	16:00	2.306	4.857
1033	<input type="checkbox"/>	P-1079	0.056	30:00	0.001	47:00	0.026	0.055
1034	<input type="checkbox"/>	P-1081	0.062	02:00	0.001	28:00	0.030	0.062
1035	<input type="checkbox"/>	P-504	1.036	29:00	0.360	16:00	0.716	0.676
1036	<input type="checkbox"/>	P-1084	0.000	00:00	0.000	00:00	0.000	0.000
1037	<input type="checkbox"/>	P-1082	0.226	29:00	0.050	16:00	0.144	0.176
1038	<input type="checkbox"/>	P-618A	3.647	29:00	0.127	16:00	1.942	3.519
1039	<input type="checkbox"/>	P-618B	3.393	29:00	0.113	16:00	1.805	3.281
1040	<input type="checkbox"/>	P-1100	0.178	29:00	0.010	16:00	0.096	0.168
1041	<input type="checkbox"/>	P-270A	0.031	33:00	0.001	42:00	0.013	0.031
1042	<input type="checkbox"/>	P-270B	0.059	29:00	0.010	16:00	0.036	0.050
1043	<input type="checkbox"/>	P-418B	0.254	29:00	0.012	16:00	0.135	0.242
1044	<input type="checkbox"/>	P-418A	0.426	29:00	0.025	16:00	0.230	0.401
1045	<input type="checkbox"/>	P-256A	0.216	29:00	0.012	16:00	0.116	0.204
1046	<input type="checkbox"/>	P-256B	0.325	29:00	0.021	16:00	0.176	0.304
1047	<input type="checkbox"/>	P-261B	0.296	29:00	0.013	16:00	0.157	0.283
1048	<input type="checkbox"/>	P-246A	0.061	29:00	0.004	16:00	0.033	0.057
1049	<input type="checkbox"/>	P-246B	0.155	29:00	0.009	16:00	0.083	0.147
1050	<input type="checkbox"/>	P-252	0.119	29:00	0.007	16:00	0.064	0.112
1051	<input type="checkbox"/>	P-1137	0.020	69:00	0.000	39:00	0.009	0.020
1052	<input type="checkbox"/>	P-1138	0.157	29:00	0.007	16:00	0.083	0.151
1053	<input type="checkbox"/>	P-1140	0.066	29:00	0.001	16:00	0.033	0.065
1054	<input type="checkbox"/>	P-1155	0.000	00:00	0.000	00:00	0.000	0.000
1055	<input type="checkbox"/>	P-1512B	0.539	69:00	0.008	56:00	0.167	0.531
1056	<input type="checkbox"/>	P-1522	0.527	69:00	0.004	24:00	0.162	0.523
1057	<input type="checkbox"/>	P-1052	0.266	35:00	0.006	45:00	0.138	0.260
1058	<input type="checkbox"/>	P-1058	0.133	35:00	0.000	45:00	0.069	0.132
1059	<input type="checkbox"/>	P-1061	0.141	35:00	0.020	68:00	0.082	0.122
1060	<input type="checkbox"/>	P-1066	0.144	35:00	0.024	68:00	0.089	0.120
1061	<input type="checkbox"/>	P-1069	0.036	30:00	0.000	40:00	0.014	0.035
1062	<input type="checkbox"/>	P-1070	0.139	35:00	0.039	68:00	0.097	0.100
1063	<input type="checkbox"/>	P-1071	0.154	35:00	0.018	68:00	0.088	0.136
1064	<input type="checkbox"/>	P-1072	0.169	35:00	0.044	68:00	0.115	0.126
1065	<input type="checkbox"/>	P-1076	0.390	35:00	0.072	68:00	0.241	0.319
1066	<input type="checkbox"/>	P-1155B	0.305	35:00	0.001	12:00	0.109	0.304
1067	<input type="checkbox"/>	P-1155A	0.230	35:00	0.001	45:00	0.117	0.229
1068	<input type="checkbox"/>	P-1083	0.250	35:00	0.030	68:00	0.141	0.219
1069	<input type="checkbox"/>	P-1088	0.572	35:00	0.135	68:00	0.377	0.437
1070	<input type="checkbox"/>	P-1101	0.047	35:00	0.000	12:00	0.017	0.047
1071	<input type="checkbox"/>	P-1102	0.035	35:00	0.000	45:00	0.018	0.035
1072	<input type="checkbox"/>	P-1103	0.331	30:00	0.114	16:00	0.201	0.217
1073	<input type="checkbox"/>	P-1141	0.369	29:00	0.181	16:00	0.277	0.187
1074	<input type="checkbox"/>	P-1150	0.130	33:00	0.016	69:00	0.064	0.114
1075	<input type="checkbox"/>	P-1151	0.316	29:00	0.060	16:00	0.191	0.257
1076	<input type="checkbox"/>	P-1156	0.911	29:00	0.275	16:00	0.610	0.636
1077	<input type="checkbox"/>	P-1159	0.686	29:00	0.228	16:00	0.469	0.457
1078	<input type="checkbox"/>	P-1160	0.372	29:00	0.140	16:00	0.265	0.232
1079	<input type="checkbox"/>	P-1161	0.318	29:00	0.046	16:00	0.191	0.272
1080	<input type="checkbox"/>	P-1162	0.180	29:00	0.005	40:00	0.083	0.175
1081	<input type="checkbox"/>	P-1163	0.109	53:00	0.080	09:00	0.091	0.028
1082	<input type="checkbox"/>	P-1164	0.297	61:00	0.234	30:00	0.280	0.064
1083	<input type="checkbox"/>	P-1167	0.244	65:00	0.001	30:00	0.124	0.244



Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1084	P-1171	0.038	65:00	0.000	30:00	0.020	0.038
1085	P-1172	0.473	29:00	0.017	40:00	0.236	0.456
1086	P-1177	0.159	53:00	0.004	15:00	0.083	0.155
1087	P-1189	0.000	00:00	0.000	00:00	0.000	0.000
1088	P-1192	0.000	00:00	0.000	00:00	0.000	0.000
1089	P-1193	0.000	00:00	0.000	00:00	0.000	0.000
1090	P-1194	0.495	30:00	0.006	13:00	0.200	0.489
1091	P-1195	0.341	29:00	0.020	33:00	0.181	0.321
1092	P-1196	0.084	29:00	0.011	16:00	0.047	0.073
1093	P-1197	0.016	00:00	0.002	57:00	0.010	0.013
1094	DC_FUTURE_PMP8_(ST_U	0.000	00:00	0.000	00:00	0.000	0.000
1095	DC_FUTURE_PMP8_(ST_D	0.000	00:00	0.000	00:00	0.000	0.000
1096	DC_PMP7_U	10.783	45:00	0.000	00:00	4.760	10.783
1097	DC_PMP7_D	10.783	45:00	0.000	00:00	4.760	10.783
1098	DC_PMP1_U	0.000	00:00	0.000	00:00	0.000	0.000
1099	DC_PMP1_D	0.000	00:00	0.000	00:00	0.000	0.000
1100	DC_PMP2_U	10.229	30:00	0.000	00:00	1.875	10.229
1101	DC_PMP2_D	10.229	30:00	0.000	00:00	1.875	10.229
1102	DC_PMP3_U	5.072	69:00	0.000	00:00	4.897	5.072
1103	DC_PMP3_D	5.072	69:00	0.000	00:00	4.897	5.072
1104	DC_PMP4_U	5.071	69:00	0.000	00:00	4.758	5.071
1105	DC_PMP4_D	5.071	69:00	0.000	00:00	4.758	5.071
1106	DC_PMP6_U	5.086	69:00	0.000	00:00	3.531	5.086
1107	DC_PMP6_D	5.086	69:00	0.000	00:00	3.531	5.086
1108	DC_PMP5_U	5.085	69:00	0.000	00:00	4.288	5.085
1109	DC_PMP5_D	5.085	69:00	0.000	00:00	4.288	5.085
1110	BB_PMP3_U	4.568	30:00	0.000	12:00	2.793	4.568
1111	BB_PMP3_D	4.568	30:00	0.000	12:00	2.793	4.568
1112	BB_PMP2_U	4.545	45:00	3.889	11:00	4.238	0.656
1113	BB_PMP2_D	4.545	45:00	3.889	11:00	4.238	0.656
1114	BB_PMP1_U	4.542	45:00	3.889	11:00	4.238	0.653
1115	BB_PMP1_D	4.542	45:00	3.889	11:00	4.238	0.653
1116	BB_FUTURE_PUMP_4_(U	0.000	00:00	0.000	00:00	0.000	0.000
1117	BB_FUTURE_PUMP_4_(D	0.000	00:00	0.000	00:00	0.000	0.000
1118	CC_PMP_3-MZ_U	0.000	00:00	0.000	00:00	0.000	0.000
1119	CC_PMP_3-MZ_D	0.000	00:00	0.000	00:00	0.000	0.000
1120	CC_PMP_4-HZ1_U	3.092	04:00	2.834	59:00	2.952	0.258
1121	CC_PMP_4-HZ1_D	3.092	04:00	2.834	59:00	2.952	0.258
1122	CC_PMP_5-HZ1_U	3.092	04:00	2.834	59:00	2.952	0.258
1123	CC_PMP_5-HZ1_D	3.092	04:00	2.834	59:00	2.952	0.258
1124	CC_PMP_6-HZ1_U	0.000	00:00	0.000	00:00	0.000	0.000
1125	CC_PMP_6-HZ1_D	0.000	00:00	0.000	00:00	0.000	0.000
1126	CC_PMP_7-HZ2_U	7.336	00:00	0.000	03:00	3.816	7.336
1127	CC_PMP_7-HZ2_D	7.336	00:00	0.000	03:00	3.816	7.336
1128	CC_PMP_8-HZ2_U	0.000	00:00	0.000	00:00	0.000	0.000
1129	CC_PMP_8-HZ2_D	0.000	00:00	0.000	00:00	0.000	0.000
1130	CC_PMP_9-HZ2_(STBY_U	0.000	00:00	0.000	00:00	0.000	0.000
1131	CC_PMP_9-HZ2_(STBY_D	0.000	00:00	0.000	00:00	0.000	0.000
1132	MN_PMP_FUTURE_U	0.000	00:00	0.000	00:00	0.000	0.000
1133	MN_PMP_FUTURE_D	0.000	00:00	0.000	00:00	0.000	0.000
1134	MN_PMP1_U	3.143	68:00	0.000	00:00	2.977	3.143
1135	MN_PMP1_D	3.143	68:00	0.000	00:00	2.977	3.143
1136	MN_PMP3_U	0.000	00:00	0.000	00:00	0.000	0.000
1137	MN_PMP3_D	0.000	00:00	0.000	00:00	0.000	0.000
1138	MN_PMP2_U	0.000	00:00	0.000	00:00	0.000	0.000
1139	MN_PMP2_D	0.000	00:00	0.000	00:00	0.000	0.000
1140	GOLDEN_BEAR_PMP-1_U	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1141	GOLDEN_BEAR_PMP-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1142	GOLDEN_BEAR_PMP-2_U	2.716	10:00	0.027	42:00	1.703	2.689
1143	GOLDEN_BEAR_PMP-2_D	2.716	10:00	0.027	42:00	1.703	2.689
1144	FCV-1_U	0.000	00:00	0.000	00:00	0.000	0.000
1145	FCV-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1146	DC_PRV_U	11.039	30:00	1.572	66:00	6.267	9.468
1147	DC_PRV_D	11.039	30:00	1.572	66:00	6.267	9.468
1148	BROADWAY_PRV_U	1.401	16:00	0.620	30:00	1.113	0.781
1149	PRV-3_U	4.281	30:00	0.000	16:00	1.667	4.281
1150	P1544	0.593	07:00	0.000	00:00	0.044	0.593
1151	P1552	9.749	33:00	0.015	25:00	2.518	9.734
1152	P1572	14.331	00:00	0.000	54:00	2.451	14.331
1153	P1578	0.206	00:00	0.001	35:00	0.047	0.204
1154	P1580	0.719	33:00	0.006	17:00	0.348	0.713
1155	P1584	0.000	00:00	0.000	00:00	0.000	0.000
1156	P1590	0.716	33:00	0.002	17:00	0.343	0.713
1157	P1594	0.000	00:00	0.000	00:00	0.000	0.000
1158	P1596	0.000	00:00	0.000	00:00	0.000	0.000
1159	P1598	0.000	00:00	0.000	00:00	0.000	0.000
1160	P1600	0.475	29:00	0.143	16:00	0.329	0.332
1161	P1602	0.787	29:00	0.095	16:00	0.455	0.692
1162	P1606	0.000	00:00	0.000	00:00	0.000	0.000
1163	P1608	0.000	00:00	0.000	00:00	0.000	0.000
1164	P1610	0.000	00:00	0.000	00:00	0.000	0.000
1165	P1612	6.184	04:00	5.669	59:00	5.905	0.515
1166	P1614	7.336	00:00	0.000	03:00	3.816	7.336
1167	P1626	0.222	16:00	0.073	00:00	0.182	0.149
1168	P1628	2.930	35:00	0.013	28:00	1.073	2.917
1169	P1634	0.656	30:00	0.127	16:00	0.363	0.529
1170	P1642	0.134	35:00	0.001	06:00	0.052	0.133
1171	P1644	0.137	35:00	0.005	54:00	0.053	0.133
1172	P1646	0.363	30:00	0.070	16:00	0.201	0.293
1173	P1648	0.027	30:00	0.005	16:00	0.015	0.022
1174	P1650	0.221	30:00	0.043	16:00	0.123	0.178
1175	P1652	0.183	30:00	0.035	16:00	0.102	0.148
1176	P1654	0.270	30:00	0.052	16:00	0.150	0.217
1177	P1656	0.041	30:00	0.008	16:00	0.023	0.033
1178	P1676	0.418	29:00	0.092	16:00	0.267	0.326
1179	P-64	6.184	04:00	5.669	59:00	5.905	0.515
1180	P1678	0.368	33:00	0.001	14:00	0.076	0.367
1181	P1680	1.180	29:00	0.225	16:00	0.728	0.955
1182	P1682	0.063	33:00	0.002	65:00	0.028	0.061
1183	P1684	0.091	33:00	0.002	17:00	0.045	0.089
1184	P1686	0.745	29:00	0.111	16:00	0.424	0.634
1185	P1688	0.141	69:00	0.004	15:00	0.062	0.137
1186	P1690	0.094	29:00	0.007	16:00	0.051	0.087
1187	P1700	0.657	30:00	0.127	16:00	0.364	0.530
1188	P1702	0.716	33:00	0.002	17:00	0.343	0.713
1189	P1704	0.657	30:00	0.127	16:00	0.364	0.530
1190	P1708	0.000	00:00	0.000	00:00	0.000	0.000
1191	P1710	0.000	00:00	0.000	00:00	0.000	0.000
1192	P1716	0.421	35:00	0.002	27:00	0.154	0.419
1193	P1718	0.000	00:00	0.000	00:00	0.000	0.000
1194	P1720	5.566	30:00	0.658	16:00	2.849	4.908
1195	P1722	128.736	00:00	0.857	43:00	11.294	127.880
1196	P1724	19.553	30:00	0.000	00:00	11.675	19.552
1197	P1726	20.578	30:00	0.000	00:00	12.434	20.577

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1198	<input type="checkbox"/>	P1728	6.472	35:00	0.015	12:00	2.290	6.456
1199	<input type="checkbox"/>	P1730	12.593	07:00	11.846	66:00	12.042	0.747
1200	<input type="checkbox"/>	P1732	13.402	30:00	8.291	16:00	11.269	5.111
1201	<input type="checkbox"/>	P1734	15.265	00:00	0.030	09:00	3.451	15.235
1202	<input type="checkbox"/>	P1736	12.841	34:00	0.231	01:00	8.918	12.611
1203	<input type="checkbox"/>	P1738	13.414	00:00	5.953	67:00	9.721	7.462
1204	<input type="checkbox"/>	P1740	107.236	00:00	1.753	17:00	25.106	105.483
1205	<input type="checkbox"/>	P1742	40.130	30:00	0.000	00:00	24.109	40.130
1206	<input type="checkbox"/>	P1760	2.716	10:00	0.000	09:00	1.678	2.716
1207	<input type="checkbox"/>	P1762	0.869	30:00	0.168	16:00	0.482	0.701
1208	<input type="checkbox"/>	P1764	2.716	10:00	0.027	42:00	1.703	2.689
1209	<input type="checkbox"/>	P1770	0.056	30:00	0.011	16:00	0.031	0.045
1210	<input type="checkbox"/>	P1790	1.679	33:00	0.103	17:00	0.985	1.577
1211	<input type="checkbox"/>	P1792	4.259	00:00	0.011	12:00	1.023	4.247
1212	<input type="checkbox"/>	P1796	2.963	00:00	0.009	09:00	0.932	2.954
1213	<input type="checkbox"/>	P1802	0.135	33:00	0.000	55:00	0.032	0.135
1214	<input type="checkbox"/>	P1818	0.217	16:00	0.044	00:00	0.193	0.173
1215	<input type="checkbox"/>	P1822	0.134	35:00	0.001	06:00	0.052	0.133
1216	<input type="checkbox"/>	P1824	2.796	35:00	0.065	28:00	1.027	2.731
1217	<input type="checkbox"/>	P1826	2.796	35:00	0.065	28:00	1.027	2.731
1218	<input type="checkbox"/>	P1830	0.235	29:00	0.048	16:00	0.144	0.187
1219	<input type="checkbox"/>	P1836	0.363	30:00	0.070	16:00	0.201	0.293
1220	<input type="checkbox"/>	P1838	0.000	00:00	0.000	00:00	0.000	0.000
1221	<input type="checkbox"/>	P1840	0.078	35:00	0.001	04:00	0.029	0.077
1222	<input type="checkbox"/>	P1842	0.078	35:00	0.001	04:00	0.029	0.077
1223	<input type="checkbox"/>	P1844	0.040	35:00	0.000	04:00	0.015	0.040
1224	<input type="checkbox"/>	P1846	0.038	35:00	0.000	04:00	0.014	0.037
1225	<input type="checkbox"/>	P1848	0.000	00:00	0.000	00:00	0.000	0.000
1226	<input type="checkbox"/>	P1850	0.038	35:00	0.000	04:00	0.014	0.037
1227	<input type="checkbox"/>	P1852	0.000	00:00	0.000	00:00	0.000	0.000
1228	<input type="checkbox"/>	P1854	0.000	00:00	0.000	01:00	0.000	0.000
1229	<input type="checkbox"/>	P1856	0.000	00:00	0.000	00:00	0.000	0.000
1230	<input type="checkbox"/>	P1858	0.000	00:00	0.000	01:00	0.000	0.000
1231	<input type="checkbox"/>	P1860	0.000	00:00	0.000	01:00	0.000	0.000
1232	<input type="checkbox"/>	P1862	0.183	30:00	0.035	16:00	0.102	0.148
1233	<input type="checkbox"/>	P1864	0.183	30:00	0.035	16:00	0.102	0.148
1234	<input type="checkbox"/>	P1866	0.000	00:00	0.000	00:00	0.000	0.000
1235	<input type="checkbox"/>	P1868	0.000	00:00	0.000	00:00	0.000	0.000
1236	<input type="checkbox"/>	P1870	0.000	00:00	0.000	00:00	0.000	0.000
1237	<input type="checkbox"/>	P1872	0.000	00:00	0.000	00:00	0.000	0.000
1238	<input type="checkbox"/>	P1874	0.000	00:00	0.000	00:00	0.000	0.000
1239	<input type="checkbox"/>	P1876	0.204	30:00	0.040	16:00	0.113	0.165
1240	<input type="checkbox"/>	P1878	0.118	30:00	0.023	16:00	0.065	0.095
1241	<input type="checkbox"/>	P1880	0.204	30:00	0.040	16:00	0.113	0.165
1242	<input type="checkbox"/>	P1882	0.656	30:00	0.127	16:00	0.363	0.529
1243	<input type="checkbox"/>	P1884	0.181	30:00	0.035	16:00	0.101	0.146
1244	<input type="checkbox"/>	P1886	0.178	30:00	0.034	16:00	0.099	0.143
1245	<input type="checkbox"/>	P1888	0.056	30:00	0.011	16:00	0.031	0.045
1246	<input type="checkbox"/>	P1890	0.213	30:00	0.041	16:00	0.118	0.172
1247	<input type="checkbox"/>	P1892	0.000	00:00	0.000	00:00	0.000	0.000
1248	<input type="checkbox"/>	P1894	0.159	30:00	0.031	16:00	0.088	0.128
1249	<input type="checkbox"/>	P1896	0.000	00:00	0.000	00:00	0.000	0.000
1250	<input type="checkbox"/>	P1898	0.126	30:00	0.024	16:00	0.070	0.101
1251	<input type="checkbox"/>	P1900	0.004	30:00	0.001	16:00	0.002	0.003
1252	<input type="checkbox"/>	P1902	0.000	00:00	0.000	00:00	0.000	0.000
1253	<input type="checkbox"/>	P1904	1.022	16:00	0.203	00:00	0.891	0.820
1254	<input type="checkbox"/>	P1906	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1255	<input type="checkbox"/>	P1908	0.825	16:00	0.204	00:00	0.693	0.620
1256	<input type="checkbox"/>	P1910	0.181	16:00	0.045	00:00	0.152	0.136
1257	<input type="checkbox"/>	P1912	0.000	00:00	0.000	00:00	0.000	0.000
1258	<input type="checkbox"/>	P1914	0.181	16:00	0.045	00:00	0.152	0.136
1259	<input type="checkbox"/>	P1916	1.006	16:00	0.249	00:00	0.846	0.757
1260	<input type="checkbox"/>	P1918	1.006	16:00	0.249	00:00	0.846	0.757
1261	<input type="checkbox"/>	P1920	0.535	16:00	0.089	00:00	0.479	0.445
1262	<input type="checkbox"/>	P1922	0.262	54:00	0.022	00:00	0.219	0.240
1263	<input type="checkbox"/>	P1924	0.154	16:00	0.037	00:00	0.133	0.117
1264	<input type="checkbox"/>	P1926	0.112	16:00	0.041	00:00	0.088	0.071
1265	<input type="checkbox"/>	P1928	0.112	16:00	0.041	00:00	0.088	0.071
1266	<input type="checkbox"/>	P1930	0.266	16:00	0.078	00:00	0.221	0.188
1267	<input type="checkbox"/>	P1932	0.666	16:00	0.192	00:00	0.527	0.474
1268	<input type="checkbox"/>	P1934	0.837	16:00	0.241	00:00	0.662	0.596
1269	<input type="checkbox"/>	P1936	0.171	16:00	0.049	00:00	0.135	0.122
1270	<input type="checkbox"/>	P1938	0.000	00:00	0.000	00:00	0.000	0.000
1271	<input type="checkbox"/>	P1940	0.000	00:00	0.000	00:00	0.000	0.000
1272	<input type="checkbox"/>	P1942	0.171	16:00	0.049	00:00	0.135	0.122
1273	<input type="checkbox"/>	P1944	0.171	16:00	0.049	00:00	0.135	0.122
1274	<input type="checkbox"/>	P1946	0.000	00:00	0.000	00:00	0.000	0.000
1275	<input type="checkbox"/>	P1948	0.000	00:00	0.000	00:00	0.000	0.000
1276	<input type="checkbox"/>	P1950	0.000	00:00	0.000	00:00	0.000	0.000
1277	<input type="checkbox"/>	P1952	0.837	16:00	0.241	00:00	0.662	0.596
1278	<input type="checkbox"/>	P1954	0.000	00:00	0.000	00:00	0.000	0.000
1279	<input type="checkbox"/>	P1956	0.064	16:00	0.000	52:00	0.028	0.064
1280	<input type="checkbox"/>	P1958	0.632	16:00	0.004	52:00	0.281	0.629
1281	<input type="checkbox"/>	P1960	0.064	16:00	0.000	52:00	0.028	0.064
1282	<input type="checkbox"/>	P1962	0.100	00:00	0.000	24:00	0.026	0.100
1283	<input type="checkbox"/>	P1964	1.091	16:00	0.433	30:00	0.813	0.658
1284	<input type="checkbox"/>	P1966	0.837	16:00	0.241	00:00	0.662	0.596
1285	<input type="checkbox"/>	P1968	0.696	16:00	0.004	52:00	0.309	0.692
1286	<input type="checkbox"/>	P1970	0.212	16:00	0.088	00:00	0.165	0.124
1287	<input type="checkbox"/>	P1972	0.039	16:00	0.001	06:00	0.018	0.038
1288	<input type="checkbox"/>	P1974	0.000	00:00	0.000	00:00	0.000	0.000
1289	<input type="checkbox"/>	P1976	0.039	16:00	0.001	06:00	0.018	0.038
1290	<input type="checkbox"/>	P1978	0.250	16:00	0.092	30:00	0.182	0.158
1291	<input type="checkbox"/>	P1980	0.504	16:00	0.112	30:00	0.333	0.392
1292	<input type="checkbox"/>	P1982	0.254	16:00	0.020	30:00	0.151	0.234
1293	<input type="checkbox"/>	P1984	0.387	16:00	0.152	00:00	0.290	0.235
1294	<input type="checkbox"/>	P1986	0.185	06:00	0.012	00:00	0.162	0.173
1295	<input type="checkbox"/>	P1988	0.000	00:00	0.000	00:00	0.000	0.000
1296	<input type="checkbox"/>	P1990	0.000	00:00	0.000	00:00	0.000	0.000
1297	<input type="checkbox"/>	P1992	0.267	00:00	0.000	01:00	0.083	0.267
1298	<input type="checkbox"/>	P1994	0.026	00:00	0.000	01:00	0.008	0.026
1299	<input type="checkbox"/>	P1996	0.268	30:00	0.063	16:00	0.162	0.205
1300	<input type="checkbox"/>	P1998	1.222	16:00	0.465	30:00	0.881	0.757
1301	<input type="checkbox"/>	P2000	0.260	16:00	0.092	30:00	0.186	0.168
1302	<input type="checkbox"/>	P2002	0.741	16:00	0.061	00:00	0.665	0.680
1303	<input type="checkbox"/>	P2004	0.608	16:00	0.002	30:00	0.352	0.605
1304	<input type="checkbox"/>	P2006	0.516	00:00	0.031	55:00	0.236	0.485
1305	<input type="checkbox"/>	P2008	0.593	16:00	0.029	51:00	0.271	0.564
1306	<input type="checkbox"/>	P2010	1.089	16:00	0.001	29:00	0.576	1.088
1307	<input type="checkbox"/>	P2012	0.593	16:00	0.029	51:00	0.271	0.564
1308	<input type="checkbox"/>	P2014	0.241	16:00	0.010	06:00	0.112	0.231
1309	<input type="checkbox"/>	P2016	1.628	16:00	0.015	51:00	0.730	1.613
1310	<input type="checkbox"/>	P2018	1.180	16:00	0.011	51:00	0.529	1.169
1311	<input type="checkbox"/>	P2020	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

	ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1312	P2022	1.180	16:00	0.011	51:00	0.529	1.169
1313	P2024	0.352	16:00	0.011	51:00	0.159	0.340
1314	P2026	1.421	16:00	0.007	51:00	0.640	1.414
1315	P2028	0.449	16:00	0.004	51:00	0.201	0.445
1316	P2030	0.081	16:00	0.004	06:00	0.037	0.077
1317	P2032	0.271	16:00	0.004	51:00	0.122	0.266
1318	P2034	0.530	16:00	0.003	51:00	0.239	0.527
1319	P2036	0.287	16:00	0.001	51:00	0.129	0.286
1320	P2038	0.243	16:00	0.002	51:00	0.109	0.241
1321	P2040	0.558	16:00	0.005	51:00	0.251	0.552
1322	P2042	0.072	16:00	0.001	51:00	0.032	0.071
1323	P2044	0.315	16:00	0.003	51:00	0.142	0.312
1324	P2046	0.000	00:00	0.000	00:00	0.000	0.000
1325	P2048	0.486	16:00	0.004	51:00	0.219	0.481
1326	P2050	0.315	16:00	0.003	51:00	0.142	0.312
1327	P2052	0.800	16:00	0.007	51:00	0.361	0.793
1328	P2054	0.000	00:00	0.000	00:00	0.000	0.000
1329	P2056	0.000	00:00	0.000	00:00	0.000	0.000
1330	P2058	0.000	00:00	0.000	00:00	0.000	0.000
1331	P2060	0.825	16:00	0.174	00:00	0.732	0.651
1332	P2062	0.016	68:00	0.001	00:00	0.015	0.015
1333	P2064	0.232	16:00	0.045	00:00	0.209	0.187
1334	P2066	0.217	16:00	0.044	00:00	0.193	0.173
1335	P2068	0.000	00:00	0.000	00:00	0.000	0.000
1336	P2072	0.010	30:00	0.002	16:00	0.005	0.008
1337	P2074	0.003	30:00	0.001	16:00	0.002	0.003
1338	P2076	0.006	30:00	0.001	16:00	0.004	0.005
1339	P2078	0.010	30:00	0.002	16:00	0.005	0.008
1340	P2082	0.050	30:00	0.010	16:00	0.028	0.041
1341	P2084	0.050	30:00	0.010	16:00	0.028	0.041
1342	P2086	0.050	30:00	0.010	16:00	0.028	0.041
1343	P2088	0.000	00:00	0.000	00:00	0.000	0.000
1344	P2090	0.000	00:00	0.000	01:00	0.000	0.000
1345	P2092	0.000	00:00	0.000	00:00	0.000	0.000
1346	P2094	0.000	00:00	0.000	00:00	0.000	0.000
1347	P2096	0.000	00:00	0.000	01:00	0.000	0.000
1348	P2098	0.000	00:00	0.000	01:00	0.000	0.000
1349	P2100	0.000	00:00	0.000	00:00	0.000	0.000
1350	P2102	0.000	00:00	0.000	00:00	0.000	0.000
1351	P2104	0.000	00:00	0.000	00:00	0.000	0.000
1352	P2106	0.000	00:00	0.000	00:00	0.000	0.000
1353	P2108	0.000	00:00	0.000	01:00	0.000	0.000
1354	P2110	0.000	00:00	0.000	01:00	0.000	0.000
1355	P2112	0.000	00:00	0.000	01:00	0.000	0.000
1356	P2114	0.000	00:00	0.000	00:00	0.000	0.000
1357	P2116	0.000	00:00	0.000	00:00	0.000	0.000
1358	P2118	0.000	00:00	0.000	01:00	0.000	0.000
1359	P2120	0.000	00:00	0.000	00:00	0.000	0.000
1360	P2122	0.000	00:00	0.000	01:00	0.000	0.000
1361	P2124	0.000	00:00	0.000	01:00	0.000	0.000
1362	P2126	0.000	00:00	0.000	01:00	0.000	0.000
1363	P2128	0.000	00:00	0.000	00:00	0.000	0.000
1364	P2130	0.000	00:00	0.000	00:00	0.000	0.000
1365	P2132	0.000	00:00	0.000	00:00	0.000	0.000
1366	P2134	0.000	00:00	0.000	00:00	0.000	0.000
1367	P2136	0.000	00:00	0.000	00:00	0.000	0.000
1368	P2138	0.000	00:00	0.000	00:00	0.000	0.000

		ID	Max.Value (mgd)	Max.Time (hrs.)	Min.Value (mgd)	Min.Time (hrs.)	Average (mgd)	Difference (mgd)
1369	<input type="checkbox"/>	P2140	0.000	00:00	0.000	00:00	0.000	0.000
1370	<input type="checkbox"/>	P2142	0.000	00:00	0.000	00:00	0.000	0.000
1371	<input type="checkbox"/>	P2144	0.000	00:00	0.000	00:00	0.000	0.000
1372	<input type="checkbox"/>	P2146	0.000	00:00	0.000	00:00	0.000	0.000
1373	<input type="checkbox"/>	P2148	0.000	00:00	0.000	00:00	0.000	0.000
1374	<input type="checkbox"/>	P2150	0.000	00:00	0.000	00:00	0.000	0.000
1375	<input type="checkbox"/>	P2152	0.000	00:00	0.000	00:00	0.000	0.000
1376	<input type="checkbox"/>	P2154	0.000	00:00	0.000	00:00	0.000	0.000
1377	<input type="checkbox"/>	P2156	0.000	00:00	0.000	01:00	0.000	0.000
1378	<input type="checkbox"/>	P2158	0.000	00:00	0.000	00:00	0.000	0.000
1379	<input type="checkbox"/>	P2160	0.000	00:00	0.000	00:00	0.000	0.000
1380	<input type="checkbox"/>	P2162	0.000	00:00	0.000	00:00	0.000	0.000
1381	<input type="checkbox"/>	P2164	0.000	00:00	0.000	00:00	0.000	0.000
1382	<input type="checkbox"/>	P2166	0.000	00:00	0.000	01:00	0.000	0.000
1383	<input type="checkbox"/>	P2168	0.000	00:00	0.000	00:00	0.000	0.000
1384	<input type="checkbox"/>	P2170	0.000	00:00	0.000	00:00	0.000	0.000
1385	<input type="checkbox"/>	P2172	0.000	00:00	0.000	00:00	0.000	0.000
1386	<input type="checkbox"/>	P2174	0.000	00:00	0.000	00:00	0.000	0.000
1387	<input type="checkbox"/>	P2176	0.000	00:00	0.000	00:00	0.000	0.000
1388	<input type="checkbox"/>	P2178	1.750	16:00	0.332	00:00	1.566	1.417
1389	<input type="checkbox"/>	P2184	2.967	35:00	0.011	05:00	1.088	2.955
1390	<input type="checkbox"/>	P2186	3.890	35:00	0.115	51:00	1.330	3.775
1391	<input type="checkbox"/>	P2188	3.259	35:00	0.096	29:00	1.083	3.163
1392	<input type="checkbox"/>	P2190	0.000	00:00	0.000	00:00	0.000	0.000
1393	<input type="checkbox"/>	P2194	0.656	30:00	0.127	16:00	0.363	0.529
1394	<input type="checkbox"/>	P2196	2.796	35:00	0.065	28:00	1.027	2.731
1395	<input type="checkbox"/>	P2198	0.000	00:00	0.000	00:00	0.000	0.000
1396	<input type="checkbox"/>	P2200	0.594	68:00	0.044	00:00	0.553	0.550
1397	<input type="checkbox"/>	P2202	2.221	16:00	0.014	51:00	1.001	2.207
1398	<input type="checkbox"/>	P2204	0.000	00:00	0.000	00:00	0.000	0.000
1399	<input type="checkbox"/>	P2206	0.000	00:00	0.000	00:00	0.000	0.000
1400	<input type="checkbox"/>	P-1143	0.237	29:00	0.039	16:00	0.143	0.199
1401	<input type="checkbox"/>	P-1444	0.237	29:00	0.039	16:00	0.143	0.199
1402	<input type="checkbox"/>	P-276	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1	<input type="checkbox"/>	P-301	0.526	30:00	0.102	16:00	0.292	0.424
2	<input type="checkbox"/>	P-302	0.280	30:00	0.054	16:00	0.155	0.226
3	<input type="checkbox"/>	P-303	0.159	30:00	0.031	16:00	0.088	0.128
4	<input type="checkbox"/>	P-304	0.108	30:00	0.021	16:00	0.060	0.087
5	<input type="checkbox"/>	P-305	0.114	30:00	0.022	16:00	0.063	0.092
6	<input type="checkbox"/>	P-306	0.300	30:00	0.058	16:00	0.166	0.242
7	<input type="checkbox"/>	P-443	0.085	30:00	0.017	16:00	0.047	0.069
8	<input type="checkbox"/>	P-446	0.410	30:00	0.079	16:00	0.227	0.330
9	<input type="checkbox"/>	P-1325	0.067	30:00	0.013	16:00	0.037	0.054
10	<input type="checkbox"/>	P-1319	0.526	30:00	0.102	16:00	0.292	0.424
11	<input type="checkbox"/>	P-309A	0.916	30:00	0.177	16:00	0.508	0.739
12	<input type="checkbox"/>	P-1318A	0.775	30:00	0.150	16:00	0.430	0.625
13	<input type="checkbox"/>	P-3012	0.927	30:00	0.179	16:00	0.514	0.747
14	<input type="checkbox"/>	P-3013	0.785	30:00	0.152	16:00	0.435	0.633
15	<input type="checkbox"/>	P-445B	0.059	30:00	0.011	16:00	0.032	0.047
16	<input type="checkbox"/>	P-445A	0.272	30:00	0.053	16:00	0.151	0.220
17	<input type="checkbox"/>	P-1345A	0.217	30:00	0.042	16:00	0.120	0.175
18	<input type="checkbox"/>	P-1317A	0.182	30:00	0.035	16:00	0.101	0.147
19	<input type="checkbox"/>	P-1317B	0.394	30:00	0.076	16:00	0.219	0.318
20	<input type="checkbox"/>	P-1030	0.274	30:00	0.053	16:00	0.152	0.221
21	<input type="checkbox"/>	P-1354B	0.049	30:00	0.009	16:00	0.027	0.040
22	<input type="checkbox"/>	P-1354C	0.030	30:00	0.006	16:00	0.017	0.024
23	<input type="checkbox"/>	P-444A	0.149	30:00	0.029	16:00	0.083	0.121
24	<input type="checkbox"/>	P-444B	0.338	30:00	0.065	16:00	0.187	0.272
25	<input type="checkbox"/>	P-1043	0.224	30:00	0.043	16:00	0.124	0.180
26	<input type="checkbox"/>	P1744	0.785	30:00	0.152	16:00	0.435	0.633
27	<input type="checkbox"/>	P1746	5.351	10:00	0.054	42:00	3.355	5.298
28	<input type="checkbox"/>	P1758	0.927	30:00	0.179	16:00	0.514	0.747
29	<input type="checkbox"/>	P-277	2.462	30:00	1.088	15:00	1.794	1.374
30	<input type="checkbox"/>	P-278	1.686	00:00	0.712	67:00	1.225	0.974
31	<input type="checkbox"/>	P-280	0.817	35:00	0.079	68:00	0.452	0.738
32	<input type="checkbox"/>	P-281	0.603	35:00	0.237	18:00	0.423	0.365
33	<input type="checkbox"/>	P-282	1.024	35:00	0.410	18:00	0.726	0.615
34	<input type="checkbox"/>	P-283	0.670	35:00	0.101	68:00	0.385	0.570
35	<input type="checkbox"/>	P-284	0.288	35:00	0.096	68:00	0.194	0.192
36	<input type="checkbox"/>	P-286	0.437	68:00	0.008	51:00	0.142	0.428
37	<input type="checkbox"/>	P-289	1.082	30:00	0.047	16:00	0.563	1.035
38	<input type="checkbox"/>	P-292	2.411	30:00	0.018	16:00	1.271	2.392
39	<input type="checkbox"/>	P-293	1.710	30:00	0.043	16:00	0.849	1.667
40	<input type="checkbox"/>	P-294	2.262	30:00	0.057	16:00	1.145	2.205
41	<input type="checkbox"/>	P-295	1.475	35:00	0.136	68:00	0.809	1.338
42	<input type="checkbox"/>	P-297	2.436	30:00	0.056	16:00	1.148	2.381
43	<input type="checkbox"/>	P-298	2.154	30:00	0.093	16:00	1.017	2.061
44	<input type="checkbox"/>	P-299	1.968	30:00	0.069	16:00	1.028	1.898
45	<input type="checkbox"/>	P-330	2.853	30:00	1.175	65:00	2.011	1.678
46	<input type="checkbox"/>	P-420	1.627	37:00	0.430	68:00	0.870	1.197
47	<input type="checkbox"/>	P-424	0.731	30:00	0.183	16:00	0.412	0.548
48	<input type="checkbox"/>	P-427	0.535	37:00	0.211	34:00	0.313	0.324
49	<input type="checkbox"/>	P-442	1.027	35:00	0.001	62:00	0.506	1.026
50	<input type="checkbox"/>	P-460	0.250	38:00	0.050	08:00	0.141	0.201
51	<input type="checkbox"/>	P-461	0.455	30:00	0.125	35:00	0.279	0.330
52	<input type="checkbox"/>	P-462	0.584	30:00	0.043	35:00	0.289	0.541
53	<input type="checkbox"/>	P-463	0.211	30:00	0.002	16:00	0.114	0.209
54	<input type="checkbox"/>	P-464	1.634	30:00	0.767	13:00	1.069	0.866
55	<input type="checkbox"/>	P-465	1.984	30:00	0.859	15:00	1.263	1.125
56	<input type="checkbox"/>	P-487	0.953	35:00	0.002	68:00	0.588	0.950
57	<input type="checkbox"/>	P-510	3.216	28:00	0.218	59:00	2.061	2.998

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
58	<input type="checkbox"/>	P-512	3.469	35:00	0.134	59:00	1.558	3.335
59	<input type="checkbox"/>	P-545	0.532	68:00	0.005	45:00	0.140	0.527
60	<input type="checkbox"/>	P-547	0.700	68:00	0.005	09:00	0.253	0.696
61	<input type="checkbox"/>	P-548	0.616	68:00	0.002	72:00	0.129	0.614
62	<input type="checkbox"/>	P-549	0.318	25:00	0.008	27:00	0.117	0.310
63	<input type="checkbox"/>	P-550	0.781	68:00	0.001	31:00	0.222	0.781
64	<input type="checkbox"/>	P-551	1.151	35:00	0.014	58:00	0.444	1.138
65	<input type="checkbox"/>	P-552	1.151	30:00	0.015	16:00	0.616	1.136
66	<input type="checkbox"/>	P-568	1.809	30:00	0.666	10:00	1.214	1.143
67	<input type="checkbox"/>	P-569	1.070	00:00	0.466	10:00	0.803	0.604
68	<input type="checkbox"/>	P-571	0.756	30:00	0.010	16:00	0.334	0.746
69	<input type="checkbox"/>	P-572	0.660	68:00	0.000	32:00	0.178	0.659
70	<input type="checkbox"/>	P-573	0.859	35:00	0.081	68:00	0.415	0.778
71	<input type="checkbox"/>	P-574	2.346	30:00	0.480	16:00	1.288	1.867
72	<input type="checkbox"/>	P-575	1.495	30:00	0.146	16:00	0.869	1.349
73	<input type="checkbox"/>	P-580	1.427	03:00	0.005	18:00	0.606	1.422
74	<input type="checkbox"/>	P-604	0.341	61:00	0.195	67:00	0.260	0.146
75	<input type="checkbox"/>	P-629	2.675	35:00	0.115	68:00	1.597	2.560
76	<input type="checkbox"/>	P-635	4.622	35:00	2.773	12:00	3.887	1.849
77	<input type="checkbox"/>	P-637	4.542	35:00	2.483	68:00	3.686	2.059
78	<input type="checkbox"/>	P-640	1.605	35:00	0.000	21:00	0.604	1.605
79	<input type="checkbox"/>	P-642	1.822	35:00	0.004	27:00	0.632	1.818
80	<input type="checkbox"/>	P-649	1.244	35:00	0.153	68:00	0.799	1.090
81	<input type="checkbox"/>	P-650	1.325	35:00	0.442	68:00	0.981	0.883
82	<input type="checkbox"/>	P-668	2.960	35:00	1.084	68:00	2.146	1.876
83	<input type="checkbox"/>	P-671	1.678	68:00	0.016	57:00	0.709	1.661
84	<input type="checkbox"/>	P-686	2.671	00:00	0.841	38:00	1.837	1.830
85	<input type="checkbox"/>	P-689	2.902	00:00	0.810	03:00	2.083	2.093
86	<input type="checkbox"/>	P-704	1.376	01:00	0.044	18:00	0.774	1.332
87	<input type="checkbox"/>	P-706	2.434	68:00	0.028	40:00	1.050	2.406
88	<input type="checkbox"/>	P-716	0.912	35:00	0.088	37:00	0.455	0.824
89	<input type="checkbox"/>	P-717	0.783	35:00	0.004	62:00	0.290	0.779
90	<input type="checkbox"/>	P-740	2.743	30:00	0.103	16:00	1.392	2.641
91	<input type="checkbox"/>	P-741	2.389	30:00	0.080	16:00	1.195	2.309
92	<input type="checkbox"/>	P-745	0.977	16:00	0.011	68:00	0.559	0.966
93	<input type="checkbox"/>	P-747	1.079	16:00	0.107	10:00	0.650	0.972
94	<input type="checkbox"/>	P-769	0.928	68:00	0.001	06:00	0.231	0.927
95	<input type="checkbox"/>	P-789	1.134	68:00	0.016	62:00	0.468	1.117
96	<input type="checkbox"/>	P-791	1.539	30:00	0.955	12:00	1.301	0.584
97	<input type="checkbox"/>	P-792	0.529	35:00	0.019	22:00	0.246	0.510
98	<input type="checkbox"/>	P-793	1.464	35:00	0.718	12:00	1.114	0.746
99	<input type="checkbox"/>	P-794	0.530	35:00	0.228	14:00	0.348	0.301
100	<input type="checkbox"/>	P-889	0.468	35:00	0.019	45:00	0.180	0.449
101	<input type="checkbox"/>	P-890	0.618	61:00	0.366	67:00	0.483	0.252
102	<input type="checkbox"/>	P-891	1.809	35:00	0.013	45:00	0.891	1.796
103	<input type="checkbox"/>	P-893	1.289	30:00	0.575	16:00	0.857	0.714
104	<input type="checkbox"/>	P-897	1.465	30:00	0.687	16:00	1.089	0.779
105	<input type="checkbox"/>	P-898	2.024	35:00	0.931	68:00	1.553	1.093
106	<input type="checkbox"/>	P-899	1.952	35:00	0.676	68:00	1.392	1.276
107	<input type="checkbox"/>	P-636	4.347	35:00	2.473	68:00	3.567	1.875
108	<input type="checkbox"/>	P-900	1.173	35:00	0.313	68:00	0.792	0.861
109	<input type="checkbox"/>	P-901	1.672	30:00	0.967	16:00	1.358	0.705
110	<input type="checkbox"/>	P-902	1.521	35:00	0.002	53:00	0.621	1.519
111	<input type="checkbox"/>	P-906	1.988	30:00	0.874	13:00	1.272	1.114
112	<input type="checkbox"/>	P-908	0.932	30:00	0.547	67:00	0.730	0.385
113	<input type="checkbox"/>	P-909	0.546	30:00	0.301	13:00	0.405	0.245
114	<input type="checkbox"/>	P-910	0.713	30:00	0.357	13:00	0.496	0.356



Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
115	<input type="checkbox"/>	P-911	0.996	30:00	0.163	16:00	0.542	0.833
116	<input type="checkbox"/>	P-947	0.599	30:00	0.077	16:00	0.330	0.522
117	<input type="checkbox"/>	P-963	1.646	30:00	0.111	16:00	0.849	1.534
118	<input type="checkbox"/>	P-964	1.579	30:00	0.009	58:00	0.725	1.570
119	<input type="checkbox"/>	P-969	0.548	38:00	0.100	10:00	0.314	0.448
120	<input type="checkbox"/>	P-970	1.340	54:00	0.243	16:00	0.873	1.097
121	<input type="checkbox"/>	P-971	1.513	30:00	0.635	10:00	1.131	0.878
122	<input type="checkbox"/>	P-972	1.007	35:00	0.099	68:00	0.567	0.908
123	<input type="checkbox"/>	P-975	1.254	35:00	0.253	44:00	0.735	1.001
124	<input type="checkbox"/>	P-976	0.492	50:00	0.007	67:00	0.200	0.486
125	<input type="checkbox"/>	P-977	0.764	68:00	0.021	47:00	0.315	0.743
126	<input type="checkbox"/>	P-978	1.242	30:00	0.064	65:00	0.625	1.178
127	<input type="checkbox"/>	P-979	0.786	54:00	0.003	64:00	0.364	0.783
128	<input type="checkbox"/>	P-981	1.681	30:00	0.482	10:00	1.006	1.199
129	<input type="checkbox"/>	P-983	0.576	38:00	0.011	00:00	0.251	0.564
130	<input type="checkbox"/>	P-986	0.758	55:00	0.022	22:00	0.383	0.736
131	<input type="checkbox"/>	P-1018	2.176	30:00	0.035	61:00	1.054	2.140
132	<input type="checkbox"/>	P-1041	0.969	30:00	0.491	37:00	0.760	0.478
133	<input type="checkbox"/>	P-1045	0.621	35:00	0.014	23:00	0.237	0.607
134	<input type="checkbox"/>	P-1057	0.951	16:00	0.000	51:00	0.366	0.951
135	<input type="checkbox"/>	P-1059	3.276	35:00	0.094	45:00	1.665	3.181
136	<input type="checkbox"/>	P-1173	1.050	30:00	0.203	16:00	0.582	0.847
137	<input type="checkbox"/>	P-1175	0.765	30:00	0.148	16:00	0.424	0.617
138	<input type="checkbox"/>	P-1176	0.132	30:00	0.026	16:00	0.073	0.106
139	<input type="checkbox"/>	P-1179	0.742	30:00	0.123	35:00	0.420	0.619
140	<input type="checkbox"/>	P-1180	1.750	35:00	0.005	18:00	0.649	1.746
141	<input type="checkbox"/>	P-1181	1.741	35:00	0.009	07:00	0.618	1.732
142	<input type="checkbox"/>	P-1182	1.333	30:00	0.024	35:00	0.744	1.309
143	<input type="checkbox"/>	P-1273	2.340	30:00	1.156	16:00	1.779	1.184
144	<input type="checkbox"/>	P-1274	3.303	35:00	1.432	68:00	2.503	1.870
145	<input type="checkbox"/>	P-1275	3.808	35:00	1.690	68:00	2.903	2.119
146	<input type="checkbox"/>	P-1281	3.153	35:00	0.035	17:00	1.136	3.118
147	<input type="checkbox"/>	P-1282	3.363	35:00	0.000	17:00	1.222	3.362
148	<input type="checkbox"/>	P-1283	1.892	35:00	0.025	54:00	0.821	1.867
149	<input type="checkbox"/>	P-1339	0.680	33:00	0.000	60:00	0.314	0.680
150	<input type="checkbox"/>	P-1340	1.715	03:00	0.055	17:00	0.777	1.660
151	<input type="checkbox"/>	P-1342	0.882	38:00	0.008	03:00	0.490	0.874
152	<input type="checkbox"/>	P-1343	0.734	68:00	0.007	03:00	0.291	0.727
153	<input type="checkbox"/>	P-1344	0.774	29:00	0.002	72:00	0.236	0.772
154	<input type="checkbox"/>	P-1355	0.616	35:00	0.092	68:00	0.390	0.524
155	<input type="checkbox"/>	P-1374	0.170	30:00	0.004	15:00	0.087	0.165
156	<input type="checkbox"/>	P-1377	0.835	30:00	0.120	16:00	0.456	0.715
157	<input type="checkbox"/>	P-1379	0.841	35:00	0.365	14:00	0.558	0.476
158	<input type="checkbox"/>	P-1380	5.025	33:00	3.090	12:00	4.276	1.936
159	<input type="checkbox"/>	P-1382	4.364	35:00	2.234	68:00	3.470	2.130
160	<input type="checkbox"/>	P-1384	1.902	35:00	0.901	68:00	1.466	1.001
161	<input type="checkbox"/>	P-1385	1.430	35:00	0.308	68:00	0.924	1.122
162	<input type="checkbox"/>	P-1389	0.624	10:00	0.009	12:00	0.319	0.615
163	<input type="checkbox"/>	P-1396	0.749	68:00	0.004	65:00	0.183	0.746
164	<input type="checkbox"/>	P-1397	1.164	22:00	0.485	03:00	0.872	0.679
165	<input type="checkbox"/>	P-1398	2.715	00:00	0.641	03:00	1.936	2.074
166	<input type="checkbox"/>	P-1183	2.014	61:00	0.965	12:00	1.309	1.048
167	<input type="checkbox"/>	P-1185	0.846	61:00	0.360	12:00	0.506	0.487
168	<input type="checkbox"/>	P-1184	1.775	61:00	0.548	45:00	0.936	1.227
169	<input type="checkbox"/>	P-1406	0.492	61:00	0.040	68:00	0.213	0.451
170	<input type="checkbox"/>	P-1408	1.706	35:00	0.001	22:00	0.770	1.705
171	<input type="checkbox"/>	P-1410	0.539	35:00	0.318	12:00	0.448	0.221

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
172	P-1412	2.642	35:00	0.232	68:00	1.516	2.410
173	P-1417	0.888	30:00	0.009	41:00	0.433	0.880
174	P-1419	0.639	30:00	0.016	67:00	0.368	0.623
175	P-1420	1.800	68:00	0.005	50:00	0.598	1.795
176	P-1421	0.619	30:00	0.014	41:00	0.264	0.606
177	P-1431	3.421	30:00	0.649	16:00	1.890	2.772
178	P-1432	2.928	30:00	0.580	16:00	1.630	2.348
179	P-1462	1.330	35:00	0.011	22:00	0.526	1.319
180	P-1463	1.308	35:00	0.029	04:00	0.496	1.280
181	P-1464	1.352	35:00	0.019	04:00	0.503	1.333
182	P-1465	1.263	35:00	0.013	04:00	0.476	1.251
183	P-1466	0.567	35:00	0.011	04:00	0.214	0.556
184	P-1506	2.084	58:00	0.011	53:00	0.682	2.073
185	P-1507	1.852	03:00	0.003	17:00	0.804	1.848
186	P-1518	1.640	56:00	0.005	11:00	0.907	1.635
187	P-1519	1.629	56:00	0.010	11:00	0.902	1.619
188	P-1542	0.000	00:00	0.000	00:00	0.000	0.000
189	P-1543	0.035	30:00	0.007	16:00	0.019	0.028
190	P-40	0.000	00:00	0.000	00:00	0.000	0.000
191	P-71	0.000	00:00	0.000	00:00	0.000	0.000
192	P-1569	4.516	30:00	2.544	16:00	3.643	1.972
193	P-1568	3.640	30:00	2.076	16:00	2.954	1.564
194	P-139	3.811	00:00	1.608	68:00	2.740	2.203
195	P-141	1.605	30:00	0.661	65:00	1.131	0.944
196	P-142	3.811	00:00	1.608	68:00	2.740	2.203
197	P-179A	1.171	30:00	0.210	16:00	0.590	0.961
198	P-194	0.041	30:00	0.008	16:00	0.023	0.033
199	P-195	0.011	30:00	0.002	16:00	0.006	0.009
200	P-333	3.482	68:00	0.000	00:00	3.299	3.482
201	P-348	3.393	35:00	0.011	18:00	1.197	3.382
202	P-353	3.188	35:00	0.034	31:00	0.971	3.154
203	P-365	3.377	35:00	0.014	51:00	1.183	3.363
204	P-366	3.377	35:00	0.014	51:00	1.183	3.363
205	P-393	2.853	35:00	0.084	29:00	0.948	2.769
206	P-454	3.725	00:00	1.471	68:00	2.654	2.254
207	P-557	2.086	30:00	0.740	65:00	1.368	1.346
208	P-469	1.213	30:00	0.020	61:00	0.587	1.193
209	P-468	0.738	68:00	0.001	32:00	0.248	0.738
210	P-475	1.379	35:00	0.624	68:00	1.055	0.755
211	P-466	1.692	35:00	0.070	69:00	0.887	1.622
212	P-1409	1.098	30:00	0.523	16:00	0.841	0.574
213	P-1065	1.775	03:00	0.027	17:00	0.788	1.748
214	P-1327	1.172	68:00	0.002	24:00	0.435	1.170
215	P-1378	1.585	30:00	0.639	15:00	0.979	0.946
216	P-912	1.357	61:00	0.770	67:00	1.027	0.587
217	P-1415	0.569	37:00	0.000	24:00	0.199	0.569
218	P-419	0.034	30:00	0.006	16:00	0.019	0.027
219	P-1330	0.195	68:00	0.000	31:00	0.055	0.194
220	P-315	2.472	35:00	0.075	58:00	1.084	2.398
221	P-628	1.744	35:00	0.890	12:00	1.328	0.854
222	P-1277B	0.958	35:00	0.014	68:00	0.532	0.944
223	P-273	1.287	30:00	0.619	16:00	0.969	0.668
224	P-275	0.778	33:00	0.380	68:00	0.653	0.398
225	P-631	3.711	32:00	2.174	68:00	3.145	1.537
226	P-632	3.859	31:00	2.347	68:00	3.254	1.512
227	P-331	0.737	35:00	0.284	68:00	0.593	0.453
228	P-334	1.370	31:00	0.815	68:00	1.153	0.555

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
229	P-798	0.665	30:00	0.113	16:00	0.362	0.552
230	P-799	0.649	30:00	0.155	16:00	0.370	0.493
231	P-1174	1.213	30:00	0.235	16:00	0.673	0.978
232	P-1512	0.711	30:00	0.205	16:00	0.418	0.506
233	P-1513	0.185	30:00	0.004	16:00	0.093	0.180
234	P-1517	0.603	30:00	0.117	16:00	0.335	0.487
235	P-1530	1.168	61:00	0.003	29:00	0.486	1.166
236	P-1531	0.475	61:00	0.001	54:00	0.188	0.474
237	P-1535	0.632	61:00	0.005	50:00	0.248	0.628
238	P-1536	1.031	61:00	0.006	23:00	0.395	1.024
239	P-1527	1.018	61:00	0.022	22:00	0.468	0.996
240	P-1516	0.653	34:00	0.016	69:00	0.405	0.636
241	P-1509	0.523	61:00	0.021	59:00	0.206	0.502
242	P-1511	0.437	61:00	0.005	23:00	0.164	0.431
243	P-1521	0.209	35:00	0.002	71:00	0.076	0.207
244	P-1529	0.294	35:00	0.003	71:00	0.106	0.291
245	P-1532	0.432	35:00	0.001	69:00	0.161	0.431
246	P-431	0.126	30:00	0.024	16:00	0.070	0.101
247	P-948	1.205	30:00	0.155	16:00	0.665	1.050
248	P-1546	1.293	30:00	0.054	63:00	0.619	1.239
249	P-1403	0.180	30:00	0.020	16:00	0.097	0.159
250	P-1402	0.366	30:00	0.029	16:00	0.196	0.336
251	P-1549	0.440	30:00	0.050	16:00	0.238	0.390
252	P-239	2.700	00:00	0.906	38:00	1.876	1.795
253	P-234	2.498	00:00	0.730	38:00	1.698	1.767
254	P-675	2.372	00:00	0.631	38:00	1.590	1.741
255	P-1373	1.739	55:00	0.005	66:00	0.962	1.735
256	P-1375	1.656	56:00	0.018	19:00	0.918	1.638
257	P-176	3.715	00:00	1.455	68:00	2.644	2.260
258	P-669	2.251	68:00	0.016	13:00	0.972	2.235
259	P-2016	0.492	68:00	0.002	41:00	0.145	0.491
260	P-2017	0.599	35:00	0.008	60:00	0.193	0.591
261	P-197B	1.200	30:00	0.216	16:00	0.606	0.984
262	P-312A	4.072	27:00	0.240	58:00	2.603	3.831
263	P-312B	2.450	35:00	0.106	58:00	1.061	2.344
264	P-540	2.346	39:00	0.096	58:00	1.368	2.250
265	P-1329B	0.438	68:00	0.000	31:00	0.125	0.437
266	P-1329A	0.438	68:00	0.000	31:00	0.125	0.437
267	P-1323B	0.881	16:00	0.013	05:00	0.320	0.868
268	P-1323A	0.973	35:00	0.004	47:00	0.332	0.969
269	P-1324B	2.657	04:00	0.232	59:00	1.250	2.424
270	P-1017	1.288	03:00	0.073	58:00	0.661	1.214
271	P-1324A	2.032	04:00	0.187	59:00	0.664	1.845
272	P-317	1.001	04:00	0.126	15:00	0.382	0.875
273	P-1354D	0.000	00:00	0.000	00:00	0.000	0.000
274	P-1046	0.257	35:00	0.001	69:00	0.123	0.255
275	P-1277A	0.420	35:00	0.243	12:00	0.349	0.177
276	P-1381A	0.883	30:00	0.164	16:00	0.528	0.719
277	P-1381B	0.428	35:00	0.005	36:00	0.145	0.423
278	P-1381C	0.667	33:00	0.340	12:00	0.523	0.327
279	P-423B	0.307	35:00	0.124	68:00	0.234	0.183
280	P-423A	0.529	30:00	0.261	16:00	0.408	0.268
281	P-1510	1.065	30:00	0.226	16:00	0.598	0.839
282	P-1500	0.706	30:00	0.182	16:00	0.408	0.524
283	P-1411A	2.694	35:00	1.291	68:00	2.210	1.404
284	P-1411D	2.431	35:00	0.356	68:00	1.623	2.075
285	P-1411E	2.990	35:00	0.170	68:00	1.886	2.819

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
286	<input type="checkbox"/>	P-1411C	2.509	35:00	0.633	68:00	1.797	1.876
287	<input type="checkbox"/>	P-1411B	2.676	35:00	1.225	68:00	2.169	1.451
288	<input type="checkbox"/>	P-1123	0.831	30:00	0.392	15:00	0.561	0.439
289	<input type="checkbox"/>	P-1127	1.017	30:00	0.421	16:00	0.660	0.596
290	<input type="checkbox"/>	P-1136	0.455	30:00	0.041	16:00	0.236	0.414
291	<input type="checkbox"/>	FCV-4_U	2.528	35:00	0.217	68:00	1.598	2.311
292	<input type="checkbox"/>	FCV-4_D	2.528	35:00	0.217	68:00	1.598	2.311
293	<input type="checkbox"/>	P1542	3.235	68:00	0.002	03:00	0.852	3.233
294	<input type="checkbox"/>	P1554	3.407	03:00	0.005	39:00	1.077	3.402
295	<input type="checkbox"/>	P1574	1.890	30:00	0.030	38:00	0.900	1.860
296	<input type="checkbox"/>	P1576	0.008	30:00	0.002	16:00	0.005	0.007
297	<input type="checkbox"/>	P1582	0.000	00:00	0.000	00:00	0.000	0.000
298	<input type="checkbox"/>	P1588	0.000	00:00	0.000	00:00	0.000	0.000
299	<input type="checkbox"/>	P1592	3.710	00:00	1.448	68:00	2.639	2.263
300	<input type="checkbox"/>	P1616	3.100	32:00	1.852	68:00	2.625	1.248
301	<input type="checkbox"/>	P1618	2.140	30:00	1.243	16:00	1.752	0.898
302	<input type="checkbox"/>	P1620	1.496	33:00	0.897	68:00	1.266	0.599
303	<input type="checkbox"/>	P1622	1.576	35:00	0.385	68:00	1.020	1.190
304	<input type="checkbox"/>	P1624	1.059	33:00	0.564	12:00	0.850	0.495
305	<input type="checkbox"/>	P1630	0.917	68:00	0.000	16:00	0.348	0.916
306	<input type="checkbox"/>	P1632	1.653	68:00	0.007	71:00	0.538	1.646
307	<input type="checkbox"/>	P1640	0.292	68:00	0.003	25:00	0.108	0.289
308	<input type="checkbox"/>	P1658	0.910	35:00	0.007	54:00	0.315	0.903
309	<input type="checkbox"/>	P1660	1.375	35:00	0.030	22:00	0.523	1.344
310	<input type="checkbox"/>	P1662	0.507	34:00	0.006	44:00	0.254	0.501
311	<input type="checkbox"/>	P1664	0.539	68:00	0.002	59:00	0.171	0.538
312	<input type="checkbox"/>	P1666	0.662	35:00	0.021	13:00	0.270	0.641
313	<input type="checkbox"/>	P1668	1.288	03:00	0.073	58:00	0.661	1.214
314	<input type="checkbox"/>	P1670	0.916	16:00	0.005	04:00	0.400	0.911
315	<input type="checkbox"/>	P1672	0.722	30:00	0.260	10:00	0.494	0.461
316	<input type="checkbox"/>	P1674	0.901	35:00	0.133	03:00	0.473	0.767
317	<input type="checkbox"/>	P1692	0.586	35:00	0.007	68:00	0.394	0.579
318	<input type="checkbox"/>	P1694	2.478	35:00	0.225	45:00	1.359	2.253
319	<input type="checkbox"/>	P1696	1.762	35:00	0.230	68:00	1.199	1.532
320	<input type="checkbox"/>	P1712	0.299	61:00	0.001	29:00	0.124	0.298
321	<input type="checkbox"/>	P1714	0.386	61:00	0.001	29:00	0.161	0.385
322	<input type="checkbox"/>	P1748	2.450	35:00	0.107	58:00	1.061	2.343
323	<input type="checkbox"/>	P1820	0.917	68:00	0.000	16:00	0.348	0.916
324	<input type="checkbox"/>	P1828	3.715	00:00	1.455	68:00	2.644	2.260
325	<input type="checkbox"/>	P2180	1.027	35:00	0.030	29:00	0.341	0.997
326	<input type="checkbox"/>	P2182	1.962	35:00	0.035	20:00	0.569	1.927
327	<input type="checkbox"/>	P-200	0.042	29:00	0.003	16:00	0.023	0.040
328	<input type="checkbox"/>	P-201	0.056	29:00	0.003	16:00	0.030	0.053
329	<input type="checkbox"/>	P-202	0.117	29:00	0.007	16:00	0.063	0.110
330	<input type="checkbox"/>	P-203	0.069	29:00	0.004	16:00	0.037	0.065
331	<input type="checkbox"/>	P-204	0.018	29:00	0.001	16:00	0.009	0.017
332	<input type="checkbox"/>	P-206	0.019	29:00	0.001	16:00	0.010	0.018
333	<input type="checkbox"/>	P-210	0.156	29:00	0.061	16:00	0.094	0.095
334	<input type="checkbox"/>	P-211	0.254	29:00	0.067	16:00	0.147	0.187
335	<input type="checkbox"/>	P-212	0.184	17:00	0.075	31:00	0.110	0.109
336	<input type="checkbox"/>	P-213	0.267	29:00	0.002	65:00	0.135	0.266
337	<input type="checkbox"/>	P-214	0.286	17:00	0.139	56:00	0.186	0.147
338	<input type="checkbox"/>	P-215	0.193	16:00	0.051	31:00	0.102	0.143
339	<input type="checkbox"/>	P-216	0.077	16:00	0.011	31:00	0.036	0.067
340	<input type="checkbox"/>	P-217	0.108	29:00	0.078	24:00	0.087	0.031
341	<input type="checkbox"/>	P-218	0.134	17:00	0.086	04:00	0.101	0.047
342	<input type="checkbox"/>	P-219	0.353	30:00	0.000	58:00	0.152	0.353

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
343	P-221	0.291	29:00	0.005	64:00	0.137	0.287
344	P-223	0.229	29:00	0.090	16:00	0.146	0.139
345	P-225	0.333	29:00	0.210	16:00	0.248	0.123
346	P-228	0.246	17:00	0.001	22:00	0.072	0.245
347	P-229	0.245	17:00	0.005	08:00	0.079	0.240
348	P-230	0.518	17:00	0.002	03:00	0.159	0.515
349	P-231	0.141	17:00	0.006	33:00	0.059	0.135
350	P-232	0.132	30:00	0.000	33:00	0.041	0.132
351	P-235	0.382	16:00	0.003	31:00	0.157	0.379
352	P-236	0.160	17:00	0.001	46:00	0.060	0.159
353	P-238	0.228	30:00	0.003	37:00	0.082	0.225
354	P-240	0.720	16:00	0.038	69:00	0.388	0.682
355	P-241	0.338	16:00	0.006	29:00	0.189	0.332
356	P-242	0.341	16:00	0.036	30:00	0.215	0.305
357	P-245	0.425	16:00	0.153	30:00	0.321	0.272
358	P-247	0.325	16:00	0.022	30:00	0.194	0.303
359	P-249	0.596	16:00	0.006	29:00	0.331	0.589
360	P-250	0.196	30:00	0.001	38:00	0.073	0.196
361	P-251	0.276	17:00	0.063	31:00	0.171	0.213
362	P-253	0.384	16:00	0.029	69:00	0.222	0.356
363	P-257	0.497	16:00	0.015	21:00	0.197	0.482
364	P-258	0.373	16:00	0.001	03:00	0.115	0.372
365	P-260	0.311	16:00	0.013	23:00	0.083	0.298
366	P-262	0.430	17:00	0.012	39:00	0.132	0.418
367	P-267	0.103	17:00	0.076	30:00	0.096	0.027
368	P-318	0.083	17:00	0.002	65:00	0.020	0.081
369	P-448	1.868	29:00	0.116	16:00	1.011	1.752
370	P-449	0.746	29:00	0.047	16:00	0.404	0.699
371	P-450	0.944	29:00	0.059	16:00	0.512	0.885
372	P-451	1.581	29:00	0.099	16:00	0.857	1.482
373	P-499	1.324	16:00	0.015	26:00	0.379	1.309
374	P-500	0.844	17:00	0.003	11:00	0.250	0.841
375	P-502	0.650	30:00	0.066	65:00	0.284	0.584
376	P-723	0.378	16:00	0.004	25:00	0.158	0.373
377	P-724	0.384	17:00	0.010	54:00	0.189	0.375
378	P-726	0.725	16:00	0.072	30:00	0.428	0.653
379	P-727	0.390	16:00	0.090	30:00	0.245	0.300
380	P-728	0.607	16:00	0.067	30:00	0.373	0.540
381	P-729	1.044	16:00	0.276	30:00	0.730	0.767
382	P-730	0.510	30:00	0.003	44:00	0.214	0.507
383	P-731	0.416	17:00	0.016	57:00	0.159	0.400
384	P-732	0.361	30:00	0.000	01:00	0.143	0.361
385	P-733	0.351	30:00	0.012	43:00	0.141	0.338
386	P-734	0.378	30:00	0.012	01:00	0.152	0.365
387	P-735	0.472	30:00	0.003	57:00	0.193	0.469
388	P-736	0.415	17:00	0.004	39:00	0.131	0.411
389	P-737	0.068	30:00	0.001	59:00	0.025	0.067
390	P-761	3.119	30:00	0.175	16:00	1.666	2.945
391	P-763	1.072	29:00	0.075	16:00	0.589	0.998
392	P-841	0.366	16:00	0.009	45:00	0.153	0.357
393	P-842	0.296	16:00	0.005	56:00	0.124	0.291
394	P-845	0.419	16:00	0.185	30:00	0.338	0.234
395	P-846	0.410	16:00	0.037	30:00	0.258	0.373
396	P-847	0.331	30:00	0.024	66:00	0.134	0.307
397	P-848	0.495	31:00	0.011	09:00	0.170	0.484
398	P-859	0.623	16:00	0.012	02:00	0.297	0.610
399	P-860	0.198	29:00	0.002	68:00	0.077	0.197

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
400	P-999	0.388	64:00	0.202	30:00	0.336	0.186
401	P-1001	0.773	16:00	0.083	30:00	0.493	0.690
402	P-1027	0.576	17:00	0.025	25:00	0.196	0.551
403	P-1029	0.737	30:00	0.008	64:00	0.275	0.729
404	P-1037	0.374	16:00	0.019	29:00	0.213	0.355
405	P-1038	1.348	16:00	0.450	30:00	0.996	0.898
406	P-1039	1.452	16:00	0.574	30:00	1.115	0.878
407	P-1128	0.058	29:00	0.003	16:00	0.031	0.055
408	P-1129	0.031	29:00	0.002	16:00	0.017	0.029
409	P-1130	0.025	29:00	0.002	16:00	0.014	0.024
410	P-1131	0.577	16:00	0.001	17:00	0.202	0.576
411	P-1132	0.664	17:00	0.002	06:00	0.200	0.662
412	P-1133	0.561	17:00	0.006	70:00	0.161	0.555
413	P-1134	0.273	16:00	0.012	22:00	0.119	0.261
414	P-1135	0.275	16:00	0.010	23:00	0.120	0.265
415	P-1270	0.198	29:00	0.012	16:00	0.107	0.186
416	P-1301	0.773	16:00	0.192	30:00	0.541	0.581
417	P-1308	1.580	30:00	0.089	16:00	0.845	1.491
418	P-1309	0.000	00:00	0.000	00:00	0.000	0.000
419	P-1400	0.156	30:00	0.038	12:00	0.083	0.117
420	P-1401	0.426	30:00	0.039	16:00	0.210	0.387
421	P-1433	0.207	17:00	0.002	23:00	0.068	0.205
422	P-1434	0.275	16:00	0.019	30:00	0.171	0.255
423	P-1435	0.273	16:00	0.003	29:00	0.155	0.270
424	P-1453	0.247	17:00	0.014	16:00	0.108	0.233
425	P-1454	0.391	16:00	0.005	29:00	0.219	0.386
426	P-186	1.205	30:00	0.014	12:00	0.449	1.191
427	P-227	0.057	29:00	0.003	16:00	0.031	0.054
428	P-440	1.348	30:00	0.028	11:00	0.497	1.320
429	P-441	0.991	30:00	0.024	36:00	0.355	0.967
430	P-452	0.281	30:00	0.065	40:00	0.146	0.216
431	P-244	0.387	16:00	0.007	52:00	0.098	0.380
432	P-1075	0.302	16:00	0.008	27:00	0.111	0.294
433	P-187A	1.660	30:00	0.094	16:00	0.888	1.566
434	P-187B	1.636	30:00	0.093	16:00	0.875	1.544
435	P-1080	0.000	00:00	0.000	00:00	0.000	0.000
436	P-1026B	0.457	17:00	0.022	05:00	0.153	0.435
437	P-1026A	0.450	17:00	0.019	25:00	0.154	0.431
438	P-1144	1.081	30:00	0.053	16:00	0.565	1.028
439	P-1147	0.193	30:00	0.000	16:00	0.085	0.193
440	BROADWAY_PRV_D	1.553	16:00	0.687	30:00	1.233	0.866
441	PRV-3_D	2.107	30:00	0.000	40:00	0.826	2.107
442	P1550	2.107	16:00	0.015	49:00	0.575	2.092
443	P1568	0.000	00:00	0.000	00:00	0.000	0.000
444	P1604	0.747	16:00	0.003	45:00	0.323	0.744
445	P-237	0.019	29:00	0.001	16:00	0.010	0.018
446	P-322	1.865	29:00	0.576	16:00	1.255	1.288
447	P-324	1.124	29:00	0.296	16:00	0.757	0.827
448	P-325	0.655	30:00	0.006	64:00	0.275	0.649
449	P-326	0.809	29:00	0.197	16:00	0.528	0.612
450	P-327	0.074	29:00	0.021	16:00	0.050	0.053
451	P-328	0.727	29:00	0.170	16:00	0.471	0.557
452	P-337	1.066	30:00	0.133	16:00	0.588	0.933
453	P-338	1.512	30:00	0.173	16:00	0.831	1.339
454	P-339	1.476	33:00	0.068	62:00	0.499	1.408
455	P-342	0.426	00:00	0.000	65:00	0.153	0.426
456	P-343	0.262	30:00	0.009	39:00	0.149	0.253

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
457	<input type="checkbox"/>	P-344	1.884	33:00	0.004	17:00	0.834	1.880
458	<input type="checkbox"/>	P-347	0.723	00:00	0.002	34:00	0.155	0.721
459	<input type="checkbox"/>	P-349	3.180	33:00	0.020	67:00	1.445	3.160
460	<input type="checkbox"/>	P-352	1.777	69:00	0.125	33:00	0.887	1.652
461	<input type="checkbox"/>	P-354	1.360	29:00	0.059	33:00	0.673	1.301
462	<input type="checkbox"/>	P-355	0.952	69:00	0.010	57:00	0.445	0.943
463	<input type="checkbox"/>	P-356	0.515	29:00	0.119	65:00	0.315	0.396
464	<input type="checkbox"/>	P-359	1.826	30:00	0.004	16:00	0.782	1.822
465	<input type="checkbox"/>	P-360	1.786	30:00	0.264	16:00	0.991	1.521
466	<input type="checkbox"/>	P-361	0.793	33:00	0.001	67:00	0.238	0.792
467	<input type="checkbox"/>	P-362	0.773	33:00	0.001	45:00	0.222	0.772
468	<input type="checkbox"/>	P-363	2.402	30:00	0.261	16:00	1.312	2.140
469	<input type="checkbox"/>	P-364	2.237	30:00	0.225	16:00	1.216	2.012
470	<input type="checkbox"/>	P-367	0.242	53:00	0.024	16:00	0.144	0.218
471	<input type="checkbox"/>	P-370	1.999	30:00	0.310	16:00	1.112	1.689
472	<input type="checkbox"/>	P-371	1.738	29:00	0.352	66:00	1.057	1.386
473	<input type="checkbox"/>	P-372	0.703	33:00	0.002	66:00	0.263	0.700
474	<input type="checkbox"/>	P-373	1.781	30:00	0.194	16:00	0.947	1.587
475	<input type="checkbox"/>	P-374	2.221	69:00	0.053	11:00	0.935	2.169
476	<input type="checkbox"/>	P-375	1.281	69:00	0.005	50:00	0.485	1.276
477	<input type="checkbox"/>	P-376	0.813	69:00	0.000	40:00	0.247	0.813
478	<input type="checkbox"/>	P-377	0.997	33:00	0.008	45:00	0.282	0.988
479	<input type="checkbox"/>	P-378	1.541	33:00	0.030	17:00	0.657	1.512
480	<input type="checkbox"/>	P-380	1.224	29:00	0.254	16:00	0.723	0.970
481	<input type="checkbox"/>	P-381	1.528	29:00	0.013	33:00	0.749	1.515
482	<input type="checkbox"/>	P-382	0.883	69:00	0.007	65:00	0.370	0.876
483	<input type="checkbox"/>	P-383	0.694	33:00	0.002	34:00	0.183	0.693
484	<input type="checkbox"/>	P-384	0.727	33:00	0.002	61:00	0.225	0.725
485	<input type="checkbox"/>	P-385	1.017	29:00	0.163	16:00	0.616	0.855
486	<input type="checkbox"/>	P-386	0.929	69:00	0.042	33:00	0.466	0.887
487	<input type="checkbox"/>	P-387	0.570	29:00	0.001	16:00	0.298	0.569
488	<input type="checkbox"/>	P-388	0.523	29:00	0.040	16:00	0.287	0.483
489	<input type="checkbox"/>	P-389	0.750	29:00	0.131	16:00	0.432	0.619
490	<input type="checkbox"/>	P-391	1.166	29:00	0.076	16:00	0.622	1.090
491	<input type="checkbox"/>	P-394	0.083	33:00	0.010	66:00	0.043	0.073
492	<input type="checkbox"/>	P-395	1.404	29:00	0.110	16:00	0.750	1.295
493	<input type="checkbox"/>	P-396	0.915	29:00	0.061	16:00	0.486	0.853
494	<input type="checkbox"/>	P-397	1.330	29:00	0.144	16:00	0.719	1.187
495	<input type="checkbox"/>	P-398	1.044	29:00	0.032	16:00	0.559	1.012
496	<input type="checkbox"/>	P-399	1.689	29:00	0.131	16:00	0.914	1.558
497	<input type="checkbox"/>	P-400	2.588	29:00	0.187	16:00	1.381	2.401
498	<input type="checkbox"/>	P-402	0.958	29:00	0.117	16:00	0.575	0.842
499	<input type="checkbox"/>	P-403	0.470	29:00	0.003	16:00	0.236	0.468
500	<input type="checkbox"/>	P-404	0.597	69:00	0.010	64:00	0.271	0.587
501	<input type="checkbox"/>	P-406	1.189	29:00	0.163	16:00	0.653	1.026
502	<input type="checkbox"/>	P-408	1.309	29:00	0.050	16:00	0.678	1.259
503	<input type="checkbox"/>	P-409	0.389	29:00	0.009	64:00	0.190	0.380
504	<input type="checkbox"/>	P-415	0.359	29:00	0.029	16:00	0.197	0.331
505	<input type="checkbox"/>	P-425	0.000	00:00	0.000	00:00	0.000	0.000
506	<input type="checkbox"/>	P-426	0.081	29:00	0.005	16:00	0.044	0.077
507	<input type="checkbox"/>	P-435	3.082	30:00	0.361	16:00	1.727	2.722
508	<input type="checkbox"/>	P-437	1.899	29:00	0.367	66:00	1.152	1.532
509	<input type="checkbox"/>	P-447	1.490	29:00	0.334	66:00	0.920	1.156
510	<input type="checkbox"/>	P-482	2.013	16:00	0.399	00:00	1.755	1.614
511	<input type="checkbox"/>	P-483	1.981	16:00	0.491	00:00	1.666	1.491
512	<input type="checkbox"/>	P-484	2.225	16:00	0.823	30:00	1.635	1.402
513	<input type="checkbox"/>	P-485	0.762	16:00	0.300	00:00	0.571	0.462



Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
514	P-488	0.039	29:00	0.003	16:00	0.021	0.036
515	P-493	0.914	00:00	0.003	50:00	0.231	0.911
516	P-494	1.299	29:00	0.214	16:00	0.789	1.085
517	P-497	0.898	69:00	0.004	39:00	0.419	0.894
518	P-503	2.094	29:00	0.712	16:00	1.440	1.383
519	P-505	3.566	29:00	1.234	16:00	2.468	2.332
520	P-506	2.839	29:00	0.876	16:00	1.923	1.963
521	P-507	0.007	29:00	0.000	65:00	0.003	0.007
522	P-508	0.281	29:00	0.017	16:00	0.151	0.264
523	P-513	0.219	29:00	0.020	00:00	0.113	0.198
524	P-514	0.000	00:00	0.000	00:00	0.000	0.000
525	P-522	0.081	66:00	0.004	55:00	0.050	0.077
526	P-523	0.184	29:00	0.045	16:00	0.122	0.139
527	P-524	0.053	69:00	0.008	65:00	0.040	0.044
528	P-526	0.424	29:00	0.106	16:00	0.270	0.319
529	P-528	0.362	29:00	0.002	16:00	0.196	0.360
530	P-563	0.449	29:00	0.009	16:00	0.232	0.440
531	P-564	1.730	33:00	0.069	17:00	0.972	1.662
532	P-565	2.125	33:00	0.153	17:00	1.249	1.971
533	P-566	0.418	29:00	0.026	16:00	0.223	0.392
534	P-584	4.171	33:00	0.168	17:00	2.289	4.003
535	P-585	4.365	33:00	0.027	17:00	2.466	4.337
536	P-599	1.451	00:00	0.002	58:00	0.452	1.449
537	P-600	1.330	00:00	0.003	35:00	0.464	1.327
538	P-601	1.111	00:00	0.000	34:00	0.264	1.111
539	P-602	0.307	33:00	0.001	13:00	0.070	0.306
540	P-1512A	0.389	69:00	0.004	11:00	0.152	0.385
541	P-612	0.505	69:00	0.004	39:00	0.220	0.500
542	P-613	0.607	69:00	0.024	39:00	0.282	0.583
543	P-614	3.387	33:00	0.010	59:00	0.877	3.377
544	P-615	3.249	33:00	0.025	59:00	0.858	3.224
545	P-617	1.917	29:00	0.032	16:00	0.996	1.885
546	P-622	2.575	33:00	0.039	62:00	0.950	2.535
547	P-654	1.661	33:00	0.321	17:00	1.008	1.340
548	P-661	0.732	33:00	0.005	59:00	0.220	0.727
549	P-662	0.752	33:00	0.010	52:00	0.228	0.742
550	P-663	0.811	33:00	0.007	06:00	0.268	0.804
551	P-749	0.529	29:00	0.114	16:00	0.337	0.414
552	P-750	1.007	29:00	0.217	16:00	0.640	0.790
553	P-751	1.734	29:00	0.389	16:00	1.117	1.345
554	P-752	2.760	29:00	0.528	16:00	1.720	2.233
555	P-753	7.222	29:00	1.541	16:00	4.555	5.681
556	P-755	0.266	29:00	0.058	16:00	0.170	0.207
557	P-756	0.520	29:00	0.114	16:00	0.332	0.406
558	P-764	2.342	30:00	0.344	66:00	1.406	1.998
559	P-765	3.296	33:00	0.169	17:00	2.016	3.127
560	P-766	2.828	33:00	0.001	17:00	1.644	2.827
561	P-767	2.890	33:00	0.137	66:00	1.544	2.752
562	P-768	1.515	31:00	0.012	17:00	0.896	1.504
563	P-774	0.024	33:00	0.000	49:00	0.005	0.024
564	P-782	0.982	29:00	0.082	16:00	0.530	0.900
565	P-783	0.608	29:00	0.059	16:00	0.329	0.549
566	P-784	0.038	33:00	0.000	12:00	0.007	0.038
567	P-785	0.444	29:00	0.003	16:00	0.238	0.441
568	P-801	1.235	33:00	0.018	61:00	0.424	1.218
569	P-802	0.843	29:00	0.052	16:00	0.455	0.791
570	P-803	0.818	29:00	0.047	16:00	0.440	0.771



Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
571	P-808	0.954	29:00	0.096	16:00	0.520	0.858
572	P-809	0.370	29:00	0.061	16:00	0.205	0.309
573	P-812	0.190	29:00	0.036	16:00	0.112	0.154
574	P-813	0.000	00:00	0.000	00:00	0.000	0.000
575	P-814	1.781	29:00	0.253	16:00	0.987	1.528
576	P-815	1.176	29:00	0.001	16:00	0.632	1.174
577	P-816	0.883	29:00	0.059	16:00	0.488	0.825
578	P-818	0.081	30:00	0.002	40:00	0.035	0.079
579	P-821	0.676	29:00	0.028	16:00	0.368	0.648
580	P-827	0.694	29:00	0.019	16:00	0.374	0.675
581	P-830	1.361	33:00	0.003	37:00	0.405	1.358
582	P-832	0.528	33:00	0.007	01:00	0.245	0.521
583	P-833	1.400	33:00	0.118	17:00	0.825	1.281
584	P-834	1.151	33:00	0.022	67:00	0.489	1.129
585	P-835	1.710	33:00	0.131	17:00	1.040	1.580
586	P-838	1.995	30:00	0.256	16:00	1.042	1.739
587	P-840	1.158	30:00	0.125	16:00	0.580	1.033
588	P-849	0.239	69:00	0.000	56:00	0.088	0.239
589	P-850	0.352	69:00	0.003	65:00	0.147	0.349
590	P-854	1.805	29:00	0.152	16:00	0.990	1.653
591	P-855	1.710	30:00	0.230	16:00	0.976	1.480
592	P-862	6.227	16:00	3.027	30:00	5.083	3.200
593	P-864	0.235	29:00	0.095	16:00	0.157	0.140
594	P-865	0.787	29:00	0.241	16:00	0.538	0.546
595	P-866	1.020	30:00	0.018	43:00	0.389	1.002
596	P-868	5.921	29:00	1.131	16:00	3.655	4.790
597	P-869	2.390	29:00	0.442	16:00	1.465	1.948
598	P-870	3.993	29:00	0.984	16:00	2.552	3.009
599	P-871	3.596	29:00	0.961	16:00	2.338	2.636
600	P-872	1.014	69:00	0.010	57:00	0.489	1.003
601	P-873	7.177	29:00	1.538	16:00	4.531	5.639
602	P-874	2.486	29:00	0.939	16:00	1.762	1.546
603	P-875	1.478	29:00	1.310	16:00	1.391	0.169
604	P-876	1.759	33:00	1.475	69:00	1.616	0.284
605	P-879	0.870	00:00	0.381	30:00	0.622	0.489
606	P-880	1.727	29:00	0.370	16:00	1.059	1.357
607	P-885	2.663	33:00	0.028	00:00	1.502	2.635
608	P-886	0.524	29:00	0.032	16:00	0.283	0.492
609	P-887	0.368	29:00	0.023	16:00	0.199	0.345
610	P-888	0.904	29:00	0.055	16:00	0.488	0.849
611	P-913	0.711	00:00	0.008	32:00	0.165	0.703
612	P-916	1.235	33:00	0.130	17:00	0.627	1.105
613	P-917	0.512	33:00	0.077	66:00	0.241	0.435
614	P-919	1.281	33:00	0.006	66:00	0.478	1.275
615	P-920	1.408	33:00	0.181	17:00	0.812	1.226
616	P-921	2.562	33:00	0.404	66:00	1.534	2.159
617	P-923	0.770	53:00	0.085	16:00	0.435	0.684
618	P-924	1.153	30:00	0.249	00:00	0.739	0.904
619	P-927	1.954	33:00	0.206	00:00	1.207	1.748
620	P-928	0.706	30:00	0.139	16:00	0.413	0.567
621	P-929	0.515	29:00	0.010	64:00	0.247	0.506
622	P-930	1.182	00:00	0.003	52:00	0.294	1.179
623	P-931	0.890	33:00	0.154	66:00	0.476	0.736
624	P-932	0.601	33:00	0.029	21:00	0.226	0.573
625	P-933	0.822	30:00	0.185	00:00	0.484	0.637
626	P-937	1.078	29:00	0.087	16:00	0.540	0.990
627	P-935	0.955	69:00	0.008	09:00	0.325	0.947

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
628	P-936	1.150	33:00	0.008	67:00	0.430	1.142
629	P-938	1.520	33:00	0.171	00:00	0.952	1.350
630	P-940	0.652	33:00	0.007	01:00	0.292	0.644
631	P-941	1.122	30:00	0.060	00:00	0.654	1.061
632	P-944	0.556	29:00	0.048	00:00	0.316	0.508
633	P-945	1.606	29:00	0.247	16:00	0.898	1.359
634	P-949	1.146	29:00	0.131	16:00	0.629	1.015
635	P-953	0.117	33:00	0.007	00:00	0.057	0.110
636	P-956	0.175	29:00	0.012	16:00	0.089	0.163
637	P-959	0.229	29:00	0.015	16:00	0.120	0.214
638	P-993	0.564	00:00	0.005	32:00	0.129	0.559
639	P-994	0.555	30:00	0.022	16:00	0.303	0.534
640	P-995	0.498	33:00	0.034	17:00	0.224	0.463
641	P-996	0.916	29:00	0.042	16:00	0.469	0.873
642	P-997	1.976	29:00	0.159	16:00	1.111	1.817
643	P-998	0.843	30:00	0.181	00:00	0.522	0.662
644	P-1002	0.306	69:00	0.034	16:00	0.155	0.272
645	P-823	4.204	00:00	0.041	38:00	0.750	4.163
646	P-824	1.908	29:00	0.030	16:00	1.049	1.877
647	P-595	4.000	00:00	0.018	30:00	0.770	3.982
648	P-1003	0.474	30:00	0.059	16:00	0.261	0.415
649	P-1006	0.000	00:00	0.000	00:00	0.000	0.000
650	P-1007	0.246	30:00	0.048	16:00	0.137	0.199
651	P-1010A	0.179	30:00	0.003	43:00	0.068	0.176
652	P-1011	0.342	30:00	0.011	18:00	0.129	0.331
653	P-1012	0.000	00:00	0.000	00:00	0.000	0.000
654	P-1019	0.649	33:00	0.001	20:00	0.181	0.648
655	P-1020	0.697	33:00	0.002	67:00	0.237	0.696
656	P-1021	0.884	33:00	0.136	66:00	0.506	0.749
657	P-1024	1.388	29:00	0.391	16:00	0.947	0.997
658	P-1028	0.000	00:00	0.000	00:00	0.000	0.000
659	P-1032	1.644	30:00	0.083	16:00	0.784	1.560
660	P-1033	4.120	29:00	1.013	16:00	2.615	3.107
661	P-1034	3.373	29:00	0.968	16:00	2.212	2.405
662	P-1047	0.777	29:00	0.047	16:00	0.415	0.730
663	P-1048	3.222	29:00	0.495	16:00	1.902	2.727
664	P-1049	3.054	29:00	0.473	16:00	1.815	2.581
665	P-1050	1.006	29:00	0.091	65:00	0.521	0.916
666	P-1051	0.346	53:00	0.005	16:00	0.186	0.341
667	P-1053	0.923	69:00	0.011	09:00	0.304	0.911
668	P-1054	0.748	33:00	0.009	67:00	0.297	0.739
669	P-1055	0.969	33:00	0.048	00:00	0.605	0.920
670	P-1056	1.469	30:00	0.305	66:00	0.886	1.164
671	P-1060	0.227	29:00	0.008	64:00	0.106	0.219
672	P-434	1.823	69:00	0.039	16:00	0.871	1.783
673	P-881	2.811	30:00	0.432	66:00	1.665	2.379
674	P-882	2.147	33:00	0.072	17:00	1.166	2.075
675	P-1085	3.144	30:00	0.000	00:00	1.878	3.144
676	P-1086	2.323	45:00	0.000	00:00	1.576	2.323
677	P-1087	1.523	45:00	0.000	00:00	0.810	1.523
678	P-1089	1.218	62:00	0.000	00:00	0.666	1.218
679	P-1090	1.672	69:00	0.000	00:00	1.234	1.672
680	P-1091	3.309	30:00	0.000	00:00	2.000	3.309
681	P-1092	0.000	00:00	0.000	00:00	0.000	0.000
682	P-1093	2.239	30:00	0.000	00:00	0.410	2.239
683	P-1094	2.498	69:00	0.000	00:00	2.412	2.498
684	P-1095	2.498	69:00	0.000	00:00	2.343	2.498

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
685	P-1096	2.505	69:00	0.000	00:00	2.112	2.505
686	P-1097	2.505	69:00	0.000	00:00	1.739	2.505
687	P-1098	2.360	45:00	0.000	00:00	1.042	2.360
688	P-1099	0.000	00:00	0.000	00:00	0.000	0.000
689	P-1120	3.159	30:00	0.131	00:00	1.900	3.028
690	P-1121	2.343	45:00	0.131	00:00	1.599	2.212
691	P-1122	1.543	45:00	0.023	42:00	0.832	1.520
692	P-1124	1.208	62:00	0.055	49:00	0.647	1.153
693	P-1125	1.672	69:00	0.131	00:00	1.215	1.541
694	P-1126	3.295	30:00	0.131	00:00	1.981	3.164
695	P-1139	0.201	69:00	0.090	16:00	0.155	0.112
696	P-1146	0.000	00:00	0.000	00:00	0.000	0.000
697	P-1152	1.756	69:00	0.190	57:00	0.951	1.566
698	P-1157	4.839	29:00	1.478	16:00	3.253	3.360
699	P-1158	5.188	29:00	1.499	16:00	3.441	3.689
700	P-1165	1.644	29:00	0.027	16:00	0.849	1.617
701	P-1166	0.736	69:00	0.011	63:00	0.329	0.725
702	P-1168	1.418	69:00	0.006	01:00	0.684	1.411
703	P-1169	1.219	33:00	0.001	55:00	0.203	1.218
704	P-1170	1.054	33:00	0.027	02:00	0.335	1.027
705	P-1190	0.734	33:00	0.011	42:00	0.323	0.723
706	P-1191	1.104	33:00	0.003	51:00	0.327	1.100
707	P-1198	6.600	30:00	4.083	16:00	5.550	2.517
708	P-1199	4.475	45:00	3.831	11:00	4.174	0.645
709	P-1200	2.237	45:00	1.915	11:00	2.087	0.322
710	P-1204	0.000	00:00	0.000	00:00	0.000	0.000
711	P-1205	1.440	30:00	0.000	12:00	0.880	1.440
712	P-1206	2.832	30:00	1.307	16:00	2.216	1.525
713	P-1216	1.316	29:00	0.049	16:00	0.697	1.267
714	P-1217	1.097	29:00	0.073	16:00	0.595	1.024
715	P-1218	1.090	29:00	0.042	16:00	0.586	1.048
716	P-1219	1.343	29:00	0.057	16:00	0.722	1.286
717	P-1220	1.385	29:00	0.059	16:00	0.745	1.326
718	P-1221	2.061	29:00	0.028	16:00	1.077	2.033
719	P-1222	1.889	69:00	0.007	64:00	0.891	1.882
720	P-1223	1.504	69:00	0.042	11:00	0.638	1.463
721	P-1224	1.383	69:00	0.024	35:00	0.569	1.359
722	P-1225	1.316	69:00	0.000	35:00	0.532	1.316
723	P-1226	1.222	69:00	0.001	65:00	0.479	1.220
724	P-1227	1.177	69:00	0.009	65:00	0.455	1.168
725	P-1228	1.429	69:00	0.023	65:00	0.542	1.406
726	P-1229	1.248	33:00	0.015	44:00	0.415	1.233
727	P-1230	0.710	33:00	0.004	44:00	0.241	0.706
728	P-1231	0.715	33:00	0.001	36:00	0.245	0.715
729	P-1232	1.353	33:00	0.016	37:00	0.506	1.337
730	P-1238	2.306	33:00	0.019	00:00	1.349	2.288
731	P-1240	1.359	29:00	0.155	16:00	0.757	1.204
732	P-1241	1.877	33:00	0.018	36:00	0.650	1.859
733	P-1242	1.400	29:00	0.022	64:00	0.681	1.378
734	P-1243	1.002	33:00	0.004	01:00	0.252	0.998
735	P-1244	1.122	29:00	0.217	65:00	0.637	0.906
736	P-1246	1.122	33:00	0.007	40:00	0.298	1.116
737	P-1247	1.054	69:00	0.001	08:00	0.407	1.053
738	P-1255	0.481	29:00	0.004	16:00	0.246	0.478
739	P-1256	0.667	29:00	0.006	16:00	0.345	0.661
740	P-1260	0.213	29:00	0.006	16:00	0.110	0.208
741	P-1261	0.218	29:00	0.020	16:00	0.122	0.198

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
742	P-1262	0.373	29:00	0.012	16:00	0.187	0.361
743	P-1263	0.445	29:00	0.006	16:00	0.227	0.439
744	P-1264	0.125	29:00	0.011	16:00	0.069	0.114
745	P-1265	0.475	33:00	0.007	42:00	0.119	0.468
746	P-1266	0.551	33:00	0.002	00:00	0.225	0.550
747	P-1267	1.577	33:00	0.029	67:00	0.541	1.548
748	P-1269	0.877	29:00	0.187	40:00	0.517	0.690
749	P-1285	1.342	16:00	0.253	00:00	1.201	1.090
750	P-1288	1.307	33:00	0.016	20:00	0.485	1.291
751	P-1291	1.377	35:00	0.032	28:00	0.506	1.345
752	P-1302	0.000	00:00	0.000	00:00	0.000	0.000
753	P-1304	0.894	29:00	0.149	16:00	0.508	0.744
754	P-1305	1.554	29:00	0.308	16:00	0.897	1.246
755	P-1306	0.312	30:00	0.003	71:00	0.109	0.309
756	P-1311	2.585	30:00	0.198	16:00	1.420	2.387
757	P-1315	1.874	33:00	0.205	17:00	1.071	1.669
758	P-1316	6.453	07:00	0.063	00:00	3.743	6.390
759	P-1320	1.992	30:00	0.410	66:00	1.223	1.582
760	P-1321	4.544	30:00	0.816	16:00	2.683	3.728
761	P-922	2.836	33:00	0.370	00:00	1.763	2.465
762	P-1328	0.291	29:00	0.014	16:00	0.155	0.277
763	P-1334	2.673	00:00	0.009	19:00	0.479	2.665
764	P-1335	0.201	00:00	0.022	16:00	0.116	0.179
765	P-1347	0.712	29:00	0.047	16:00	0.368	0.665
766	P-1350	0.287	29:00	0.019	16:00	0.147	0.268
767	P-1353	1.087	29:00	0.069	16:00	0.572	1.018
768	P-1358	0.433	66:00	0.103	30:00	0.326	0.330
769	P-1359	0.534	69:00	0.276	16:00	0.436	0.258
770	P-1360	0.239	00:00	0.156	16:00	0.215	0.083
771	P-1361	1.083	29:00	0.125	16:00	0.626	0.958
772	P-1363	0.643	29:00	0.173	16:00	0.421	0.470
773	P-1364	0.654	69:00	0.184	33:00	0.451	0.470
774	P-1365	1.009	29:00	0.437	16:00	0.740	0.572
775	P-1367	0.675	29:00	0.013	66:00	0.338	0.661
776	P-1366	4.234	33:00	0.230	66:00	2.225	4.004
777	P-1368	4.248	33:00	0.241	66:00	2.244	4.007
778	P-1369	2.276	29:00	0.425	16:00	1.399	1.851
779	P-1370	3.989	00:00	0.002	30:00	0.773	3.987
780	P-1371	0.617	00:00	0.013	41:00	0.144	0.604
781	P-1372	0.853	29:00	0.055	16:00	0.444	0.797
782	P-1386	1.433	33:00	0.040	67:00	0.723	1.393
783	P-1387	1.783	29:00	0.073	16:00	0.953	1.710
784	P-1390	0.174	00:00	0.003	42:00	0.071	0.171
785	P-1392	1.459	00:00	0.004	09:00	0.459	1.455
786	P-1393	1.655	00:00	0.004	65:00	0.618	1.652
787	P-1394	1.259	29:00	0.097	16:00	0.681	1.163
788	P-1399	0.598	29:00	0.036	16:00	0.322	0.562
789	P-1414	0.365	06:00	0.024	00:00	0.320	0.341
790	P-1422	0.948	33:00	0.029	61:00	0.304	0.918
791	P-1423	1.539	33:00	0.008	42:00	0.672	1.531
792	P-1424	1.358	33:00	0.011	37:00	0.510	1.347
793	P-1425	1.694	33:00	0.007	21:00	0.758	1.688
794	P-1430	1.430	30:00	0.274	16:00	0.853	1.156
795	P-1437	0.154	29:00	0.041	16:00	0.097	0.113
796	P-1438	0.454	16:00	0.001	52:00	0.206	0.453
797	P-1439	1.688	29:00	0.168	16:00	0.970	1.520
798	P-1442	0.544	00:00	0.290	33:00	0.412	0.254

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
799	P-1443	0.822	69:00	0.356	16:00	0.631	0.466
800	P-1445	0.701	66:00	0.108	30:00	0.422	0.593
801	P-1455	1.014	06:00	0.507	16:00	0.867	0.507
802	P-1456	1.010	29:00	0.222	16:00	0.645	0.788
803	P-1457	1.531	30:00	0.078	16:00	0.795	1.453
804	P-1458	3.671	29:00	0.558	16:00	2.117	3.113
805	P-1459	2.514	33:00	0.358	66:00	1.391	2.155
806	P-1460	1.267	33:00	0.000	20:00	0.383	1.267
807	P-1461	2.071	30:00	0.300	16:00	1.181	1.771
808	P-1467	2.544	33:00	0.035	13:00	1.004	2.510
809	P-1468	2.693	33:00	0.001	13:00	1.074	2.693
810	P-1472	1.098	07:00	0.213	66:00	0.666	0.885
811	P-1473	1.330	33:00	0.079	00:00	0.680	1.250
812	P-1474	0.598	33:00	0.000	55:00	0.140	0.597
813	P-1475	0.270	33:00	0.003	10:00	0.061	0.267
814	P-1476	1.080	33:00	0.011	10:00	0.244	1.069
815	P-1477	1.314	33:00	0.027	04:00	0.405	1.287
816	P-1478	1.120	33:00	0.003	59:00	0.268	1.117
817	P-1479	1.409	33:00	0.021	41:00	0.424	1.387
818	P-1481	2.103	33:00	0.033	36:00	0.645	2.070
819	P-1482	1.275	29:00	0.184	16:00	0.717	1.091
820	P-1483	0.774	29:00	0.091	16:00	0.420	0.684
821	P-1484	2.460	33:00	0.027	66:00	1.281	2.433
822	P-1485	2.460	33:00	0.027	66:00	1.281	2.433
823	P-1486	2.224	33:00	0.119	17:00	1.179	2.105
824	P-1487	1.780	33:00	0.092	17:00	0.937	1.688
825	P-1489	2.509	33:00	0.022	66:00	1.308	2.488
826	P-1490	2.588	33:00	0.006	66:00	1.374	2.582
827	P-1492	1.563	30:00	0.336	66:00	0.952	1.227
828	P-1493	0.651	30:00	0.141	16:00	0.395	0.510
829	P-1494	1.644	30:00	0.087	16:00	0.861	1.557
830	P-1497	3.052	16:00	0.558	00:00	2.715	2.493
831	P-1499	3.107	33:00	0.026	38:00	0.798	3.080
832	P-1514	3.176	29:00	0.088	16:00	1.647	3.088
833	P-1515	2.949	29:00	0.101	16:00	1.525	2.848
834	P-6	0.000	00:00	0.000	00:00	0.000	0.000
835	P-9	8.771	04:00	8.040	59:00	8.375	0.731
836	P-10	8.771	04:00	8.040	59:00	8.375	0.731
837	P-11	0.000	00:00	0.000	00:00	0.000	0.000
838	P-12	3.046	04:00	2.792	59:00	2.908	0.254
839	P-13	1.523	04:00	1.396	59:00	1.454	0.127
840	P-14	0.000	00:00	0.000	00:00	0.000	0.000
841	P-16	3.811	00:00	1.608	68:00	2.740	2.203
842	P-33	0.000	00:00	0.000	00:00	0.000	0.000
843	P-34	1.523	04:00	1.396	59:00	1.454	0.127
844	P-41	0.250	29:00	0.055	16:00	0.160	0.195
845	P-63	3.046	04:00	2.792	59:00	2.908	0.254
846	P-68	1.619	30:00	0.664	65:00	1.139	0.955
847	P-69	1.619	30:00	0.664	65:00	1.139	0.955
848	P-72	1.619	30:00	0.664	65:00	1.139	0.955
849	P-78	0.903	00:00	0.000	03:00	0.470	0.903
850	P-85	1.606	00:00	0.000	03:00	0.835	1.606
851	P-86	1.606	00:00	0.000	03:00	0.835	1.606
852	P-76	0.000	00:00	0.000	00:00	0.000	0.000
853	P-91	0.000	00:00	0.000	00:00	0.000	0.000
854	P-110	0.359	29:00	0.017	65:00	0.178	0.341
855	P-114	0.483	29:00	0.033	16:00	0.247	0.450

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
856	P-137	1.354	04:00	1.241	59:00	1.292	0.113
857	P-144	0.000	00:00	0.000	00:00	0.000	0.000
858	P-148	2.173	30:00	1.345	16:00	1.827	0.829
859	P-149	2.173	30:00	1.345	16:00	1.827	0.829
860	P-154	3.223	45:00	2.758	11:00	3.006	0.465
861	P-156	3.221	45:00	2.758	11:00	3.005	0.463
862	P-108	0.787	42:00	0.000	00:00	0.363	0.787
863	P-112	0.791	42:00	0.003	39:00	0.361	0.788
864	P-159	3.295	30:00	0.131	00:00	1.981	3.164
865	P-160	3.159	30:00	0.131	00:00	1.900	3.028
866	P-164	1.588	30:00	0.209	66:00	0.908	1.379
867	P-165	5.722	31:00	0.652	17:00	3.488	5.070
868	P-167	3.309	30:00	0.000	00:00	2.000	3.309
869	P-168	3.144	30:00	0.000	00:00	1.878	3.144
870	P-171	2.542	30:00	0.216	00:00	1.498	2.326
871	P-172	0.000	00:00	0.000	00:00	0.000	0.000
872	P-173	2.542	30:00	0.216	00:00	1.498	2.326
873	P-177	0.475	00:00	0.001	01:00	0.147	0.475
874	P-185	3.026	30:00	0.355	16:00	1.546	2.671
875	P-190	3.642	29:00	1.179	16:00	2.457	2.463
876	P-198	1.155	30:00	0.145	00:00	0.714	1.010
877	P-207	1.724	33:00	0.039	66:00	0.857	1.684
878	P-220	3.308	33:00	0.120	17:00	1.905	3.188
879	P-233	0.572	29:00	0.036	16:00	0.303	0.537
880	P-243	0.196	29:00	0.013	16:00	0.102	0.183
881	P-287	0.000	00:00	0.000	00:00	0.000	0.000
882	P-288	2.283	54:00	0.039	00:00	2.124	2.244
883	P-274	0.000	00:00	0.000	00:00	0.000	0.000
884	P-279	0.000	00:00	0.000	00:00	0.000	0.000
885	P-285	0.000	00:00	0.000	00:00	0.000	0.000
886	P-290	0.000	00:00	0.000	00:00	0.000	0.000
887	P-291	0.000	00:00	0.000	00:00	0.000	0.000
888	P-308	0.658	68:00	0.049	00:00	0.612	0.610
889	P-310	0.000	00:00	0.000	00:00	0.000	0.000
890	P-307	0.658	68:00	0.049	00:00	0.612	0.610
891	P-311	0.658	68:00	0.049	00:00	0.612	0.610
892	P-323	3.482	68:00	0.000	00:00	3.299	3.482
893	P-335	0.658	68:00	0.049	00:00	0.612	0.610
894	P-336	1.871	54:00	0.368	00:00	1.574	1.503
895	P-340	1.303	54:00	0.319	00:00	0.961	0.984
896	P-341	2.634	68:00	0.196	00:00	2.449	2.438
897	P-345	2.889	54:00	0.049	00:00	2.688	2.841
898	P-346	2.889	54:00	0.049	00:00	2.688	2.841
899	P-351	2.853	35:00	0.084	29:00	0.948	2.769
900	P-368	0.000	00:00	0.000	00:00	0.000	0.000
901	P-392	1.304	30:00	0.252	16:00	0.723	1.052
902	P-407	0.961	30:00	0.186	16:00	0.533	0.775
903	P-422_CV	0.000	00:00	0.000	00:00	0.000	0.000
904	P-1501	3.090	53:00	0.361	00:00	1.878	2.729
905	P-163	0.686	33:00	0.002	20:00	0.213	0.685
906	P-162	8.087	30:00	0.345	00:00	4.854	7.742
907	P-1239	3.019	53:00	0.319	00:00	1.836	2.700
908	P-412	3.240	30:00	0.000	12:00	1.981	3.240
909	P-413	6.191	68:00	0.000	00:00	5.864	6.191
910	P-411	0.720	29:00	0.148	16:00	0.438	0.572
911	P-414	2.230	29:00	0.402	16:00	1.325	1.828
912	P-1449	4.315	29:00	1.100	16:00	2.761	3.215

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
913	<input type="checkbox"/>	P-197	5.311	31:00	0.146	00:00	3.214	5.164
914	<input type="checkbox"/>	P-196	4.576	31:00	0.077	00:00	2.770	4.499
915	<input type="checkbox"/>	P-1303	0.427	69:00	0.009	50:00	0.139	0.419
916	<input type="checkbox"/>	P-1300	0.387	69:00	0.008	13:00	0.126	0.380
917	<input type="checkbox"/>	P-438	5.453	29:00	1.515	16:00	3.584	3.939
918	<input type="checkbox"/>	P-453	0.000	00:00	0.000	00:00	0.000	0.000
919	<input type="checkbox"/>	P-18	1.719	15:00	1.373	54:00	1.537	0.346
920	<input type="checkbox"/>	P-67	1.619	30:00	0.664	65:00	1.139	0.955
921	<input type="checkbox"/>	P-436	1.243	30:00	0.120	16:00	0.656	1.123
922	<input type="checkbox"/>	P-781	0.799	33:00	0.022	69:00	0.390	0.777
923	<input type="checkbox"/>	P-456	1.986	30:00	0.255	16:00	1.037	1.730
924	<input type="checkbox"/>	P-1447	3.702	30:00	0.563	66:00	2.026	3.139
925	<input type="checkbox"/>	P-428	4.169	33:00	0.365	17:00	2.578	3.804
926	<input type="checkbox"/>	P-1446	4.176	33:00	0.374	17:00	2.588	3.803
927	<input type="checkbox"/>	P-458	3.613	00:00	0.000	03:00	1.879	3.613
928	<input type="checkbox"/>	P-459	2.907	33:00	0.063	17:00	1.574	2.844
929	<input type="checkbox"/>	P-467	3.179	33:00	0.049	17:00	1.782	3.130
930	<input type="checkbox"/>	P-543	1.409	16:00	0.158	53:00	0.920	1.251
931	<input type="checkbox"/>	P-544	3.931	33:00	3.255	69:00	3.597	0.676
932	<input type="checkbox"/>	P-861	6.261	16:00	3.592	30:00	5.388	2.669
933	<input type="checkbox"/>	P-559	0.969	29:00	0.222	16:00	0.638	0.747
934	<input type="checkbox"/>	P-950	0.226	29:00	0.032	65:00	0.122	0.195
935	<input type="checkbox"/>	P-918	1.130	00:00	0.002	64:00	0.412	1.127
936	<input type="checkbox"/>	P-542	0.731	00:00	0.236	30:00	0.623	0.495
937	<input type="checkbox"/>	P-1035	0.275	53:00	0.002	67:00	0.140	0.272
938	<input type="checkbox"/>	P-883	1.831	33:00	0.017	42:00	0.912	1.814
939	<input type="checkbox"/>	P-1547	1.313	33:00	0.001	54:00	0.325	1.312
940	<input type="checkbox"/>	P-208	4.342	31:00	0.056	00:00	2.621	4.286
941	<input type="checkbox"/>	P-1450	3.174	30:00	0.382	16:00	1.633	2.792
942	<input type="checkbox"/>	P-439	2.234	33:00	0.058	66:00	0.957	2.176
943	<input type="checkbox"/>	P-416	2.744	30:00	0.324	16:00	1.405	2.420
944	<input type="checkbox"/>	P-1145	1.195	16:00	0.537	30:00	0.973	0.658
945	<input type="checkbox"/>	P-192	0.471	33:00	0.012	71:00	0.164	0.458
946	<input type="checkbox"/>	P-780	1.076	69:00	0.012	58:00	0.408	1.065
947	<input type="checkbox"/>	P-410	0.151	29:00	0.031	65:00	0.088	0.120
948	<input type="checkbox"/>	P-1245	0.924	29:00	0.202	65:00	0.552	0.722
949	<input type="checkbox"/>	P-1248	0.245	29:00	0.026	16:00	0.126	0.220
950	<input type="checkbox"/>	P-1249	0.238	33:00	0.002	66:00	0.102	0.236
951	<input type="checkbox"/>	P-474	1.298	29:00	0.065	16:00	0.695	1.232
952	<input type="checkbox"/>	P-480	1.095	29:00	0.052	16:00	0.585	1.042
953	<input type="checkbox"/>	P-481	0.850	29:00	0.037	16:00	0.452	0.813
954	<input type="checkbox"/>	P-1491	0.980	30:00	0.213	16:00	0.594	0.768
955	<input type="checkbox"/>	P-1488	1.008	33:00	0.070	17:00	0.554	0.937
956	<input type="checkbox"/>	P-1062	1.980	29:00	0.022	16:00	0.995	1.958
957	<input type="checkbox"/>	P-1063	1.954	29:00	0.104	16:00	1.045	1.850
958	<input type="checkbox"/>	P-1064	2.479	29:00	0.005	16:00	1.261	2.474
959	<input type="checkbox"/>	P-1495	2.578	33:00	0.062	62:00	0.993	2.516
960	<input type="checkbox"/>	P-1496	3.449	33:00	0.072	67:00	1.691	3.377
961	<input type="checkbox"/>	P-529	1.368	29:00	0.341	16:00	0.925	1.027
962	<input type="checkbox"/>	P-530	1.125	30:00	0.041	16:00	0.580	1.084
963	<input type="checkbox"/>	P-531	1.085	29:00	0.212	16:00	0.676	0.874
964	<input type="checkbox"/>	P-1326	0.000	00:00	0.000	00:00	0.000	0.000
965	<input type="checkbox"/>	P-314	2.452	35:00	0.105	58:00	1.062	2.347
966	<input type="checkbox"/>	P-3002	1.927	10:00	0.019	42:00	1.208	1.907
967	<input type="checkbox"/>	P-3003	0.000	00:00	0.000	00:00	0.000	0.000
968	<input type="checkbox"/>	P-3006	5.351	10:00	0.054	42:00	3.355	5.298
969	<input type="checkbox"/>	P-3009	3.932	10:00	0.039	42:00	2.465	3.892

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
970	P-191	4.507	30:00	0.125	00:00	2.726	4.382
971	P-498	1.895	16:00	0.735	30:00	1.369	1.161
972	P-496	1.258	00:00	0.002	71:00	0.450	1.256
973	P-259	0.710	29:00	0.046	16:00	0.386	0.664
974	P-254	0.416	29:00	0.024	16:00	0.224	0.392
975	P-272	1.389	29:00	0.071	16:00	0.741	1.319
976	P-266	0.518	29:00	0.028	16:00	0.277	0.489
977	P-246	0.369	29:00	0.024	16:00	0.200	0.344
978	P-271	0.571	29:00	0.025	16:00	0.301	0.546
979	P-605	1.101	30:00	0.429	16:00	0.704	0.672
980	P-1413	3.282	35:00	0.023	21:00	1.181	3.258
981	P-104	2.045	16:00	0.537	00:00	1.751	1.508
982	P-1523	1.655	16:00	0.345	00:00	1.472	1.309
983	P-603	0.337	33:00	0.003	67:00	0.100	0.334
984	P-607	0.000	00:00	0.000	00:00	0.000	0.000
985	P-470	1.437	33:00	0.026	42:00	0.509	1.411
986	P-471	0.000	00:00	0.000	00:00	0.000	0.000
987	P-1540	1.433	33:00	0.027	66:00	0.504	1.406
988	P-430	0.000	00:00	0.000	00:00	0.000	0.000
989	P-942	1.205	30:00	0.155	16:00	0.665	1.050
990	P-1520	1.425	29:00	0.088	16:00	0.757	1.337
991	P-1525	1.380	29:00	0.086	16:00	0.731	1.294
992	P-1533	1.319	29:00	0.083	16:00	0.695	1.235
993	P-1538	0.961	29:00	0.061	16:00	0.506	0.900
994	P-115	0.088	29:00	0.005	16:00	0.049	0.083
995	P-685	0.059	00:00	0.002	16:00	0.031	0.058
996	P-746	1.982	29:00	0.126	16:00	1.042	1.856
997	P-952	0.128	33:00	0.005	39:00	0.048	0.123
998	P-943	2.793	30:00	0.314	16:00	1.540	2.478
999	P-946	1.265	30:00	0.125	16:00	0.695	1.140
1000	P-1351	0.521	00:00	0.035	33:00	0.251	0.486
1001	P-817	0.220	29:00	0.030	33:00	0.130	0.190
1002	P-759	0.544	29:00	0.032	16:00	0.294	0.512
1003	P-1388	1.222	29:00	0.075	16:00	0.650	1.147
1004	P-951	0.140	33:00	0.001	32:00	0.034	0.139
1005	P-795	1.057	29:00	0.137	16:00	0.589	0.919
1006	P-796	0.245	29:00	0.004	16:00	0.134	0.241
1007	P-135	0.879	29:00	0.108	16:00	0.495	0.771
1008	P-140	0.140	33:00	0.001	32:00	0.034	0.139
1009	P-810	0.473	33:00	0.030	17:00	0.211	0.443
1010	P-811	1.345	29:00	0.022	16:00	0.735	1.322
1011	P-616	2.533	33:00	0.013	59:00	0.666	2.520
1012	P-2013	2.771	33:00	0.045	21:00	1.144	2.725
1013	P-2014	2.019	33:00	0.012	44:00	0.590	2.007
1014	P-2024	2.833	30:00	1.753	16:00	2.382	1.080
1015	P-3001	5.351	10:00	0.054	42:00	3.355	5.298
1016	P-309B	0.000	00:00	0.000	00:00	0.000	0.000
1017	P-1318B	0.000	00:00	0.000	00:00	0.000	0.000
1018	P-1014	0.000	00:00	0.000	00:00	0.000	0.000
1019	P-178	1.867	35:00	0.009	27:00	0.681	1.858
1020	P-103	0.080	30:00	0.016	16:00	0.045	0.065
1021	P-863B	0.158	29:00	0.003	09:00	0.069	0.155
1022	P-863A	0.240	29:00	0.009	65:00	0.117	0.231
1023	P-1067	0.142	29:00	0.000	66:00	0.064	0.142
1024	P-1068	0.217	29:00	0.013	40:00	0.103	0.204
1025	P-844A	1.317	29:00	0.300	16:00	0.851	1.017
1026	P-844B	0.758	29:00	0.191	16:00	0.506	0.566



Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1027	<input type="checkbox"/>	P-1010B	0.134	66:00	0.063	30:00	0.100	0.071
1028	<input type="checkbox"/>	P-1010C	0.455	29:00	0.161	16:00	0.321	0.294
1029	<input type="checkbox"/>	P-1073	0.243	30:00	0.006	68:00	0.103	0.237
1030	<input type="checkbox"/>	P-1074	0.123	66:00	0.000	55:00	0.067	0.123
1031	<input type="checkbox"/>	P-357	2.308	29:00	0.381	16:00	1.325	1.927
1032	<input type="checkbox"/>	P-188A	2.538	30:00	0.146	16:00	1.136	2.392
1033	<input type="checkbox"/>	P-1079	0.248	30:00	0.004	47:00	0.116	0.244
1034	<input type="checkbox"/>	P-1081	0.276	02:00	0.003	28:00	0.132	0.273
1035	<input type="checkbox"/>	P-504	2.040	29:00	0.708	16:00	1.410	1.332
1036	<input type="checkbox"/>	P-1084	0.000	00:00	0.000	00:00	0.000	0.000
1037	<input type="checkbox"/>	P-1082	0.445	29:00	0.098	16:00	0.285	0.347
1038	<input type="checkbox"/>	P-618A	1.796	29:00	0.063	16:00	0.956	1.733
1039	<input type="checkbox"/>	P-618B	1.671	29:00	0.056	16:00	0.889	1.616
1040	<input type="checkbox"/>	P-1100	0.789	29:00	0.045	16:00	0.425	0.744
1041	<input type="checkbox"/>	P-270A	0.140	33:00	0.004	42:00	0.057	0.136
1042	<input type="checkbox"/>	P-270B	0.262	29:00	0.042	16:00	0.160	0.220
1043	<input type="checkbox"/>	P-418B	0.499	29:00	0.023	16:00	0.266	0.476
1044	<input type="checkbox"/>	P-418A	0.840	29:00	0.049	16:00	0.452	0.791
1045	<input type="checkbox"/>	P-256A	0.426	29:00	0.024	16:00	0.229	0.402
1046	<input type="checkbox"/>	P-256B	0.640	29:00	0.040	16:00	0.346	0.600
1047	<input type="checkbox"/>	P-261B	0.583	29:00	0.026	16:00	0.309	0.557
1048	<input type="checkbox"/>	P-246A	0.270	29:00	0.018	16:00	0.146	0.251
1049	<input type="checkbox"/>	P-246B	0.689	29:00	0.039	16:00	0.370	0.650
1050	<input type="checkbox"/>	P-252	0.528	29:00	0.032	16:00	0.285	0.496
1051	<input type="checkbox"/>	P-1137	0.091	69:00	0.000	39:00	0.041	0.091
1052	<input type="checkbox"/>	P-1138	0.698	29:00	0.029	16:00	0.370	0.669
1053	<input type="checkbox"/>	P-1140	0.293	29:00	0.003	16:00	0.147	0.290
1054	<input type="checkbox"/>	P-1155	0.000	00:00	0.000	00:00	0.000	0.000
1055	<input type="checkbox"/>	P-1512B	0.265	69:00	0.004	56:00	0.082	0.262
1056	<input type="checkbox"/>	P-1522	1.038	69:00	0.007	24:00	0.319	1.031
1057	<input type="checkbox"/>	P-1052	0.525	35:00	0.011	45:00	0.272	0.513
1058	<input type="checkbox"/>	P-1058	0.261	35:00	0.001	45:00	0.135	0.260
1059	<input type="checkbox"/>	P-1061	0.278	35:00	0.038	68:00	0.162	0.239
1060	<input type="checkbox"/>	P-1066	0.284	35:00	0.047	68:00	0.175	0.237
1061	<input type="checkbox"/>	P-1069	0.070	30:00	0.000	40:00	0.028	0.070
1062	<input type="checkbox"/>	P-1070	0.274	35:00	0.077	68:00	0.192	0.198
1063	<input type="checkbox"/>	P-1071	0.304	35:00	0.036	68:00	0.174	0.268
1064	<input type="checkbox"/>	P-1072	0.334	35:00	0.086	68:00	0.226	0.248
1065	<input type="checkbox"/>	P-1076	0.769	35:00	0.141	68:00	0.475	0.628
1066	<input type="checkbox"/>	P-1155B	0.150	35:00	0.000	12:00	0.054	0.150
1067	<input type="checkbox"/>	P-1155A	0.113	35:00	0.001	45:00	0.058	0.113
1068	<input type="checkbox"/>	P-1083	0.492	35:00	0.060	68:00	0.278	0.432
1069	<input type="checkbox"/>	P-1088	1.126	35:00	0.266	68:00	0.742	0.860
1070	<input type="checkbox"/>	P-1101	0.092	35:00	0.000	12:00	0.033	0.092
1071	<input type="checkbox"/>	P-1102	0.068	35:00	0.000	45:00	0.035	0.068
1072	<input type="checkbox"/>	P-1103	0.651	30:00	0.225	16:00	0.395	0.427
1073	<input type="checkbox"/>	P-1141	1.635	29:00	0.804	16:00	1.228	0.831
1074	<input type="checkbox"/>	P-1150	0.575	33:00	0.070	69:00	0.285	0.506
1075	<input type="checkbox"/>	P-1151	1.402	29:00	0.265	16:00	0.845	1.137
1076	<input type="checkbox"/>	P-1156	4.037	29:00	1.218	16:00	2.706	2.819
1077	<input type="checkbox"/>	P-1159	3.040	29:00	1.012	16:00	2.079	2.028
1078	<input type="checkbox"/>	P-1160	1.647	29:00	0.620	16:00	1.173	1.027
1079	<input type="checkbox"/>	P-1161	1.410	29:00	0.205	16:00	0.848	1.205
1080	<input type="checkbox"/>	P-1162	0.796	29:00	0.021	40:00	0.368	0.775
1081	<input type="checkbox"/>	P-1163	0.482	53:00	0.356	09:00	0.403	0.126
1082	<input type="checkbox"/>	P-1164	1.319	61:00	1.036	30:00	1.242	0.283
1083	<input type="checkbox"/>	P-1167	0.481	65:00	0.001	30:00	0.245	0.480

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1084	P-1171	0.169	65:00	0.001	30:00	0.088	0.167
1085	P-1172	2.097	29:00	0.076	40:00	1.045	2.021
1086	P-1177	0.313	53:00	0.007	15:00	0.163	0.306
1087	P-1189	0.000	00:00	0.000	00:00	0.000	0.000
1088	P-1192	0.000	00:00	0.000	00:00	0.000	0.000
1089	P-1193	0.000	00:00	0.000	00:00	0.000	0.000
1090	P-1194	0.976	30:00	0.013	13:00	0.395	0.963
1091	P-1195	1.512	29:00	0.090	33:00	0.804	1.422
1092	P-1196	0.660	29:00	0.083	16:00	0.373	0.576
1093	P-1197	0.069	00:00	0.009	57:00	0.044	0.060
1094	DC_FUTURE_PMP8_(ST_U	0.000	00:00	0.000	00:00	0.000	0.000
1095	DC_FUTURE_PMP8_(ST_D	0.000	00:00	0.000	00:00	0.000	0.000
1096	DC_PMP7_U	1.734	45:00	0.000	00:00	0.766	1.734
1097	DC_PMP7_D	11.949	45:00	0.000	00:00	5.275	11.949
1098	DC_PMP1_U	0.000	00:00	0.000	00:00	0.000	0.000
1099	DC_PMP1_D	0.000	00:00	0.000	00:00	0.000	0.000
1100	DC_PMP2_U	1.645	30:00	0.000	00:00	0.302	1.645
1101	DC_PMP2_D	11.335	30:00	0.000	00:00	2.078	11.335
1102	DC_PMP3_U	1.110	69:00	0.000	00:00	1.072	1.110
1103	DC_PMP3_D	9.991	69:00	0.000	00:00	9.647	9.991
1104	DC_PMP4_U	1.110	69:00	0.000	00:00	1.042	1.110
1105	DC_PMP4_D	9.990	69:00	0.000	00:00	9.374	9.990
1106	DC_PMP6_U	1.113	69:00	0.000	00:00	0.773	1.113
1107	DC_PMP6_D	10.018	69:00	0.000	00:00	6.955	10.018
1108	DC_PMP5_U	1.113	69:00	0.000	00:00	0.939	1.113
1109	DC_PMP5_D	10.018	69:00	0.000	00:00	8.447	10.018
1110	BB_PMP3_U	3.240	30:00	0.000	12:00	1.981	3.240
1111	BB_PMP3_D	8.999	30:00	0.000	12:00	5.502	8.999
1112	BB_PMP2_U	3.223	45:00	2.758	11:00	3.006	0.465
1113	BB_PMP2_D	8.954	45:00	7.661	11:00	8.349	1.293
1114	BB_PMP1_U	3.221	45:00	2.758	11:00	3.005	0.463
1115	BB_PMP1_D	8.948	45:00	7.662	11:00	8.348	1.286
1116	BB_FUTURE_PUMP_4_(U	0.000	00:00	0.000	00:00	0.000	0.000
1117	BB_FUTURE_PUMP_4_(D	0.000	00:00	0.000	00:00	0.000	0.000
1118	CC_PMP_3-MZ_U	0.000	00:00	0.000	00:00	0.000	0.000
1119	CC_PMP_3-MZ_D	0.000	00:00	0.000	00:00	0.000	0.000
1120	CC_PMP_4-HZ1_U	13.705	04:00	12.563	59:00	13.086	1.142
1121	CC_PMP_4-HZ1_D	13.705	04:00	12.563	59:00	13.086	1.142
1122	CC_PMP_5-HZ1_U	13.705	04:00	12.563	59:00	13.086	1.142
1123	CC_PMP_5-HZ1_D	13.705	04:00	12.563	59:00	13.086	1.142
1124	CC_PMP_6-HZ1_U	0.000	00:00	0.000	00:00	0.000	0.000
1125	CC_PMP_6-HZ1_D	0.000	00:00	0.000	00:00	0.000	0.000
1126	CC_PMP_7-HZ2_U	8.129	00:00	0.000	03:00	4.229	8.129
1127	CC_PMP_7-HZ2_D	10.618	00:00	0.000	03:00	5.523	10.618
1128	CC_PMP_8-HZ2_U	0.000	00:00	0.000	00:00	0.000	0.000
1129	CC_PMP_8-HZ2_D	0.000	00:00	0.000	00:00	0.000	0.000
1130	CC_PMP_9-HZ2_(STBY_U	0.000	00:00	0.000	00:00	0.000	0.000
1131	CC_PMP_9-HZ2_(STBY_D	0.000	00:00	0.000	00:00	0.000	0.000
1132	MN_PMP_FUTURE_U	0.000	00:00	0.000	00:00	0.000	0.000
1133	MN_PMP_FUTURE_D	0.000	00:00	0.000	00:00	0.000	0.000
1134	MN_PMP1_U	6.191	68:00	0.000	00:00	5.864	6.191
1135	MN_PMP1_D	6.191	68:00	0.000	00:00	5.864	6.191
1136	MN_PMP3_U	0.000	00:00	0.000	00:00	0.000	0.000
1137	MN_PMP3_D	0.000	00:00	0.000	00:00	0.000	0.000
1138	MN_PMP2_U	0.000	00:00	0.000	00:00	0.000	0.000
1139	MN_PMP2_D	0.000	00:00	0.000	00:00	0.000	0.000
1140	GOLDEN_BEAR_PMP-1_U	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1141	GOLDEN_BEAR_PMP-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1142	GOLDEN_BEAR_PMP-2_U	5.351	10:00	0.054	42:00	3.355	5.298
1143	GOLDEN_BEAR_PMP-2_D	5.351	10:00	0.054	42:00	3.355	5.298
1144	FCV-1_U	0.000	00:00	0.000	00:00	0.000	0.000
1145	FCV-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1146	DC_PRV_U	9.665	30:00	1.376	66:00	5.487	8.289
1147	DC_PRV_D	9.665	30:00	1.376	66:00	5.487	8.289
1148	BROADWAY_PRV_U	1.553	16:00	0.687	30:00	1.233	0.866
1149	PRV-3_U	2.109	30:00	0.000	16:00	0.821	2.109
1150	P1544	0.292	07:00	0.000	00:00	0.022	0.292
1151	P1552	3.073	33:00	0.005	25:00	0.794	3.068
1152	P1572	4.517	00:00	0.000	54:00	0.773	4.517
1153	P1578	0.912	00:00	0.006	35:00	0.209	0.906
1154	P1580	1.417	33:00	0.012	17:00	0.685	1.404
1155	P1584	0.000	00:00	0.000	00:00	0.000	0.000
1156	P1590	1.410	33:00	0.004	17:00	0.676	1.406
1157	P1594	0.000	00:00	0.000	00:00	0.000	0.000
1158	P1596	0.000	00:00	0.000	00:00	0.000	0.000
1159	P1598	0.000	00:00	0.000	00:00	0.000	0.000
1160	P1600	0.936	29:00	0.282	16:00	0.647	0.654
1161	P1602	1.551	29:00	0.187	16:00	0.897	1.364
1162	P1606	0.000	00:00	0.000	00:00	0.000	0.000
1163	P1608	0.000	00:00	0.000	00:00	0.000	0.000
1164	P1610	0.000	00:00	0.000	00:00	0.000	0.000
1165	P1612	1.354	04:00	1.241	59:00	1.292	0.113
1166	P1614	3.613	00:00	0.000	03:00	1.879	3.613
1167	P1626	0.986	16:00	0.325	00:00	0.805	0.661
1168	P1628	2.565	35:00	0.012	28:00	0.939	2.554
1169	P1634	2.906	30:00	0.562	16:00	1.611	2.343
1170	P1642	0.265	35:00	0.002	06:00	0.102	0.263
1171	P1644	0.608	35:00	0.021	54:00	0.235	0.587
1172	P1646	1.610	30:00	0.312	16:00	0.893	1.298
1173	P1648	0.119	30:00	0.023	16:00	0.066	0.096
1174	P1650	0.980	30:00	0.190	16:00	0.543	0.790
1175	P1652	0.812	30:00	0.157	16:00	0.450	0.655
1176	P1654	1.195	30:00	0.231	16:00	0.663	0.964
1177	P1656	0.181	30:00	0.035	16:00	0.101	0.146
1178	P1676	0.823	29:00	0.181	16:00	0.525	0.642
1179	P-64	3.046	04:00	2.792	59:00	2.908	0.254
1180	P1678	0.724	33:00	0.001	14:00	0.149	0.723
1181	P1680	2.325	29:00	0.444	16:00	1.435	1.881
1182	P1682	0.278	33:00	0.008	65:00	0.123	0.269
1183	P1684	0.179	33:00	0.004	17:00	0.088	0.175
1184	P1686	1.468	29:00	0.219	16:00	0.834	1.250
1185	P1688	0.277	69:00	0.008	15:00	0.123	0.269
1186	P1690	0.184	29:00	0.013	16:00	0.101	0.171
1187	P1700	2.912	30:00	0.564	16:00	1.615	2.348
1188	P1702	1.410	33:00	0.004	17:00	0.676	1.406
1189	P1704	1.294	30:00	0.250	16:00	0.718	1.044
1190	P1708	0.000	00:00	0.000	00:00	0.000	0.000
1191	P1710	0.000	00:00	0.000	00:00	0.000	0.000
1192	P1716	1.867	35:00	0.009	27:00	0.681	1.858
1193	P1718	0.000	00:00	0.000	00:00	0.000	0.000
1194	P1720	2.741	30:00	0.324	16:00	1.403	2.417
1195	P1722	20.703	00:00	0.138	43:00	1.816	20.565
1196	P1724	3.144	30:00	0.000	00:00	1.878	3.144
1197	P1726	3.309	30:00	0.000	00:00	2.000	3.309

Test Report Print Title

	ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1198	P1728	3.187	35:00	0.007	12:00	1.128	3.180
1199	P1730	6.202	07:00	5.834	66:00	5.930	0.368
1200	P1732	4.224	30:00	2.613	16:00	3.552	1.611
1201	P1734	30.072	00:00	0.059	09:00	6.799	30.013
1202	P1736	14.230	34:00	0.256	01:00	9.882	13.974
1203	P1738	14.865	00:00	6.596	67:00	10.772	8.268
1204	P1740	17.245	00:00	0.282	17:00	4.037	16.963
1205	P1742	6.454	30:00	0.000	00:00	3.877	6.454
1206	P1760	5.351	10:00	0.000	09:00	3.306	5.351
1207	P1762	1.712	30:00	0.331	16:00	0.949	1.381
1208	P1764	5.351	10:00	0.054	42:00	3.355	5.298
1209	P1770	0.246	30:00	0.048	16:00	0.137	0.199
1210	P1790	3.308	33:00	0.202	17:00	1.941	3.106
1211	P1792	2.097	00:00	0.006	12:00	0.504	2.092
1212	P1796	1.459	00:00	0.004	09:00	0.459	1.455
1213	P1802	0.598	33:00	0.000	55:00	0.140	0.597
1214	P1818	0.427	16:00	0.087	00:00	0.381	0.341
1215	P1822	0.265	35:00	0.002	06:00	0.102	0.263
1216	P1824	1.377	35:00	0.032	28:00	0.506	1.345
1217	P1826	1.377	35:00	0.032	28:00	0.506	1.345
1218	P1830	1.043	29:00	0.213	16:00	0.638	0.830
1219	P1836	1.610	30:00	0.312	16:00	0.893	1.298
1220	P1838	0.000	00:00	0.000	00:00	0.000	0.000
1221	P1840	0.347	35:00	0.003	04:00	0.131	0.343
1222	P1842	0.347	35:00	0.003	04:00	0.131	0.343
1223	P1844	0.179	35:00	0.002	04:00	0.067	0.177
1224	P1846	0.168	35:00	0.002	04:00	0.063	0.166
1225	P1848	0.000	00:00	0.000	00:00	0.000	0.000
1226	P1850	0.168	35:00	0.002	04:00	0.063	0.166
1227	P1852	0.000	00:00	0.000	00:00	0.000	0.000
1228	P1854	0.000	00:00	0.000	01:00	0.000	0.000
1229	P1856	0.000	00:00	0.000	00:00	0.000	0.000
1230	P1858	0.000	00:00	0.000	01:00	0.000	0.000
1231	P1860	0.000	00:00	0.000	01:00	0.000	0.000
1232	P1862	0.812	30:00	0.157	16:00	0.450	0.655
1233	P1864	0.812	30:00	0.157	16:00	0.450	0.655
1234	P1866	0.000	00:00	0.000	00:00	0.000	0.000
1235	P1868	0.000	00:00	0.000	00:00	0.000	0.000
1236	P1870	0.000	00:00	0.000	00:00	0.000	0.000
1237	P1872	0.000	00:00	0.000	00:00	0.000	0.000
1238	P1874	0.000	00:00	0.000	00:00	0.000	0.000
1239	P1876	0.905	30:00	0.175	16:00	0.502	0.730
1240	P1878	0.523	30:00	0.101	16:00	0.290	0.422
1241	P1880	0.905	30:00	0.175	16:00	0.502	0.730
1242	P1882	2.906	30:00	0.562	16:00	1.611	2.343
1243	P1884	0.804	30:00	0.156	16:00	0.446	0.648
1244	P1886	0.788	30:00	0.153	16:00	0.437	0.636
1245	P1888	0.246	30:00	0.048	16:00	0.137	0.199
1246	P1890	0.946	30:00	0.183	16:00	0.524	0.763
1247	P1892	0.000	00:00	0.000	00:00	0.000	0.000
1248	P1894	0.705	30:00	0.136	16:00	0.391	0.568
1249	P1896	0.000	00:00	0.000	00:00	0.000	0.000
1250	P1898	0.557	30:00	0.108	16:00	0.309	0.449
1251	P1900	0.016	30:00	0.003	16:00	0.009	0.013
1252	P1902	0.000	00:00	0.000	00:00	0.000	0.000
1253	P1904	2.013	16:00	0.399	00:00	1.755	1.614
1254	P1906	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1255	<input type="checkbox"/>	P1908	1.625	16:00	0.402	00:00	1.366	1.222
1256	<input type="checkbox"/>	P1910	0.803	16:00	0.199	00:00	0.675	0.604
1257	<input type="checkbox"/>	P1912	0.000	00:00	0.000	00:00	0.000	0.000
1258	<input type="checkbox"/>	P1914	0.803	16:00	0.199	00:00	0.675	0.604
1259	<input type="checkbox"/>	P1916	4.458	16:00	1.104	00:00	3.749	3.354
1260	<input type="checkbox"/>	P1918	1.981	16:00	0.491	00:00	1.666	1.491
1261	<input type="checkbox"/>	P1920	2.370	16:00	0.396	00:00	2.124	1.974
1262	<input type="checkbox"/>	P1922	0.516	54:00	0.043	00:00	0.432	0.473
1263	<input type="checkbox"/>	P1924	0.682	16:00	0.162	00:00	0.590	0.519
1264	<input type="checkbox"/>	P1926	0.496	16:00	0.182	00:00	0.391	0.313
1265	<input type="checkbox"/>	P1928	0.496	16:00	0.182	00:00	0.391	0.313
1266	<input type="checkbox"/>	P1930	0.523	16:00	0.153	00:00	0.436	0.370
1267	<input type="checkbox"/>	P1932	1.312	16:00	0.377	00:00	1.038	0.935
1268	<input type="checkbox"/>	P1934	1.648	16:00	0.474	00:00	1.304	1.174
1269	<input type="checkbox"/>	P1936	0.756	16:00	0.218	00:00	0.598	0.539
1270	<input type="checkbox"/>	P1938	0.000	00:00	0.000	00:00	0.000	0.000
1271	<input type="checkbox"/>	P1940	0.000	00:00	0.000	00:00	0.000	0.000
1272	<input type="checkbox"/>	P1942	0.756	16:00	0.218	00:00	0.598	0.539
1273	<input type="checkbox"/>	P1944	0.336	16:00	0.097	00:00	0.266	0.239
1274	<input type="checkbox"/>	P1946	0.000	00:00	0.000	00:00	0.000	0.000
1275	<input type="checkbox"/>	P1948	0.000	00:00	0.000	00:00	0.000	0.000
1276	<input type="checkbox"/>	P1950	0.000	00:00	0.000	00:00	0.000	0.000
1277	<input type="checkbox"/>	P1952	1.648	16:00	0.474	00:00	1.304	1.174
1278	<input type="checkbox"/>	P1954	0.000	00:00	0.000	00:00	0.000	0.000
1279	<input type="checkbox"/>	P1956	0.126	16:00	0.001	52:00	0.056	0.125
1280	<input type="checkbox"/>	P1958	1.246	16:00	0.007	52:00	0.553	1.238
1281	<input type="checkbox"/>	P1960	0.283	16:00	0.002	52:00	0.126	0.282
1282	<input type="checkbox"/>	P1962	0.197	00:00	0.000	24:00	0.051	0.196
1283	<input type="checkbox"/>	P1964	2.148	16:00	0.852	30:00	1.602	1.296
1284	<input type="checkbox"/>	P1966	1.648	16:00	0.474	00:00	1.304	1.174
1285	<input type="checkbox"/>	P1968	1.371	16:00	0.008	52:00	0.609	1.363
1286	<input type="checkbox"/>	P1970	0.938	16:00	0.388	00:00	0.731	0.550
1287	<input type="checkbox"/>	P1972	0.172	16:00	0.005	06:00	0.080	0.167
1288	<input type="checkbox"/>	P1974	0.000	00:00	0.000	00:00	0.000	0.000
1289	<input type="checkbox"/>	P1976	0.172	16:00	0.005	06:00	0.080	0.167
1290	<input type="checkbox"/>	P1978	1.109	16:00	0.408	30:00	0.805	0.702
1291	<input type="checkbox"/>	P1980	2.235	16:00	0.498	30:00	1.476	1.737
1292	<input type="checkbox"/>	P1982	0.500	16:00	0.040	30:00	0.298	0.460
1293	<input type="checkbox"/>	P1984	0.762	16:00	0.300	00:00	0.571	0.462
1294	<input type="checkbox"/>	P1986	0.365	06:00	0.024	00:00	0.320	0.341
1295	<input type="checkbox"/>	P1988	0.000	00:00	0.000	00:00	0.000	0.000
1296	<input type="checkbox"/>	P1990	0.000	00:00	0.000	00:00	0.000	0.000
1297	<input type="checkbox"/>	P1992	0.527	00:00	0.001	01:00	0.163	0.526
1298	<input type="checkbox"/>	P1994	0.115	00:00	0.000	01:00	0.036	0.115
1299	<input type="checkbox"/>	P1996	0.528	30:00	0.124	16:00	0.318	0.404
1300	<input type="checkbox"/>	P1998	2.408	16:00	0.916	30:00	1.735	1.492
1301	<input type="checkbox"/>	P2000	1.154	16:00	0.408	30:00	0.823	0.745
1302	<input type="checkbox"/>	P2002	1.459	16:00	0.120	00:00	1.310	1.339
1303	<input type="checkbox"/>	P2004	1.197	16:00	0.005	30:00	0.694	1.192
1304	<input type="checkbox"/>	P2006	1.017	00:00	0.061	55:00	0.465	0.956
1305	<input type="checkbox"/>	P2008	1.168	16:00	0.057	51:00	0.534	1.111
1306	<input type="checkbox"/>	P2010	2.146	16:00	0.003	29:00	1.135	2.143
1307	<input type="checkbox"/>	P2012	2.628	16:00	0.129	51:00	1.201	2.499
1308	<input type="checkbox"/>	P2014	1.069	16:00	0.045	06:00	0.495	1.024
1309	<input type="checkbox"/>	P2016	7.218	16:00	0.068	51:00	3.236	7.150
1310	<input type="checkbox"/>	P2018	2.324	16:00	0.022	51:00	1.041	2.302
1311	<input type="checkbox"/>	P2020	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1312	<input type="checkbox"/>	P2022	2.324	16:00	0.022	51:00	1.041	2.302
1313	<input type="checkbox"/>	P2024	1.559	16:00	0.050	51:00	0.706	1.508
1314	<input type="checkbox"/>	P2026	2.799	16:00	0.013	51:00	1.261	2.786
1315	<input type="checkbox"/>	P2028	1.989	16:00	0.018	51:00	0.893	1.970
1316	<input type="checkbox"/>	P2030	0.358	16:00	0.017	06:00	0.165	0.342
1317	<input type="checkbox"/>	P2032	1.200	16:00	0.020	51:00	0.541	1.181
1318	<input type="checkbox"/>	P2034	2.347	16:00	0.012	51:00	1.057	2.335
1319	<input type="checkbox"/>	P2036	1.271	16:00	0.005	51:00	0.573	1.267
1320	<input type="checkbox"/>	P2038	1.076	16:00	0.008	51:00	0.485	1.068
1321	<input type="checkbox"/>	P2040	2.471	16:00	0.024	51:00	1.114	2.447
1322	<input type="checkbox"/>	P2042	0.319	16:00	0.005	51:00	0.144	0.314
1323	<input type="checkbox"/>	P2044	1.395	16:00	0.012	51:00	0.629	1.382
1324	<input type="checkbox"/>	P2046	0.000	00:00	0.000	00:00	0.000	0.000
1325	<input type="checkbox"/>	P2048	2.153	16:00	0.019	51:00	0.970	2.133
1326	<input type="checkbox"/>	P2050	1.395	16:00	0.012	51:00	0.629	1.382
1327	<input type="checkbox"/>	P2052	3.547	16:00	0.032	51:00	1.599	3.515
1328	<input type="checkbox"/>	P2054	0.000	00:00	0.000	00:00	0.000	0.000
1329	<input type="checkbox"/>	P2056	0.000	00:00	0.000	00:00	0.000	0.000
1330	<input type="checkbox"/>	P2058	0.000	00:00	0.000	00:00	0.000	0.000
1331	<input type="checkbox"/>	P2060	1.625	16:00	0.343	00:00	1.442	1.282
1332	<input type="checkbox"/>	P2062	0.071	68:00	0.006	00:00	0.068	0.065
1333	<input type="checkbox"/>	P2064	1.029	16:00	0.201	00:00	0.925	0.828
1334	<input type="checkbox"/>	P2066	0.962	16:00	0.195	00:00	0.857	0.767
1335	<input type="checkbox"/>	P2068	0.000	00:00	0.000	00:00	0.000	0.000
1336	<input type="checkbox"/>	P2072	0.042	30:00	0.008	16:00	0.024	0.034
1337	<input type="checkbox"/>	P2074	0.014	30:00	0.003	16:00	0.008	0.011
1338	<input type="checkbox"/>	P2076	0.028	30:00	0.005	16:00	0.016	0.023
1339	<input type="checkbox"/>	P2078	0.042	30:00	0.008	16:00	0.024	0.034
1340	<input type="checkbox"/>	P2082	0.099	30:00	0.019	16:00	0.055	0.080
1341	<input type="checkbox"/>	P2084	0.099	30:00	0.019	16:00	0.055	0.080
1342	<input type="checkbox"/>	P2086	0.099	30:00	0.019	16:00	0.055	0.080
1343	<input type="checkbox"/>	P2088	0.000	00:00	0.000	00:00	0.000	0.000
1344	<input type="checkbox"/>	P2090	0.000	00:00	0.000	01:00	0.000	0.000
1345	<input type="checkbox"/>	P2092	0.000	00:00	0.000	00:00	0.000	0.000
1346	<input type="checkbox"/>	P2094	0.000	00:00	0.000	00:00	0.000	0.000
1347	<input type="checkbox"/>	P2096	0.000	00:00	0.000	01:00	0.000	0.000
1348	<input type="checkbox"/>	P2098	0.000	00:00	0.000	01:00	0.000	0.000
1349	<input type="checkbox"/>	P2100	0.000	00:00	0.000	00:00	0.000	0.000
1350	<input type="checkbox"/>	P2102	0.000	00:00	0.000	00:00	0.000	0.000
1351	<input type="checkbox"/>	P2104	0.000	00:00	0.000	00:00	0.000	0.000
1352	<input type="checkbox"/>	P2106	0.000	00:00	0.000	00:00	0.000	0.000
1353	<input type="checkbox"/>	P2108	0.000	00:00	0.000	01:00	0.000	0.000
1354	<input type="checkbox"/>	P2110	0.000	00:00	0.000	01:00	0.000	0.000
1355	<input type="checkbox"/>	P2112	0.000	00:00	0.000	01:00	0.000	0.000
1356	<input type="checkbox"/>	P2114	0.000	00:00	0.000	00:00	0.000	0.000
1357	<input type="checkbox"/>	P2116	0.000	00:00	0.000	00:00	0.000	0.000
1358	<input type="checkbox"/>	P2118	0.001	00:00	0.000	01:00	0.000	0.001
1359	<input type="checkbox"/>	P2120	0.000	00:00	0.000	00:00	0.000	0.000
1360	<input type="checkbox"/>	P2122	0.000	00:00	0.000	01:00	0.000	0.000
1361	<input type="checkbox"/>	P2124	0.001	00:00	0.000	01:00	0.000	0.001
1362	<input type="checkbox"/>	P2126	0.000	00:00	0.000	01:00	0.000	0.000
1363	<input type="checkbox"/>	P2128	0.000	00:00	0.000	00:00	0.000	0.000
1364	<input type="checkbox"/>	P2130	0.000	00:00	0.000	00:00	0.000	0.000
1365	<input type="checkbox"/>	P2132	0.000	00:00	0.000	00:00	0.000	0.000
1366	<input type="checkbox"/>	P2134	0.000	00:00	0.000	00:00	0.000	0.000
1367	<input type="checkbox"/>	P2136	0.000	00:00	0.000	00:00	0.000	0.000
1368	<input type="checkbox"/>	P2138	0.000	00:00	0.000	00:00	0.000	0.000

		ID	Max.Value (ft/s)	Max.Time (hrs.)	Min.Value (ft/s)	Min.Time (hrs.)	Average (ft/s)	Difference (ft/s)
1369	<input type="checkbox"/>	P2140	0.000	00:00	0.000	00:00	0.000	0.000
1370	<input type="checkbox"/>	P2142	0.000	00:00	0.000	00:00	0.000	0.000
1371	<input type="checkbox"/>	P2144	0.000	00:00	0.000	00:00	0.000	0.000
1372	<input type="checkbox"/>	P2146	0.000	00:00	0.000	00:00	0.000	0.000
1373	<input type="checkbox"/>	P2148	0.000	00:00	0.000	00:00	0.000	0.000
1374	<input type="checkbox"/>	P2150	0.000	00:00	0.000	00:00	0.000	0.000
1375	<input type="checkbox"/>	P2152	0.000	00:00	0.000	00:00	0.000	0.000
1376	<input type="checkbox"/>	P2154	0.000	00:00	0.000	00:00	0.000	0.000
1377	<input type="checkbox"/>	P2156	0.000	00:00	0.000	01:00	0.000	0.000
1378	<input type="checkbox"/>	P2158	0.000	00:00	0.000	00:00	0.000	0.000
1379	<input type="checkbox"/>	P2160	0.000	00:00	0.000	00:00	0.000	0.000
1380	<input type="checkbox"/>	P2162	0.000	00:00	0.000	00:00	0.000	0.000
1381	<input type="checkbox"/>	P2164	0.000	00:00	0.000	00:00	0.000	0.000
1382	<input type="checkbox"/>	P2166	0.000	00:00	0.000	01:00	0.000	0.000
1383	<input type="checkbox"/>	P2168	0.000	00:00	0.000	00:00	0.000	0.000
1384	<input type="checkbox"/>	P2170	0.000	00:00	0.000	00:00	0.000	0.000
1385	<input type="checkbox"/>	P2172	0.000	00:00	0.000	00:00	0.000	0.000
1386	<input type="checkbox"/>	P2174	0.000	00:00	0.000	00:00	0.000	0.000
1387	<input type="checkbox"/>	P2176	0.000	00:00	0.000	00:00	0.000	0.000
1388	<input type="checkbox"/>	P2178	1.532	16:00	0.291	00:00	1.371	1.241
1389	<input type="checkbox"/>	P2184	1.461	35:00	0.006	05:00	0.536	1.456
1390	<input type="checkbox"/>	P2186	1.916	35:00	0.057	51:00	0.655	1.859
1391	<input type="checkbox"/>	P2188	1.605	35:00	0.047	29:00	0.533	1.558
1392	<input type="checkbox"/>	P2190	0.000	00:00	0.000	00:00	0.000	0.000
1393	<input type="checkbox"/>	P2194	2.906	30:00	0.562	16:00	1.611	2.343
1394	<input type="checkbox"/>	P2196	1.377	35:00	0.032	28:00	0.506	1.345
1395	<input type="checkbox"/>	P2198	0.000	00:00	0.000	00:00	0.000	0.000
1396	<input type="checkbox"/>	P2200	2.634	68:00	0.196	00:00	2.449	2.438
1397	<input type="checkbox"/>	P2202	4.376	16:00	0.027	51:00	1.971	4.349
1398	<input type="checkbox"/>	P2204	0.000	00:00	0.000	00:00	0.000	0.000
1399	<input type="checkbox"/>	P2206	0.000	00:00	0.000	00:00	0.000	0.000
1400	<input type="checkbox"/>	P-1143	1.053	29:00	0.172	16:00	0.632	0.881
1401	<input type="checkbox"/>	P-1444	0.468	29:00	0.076	16:00	0.281	0.392
1402	<input type="checkbox"/>	P-276	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1	<input type="checkbox"/>	P-301	0.229	30:00	0.011	16:00	0.084	0.218
2	<input type="checkbox"/>	P-302	0.031	30:00	0.002	16:00	0.012	0.030
3	<input type="checkbox"/>	P-303	0.010	30:00	0.000	16:00	0.004	0.009
4	<input type="checkbox"/>	P-304	0.004	30:00	0.000	16:00	0.001	0.003
5	<input type="checkbox"/>	P-305	0.025	30:00	0.001	16:00	0.009	0.024
6	<input type="checkbox"/>	P-306	0.033	30:00	0.002	16:00	0.012	0.031
7	<input type="checkbox"/>	P-443	0.006	30:00	0.000	16:00	0.002	0.006
8	<input type="checkbox"/>	P-446	0.080	30:00	0.004	16:00	0.029	0.076
9	<input type="checkbox"/>	P-1325	0.001	30:00	0.000	10:00	0.000	0.001
10	<input type="checkbox"/>	P-1319	0.238	30:00	0.011	16:00	0.088	0.227
11	<input type="checkbox"/>	P-309A	0.386	30:00	0.018	16:00	0.142	0.367
12	<input type="checkbox"/>	P-1318A	0.129	30:00	0.006	16:00	0.048	0.123
13	<input type="checkbox"/>	P-3012	0.174	30:00	0.008	16:00	0.064	0.165
14	<input type="checkbox"/>	P-3013	0.007	30:00	0.000	16:00	0.003	0.007
15	<input type="checkbox"/>	P-445B	0.003	30:00	0.000	16:00	0.001	0.003
16	<input type="checkbox"/>	P-445A	0.083	30:00	0.004	16:00	0.031	0.079
17	<input type="checkbox"/>	P-1345A	0.021	30:00	0.001	16:00	0.008	0.020
18	<input type="checkbox"/>	P-1317A	0.029	30:00	0.001	16:00	0.011	0.028
19	<input type="checkbox"/>	P-1317B	0.208	30:00	0.010	16:00	0.077	0.198
20	<input type="checkbox"/>	P-1030	0.015	30:00	0.001	16:00	0.005	0.014
21	<input type="checkbox"/>	P-1354B	0.000	06:00	0.000	10:00	0.000	0.000
22	<input type="checkbox"/>	P-1354C	0.001	30:00	0.000	15:00	0.000	0.001
23	<input type="checkbox"/>	P-444A	0.017	30:00	0.001	16:00	0.006	0.017
24	<input type="checkbox"/>	P-444B	0.021	30:00	0.001	16:00	0.008	0.020
25	<input type="checkbox"/>	P-1043	0.028	30:00	0.001	16:00	0.010	0.027
26	<input type="checkbox"/>	P1744	0.112	30:00	0.005	16:00	0.041	0.107
27	<input type="checkbox"/>	P1746	1.185	10:00	0.001	42:00	0.726	1.184
28	<input type="checkbox"/>	P1758	0.027	30:00	0.001	16:00	0.010	0.026
29	<input type="checkbox"/>	P-277	2.885	30:00	0.629	10:00	1.741	2.257
30	<input type="checkbox"/>	P-278	1.134	35:00	0.229	67:00	0.690	0.905
31	<input type="checkbox"/>	P-280	0.388	35:00	0.005	68:00	0.146	0.383
32	<input type="checkbox"/>	P-281	0.375	35:00	0.064	18:00	0.210	0.311
33	<input type="checkbox"/>	P-282	0.312	35:00	0.055	18:00	0.177	0.257
34	<input type="checkbox"/>	P-283	0.451	35:00	0.013	68:00	0.179	0.438
35	<input type="checkbox"/>	P-284	0.063	35:00	0.008	68:00	0.033	0.055
36	<input type="checkbox"/>	P-286	0.169	68:00	0.001	52:00	0.028	0.168
37	<input type="checkbox"/>	P-289	0.378	30:00	0.000	65:00	0.147	0.378
38	<input type="checkbox"/>	P-292	3.920	30:00	0.006	65:00	1.589	3.914
39	<input type="checkbox"/>	P-293	1.217	30:00	0.001	16:00	0.417	1.216
40	<input type="checkbox"/>	P-294	2.004	30:00	0.004	16:00	0.720	2.000
41	<input type="checkbox"/>	P-295	0.617	35:00	0.007	68:00	0.228	0.609
42	<input type="checkbox"/>	P-297	2.381	30:00	0.002	16:00	0.741	2.379
43	<input type="checkbox"/>	P-298	1.707	30:00	0.003	35:00	0.526	1.704
44	<input type="checkbox"/>	P-299	0.488	30:00	0.001	16:00	0.185	0.487
45	<input type="checkbox"/>	P-330	11.109	30:00	2.142	65:00	6.278	8.966
46	<input type="checkbox"/>	P-420	1.935	37:00	0.162	68:00	0.647	1.773
47	<input type="checkbox"/>	P-424	0.360	30:00	0.028	16:00	0.135	0.332
48	<input type="checkbox"/>	P-427	0.051	37:00	0.009	34:00	0.020	0.042
49	<input type="checkbox"/>	P-442	0.439	35:00	0.000	41:00	0.205	0.439
50	<input type="checkbox"/>	P-460	0.039	38:00	0.002	08:00	0.015	0.037
51	<input type="checkbox"/>	P-461	0.090	30:00	0.009	35:00	0.040	0.082
52	<input type="checkbox"/>	P-462	0.057	30:00	0.000	35:00	0.018	0.057
53	<input type="checkbox"/>	P-463	0.042	30:00	0.000	16:00	0.016	0.042
54	<input type="checkbox"/>	P-464	0.991	30:00	0.247	13:00	0.471	0.744
55	<input type="checkbox"/>	P-465	0.881	30:00	0.188	15:00	0.400	0.693
56	<input type="checkbox"/>	P-487	0.335	35:00	0.000	68:00	0.147	0.335
57	<input type="checkbox"/>	P-510	1.447	30:00	0.007	58:00	0.746	1.440



Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
58	<input type="checkbox"/>	P-512	2.561	35:00	0.004	58:00	1.209	2.557
59	<input type="checkbox"/>	P-545	0.221	68:00	0.000	03:00	0.023	0.220
60	<input type="checkbox"/>	P-547	0.658	68:00	0.000	09:00	0.118	0.658
61	<input type="checkbox"/>	P-548	0.275	68:00	0.000	44:00	0.020	0.275
62	<input type="checkbox"/>	P-549	0.115	68:00	0.000	16:00	0.037	0.115
63	<input type="checkbox"/>	P-550	0.453	68:00	0.000	54:00	0.083	0.453
64	<input type="checkbox"/>	P-551	0.500	35:00	0.002	59:00	0.125	0.498
65	<input type="checkbox"/>	P-552	1.866	30:00	0.006	15:00	0.793	1.860
66	<input type="checkbox"/>	P-568	1.728	30:00	0.270	10:00	0.880	1.458
67	<input type="checkbox"/>	P-569	2.053	30:00	0.439	10:00	1.297	1.615
68	<input type="checkbox"/>	P-571	0.871	30:00	0.000	15:00	0.262	0.871
69	<input type="checkbox"/>	P-572	0.214	68:00	0.000	41:00	0.029	0.214
70	<input type="checkbox"/>	P-573	0.690	35:00	0.008	68:00	0.208	0.681
71	<input type="checkbox"/>	P-574	4.969	30:00	0.263	16:00	1.820	4.706
72	<input type="checkbox"/>	P-575	1.901	30:00	0.026	16:00	0.788	1.875
73	<input type="checkbox"/>	P-580	0.131	03:00	0.000	18:00	0.027	0.131
74	<input type="checkbox"/>	P-604	0.036	37:00	0.013	67:00	0.022	0.023
75	<input type="checkbox"/>	P-629	1.878	35:00	0.006	68:00	0.780	1.873
76	<input type="checkbox"/>	P-635	2.647	35:00	1.028	12:00	1.969	1.619
77	<input type="checkbox"/>	P-637	1.798	35:00	0.587	68:00	1.254	1.211
78	<input type="checkbox"/>	P-640	0.557	35:00	0.000	21:00	0.119	0.557
79	<input type="checkbox"/>	P-642	0.260	35:00	0.000	27:00	0.049	0.260
80	<input type="checkbox"/>	P-649	1.465	35:00	0.030	68:00	0.686	1.435
81	<input type="checkbox"/>	P-650	1.050	35:00	0.137	68:00	0.623	0.912
82	<input type="checkbox"/>	P-668	2.967	35:00	0.461	68:00	1.693	2.506
83	<input type="checkbox"/>	P-671	1.230	68:00	0.001	57:00	0.305	1.229
84	<input type="checkbox"/>	P-686	0.510	00:00	0.060	38:00	0.289	0.450
85	<input type="checkbox"/>	P-689	1.602	00:00	0.153	03:00	0.940	1.449
86	<input type="checkbox"/>	P-704	0.806	02:00	0.001	13:00	0.351	0.805
87	<input type="checkbox"/>	P-706	2.238	68:00	0.001	40:00	0.592	2.238
88	<input type="checkbox"/>	P-716	0.219	58:00	0.002	37:00	0.068	0.216
89	<input type="checkbox"/>	P-717	0.261	30:00	0.000	61:00	0.065	0.261
90	<input type="checkbox"/>	P-740	0.818	30:00	0.000	16:00	0.290	0.817
91	<input type="checkbox"/>	P-741	0.463	30:00	0.000	16:00	0.159	0.463
92	<input type="checkbox"/>	P-745	0.210	16:00	0.000	68:00	0.087	0.210
93	<input type="checkbox"/>	P-747	0.260	22:00	0.005	68:00	0.116	0.255
94	<input type="checkbox"/>	P-769	0.564	68:00	0.000	15:00	0.060	0.564
95	<input type="checkbox"/>	P-789	2.362	68:00	0.001	62:00	0.576	2.362
96	<input type="checkbox"/>	P-791	2.242	30:00	0.926	12:00	1.683	1.315
97	<input type="checkbox"/>	P-792	0.078	35:00	0.000	22:00	0.023	0.078
98	<input type="checkbox"/>	P-793	1.520	35:00	0.406	12:00	0.947	1.114
99	<input type="checkbox"/>	P-794	1.935	35:00	0.407	14:00	0.923	1.528
100	<input type="checkbox"/>	P-889	0.366	35:00	0.001	45:00	0.080	0.365
101	<input type="checkbox"/>	P-890	0.263	61:00	0.100	67:00	0.170	0.164
102	<input type="checkbox"/>	P-891	0.349	35:00	0.000	45:00	0.109	0.349
103	<input type="checkbox"/>	P-893	1.663	30:00	0.375	16:00	0.809	1.288
104	<input type="checkbox"/>	P-897	3.136	30:00	0.768	16:00	1.859	2.368
105	<input type="checkbox"/>	P-898	3.605	35:00	0.856	68:00	2.276	2.749
106	<input type="checkbox"/>	P-899	2.951	35:00	0.414	68:00	1.641	2.536
107	<input type="checkbox"/>	P-636	1.695	35:00	0.596	68:00	1.205	1.099
108	<input type="checkbox"/>	P-900	0.888	35:00	0.077	68:00	0.449	0.812
109	<input type="checkbox"/>	P-901	5.559	30:00	2.010	16:00	3.869	3.550
110	<input type="checkbox"/>	P-902	2.441	35:00	0.000	21:00	0.578	2.441
111	<input type="checkbox"/>	P-906	4.131	30:00	0.908	13:00	1.882	3.223
112	<input type="checkbox"/>	P-908	1.470	30:00	0.552	67:00	0.962	0.918
113	<input type="checkbox"/>	P-909	0.036	30:00	0.012	13:00	0.022	0.024
114	<input type="checkbox"/>	P-910	0.080	30:00	0.022	13:00	0.042	0.058

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
115	<input type="checkbox"/>	P-911	1.378	30:00	0.048	16:00	0.495	1.330
116	<input type="checkbox"/>	P-947	0.151	30:00	0.003	16:00	0.055	0.147
117	<input type="checkbox"/>	P-963	1.102	30:00	0.006	16:00	0.393	1.096
118	<input type="checkbox"/>	P-964	1.422	30:00	0.000	58:00	0.423	1.422
119	<input type="checkbox"/>	P-969	0.232	38:00	0.007	03:00	0.084	0.226
120	<input type="checkbox"/>	P-970	1.268	54:00	0.054	16:00	0.662	1.214
121	<input type="checkbox"/>	P-971	2.620	30:00	0.521	10:00	1.614	2.099
122	<input type="checkbox"/>	P-972	0.993	35:00	0.013	68:00	0.377	0.980
123	<input type="checkbox"/>	P-975	0.811	35:00	0.048	44:00	0.339	0.763
124	<input type="checkbox"/>	P-976	0.200	03:00	0.000	18:00	0.060	0.200
125	<input type="checkbox"/>	P-977	1.328	68:00	0.002	32:00	0.271	1.326
126	<input type="checkbox"/>	P-978	2.375	30:00	0.010	65:00	0.753	2.365
127	<input type="checkbox"/>	P-979	0.513	54:00	0.000	64:00	0.161	0.513
128	<input type="checkbox"/>	P-981	1.698	30:00	0.176	10:00	0.709	1.521
129	<input type="checkbox"/>	P-983	0.450	38:00	0.000	00:00	0.129	0.449
130	<input type="checkbox"/>	P-986	0.303	55:00	0.001	12:00	0.111	0.303
131	<input type="checkbox"/>	P-1018	4.414	30:00	0.002	61:00	1.399	4.412
132	<input type="checkbox"/>	P-1041	1.828	22:00	0.350	10:00	1.140	1.478
133	<input type="checkbox"/>	P-1045	1.095	68:00	0.002	05:00	0.202	1.093
134	<input type="checkbox"/>	P-1057	0.018	16:00	0.000	31:00	0.004	0.018
135	<input type="checkbox"/>	P-1059	1.746	35:00	0.003	45:00	0.563	1.744
136	<input type="checkbox"/>	P-1173	1.100	30:00	0.053	16:00	0.405	1.047
137	<input type="checkbox"/>	P-1175	0.832	30:00	0.040	16:00	0.306	0.792
138	<input type="checkbox"/>	P-1176	0.011	30:00	0.001	16:00	0.004	0.011
139	<input type="checkbox"/>	P-1179	0.604	30:00	0.019	35:00	0.230	0.585
140	<input type="checkbox"/>	P-1180	0.140	35:00	0.000	18:00	0.029	0.140
141	<input type="checkbox"/>	P-1181	0.411	35:00	0.000	07:00	0.080	0.411
142	<input type="checkbox"/>	P-1182	1.434	30:00	0.001	35:00	0.535	1.433
143	<input type="checkbox"/>	P-1273	2.208	30:00	0.598	16:00	1.367	1.610
144	<input type="checkbox"/>	P-1274	1.396	35:00	0.297	68:00	0.861	1.099
145	<input type="checkbox"/>	P-1275	0.232	35:00	0.052	68:00	0.145	0.181
146	<input type="checkbox"/>	P-1281	0.878	35:00	0.000	17:00	0.176	0.878
147	<input type="checkbox"/>	P-1282	0.423	35:00	0.000	17:00	0.086	0.423
148	<input type="checkbox"/>	P-1283	2.290	35:00	0.014	44:00	0.586	2.276
149	<input type="checkbox"/>	P-1339	0.489	00:00	0.000	42:00	0.186	0.488
150	<input type="checkbox"/>	P-1340	0.443	03:00	0.001	17:00	0.104	0.442
151	<input type="checkbox"/>	P-1342	0.533	38:00	0.012	69:00	0.202	0.521
152	<input type="checkbox"/>	P-1343	0.438	68:00	0.004	71:00	0.081	0.434
153	<input type="checkbox"/>	P-1344	0.682	35:00	0.002	43:00	0.125	0.681
154	<input type="checkbox"/>	P-1355	1.011	35:00	0.028	68:00	0.490	0.983
155	<input type="checkbox"/>	P-1374	0.091	30:00	0.000	15:00	0.030	0.091
156	<input type="checkbox"/>	P-1377	0.108	30:00	0.003	16:00	0.039	0.105
157	<input type="checkbox"/>	P-1379	1.857	35:00	0.396	14:00	0.900	1.460
158	<input type="checkbox"/>	P-1380	3.454	33:00	1.404	12:00	2.626	2.050
159	<input type="checkbox"/>	P-1382	4.714	35:00	1.364	68:00	3.168	3.350
160	<input type="checkbox"/>	P-1384	1.873	35:00	0.469	68:00	1.189	1.403
161	<input type="checkbox"/>	P-1385	0.971	35:00	0.056	68:00	0.455	0.915
162	<input type="checkbox"/>	P-1389	0.462	55:00	0.000	69:00	0.209	0.462
163	<input type="checkbox"/>	P-1396	0.439	68:00	0.000	15:00	0.048	0.439
164	<input type="checkbox"/>	P-1397	2.910	22:00	0.601	03:00	1.809	2.309
165	<input type="checkbox"/>	P-1398	2.901	00:00	0.207	03:00	1.683	2.695
166	<input type="checkbox"/>	P-1183	0.948	61:00	0.251	12:00	0.441	0.697
167	<input type="checkbox"/>	P-1185	0.182	61:00	0.038	45:00	0.073	0.143
168	<input type="checkbox"/>	P-1184	0.680	37:00	0.078	45:00	0.225	0.602
169	<input type="checkbox"/>	P-1406	0.212	61:00	0.002	68:00	0.053	0.210
170	<input type="checkbox"/>	P-1408	0.620	35:00	0.000	22:00	0.173	0.620
171	<input type="checkbox"/>	P-1410	0.131	35:00	0.049	12:00	0.095	0.082

Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
172	P-1412	1.323	35:00	0.015	68:00	0.514	1.309
173	P-1417	2.312	30:00	0.000	41:00	0.726	2.311
174	P-1419	0.622	30:00	0.001	67:00	0.255	0.621
175	P-1420	0.713	68:00	0.000	50:00	0.129	0.713
176	P-1421	0.544	30:00	0.000	40:00	0.138	0.544
177	P-1431	12.471	30:00	0.573	16:00	4.571	11.898
178	P-1432	12.210	30:00	0.609	16:00	4.519	11.601
179	P-1462	0.417	35:00	0.001	26:00	0.093	0.417
180	P-1463	0.220	35:00	0.000	04:00	0.045	0.220
181	P-1464	0.156	35:00	0.000	04:00	0.031	0.156
182	P-1465	0.135	35:00	0.000	04:00	0.027	0.135
183	P-1466	0.356	35:00	0.000	04:00	0.072	0.355
184	P-1506	0.335	58:00	0.000	53:00	0.055	0.335
185	P-1507	0.481	03:00	0.001	21:00	0.108	0.480
186	P-1518	1.107	56:00	0.000	11:00	0.500	1.107
187	P-1519	1.337	56:00	0.000	11:00	0.603	1.337
188	P-1542	0.000	00:00	0.000	00:00	0.000	0.000
189	P-1543	0.001	30:00	0.000	10:00	0.000	0.001
190	P-40	0.000	00:00	0.000	00:00	0.000	0.000
191	P-71	0.000	00:00	0.000	00:00	0.000	0.000
192	P-1569	1.598	30:00	0.553	16:00	1.103	1.045
193	P-1568	1.267	30:00	0.448	16:00	0.884	0.819
194	P-139	0.695	00:00	0.140	68:00	0.413	0.554
195	P-141	0.125	30:00	0.024	65:00	0.071	0.101
196	P-142	0.191	00:00	0.039	68:00	0.114	0.153
197	P-179A	0.110	30:00	0.005	16:00	0.035	0.106
198	P-194	0.000	06:00	0.000	09:00	0.000	0.000
199	P-195	0.000	30:00	0.000	13:00	0.000	0.000
200	P-333	0.485	68:00	0.000	00:00	0.443	0.485
201	P-348	2.168	35:00	0.000	18:00	0.419	2.167
202	P-353	0.085	35:00	0.000	31:00	0.013	0.085
203	P-365	0.509	35:00	0.000	51:00	0.097	0.509
204	P-366	0.019	35:00	0.000	05:00	0.004	0.019
205	P-393	2.367	35:00	0.001	54:00	0.396	2.366
206	P-454	1.094	00:00	0.196	68:00	0.642	0.899
207	P-557	4.651	30:00	0.680	65:00	2.271	3.971
208	P-469	4.414	30:00	0.002	61:00	1.399	4.412
209	P-468	0.344	68:00	0.000	32:00	0.064	0.344
210	P-475	1.527	35:00	0.351	68:00	0.956	1.176
211	P-466	3.227	35:00	0.009	69:00	1.104	3.219
212	P-1409	1.394	30:00	0.355	16:00	0.882	1.039
213	P-1065	0.573	03:00	0.000	17:00	0.131	0.573
214	P-1327	2.471	68:00	0.000	63:00	0.537	2.471
215	P-1378	2.216	30:00	0.414	15:00	0.956	1.802
216	P-912	1.636	37:00	0.570	67:00	0.993	1.066
217	P-1415	0.427	37:00	0.000	21:00	0.084	0.427
218	P-419	0.000	30:00	0.000	15:00	0.000	0.000
219	P-1330	0.031	68:00	0.000	54:00	0.006	0.031
220	P-315	2.646	35:00	0.006	09:00	1.052	2.640
221	P-628	1.738	35:00	0.500	12:00	1.080	1.238
222	P-1277B	0.389	35:00	0.000	68:00	0.145	0.389
223	P-273	1.128	30:00	0.291	16:00	0.688	0.837
224	P-275	0.648	33:00	0.172	68:00	0.481	0.476
225	P-631	2.476	32:00	0.920	68:00	1.868	1.556
226	P-632	3.341	31:00	1.330	68:00	2.498	2.011
227	P-331	0.746	35:00	0.128	68:00	0.513	0.618
228	P-334	2.259	31:00	0.863	68:00	1.682	1.396

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
229	<input type="checkbox"/>	P-798	0.908	30:00	0.034	16:00	0.327	0.874
230	<input type="checkbox"/>	P-799	0.551	30:00	0.039	16:00	0.211	0.512
231	<input type="checkbox"/>	P-1174	0.818	30:00	0.039	16:00	0.301	0.778
232	<input type="checkbox"/>	P-1512	0.440	30:00	0.044	16:00	0.176	0.396
233	<input type="checkbox"/>	P-1513	0.037	30:00	0.000	35:00	0.012	0.037
234	<input type="checkbox"/>	P-1517	0.456	30:00	0.022	16:00	0.168	0.434
235	<input type="checkbox"/>	P-1530	0.879	61:00	0.001	07:00	0.225	0.878
236	<input type="checkbox"/>	P-1531	0.206	61:00	0.000	53:00	0.050	0.206
237	<input type="checkbox"/>	P-1535	0.469	61:00	0.000	50:00	0.105	0.468
238	<input type="checkbox"/>	P-1536	0.446	61:00	0.000	23:00	0.097	0.446
239	<input type="checkbox"/>	P-1527	2.256	61:00	0.013	45:00	0.623	2.243
240	<input type="checkbox"/>	P-1516	0.132	30:00	0.000	69:00	0.057	0.132
241	<input type="checkbox"/>	P-1509	0.199	61:00	0.000	59:00	0.045	0.199
242	<input type="checkbox"/>	P-1511	0.262	61:00	0.000	23:00	0.056	0.262
243	<input type="checkbox"/>	P-1521	0.074	35:00	0.000	32:00	0.015	0.074
244	<input type="checkbox"/>	P-1529	0.074	35:00	0.000	32:00	0.015	0.074
245	<input type="checkbox"/>	P-1532	0.261	35:00	0.001	12:00	0.053	0.260
246	<input type="checkbox"/>	P-431	0.002	30:00	0.000	16:00	0.001	0.002
247	<input type="checkbox"/>	P-948	0.405	30:00	0.009	16:00	0.149	0.396
248	<input type="checkbox"/>	P-1546	1.695	30:00	0.003	39:00	0.511	1.692
249	<input type="checkbox"/>	P-1403	0.098	30:00	0.002	16:00	0.035	0.096
250	<input type="checkbox"/>	P-1402	0.035	30:00	0.000	16:00	0.012	0.035
251	<input type="checkbox"/>	P-1549	0.098	30:00	0.002	16:00	0.035	0.096
252	<input type="checkbox"/>	P-239	2.647	00:00	0.349	38:00	1.519	2.298
253	<input type="checkbox"/>	P-234	1.808	00:00	0.185	38:00	1.011	1.623
254	<input type="checkbox"/>	P-675	1.378	00:00	0.118	38:00	0.758	1.260
255	<input type="checkbox"/>	P-1373	0.152	55:00	0.000	42:00	0.069	0.152
256	<input type="checkbox"/>	P-1375	0.630	55:00	0.000	19:00	0.288	0.630
257	<input type="checkbox"/>	P-176	0.472	00:00	0.083	68:00	0.276	0.389
258	<input type="checkbox"/>	P-669	1.068	68:00	0.000	13:00	0.280	1.068
259	<input type="checkbox"/>	P-2016	0.109	68:00	0.000	41:00	0.015	0.109
260	<input type="checkbox"/>	P-2017	0.215	35:00	0.000	60:00	0.038	0.214
261	<input type="checkbox"/>	P-197B	0.035	30:00	0.001	16:00	0.011	0.034
262	<input type="checkbox"/>	P-312A	2.344	30:00	0.003	58:00	1.218	2.342
263	<input type="checkbox"/>	P-312B	0.619	35:00	0.000	58:00	0.236	0.619
264	<input type="checkbox"/>	P-540	3.923	30:00	0.002	09:00	1.969	3.921
265	<input type="checkbox"/>	P-1329B	0.148	68:00	0.000	54:00	0.027	0.148
266	<input type="checkbox"/>	P-1329A	0.275	68:00	0.000	54:00	0.050	0.275
267	<input type="checkbox"/>	P-1323B	0.162	16:00	0.000	07:00	0.035	0.162
268	<input type="checkbox"/>	P-1323A	0.095	35:00	0.000	23:00	0.021	0.095
269	<input type="checkbox"/>	P-1324B	1.830	35:00	0.030	59:00	0.808	1.800
270	<input type="checkbox"/>	P-1017	0.022	30:00	0.000	58:00	0.010	0.021
271	<input type="checkbox"/>	P-1324A	0.870	35:00	0.024	36:00	0.367	0.846
272	<input type="checkbox"/>	P-317	0.146	30:00	0.010	15:00	0.071	0.136
273	<input type="checkbox"/>	P-1354D	0.000	00:00	0.000	00:00	0.000	0.000
274	<input type="checkbox"/>	P-1046	0.064	35:00	0.000	69:00	0.019	0.064
275	<input type="checkbox"/>	P-1277A	0.177	35:00	0.064	12:00	0.129	0.113
276	<input type="checkbox"/>	P-1381A	0.724	30:00	0.032	16:00	0.303	0.692
277	<input type="checkbox"/>	P-1381B	0.189	35:00	0.000	02:00	0.035	0.189
278	<input type="checkbox"/>	P-1381C	0.409	33:00	0.119	12:00	0.272	0.290
279	<input type="checkbox"/>	P-423B	0.038	35:00	0.007	68:00	0.024	0.031
280	<input type="checkbox"/>	P-423A	0.135	30:00	0.036	16:00	0.085	0.099
281	<input type="checkbox"/>	P-1510	0.329	30:00	0.019	16:00	0.123	0.310
282	<input type="checkbox"/>	P-1500	0.386	30:00	0.031	16:00	0.151	0.355
283	<input type="checkbox"/>	P-1411A	1.491	35:00	0.381	68:00	1.061	1.109
284	<input type="checkbox"/>	P-1411D	1.024	35:00	0.029	68:00	0.510	0.995
285	<input type="checkbox"/>	P-1411E	0.569	35:00	0.003	68:00	0.258	0.567

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
286	<input type="checkbox"/>	P-1411C	2.268	35:00	0.177	68:00	1.271	2.091
287	<input type="checkbox"/>	P-1411B	1.598	35:00	0.376	68:00	1.114	1.222
288	<input type="checkbox"/>	P-1123	0.076	30:00	0.019	15:00	0.038	0.057
289	<input type="checkbox"/>	P-1127	0.208	30:00	0.041	16:00	0.097	0.168
290	<input type="checkbox"/>	P-1136	0.269	30:00	0.003	16:00	0.091	0.266
291	<input type="checkbox"/>	FCV-4_U	1.198	35:00	0.013	68:00	0.572	1.184
292	<input type="checkbox"/>	FCV-4_D	0.919	35:00	0.010	68:00	0.439	0.909
293	<input type="checkbox"/>	P1542	0.467	68:00	0.000	38:00	0.057	0.467
294	<input type="checkbox"/>	P1554	0.313	03:00	0.000	17:00	0.055	0.313
295	<input type="checkbox"/>	P1574	0.934	30:00	0.000	38:00	0.284	0.933
296	<input type="checkbox"/>	P1576	0.000	05:00	0.000	00:00	0.000	0.000
297	<input type="checkbox"/>	P1582	0.000	00:00	0.000	00:00	0.000	0.000
298	<input type="checkbox"/>	P1588	0.000	00:00	0.000	00:00	0.000	0.000
299	<input type="checkbox"/>	P1592	0.178	00:00	0.031	68:00	0.104	0.147
300	<input type="checkbox"/>	P1616	0.200	32:00	0.077	68:00	0.151	0.123
301	<input type="checkbox"/>	P1618	1.461	30:00	0.534	16:00	1.035	0.927
302	<input type="checkbox"/>	P1620	0.661	33:00	0.257	68:00	0.499	0.404
303	<input type="checkbox"/>	P1622	2.268	35:00	0.167	68:00	1.076	2.101
304	<input type="checkbox"/>	P1624	1.626	33:00	0.518	12:00	1.137	1.108
305	<input type="checkbox"/>	P1630	0.135	68:00	0.000	16:00	0.028	0.135
306	<input type="checkbox"/>	P1632	0.463	68:00	0.000	36:00	0.083	0.463
307	<input type="checkbox"/>	P1640	0.051	68:00	0.000	24:00	0.010	0.051
308	<input type="checkbox"/>	P1658	0.534	35:00	0.002	06:00	0.092	0.532
309	<input type="checkbox"/>	P1660	0.130	35:00	0.000	04:00	0.027	0.130
310	<input type="checkbox"/>	P1662	0.096	34:00	0.000	19:00	0.037	0.096
311	<input type="checkbox"/>	P1664	0.032	68:00	0.000	59:00	0.005	0.032
312	<input type="checkbox"/>	P1666	0.414	35:00	0.000	22:00	0.093	0.414
313	<input type="checkbox"/>	P1668	0.842	30:00	0.004	58:00	0.401	0.838
314	<input type="checkbox"/>	P1670	0.406	16:00	0.001	30:00	0.114	0.405
315	<input type="checkbox"/>	P1672	0.734	30:00	0.113	10:00	0.383	0.621
316	<input type="checkbox"/>	P1674	1.274	35:00	0.037	03:00	0.463	1.237
317	<input type="checkbox"/>	P1692	0.403	35:00	0.000	68:00	0.205	0.403
318	<input type="checkbox"/>	P1694	2.380	35:00	0.028	45:00	0.861	2.352
319	<input type="checkbox"/>	P1696	4.418	35:00	0.101	68:00	2.274	4.317
320	<input type="checkbox"/>	P1712	0.008	61:00	0.000	07:00	0.002	0.008
321	<input type="checkbox"/>	P1714	0.008	61:00	0.000	07:00	0.002	0.008
322	<input type="checkbox"/>	P1748	0.068	35:00	0.000	58:00	0.026	0.068
323	<input type="checkbox"/>	P1820	0.485	68:00	0.000	16:00	0.100	0.485
324	<input type="checkbox"/>	P1828	4.266	00:00	0.751	68:00	2.498	3.515
325	<input type="checkbox"/>	P2180	0.001	35:00	0.000	04:00	0.000	0.001
326	<input type="checkbox"/>	P2182	0.003	35:00	0.000	05:00	0.000	0.003
327	<input type="checkbox"/>	P-200	0.001	29:00	0.000	16:00	0.000	0.001
328	<input type="checkbox"/>	P-201	0.004	30:00	0.000	16:00	0.002	0.004
329	<input type="checkbox"/>	P-202	0.004	29:00	0.000	16:00	0.001	0.004
330	<input type="checkbox"/>	P-203	0.001	29:00	0.000	16:00	0.001	0.001
331	<input type="checkbox"/>	P-204	0.000	29:00	0.000	14:00	0.000	0.000
332	<input type="checkbox"/>	P-206	0.000	30:00	0.000	12:00	0.000	0.000
333	<input type="checkbox"/>	P-210	0.012	29:00	0.002	16:00	0.005	0.010
334	<input type="checkbox"/>	P-211	0.068	29:00	0.006	16:00	0.026	0.062
335	<input type="checkbox"/>	P-212	0.015	17:00	0.003	31:00	0.006	0.012
336	<input type="checkbox"/>	P-213	0.075	29:00	0.000	65:00	0.025	0.075
337	<input type="checkbox"/>	P-214	0.047	17:00	0.012	56:00	0.022	0.035
338	<input type="checkbox"/>	P-215	0.021	16:00	0.002	31:00	0.007	0.020
339	<input type="checkbox"/>	P-216	0.006	16:00	0.000	30:00	0.002	0.006
340	<input type="checkbox"/>	P-217	0.012	29:00	0.006	24:00	0.008	0.005
341	<input type="checkbox"/>	P-218	0.016	17:00	0.007	04:00	0.010	0.009
342	<input type="checkbox"/>	P-219	0.107	30:00	0.000	58:00	0.029	0.107

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
343	<input type="checkbox"/>	P-221	0.084	29:00	0.000	64:00	0.026	0.084
344	<input type="checkbox"/>	P-223	0.061	29:00	0.011	16:00	0.028	0.051
345	<input type="checkbox"/>	P-225	0.047	29:00	0.020	16:00	0.027	0.027
346	<input type="checkbox"/>	P-228	0.040	17:00	0.000	22:00	0.005	0.040
347	<input type="checkbox"/>	P-229	0.065	17:00	0.000	08:00	0.010	0.065
348	<input type="checkbox"/>	P-230	0.056	17:00	0.000	03:00	0.009	0.056
349	<input type="checkbox"/>	P-231	0.009	17:00	0.000	57:00	0.002	0.009
350	<input type="checkbox"/>	P-232	0.004	30:00	0.000	09:00	0.001	0.004
351	<input type="checkbox"/>	P-235	0.043	16:00	0.000	31:00	0.011	0.043
352	<input type="checkbox"/>	P-236	0.009	17:00	0.000	06:00	0.002	0.009
353	<input type="checkbox"/>	P-238	0.016	30:00	0.000	33:00	0.003	0.016
354	<input type="checkbox"/>	P-240	0.289	16:00	0.001	53:00	0.106	0.288
355	<input type="checkbox"/>	P-241	0.050	16:00	0.000	29:00	0.019	0.050
356	<input type="checkbox"/>	P-242	0.106	16:00	0.002	30:00	0.049	0.105
357	<input type="checkbox"/>	P-245	0.036	16:00	0.005	30:00	0.022	0.031
358	<input type="checkbox"/>	P-247	0.086	16:00	0.001	30:00	0.037	0.085
359	<input type="checkbox"/>	P-249	0.066	16:00	0.000	29:00	0.026	0.066
360	<input type="checkbox"/>	P-250	0.036	30:00	0.000	38:00	0.007	0.036
361	<input type="checkbox"/>	P-251	0.055	17:00	0.004	31:00	0.024	0.051
362	<input type="checkbox"/>	P-253	0.023	16:00	0.000	53:00	0.009	0.023
363	<input type="checkbox"/>	P-257	0.206	16:00	0.000	21:00	0.047	0.206
364	<input type="checkbox"/>	P-258	0.108	16:00	0.000	03:00	0.018	0.108
365	<input type="checkbox"/>	P-260	0.092	16:00	0.000	23:00	0.010	0.092
366	<input type="checkbox"/>	P-262	0.075	17:00	0.000	39:00	0.010	0.075
367	<input type="checkbox"/>	P-267	0.001	12:00	0.000	30:00	0.001	0.000
368	<input type="checkbox"/>	P-318	0.007	17:00	0.000	29:00	0.001	0.007
369	<input type="checkbox"/>	P-448	3.170	29:00	0.018	16:00	1.142	3.152
370	<input type="checkbox"/>	P-449	0.462	29:00	0.003	16:00	0.167	0.459
371	<input type="checkbox"/>	P-450	0.462	29:00	0.003	16:00	0.167	0.459
372	<input type="checkbox"/>	P-451	3.490	29:00	0.020	16:00	1.258	3.469
373	<input type="checkbox"/>	P-499	0.563	16:00	0.000	26:00	0.070	0.563
374	<input type="checkbox"/>	P-500	0.432	17:00	0.000	11:00	0.058	0.432
375	<input type="checkbox"/>	P-502	0.299	30:00	0.004	65:00	0.081	0.295
376	<input type="checkbox"/>	P-723	0.033	16:00	0.000	25:00	0.009	0.033
377	<input type="checkbox"/>	P-724	0.072	17:00	0.000	54:00	0.024	0.072
378	<input type="checkbox"/>	P-726	0.249	16:00	0.003	30:00	0.104	0.246
379	<input type="checkbox"/>	P-727	0.054	16:00	0.004	30:00	0.025	0.051
380	<input type="checkbox"/>	P-728	0.134	16:00	0.002	30:00	0.059	0.132
381	<input type="checkbox"/>	P-729	0.446	16:00	0.038	30:00	0.241	0.407
382	<input type="checkbox"/>	P-730	0.053	30:00	0.000	44:00	0.013	0.053
383	<input type="checkbox"/>	P-731	0.072	17:00	0.000	57:00	0.015	0.072
384	<input type="checkbox"/>	P-732	0.024	30:00	0.000	01:00	0.005	0.024
385	<input type="checkbox"/>	P-733	0.026	30:00	0.000	42:00	0.006	0.026
386	<input type="checkbox"/>	P-734	0.028	30:00	0.000	01:00	0.006	0.028
387	<input type="checkbox"/>	P-735	0.108	30:00	0.000	01:00	0.025	0.108
388	<input type="checkbox"/>	P-736	0.155	17:00	0.000	39:00	0.022	0.155
389	<input type="checkbox"/>	P-737	0.001	30:00	0.000	09:00	0.000	0.001
390	<input type="checkbox"/>	P-761	6.438	30:00	0.031	16:00	2.274	6.406
391	<input type="checkbox"/>	P-763	2.366	29:00	0.017	16:00	0.869	2.349
392	<input type="checkbox"/>	P-841	0.099	16:00	0.000	45:00	0.025	0.099
393	<input type="checkbox"/>	P-842	0.098	16:00	0.000	56:00	0.025	0.098
394	<input type="checkbox"/>	P-845	0.184	16:00	0.040	30:00	0.126	0.143
395	<input type="checkbox"/>	P-846	0.298	16:00	0.003	30:00	0.137	0.295
396	<input type="checkbox"/>	P-847	0.204	30:00	0.002	66:00	0.050	0.202
397	<input type="checkbox"/>	P-848	0.154	31:00	0.000	09:00	0.027	0.154
398	<input type="checkbox"/>	P-859	0.192	16:00	0.001	27:00	0.061	0.191
399	<input type="checkbox"/>	P-860	0.021	29:00	0.000	68:00	0.005	0.021

Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
400	P-999	0.258	64:00	0.077	30:00	0.200	0.181
401	P-1001	0.890	16:00	0.014	30:00	0.417	0.876
402	P-1027	0.078	17:00	0.000	09:00	0.013	0.078
403	P-1029	0.432	30:00	0.000	13:00	0.098	0.431
404	P-1037	0.165	16:00	0.001	29:00	0.066	0.165
405	P-1038	0.175	16:00	0.023	30:00	0.103	0.152
406	P-1039	0.422	16:00	0.076	30:00	0.266	0.346
407	P-1128	0.000	30:00	0.000	11:00	0.000	0.000
408	P-1129	0.001	29:00	0.000	14:00	0.000	0.001
409	P-1130	0.001	29:00	0.000	14:00	0.000	0.001
410	P-1131	0.091	16:00	0.000	17:00	0.018	0.091
411	P-1132	0.011	17:00	0.000	04:00	0.002	0.011
412	P-1133	0.085	17:00	0.000	70:00	0.011	0.085
413	P-1134	0.053	16:00	0.000	22:00	0.014	0.053
414	P-1135	0.024	16:00	0.000	02:00	0.006	0.023
415	P-1270	0.034	29:00	0.000	16:00	0.012	0.034
416	P-1301	0.858	16:00	0.065	30:00	0.465	0.793
417	P-1308	0.249	30:00	0.001	16:00	0.088	0.248
418	P-1309	0.000	00:00	0.000	00:00	0.000	0.000
419	P-1400	0.004	30:00	0.000	12:00	0.002	0.004
420	P-1401	0.100	30:00	0.001	16:00	0.032	0.099
421	P-1433	0.051	17:00	0.000	21:00	0.009	0.051
422	P-1434	0.038	16:00	0.000	30:00	0.017	0.037
423	P-1435	0.047	16:00	0.000	29:00	0.019	0.047
424	P-1453	0.035	17:00	0.000	16:00	0.008	0.035
425	P-1454	0.043	16:00	0.000	29:00	0.017	0.043
426	P-186	0.770	30:00	0.000	12:00	0.178	0.769
427	P-227	0.001	29:00	0.000	16:00	0.000	0.001
428	P-440	0.744	30:00	0.001	11:00	0.170	0.744
429	P-441	0.544	30:00	0.000	36:00	0.114	0.544
430	P-452	0.022	30:00	0.001	16:00	0.007	0.020
431	P-244	0.153	17:00	0.000	52:00	0.024	0.153
432	P-1075	0.080	16:00	0.000	27:00	0.015	0.080
433	P-187A	0.282	30:00	0.001	16:00	0.100	0.281
434	P-187B	0.341	30:00	0.002	16:00	0.121	0.340
435	P-1080	0.000	00:00	0.000	00:00	0.000	0.000
436	P-1026B	0.040	17:00	0.000	05:00	0.007	0.040
437	P-1026A	0.055	17:00	0.000	25:00	0.009	0.055
438	P-1144	3.249	30:00	0.013	16:00	1.111	3.237
439	P-1147	0.064	30:00	0.000	16:00	0.017	0.064
440	BROADWAY_PRV_D	0.027	16:00	0.006	30:00	0.018	0.021
441	PRV-3_D	0.081	30:00	0.000	15:00	0.020	0.081
442	P1550	0.994	16:00	0.000	49:00	0.121	0.994
443	P1568	0.000	00:00	0.000	00:00	0.000	0.000
444	P1604	0.207	16:00	0.000	45:00	0.057	0.207
445	P-237	0.001	29:00	0.000	16:00	0.000	0.001
446	P-322	3.623	29:00	0.411	16:00	1.814	3.211
447	P-324	1.362	29:00	0.115	16:00	0.685	1.247
448	P-325	0.153	30:00	0.000	64:00	0.040	0.153
449	P-326	0.617	29:00	0.045	16:00	0.295	0.572
450	P-327	0.002	29:00	0.000	16:00	0.001	0.002
451	P-328	0.600	29:00	0.040	16:00	0.283	0.559
452	P-337	0.631	30:00	0.013	16:00	0.232	0.618
453	P-338	0.861	30:00	0.016	16:00	0.315	0.845
454	P-339	2.073	33:00	0.007	62:00	0.347	2.067
455	P-342	0.105	00:00	0.000	65:00	0.017	0.105
456	P-343	0.036	30:00	0.000	39:00	0.014	0.036

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
457	<input type="checkbox"/>	P-344	1.874	33:00	0.000	17:00	0.470	1.874
458	<input type="checkbox"/>	P-347	0.335	00:00	0.000	12:00	0.027	0.335
459	<input type="checkbox"/>	P-349	7.582	33:00	0.001	67:00	2.023	7.580
460	<input type="checkbox"/>	P-352	2.091	69:00	0.005	33:00	0.673	2.086
461	<input type="checkbox"/>	P-354	1.505	29:00	0.001	33:00	0.483	1.505
462	<input type="checkbox"/>	P-355	0.601	69:00	0.000	57:00	0.178	0.601
463	<input type="checkbox"/>	P-356	0.324	29:00	0.022	65:00	0.144	0.302
464	<input type="checkbox"/>	P-359	1.419	30:00	0.000	16:00	0.373	1.419
465	<input type="checkbox"/>	P-360	3.150	30:00	0.092	16:00	1.200	3.059
466	<input type="checkbox"/>	P-361	0.287	33:00	0.000	13:00	0.037	0.286
467	<input type="checkbox"/>	P-362	0.243	33:00	0.000	37:00	0.029	0.243
468	<input type="checkbox"/>	P-363	2.086	30:00	0.034	16:00	0.765	2.052
469	<input type="checkbox"/>	P-364	1.234	30:00	0.017	16:00	0.448	1.216
470	<input type="checkbox"/>	P-367	0.048	53:00	0.001	16:00	0.021	0.047
471	<input type="checkbox"/>	P-370	1.470	30:00	0.047	16:00	0.557	1.423
472	<input type="checkbox"/>	P-371	0.886	29:00	0.046	66:00	0.392	0.840
473	<input type="checkbox"/>	P-372	0.198	33:00	0.000	66:00	0.037	0.198
474	<input type="checkbox"/>	P-373	1.242	30:00	0.020	16:00	0.436	1.221
475	<input type="checkbox"/>	P-374	1.320	69:00	0.001	11:00	0.329	1.319
476	<input type="checkbox"/>	P-375	0.494	69:00	0.000	50:00	0.104	0.493
477	<input type="checkbox"/>	P-376	0.207	69:00	0.000	34:00	0.032	0.207
478	<input type="checkbox"/>	P-377	0.301	33:00	0.000	06:00	0.040	0.301
479	<input type="checkbox"/>	P-378	0.476	33:00	0.000	00:00	0.121	0.476
480	<input type="checkbox"/>	P-380	1.057	29:00	0.057	16:00	0.439	1.000
481	<input type="checkbox"/>	P-381	0.467	29:00	0.000	33:00	0.148	0.467
482	<input type="checkbox"/>	P-382	0.247	69:00	0.000	65:00	0.061	0.247
483	<input type="checkbox"/>	P-383	0.163	33:00	0.000	34:00	0.019	0.163
484	<input type="checkbox"/>	P-384	0.173	33:00	0.000	37:00	0.025	0.173
485	<input type="checkbox"/>	P-385	0.323	29:00	0.011	16:00	0.142	0.312
486	<input type="checkbox"/>	P-386	0.637	69:00	0.003	16:00	0.208	0.634
487	<input type="checkbox"/>	P-387	0.258	29:00	0.000	16:00	0.090	0.258
488	<input type="checkbox"/>	P-388	0.219	29:00	0.002	16:00	0.083	0.217
489	<input type="checkbox"/>	P-389	0.427	29:00	0.017	16:00	0.170	0.410
490	<input type="checkbox"/>	P-391	0.437	29:00	0.003	16:00	0.154	0.434
491	<input type="checkbox"/>	P-394	0.007	33:00	0.000	66:00	0.003	0.007
492	<input type="checkbox"/>	P-395	0.939	29:00	0.008	16:00	0.331	0.931
493	<input type="checkbox"/>	P-396	0.498	29:00	0.003	16:00	0.175	0.494
494	<input type="checkbox"/>	P-397	1.099	29:00	0.018	16:00	0.395	1.081
495	<input type="checkbox"/>	P-398	2.501	29:00	0.004	16:00	0.886	2.497
496	<input type="checkbox"/>	P-399	2.361	29:00	0.021	16:00	0.850	2.340
497	<input type="checkbox"/>	P-400	3.454	29:00	0.027	16:00	1.218	3.427
498	<input type="checkbox"/>	P-402	0.929	29:00	0.019	16:00	0.401	0.910
499	<input type="checkbox"/>	P-403	0.108	29:00	0.000	16:00	0.035	0.108
500	<input type="checkbox"/>	P-404	0.268	69:00	0.000	64:00	0.077	0.268
501	<input type="checkbox"/>	P-406	0.879	29:00	0.022	16:00	0.322	0.858
502	<input type="checkbox"/>	P-408	1.237	29:00	0.003	16:00	0.420	1.234
503	<input type="checkbox"/>	P-409	0.124	29:00	0.000	64:00	0.039	0.124
504	<input type="checkbox"/>	P-415	0.139	29:00	0.001	16:00	0.051	0.138
505	<input type="checkbox"/>	P-425	0.000	00:00	0.000	00:00	0.000	0.000
506	<input type="checkbox"/>	P-426	0.005	29:00	0.000	16:00	0.002	0.005
507	<input type="checkbox"/>	P-435	3.640	30:00	0.068	16:00	1.386	3.571
508	<input type="checkbox"/>	P-437	2.273	29:00	0.108	66:00	1.003	2.164
509	<input type="checkbox"/>	P-447	1.482	29:00	0.093	66:00	0.668	1.389
510	<input type="checkbox"/>	P-482	1.399	16:00	0.070	00:00	1.096	1.329
511	<input type="checkbox"/>	P-483	0.368	16:00	0.028	00:00	0.270	0.340
512	<input type="checkbox"/>	P-484	0.251	16:00	0.040	30:00	0.146	0.211
513	<input type="checkbox"/>	P-485	0.202	16:00	0.036	00:00	0.120	0.166



Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
514	P-488	0.001	29:00	0.000	16:00	0.000	0.001
515	P-493	0.270	00:00	0.000	50:00	0.029	0.270
516	P-494	1.170	29:00	0.042	16:00	0.499	1.128
517	P-497	0.273	69:00	0.000	39:00	0.078	0.273
518	P-503	2.683	29:00	0.363	16:00	1.392	2.320
519	P-505	2.944	29:00	0.412	16:00	1.548	2.532
520	P-506	1.495	29:00	0.169	16:00	0.759	1.326
521	P-507	0.000	06:00	0.000	00:00	0.000	0.000
522	P-508	0.063	29:00	0.000	16:00	0.023	0.063
523	P-513	0.011	29:00	0.000	00:00	0.004	0.011
524	P-514	0.000	00:00	0.000	00:00	0.000	0.000
525	P-522	0.014	66:00	0.000	55:00	0.007	0.014
526	P-523	0.055	29:00	0.004	16:00	0.027	0.051
527	P-524	0.006	69:00	0.000	65:00	0.004	0.006
528	P-526	0.109	29:00	0.008	16:00	0.050	0.100
529	P-528	0.108	29:00	0.000	16:00	0.040	0.108
530	P-563	0.491	29:00	0.000	16:00	0.166	0.491
531	P-564	6.168	33:00	0.015	17:00	2.395	6.153
532	P-565	9.729	33:00	0.073	17:00	4.077	9.656
533	P-566	0.070	29:00	0.000	16:00	0.025	0.070
534	P-584	2.062	33:00	0.005	17:00	0.771	2.056
535	P-585	4.187	33:00	0.000	17:00	1.644	4.186
536	P-599	0.264	00:00	0.000	09:00	0.044	0.264
537	P-600	0.074	00:00	0.000	35:00	0.015	0.074
538	P-601	0.403	00:00	0.000	34:00	0.044	0.403
539	P-602	0.028	33:00	0.000	06:00	0.003	0.028
540	P-1512A	0.033	69:00	0.000	63:00	0.007	0.033
541	P-612	0.055	69:00	0.000	39:00	0.014	0.055
542	P-613	0.082	69:00	0.000	39:00	0.023	0.082
543	P-614	1.309	33:00	0.000	05:00	0.157	1.309
544	P-615	1.680	33:00	0.000	59:00	0.205	1.680
545	P-617	0.386	29:00	0.000	16:00	0.131	0.386
546	P-622	1.339	33:00	0.001	62:00	0.258	1.339
547	P-654	2.497	33:00	0.021	00:00	1.070	2.476
548	P-661	0.413	33:00	0.000	05:00	0.058	0.413
549	P-662	0.167	33:00	0.000	52:00	0.024	0.166
550	P-663	0.086	33:00	0.000	06:00	0.014	0.086
551	P-749	0.057	29:00	0.003	16:00	0.026	0.054
552	P-750	0.426	29:00	0.025	16:00	0.195	0.401
553	P-751	1.321	29:00	0.083	16:00	0.618	1.238
554	P-752	0.932	29:00	0.043	16:00	0.414	0.889
555	P-753	10.404	29:00	0.595	16:00	4.704	9.809
556	P-755	0.020	29:00	0.001	16:00	0.009	0.019
557	P-756	0.033	29:00	0.002	16:00	0.015	0.031
558	P-764	1.608	30:00	0.046	66:00	0.708	1.562
559	P-765	2.821	33:00	0.011	17:00	1.274	2.810
560	P-766	1.741	33:00	0.000	17:00	0.719	1.741
561	P-767	4.800	33:00	0.017	66:00	1.709	4.783
562	P-768	1.942	31:00	0.000	17:00	0.860	1.941
563	P-774	0.000	33:00	0.000	01:00	0.000	0.000
564	P-782	0.917	29:00	0.009	16:00	0.329	0.908
565	P-783	0.705	29:00	0.010	16:00	0.253	0.696
566	P-784	0.003	33:00	0.000	01:00	0.000	0.003
567	P-785	0.532	29:00	0.000	16:00	0.190	0.532
568	P-801	4.339	33:00	0.002	61:00	0.732	4.338
569	P-802	1.111	29:00	0.006	16:00	0.398	1.105
570	P-803	1.153	29:00	0.006	16:00	0.412	1.147

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
571	<input type="checkbox"/>	P-808	1.246	29:00	0.018	16:00	0.453	1.228
572	<input type="checkbox"/>	P-809	0.225	29:00	0.008	16:00	0.084	0.217
573	<input type="checkbox"/>	P-812	0.118	29:00	0.005	16:00	0.048	0.113
574	<input type="checkbox"/>	P-813	0.000	00:00	0.000	00:00	0.000	0.000
575	<input type="checkbox"/>	P-814	2.858	29:00	0.076	16:00	1.062	2.782
576	<input type="checkbox"/>	P-815	1.304	29:00	0.000	16:00	0.469	1.304
577	<input type="checkbox"/>	P-816	0.769	29:00	0.005	16:00	0.286	0.763
578	<input type="checkbox"/>	P-818	0.005	30:00	0.000	15:00	0.001	0.005
579	<input type="checkbox"/>	P-821	0.573	29:00	0.002	16:00	0.210	0.571
580	<input type="checkbox"/>	P-827	0.630	29:00	0.001	16:00	0.226	0.630
581	<input type="checkbox"/>	P-830	4.375	33:00	0.000	37:00	0.614	4.375
582	<input type="checkbox"/>	P-832	0.547	33:00	0.000	01:00	0.156	0.547
583	<input type="checkbox"/>	P-833	4.088	33:00	0.042	17:00	1.724	4.046
584	<input type="checkbox"/>	P-834	1.105	33:00	0.001	67:00	0.264	1.104
585	<input type="checkbox"/>	P-835	3.499	33:00	0.029	17:00	1.551	3.471
586	<input type="checkbox"/>	P-838	1.110	30:00	0.025	16:00	0.386	1.085
587	<input type="checkbox"/>	P-840	0.687	30:00	0.011	16:00	0.225	0.675
588	<input type="checkbox"/>	P-849	0.046	69:00	0.000	14:00	0.009	0.046
589	<input type="checkbox"/>	P-850	0.120	69:00	0.000	65:00	0.030	0.120
590	<input type="checkbox"/>	P-854	2.866	29:00	0.029	16:00	1.052	2.837
591	<input type="checkbox"/>	P-855	1.271	30:00	0.031	16:00	0.497	1.241
592	<input type="checkbox"/>	P-862	37.191	16:00	9.792	30:00	25.976	27.399
593	<input type="checkbox"/>	P-864	0.112	29:00	0.021	16:00	0.054	0.091
594	<input type="checkbox"/>	P-865	1.096	29:00	0.122	16:00	0.560	0.974
595	<input type="checkbox"/>	P-866	2.153	30:00	0.001	43:00	0.468	2.152
596	<input type="checkbox"/>	P-868	12.522	29:00	0.583	16:00	5.476	11.940
597	<input type="checkbox"/>	P-869	13.301	29:00	0.584	16:00	5.753	12.717
598	<input type="checkbox"/>	P-870	12.107	29:00	0.904	16:00	5.578	11.203
599	<input type="checkbox"/>	P-871	10.432	29:00	0.904	16:00	4.939	9.528
600	<input type="checkbox"/>	P-872	0.679	69:00	0.001	57:00	0.204	0.678
601	<input type="checkbox"/>	P-873	10.928	29:00	0.630	16:00	4.949	10.298
602	<input type="checkbox"/>	P-874	3.076	29:00	0.507	16:00	1.681	2.570
603	<input type="checkbox"/>	P-875	1.038	29:00	0.829	16:00	0.928	0.210
604	<input type="checkbox"/>	P-876	0.589	33:00	0.423	69:00	0.501	0.166
605	<input type="checkbox"/>	P-879	0.276	00:00	0.058	33:00	0.152	0.218
606	<input type="checkbox"/>	P-880	0.884	29:00	0.051	16:00	0.391	0.833
607	<input type="checkbox"/>	P-885	2.268	33:00	0.000	00:00	0.922	2.268
608	<input type="checkbox"/>	P-886	0.298	29:00	0.002	16:00	0.107	0.296
609	<input type="checkbox"/>	P-887	0.175	29:00	0.001	16:00	0.063	0.174
610	<input type="checkbox"/>	P-888	0.473	29:00	0.003	16:00	0.170	0.470
611	<input type="checkbox"/>	P-913	0.416	00:00	0.000	32:00	0.037	0.416
612	<input type="checkbox"/>	P-916	1.507	33:00	0.023	17:00	0.475	1.484
613	<input type="checkbox"/>	P-917	0.310	00:00	0.009	66:00	0.081	0.301
614	<input type="checkbox"/>	P-919	1.734	33:00	0.000	66:00	0.326	1.734
615	<input type="checkbox"/>	P-920	1.396	33:00	0.029	00:00	0.557	1.367
616	<input type="checkbox"/>	P-921	1.475	33:00	0.047	66:00	0.626	1.428
617	<input type="checkbox"/>	P-923	0.535	53:00	0.009	16:00	0.218	0.526
618	<input type="checkbox"/>	P-924	1.662	30:00	0.087	00:00	0.791	1.575
619	<input type="checkbox"/>	P-927	3.407	33:00	0.063	00:00	1.544	3.345
620	<input type="checkbox"/>	P-928	0.714	30:00	0.035	16:00	0.290	0.679
621	<input type="checkbox"/>	P-929	0.474	29:00	0.000	64:00	0.147	0.474
622	<input type="checkbox"/>	P-930	1.489	00:00	0.000	28:00	0.158	1.489
623	<input type="checkbox"/>	P-931	0.599	33:00	0.024	66:00	0.210	0.575
624	<input type="checkbox"/>	P-932	0.447	33:00	0.002	21:00	0.091	0.445
625	<input type="checkbox"/>	P-933	0.696	30:00	0.040	00:00	0.288	0.656
626	<input type="checkbox"/>	P-937	1.066	29:00	0.010	16:00	0.348	1.056
627	<input type="checkbox"/>	P-935	0.689	69:00	0.000	09:00	0.125	0.689

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
628	<input type="checkbox"/>	P-936	1.309	33:00	0.000	67:00	0.254	1.309
629	<input type="checkbox"/>	P-938	1.494	33:00	0.023	00:00	0.694	1.471
630	<input type="checkbox"/>	P-940	0.233	33:00	0.000	01:00	0.062	0.232
631	<input type="checkbox"/>	P-941	0.890	30:00	0.003	00:00	0.362	0.887
632	<input type="checkbox"/>	P-944	0.266	29:00	0.000	00:00	0.104	0.265
633	<input type="checkbox"/>	P-945	1.486	29:00	0.046	16:00	0.561	1.439
634	<input type="checkbox"/>	P-949	1.614	29:00	0.029	16:00	0.593	1.585
635	<input type="checkbox"/>	P-953	0.012	33:00	0.000	00:00	0.003	0.012
636	<input type="checkbox"/>	P-956	0.050	29:00	0.000	16:00	0.017	0.050
637	<input type="checkbox"/>	P-959	0.061	29:00	0.000	16:00	0.021	0.060
638	<input type="checkbox"/>	P-993	0.090	00:00	0.000	32:00	0.011	0.090
639	<input type="checkbox"/>	P-994	0.263	30:00	0.001	16:00	0.098	0.262
640	<input type="checkbox"/>	P-995	0.242	33:00	0.002	17:00	0.064	0.241
641	<input type="checkbox"/>	P-996	0.391	29:00	0.001	16:00	0.132	0.389
642	<input type="checkbox"/>	P-997	1.346	29:00	0.013	16:00	0.519	1.334
643	<input type="checkbox"/>	P-998	0.470	30:00	0.024	00:00	0.214	0.446
644	<input type="checkbox"/>	P-1002	0.102	69:00	0.002	16:00	0.032	0.100
645	<input type="checkbox"/>	P-823	2.495	00:00	0.000	38:00	0.169	2.494
646	<input type="checkbox"/>	P-824	2.344	29:00	0.001	16:00	0.875	2.343
647	<input type="checkbox"/>	P-595	0.691	00:00	0.000	30:00	0.052	0.691
648	<input type="checkbox"/>	P-1003	0.631	30:00	0.013	16:00	0.232	0.618
649	<input type="checkbox"/>	P-1006	0.000	00:00	0.000	00:00	0.000	0.000
650	<input type="checkbox"/>	P-1007	0.040	30:00	0.002	16:00	0.015	0.038
651	<input type="checkbox"/>	P-1010A	0.006	30:00	0.000	33:00	0.001	0.006
652	<input type="checkbox"/>	P-1011	0.078	30:00	0.000	18:00	0.017	0.077
653	<input type="checkbox"/>	P-1012	0.000	00:00	0.000	00:00	0.000	0.000
654	<input type="checkbox"/>	P-1019	0.335	33:00	0.000	20:00	0.042	0.335
655	<input type="checkbox"/>	P-1020	0.477	33:00	0.000	67:00	0.083	0.477
656	<input type="checkbox"/>	P-1021	0.809	33:00	0.025	66:00	0.322	0.784
657	<input type="checkbox"/>	P-1024	1.052	29:00	0.101	16:00	0.540	0.951
658	<input type="checkbox"/>	P-1028	0.000	00:00	0.000	00:00	0.000	0.000
659	<input type="checkbox"/>	P-1032	0.696	30:00	0.003	16:00	0.209	0.693
660	<input type="checkbox"/>	P-1033	13.697	29:00	1.018	16:00	6.305	12.679
661	<input type="checkbox"/>	P-1034	9.461	29:00	0.937	16:00	4.599	8.523
662	<input type="checkbox"/>	P-1047	0.227	29:00	0.001	16:00	0.080	0.226
663	<input type="checkbox"/>	P-1048	1.401	29:00	0.044	16:00	0.571	1.357
664	<input type="checkbox"/>	P-1049	0.601	29:00	0.019	16:00	0.248	0.582
665	<input type="checkbox"/>	P-1050	0.862	29:00	0.010	65:00	0.297	0.852
666	<input type="checkbox"/>	P-1051	0.102	29:00	0.000	16:00	0.039	0.102
667	<input type="checkbox"/>	P-1053	0.598	69:00	0.000	09:00	0.103	0.598
668	<input type="checkbox"/>	P-1054	0.500	33:00	0.000	67:00	0.107	0.500
669	<input type="checkbox"/>	P-1055	1.934	33:00	0.003	00:00	0.899	1.931
670	<input type="checkbox"/>	P-1056	1.447	30:00	0.079	66:00	0.627	1.368
671	<input type="checkbox"/>	P-1060	0.008	29:00	0.000	11:00	0.002	0.008
672	<input type="checkbox"/>	P-434	1.258	69:00	0.001	16:00	0.376	1.257
673	<input type="checkbox"/>	P-881	1.596	30:00	0.050	66:00	0.685	1.547
674	<input type="checkbox"/>	P-882	1.059	33:00	0.002	17:00	0.402	1.057
675	<input type="checkbox"/>	P-1085	0.050	30:00	0.000	00:00	0.022	0.050
676	<input type="checkbox"/>	P-1086	0.028	45:00	0.000	00:00	0.015	0.028
677	<input type="checkbox"/>	P-1087	0.014	45:00	0.000	00:00	0.006	0.014
678	<input type="checkbox"/>	P-1089	0.009	37:00	0.000	00:00	0.004	0.009
679	<input type="checkbox"/>	P-1090	0.016	69:00	0.000	00:00	0.010	0.016
680	<input type="checkbox"/>	P-1091	0.058	30:00	0.000	00:00	0.027	0.058
681	<input type="checkbox"/>	P-1092	0.000	00:00	0.000	00:00	0.000	0.000
682	<input type="checkbox"/>	P-1093	0.294	30:00	0.000	00:00	0.052	0.294
683	<input type="checkbox"/>	P-1094	0.422	69:00	0.000	00:00	0.399	0.422
684	<input type="checkbox"/>	P-1095	0.422	69:00	0.000	00:00	0.388	0.422

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
685	<input type="checkbox"/>	P-1096	0.424	69:00	0.000	00:00	0.350	0.424
686	<input type="checkbox"/>	P-1097	0.424	69:00	0.000	00:00	0.287	0.424
687	<input type="checkbox"/>	P-1098	0.326	45:00	0.000	00:00	0.137	0.326
688	<input type="checkbox"/>	P-1099	0.000	00:00	0.000	00:00	0.000	0.000
689	<input type="checkbox"/>	P-1120	0.050	30:00	0.000	00:00	0.022	0.050
690	<input type="checkbox"/>	P-1121	0.029	45:00	0.000	00:00	0.015	0.029
691	<input type="checkbox"/>	P-1122	0.014	28:00	0.000	13:00	0.006	0.014
692	<input type="checkbox"/>	P-1124	0.008	37:00	0.000	03:00	0.003	0.008
693	<input type="checkbox"/>	P-1125	0.016	69:00	0.000	00:00	0.010	0.016
694	<input type="checkbox"/>	P-1126	0.058	30:00	0.000	00:00	0.026	0.058
695	<input type="checkbox"/>	P-1139	0.021	69:00	0.005	16:00	0.013	0.016
696	<input type="checkbox"/>	P-1146	0.000	00:00	0.000	00:00	0.000	0.000
697	<input type="checkbox"/>	P-1152	6.683	69:00	0.076	57:00	2.371	6.607
698	<input type="checkbox"/>	P-1157	18.871	29:00	2.098	16:00	9.485	16.773
699	<input type="checkbox"/>	P-1158	7.522	29:00	0.754	16:00	3.698	6.768
700	<input type="checkbox"/>	P-1165	2.609	29:00	0.001	16:00	0.881	2.608
701	<input type="checkbox"/>	P-1166	0.128	69:00	0.000	63:00	0.035	0.128
702	<input type="checkbox"/>	P-1168	1.369	69:00	0.000	01:00	0.416	1.369
703	<input type="checkbox"/>	P-1169	0.387	33:00	0.000	08:00	0.022	0.387
704	<input type="checkbox"/>	P-1170	0.995	33:00	0.003	56:00	0.143	0.993
705	<input type="checkbox"/>	P-1190	0.779	33:00	0.000	42:00	0.201	0.779
706	<input type="checkbox"/>	P-1191	1.345	33:00	0.000	20:00	0.185	1.345
707	<input type="checkbox"/>	P-1198	1.237	30:00	0.508	16:00	0.919	0.729
708	<input type="checkbox"/>	P-1199	0.723	45:00	0.540	11:00	0.635	0.183
709	<input type="checkbox"/>	P-1200	0.202	45:00	0.151	11:00	0.178	0.051
710	<input type="checkbox"/>	P-1204	0.000	00:00	0.000	00:00	0.000	0.000
711	<input type="checkbox"/>	P-1205	0.065	30:00	0.000	12:00	0.038	0.065
712	<input type="checkbox"/>	P-1206	0.195	30:00	0.047	16:00	0.132	0.149
713	<input type="checkbox"/>	P-1216	0.426	29:00	0.001	16:00	0.149	0.425
714	<input type="checkbox"/>	P-1217	0.292	29:00	0.002	16:00	0.106	0.290
715	<input type="checkbox"/>	P-1218	0.331	29:00	0.001	16:00	0.118	0.330
716	<input type="checkbox"/>	P-1219	0.511	29:00	0.001	16:00	0.183	0.509
717	<input type="checkbox"/>	P-1220	0.381	29:00	0.001	16:00	0.136	0.380
718	<input type="checkbox"/>	P-1221	1.218	29:00	0.000	16:00	0.421	1.217
719	<input type="checkbox"/>	P-1222	0.617	69:00	0.000	64:00	0.185	0.617
720	<input type="checkbox"/>	P-1223	0.301	69:00	0.000	11:00	0.076	0.301
721	<input type="checkbox"/>	P-1224	0.373	69:00	0.000	35:00	0.089	0.373
722	<input type="checkbox"/>	P-1225	0.704	69:00	0.000	35:00	0.164	0.704
723	<input type="checkbox"/>	P-1226	0.165	69:00	0.000	65:00	0.037	0.165
724	<input type="checkbox"/>	P-1227	0.232	69:00	0.000	65:00	0.050	0.232
725	<input type="checkbox"/>	P-1228	0.541	69:00	0.000	65:00	0.114	0.540
726	<input type="checkbox"/>	P-1229	0.121	33:00	0.000	44:00	0.020	0.121
727	<input type="checkbox"/>	P-1230	0.062	33:00	0.000	36:00	0.011	0.062
728	<input type="checkbox"/>	P-1231	0.038	33:00	0.000	36:00	0.007	0.038
729	<input type="checkbox"/>	P-1232	0.391	33:00	0.000	37:00	0.078	0.391
730	<input type="checkbox"/>	P-1238	1.160	33:00	0.000	00:00	0.490	1.159
731	<input type="checkbox"/>	P-1240	1.267	29:00	0.022	16:00	0.478	1.245
732	<input type="checkbox"/>	P-1241	0.766	33:00	0.000	36:00	0.140	0.766
733	<input type="checkbox"/>	P-1242	1.021	29:00	0.000	64:00	0.321	1.021
734	<input type="checkbox"/>	P-1243	0.330	33:00	0.000	01:00	0.036	0.330
735	<input type="checkbox"/>	P-1244	0.261	29:00	0.012	65:00	0.101	0.248
736	<input type="checkbox"/>	P-1246	0.917	33:00	0.000	40:00	0.119	0.916
737	<input type="checkbox"/>	P-1247	0.652	69:00	0.000	08:00	0.146	0.652
738	<input type="checkbox"/>	P-1255	0.047	29:00	0.000	16:00	0.016	0.047
739	<input type="checkbox"/>	P-1256	0.116	29:00	0.000	16:00	0.039	0.116
740	<input type="checkbox"/>	P-1260	0.053	29:00	0.000	16:00	0.018	0.053
741	<input type="checkbox"/>	P-1261	0.041	29:00	0.001	16:00	0.016	0.041

Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
742	P-1262	0.052	29:00	0.000	16:00	0.017	0.052
743	P-1263	0.075	29:00	0.000	16:00	0.025	0.075
744	P-1264	0.001	29:00	0.000	16:00	0.000	0.001
745	P-1265	0.182	33:00	0.000	42:00	0.018	0.182
746	P-1266	0.258	33:00	0.001	00:00	0.055	0.257
747	P-1267	0.860	33:00	0.001	67:00	0.150	0.859
748	P-1269	0.809	29:00	0.046	40:00	0.336	0.763
749	P-1285	0.286	16:00	0.013	00:00	0.234	0.273
750	P-1288	0.399	33:00	0.000	20:00	0.074	0.399
751	P-1291	0.057	35:00	0.000	04:00	0.011	0.057
752	P-1302	0.000	00:00	0.000	00:00	0.000	0.000
753	P-1304	0.192	29:00	0.007	16:00	0.075	0.185
754	P-1305	0.095	29:00	0.005	16:00	0.038	0.090
755	P-1306	0.110	30:00	0.000	71:00	0.020	0.110
756	P-1311	0.702	30:00	0.006	16:00	0.261	0.696
757	P-1315	0.943	33:00	0.016	17:00	0.369	0.927
758	P-1316	1.688	07:00	0.005	00:00	0.721	1.683
759	P-1320	5.848	30:00	0.314	66:00	2.619	5.534
760	P-1321	1.639	30:00	0.068	16:00	0.695	1.571
761	P-922	4.471	33:00	0.107	00:00	2.051	4.364
762	P-1328	0.111	29:00	0.000	16:00	0.039	0.111
763	P-1334	2.615	00:00	0.000	19:00	0.180	2.615
764	P-1335	0.093	00:00	0.002	16:00	0.035	0.092
765	P-1347	0.205	29:00	0.001	16:00	0.069	0.204
766	P-1350	0.146	29:00	0.001	16:00	0.049	0.145
767	P-1353	1.931	29:00	0.012	16:00	0.668	1.919
768	P-1358	0.160	66:00	0.011	30:00	0.098	0.148
769	P-1359	0.341	69:00	0.100	16:00	0.236	0.240
770	P-1360	0.105	00:00	0.048	16:00	0.087	0.057
771	P-1361	0.445	29:00	0.008	16:00	0.177	0.437
772	P-1363	0.783	29:00	0.069	16:00	0.375	0.714
773	P-1364	0.523	69:00	0.042	33:00	0.271	0.482
774	P-1365	1.128	29:00	0.239	16:00	0.654	0.889
775	P-1367	0.412	29:00	0.000	66:00	0.134	0.411
776	P-1366	5.227	33:00	0.023	66:00	1.807	5.203
777	P-1368	4.380	33:00	0.021	66:00	1.528	4.358
778	P-1369	0.659	29:00	0.029	16:00	0.287	0.630
779	P-1370	1.051	00:00	0.000	30:00	0.080	1.051
780	P-1371	0.226	00:00	0.000	41:00	0.021	0.226
781	P-1372	0.591	29:00	0.004	16:00	0.202	0.587
782	P-1386	1.348	33:00	0.001	67:00	0.444	1.347
783	P-1387	4.990	29:00	0.013	16:00	1.765	4.977
784	P-1390	0.061	33:00	0.000	42:00	0.013	0.061
785	P-1392	0.388	00:00	0.000	09:00	0.065	0.388
786	P-1393	0.376	00:00	0.000	65:00	0.083	0.376
787	P-1394	1.785	29:00	0.015	16:00	0.641	1.770
788	P-1399	0.227	29:00	0.001	16:00	0.081	0.225
789	P-1414	0.021	69:00	0.000	00:00	0.019	0.020
790	P-1422	2.741	33:00	0.004	61:00	0.425	2.737
791	P-1423	1.421	33:00	0.000	42:00	0.355	1.420
792	P-1424	0.496	33:00	0.000	37:00	0.100	0.496
793	P-1425	1.007	33:00	0.000	21:00	0.279	1.007
794	P-1430	4.942	30:00	0.232	16:00	2.108	4.711
795	P-1437	0.051	29:00	0.004	16:00	0.023	0.047
796	P-1438	0.113	16:00	0.000	28:00	0.035	0.113
797	P-1439	1.591	29:00	0.022	16:00	0.627	1.569
798	P-1442	0.109	00:00	0.030	33:00	0.066	0.078

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
799	<input type="checkbox"/>	P-1443	0.529	69:00	0.112	16:00	0.330	0.417
800	<input type="checkbox"/>	P-1445	0.297	66:00	0.009	30:00	0.131	0.287
801	<input type="checkbox"/>	P-1455	1.365	47:00	0.379	16:00	1.042	0.986
802	<input type="checkbox"/>	P-1456	0.106	29:00	0.006	16:00	0.049	0.100
803	<input type="checkbox"/>	P-1457	1.567	30:00	0.006	16:00	0.532	1.561
804	<input type="checkbox"/>	P-1458	6.994	29:00	0.213	16:00	2.800	6.781
805	<input type="checkbox"/>	P-1459	2.813	33:00	0.075	66:00	1.049	2.738
806	<input type="checkbox"/>	P-1460	0.472	33:00	0.000	20:00	0.066	0.472
807	<input type="checkbox"/>	P-1461	2.348	30:00	0.066	16:00	0.922	2.283
808	<input type="checkbox"/>	P-1467	0.280	33:00	0.000	13:00	0.061	0.280
809	<input type="checkbox"/>	P-1468	0.477	33:00	0.000	13:00	0.106	0.477
810	<input type="checkbox"/>	P-1472	1.503	07:00	0.072	66:00	0.662	1.431
811	<input type="checkbox"/>	P-1473	1.476	33:00	0.003	00:00	0.510	1.473
812	<input type="checkbox"/>	P-1474	0.141	33:00	0.000	55:00	0.014	0.141
813	<input type="checkbox"/>	P-1475	0.049	33:00	0.000	27:00	0.005	0.049
814	<input type="checkbox"/>	P-1476	0.674	33:00	0.000	10:00	0.066	0.674
815	<input type="checkbox"/>	P-1477	1.823	33:00	0.001	47:00	0.298	1.822
816	<input type="checkbox"/>	P-1478	0.180	33:00	0.000	05:00	0.018	0.180
817	<input type="checkbox"/>	P-1479	0.584	33:00	0.000	41:00	0.083	0.583
818	<input type="checkbox"/>	P-1481	0.597	33:00	0.000	36:00	0.084	0.597
819	<input type="checkbox"/>	P-1482	1.333	29:00	0.037	16:00	0.510	1.296
820	<input type="checkbox"/>	P-1483	1.227	29:00	0.023	16:00	0.445	1.204
821	<input type="checkbox"/>	P-1484	0.305	33:00	0.000	66:00	0.108	0.305
822	<input type="checkbox"/>	P-1485	0.256	33:00	0.000	42:00	0.090	0.256
823	<input type="checkbox"/>	P-1486	1.641	33:00	0.007	17:00	0.564	1.633
824	<input type="checkbox"/>	P-1487	0.227	33:00	0.001	17:00	0.077	0.226
825	<input type="checkbox"/>	P-1489	0.708	33:00	0.000	66:00	0.249	0.708
826	<input type="checkbox"/>	P-1490	1.345	33:00	0.000	66:00	0.489	1.345
827	<input type="checkbox"/>	P-1492	0.770	30:00	0.045	66:00	0.339	0.725
828	<input type="checkbox"/>	P-1493	0.711	30:00	0.042	16:00	0.310	0.669
829	<input type="checkbox"/>	P-1494	1.609	30:00	0.007	16:00	0.553	1.602
830	<input type="checkbox"/>	P-1497	1.874	16:00	0.081	00:00	1.514	1.794
831	<input type="checkbox"/>	P-1499	0.117	33:00	0.000	38:00	0.014	0.117
832	<input type="checkbox"/>	P-1514	2.613	29:00	0.003	16:00	0.887	2.609
833	<input type="checkbox"/>	P-1515	3.261	29:00	0.006	16:00	1.104	3.255
834	<input type="checkbox"/>	P-6	0.000	00:00	0.000	00:00	0.000	0.000
835	<input type="checkbox"/>	P-9	2.912	04:00	2.450	59:00	2.659	0.461
836	<input type="checkbox"/>	P-10	2.912	04:00	2.451	59:00	2.659	0.461
837	<input type="checkbox"/>	P-11	0.000	00:00	0.000	00:00	0.000	0.000
838	<input type="checkbox"/>	P-12	0.017	04:00	0.014	36:00	0.015	0.002
839	<input type="checkbox"/>	P-13	0.005	04:00	0.004	50:00	0.004	0.001
840	<input type="checkbox"/>	P-14	0.000	00:00	0.000	00:00	0.000	0.000
841	<input type="checkbox"/>	P-16	0.044	00:00	0.009	68:00	0.026	0.035
842	<input type="checkbox"/>	P-33	0.000	00:00	0.000	00:00	0.000	0.000
843	<input type="checkbox"/>	P-34	0.005	04:00	0.004	36:00	0.004	0.001
844	<input type="checkbox"/>	P-41	0.001	29:00	0.000	16:00	0.000	0.001
845	<input type="checkbox"/>	P-63	0.120	04:00	0.101	59:00	0.110	0.019
846	<input type="checkbox"/>	P-68	0.030	30:00	0.006	65:00	0.017	0.024
847	<input type="checkbox"/>	P-69	0.037	30:00	0.007	65:00	0.021	0.030
848	<input type="checkbox"/>	P-72	0.065	30:00	0.012	65:00	0.036	0.052
849	<input type="checkbox"/>	P-78	0.001	00:00	0.000	03:00	0.000	0.001
850	<input type="checkbox"/>	P-85	0.004	00:00	0.000	03:00	0.002	0.004
851	<input type="checkbox"/>	P-86	0.005	00:00	0.000	03:00	0.002	0.005
852	<input type="checkbox"/>	P-76	0.000	00:00	0.000	00:00	0.000	0.000
853	<input type="checkbox"/>	P-91	0.000	00:00	0.000	00:00	0.000	0.000
854	<input type="checkbox"/>	P-110	0.068	29:00	0.000	65:00	0.022	0.068
855	<input type="checkbox"/>	P-114	0.053	29:00	0.000	16:00	0.018	0.053

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
856	<input type="checkbox"/>	P-137	0.015	04:00	0.013	36:00	0.014	0.002
857	<input type="checkbox"/>	P-144	0.000	00:00	0.000	00:00	0.000	0.000
858	<input type="checkbox"/>	P-148	0.256	30:00	0.105	16:00	0.190	0.151
859	<input type="checkbox"/>	P-149	0.738	30:00	0.303	16:00	0.548	0.435
860	<input type="checkbox"/>	P-154	0.274	45:00	0.205	11:00	0.241	0.069
861	<input type="checkbox"/>	P-156	0.274	45:00	0.206	11:00	0.241	0.069
862	<input type="checkbox"/>	P-108	0.008	42:00	0.000	00:00	0.003	0.008
863	<input type="checkbox"/>	P-112	0.008	42:00	0.000	01:00	0.003	0.008
864	<input type="checkbox"/>	P-159	0.054	30:00	0.000	00:00	0.024	0.054
865	<input type="checkbox"/>	P-160	0.045	30:00	0.000	00:00	0.020	0.045
866	<input type="checkbox"/>	P-164	0.262	30:00	0.006	66:00	0.106	0.256
867	<input type="checkbox"/>	P-165	0.214	31:00	0.004	17:00	0.097	0.210
868	<input type="checkbox"/>	P-167	0.110	30:00	0.000	00:00	0.050	0.110
869	<input type="checkbox"/>	P-168	0.110	30:00	0.000	00:00	0.048	0.110
870	<input type="checkbox"/>	P-171	0.231	30:00	0.003	00:00	0.098	0.228
871	<input type="checkbox"/>	P-172	0.000	00:00	0.000	00:00	0.000	0.000
872	<input type="checkbox"/>	P-173	0.244	30:00	0.003	00:00	0.104	0.241
873	<input type="checkbox"/>	P-177	0.034	00:00	0.000	01:00	0.005	0.034
874	<input type="checkbox"/>	P-185	0.634	30:00	0.012	16:00	0.214	0.622
875	<input type="checkbox"/>	P-190	5.144	29:00	0.636	16:00	2.584	4.509
876	<input type="checkbox"/>	P-198	0.322	30:00	0.007	00:00	0.148	0.315
877	<input type="checkbox"/>	P-207	0.499	33:00	0.000	66:00	0.158	0.498
878	<input type="checkbox"/>	P-220	1.075	33:00	0.002	17:00	0.448	1.073
879	<input type="checkbox"/>	P-233	0.548	29:00	0.003	16:00	0.191	0.545
880	<input type="checkbox"/>	P-243	0.102	29:00	0.001	16:00	0.035	0.102
881	<input type="checkbox"/>	P-287	0.000	00:00	0.000	00:00	0.000	0.000
882	<input type="checkbox"/>	P-288	0.201	68:00	0.000	00:00	0.184	0.201
883	<input type="checkbox"/>	P-274	0.000	00:00	0.000	00:00	0.000	0.000
884	<input type="checkbox"/>	P-279	0.000	00:00	0.000	00:00	0.000	0.000
885	<input type="checkbox"/>	P-285	0.000	00:00	0.000	00:00	0.000	0.000
886	<input type="checkbox"/>	P-290	0.000	00:00	0.000	00:00	0.000	0.000
887	<input type="checkbox"/>	P-291	0.000	00:00	0.000	00:00	0.000	0.000
888	<input type="checkbox"/>	P-308	0.001	68:00	0.000	00:00	0.001	0.001
889	<input type="checkbox"/>	P-310	0.000	00:00	0.000	00:00	0.000	0.000
890	<input type="checkbox"/>	P-307	0.001	68:00	0.000	00:00	0.001	0.001
891	<input type="checkbox"/>	P-311	0.001	01:00	0.000	00:00	0.001	0.001
892	<input type="checkbox"/>	P-323	0.066	68:00	0.000	00:00	0.060	0.066
893	<input type="checkbox"/>	P-335	0.003	68:00	0.000	00:00	0.002	0.003
894	<input type="checkbox"/>	P-336	0.296	30:00	0.015	00:00	0.218	0.281
895	<input type="checkbox"/>	P-340	0.102	30:00	0.008	00:00	0.064	0.093
896	<input type="checkbox"/>	P-341	0.435	68:00	0.004	00:00	0.388	0.432
897	<input type="checkbox"/>	P-345	0.174	68:00	0.000	00:00	0.159	0.174
898	<input type="checkbox"/>	P-346	0.504	68:00	0.000	00:00	0.462	0.504
899	<input type="checkbox"/>	P-351	0.150	35:00	0.000	54:00	0.025	0.150
900	<input type="checkbox"/>	P-368	0.000	00:00	0.000	00:00	0.000	0.000
901	<input type="checkbox"/>	P-392	1.206	30:00	0.058	16:00	0.444	1.149
902	<input type="checkbox"/>	P-407	0.569	30:00	0.027	16:00	0.210	0.542
903	<input type="checkbox"/>	P-422_CV	0.000	00:00	0.000	00:00	0.000	0.000
904	<input type="checkbox"/>	P-1501	0.265	30:00	0.005	00:00	0.121	0.261
905	<input type="checkbox"/>	P-163	0.003	33:00	0.000	03:00	0.001	0.003
906	<input type="checkbox"/>	P-162	0.454	30:00	0.001	00:00	0.203	0.453
907	<input type="checkbox"/>	P-1239	2.358	31:00	0.035	00:00	1.078	2.323
908	<input type="checkbox"/>	P-412	0.277	30:00	0.000	12:00	0.162	0.277
909	<input type="checkbox"/>	P-413	0.073	68:00	0.000	00:00	0.067	0.073
910	<input type="checkbox"/>	P-411	0.089	29:00	0.005	16:00	0.039	0.084
911	<input type="checkbox"/>	P-414	7.536	29:00	0.315	16:00	3.157	7.221
912	<input type="checkbox"/>	P-1449	32.008	29:00	2.545	16:00	14.881	29.463

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
913	<input type="checkbox"/>	P-197	0.304	31:00	0.000	00:00	0.138	0.304
914	<input type="checkbox"/>	P-196	1.771	31:00	0.001	00:00	0.802	1.770
915	<input type="checkbox"/>	P-1303	0.036	69:00	0.000	50:00	0.006	0.036
916	<input type="checkbox"/>	P-1300	0.048	69:00	0.000	13:00	0.008	0.048
917	<input type="checkbox"/>	P-438	7.299	29:00	0.680	16:00	3.535	6.619
918	<input type="checkbox"/>	P-453	0.000	00:00	0.000	00:00	0.000	0.000
919	<input type="checkbox"/>	P-18	0.040	15:00	0.026	54:00	0.033	0.014
920	<input type="checkbox"/>	P-67	0.016	30:00	0.003	65:00	0.009	0.013
921	<input type="checkbox"/>	P-436	0.272	30:00	0.004	16:00	0.094	0.268
922	<input type="checkbox"/>	P-781	1.005	33:00	0.000	00:00	0.258	1.005
923	<input type="checkbox"/>	P-456	0.132	30:00	0.003	16:00	0.046	0.129
924	<input type="checkbox"/>	P-1447	2.965	30:00	0.091	66:00	1.118	2.874
925	<input type="checkbox"/>	P-428	3.416	33:00	0.037	17:00	1.575	3.379
926	<input type="checkbox"/>	P-1446	2.447	33:00	0.027	17:00	1.133	2.420
927	<input type="checkbox"/>	P-458	0.393	00:00	0.000	03:00	0.196	0.393
928	<input type="checkbox"/>	P-459	1.107	33:00	0.001	66:00	0.414	1.106
929	<input type="checkbox"/>	P-467	3.106	33:00	0.001	17:00	1.233	3.104
930	<input type="checkbox"/>	P-543	3.087	16:00	0.031	53:00	1.555	3.056
931	<input type="checkbox"/>	P-544	2.206	33:00	1.546	69:00	1.861	0.659
932	<input type="checkbox"/>	P-861	14.937	16:00	5.344	30:00	11.436	9.593
933	<input type="checkbox"/>	P-559	1.649	29:00	0.108	16:00	0.804	1.541
934	<input type="checkbox"/>	P-950	0.152	29:00	0.004	65:00	0.055	0.148
935	<input type="checkbox"/>	P-918	0.220	00:00	0.000	39:00	0.036	0.220
936	<input type="checkbox"/>	P-542	0.964	00:00	0.118	30:00	0.721	0.846
937	<input type="checkbox"/>	P-1035	0.094	53:00	0.000	36:00	0.037	0.094
938	<input type="checkbox"/>	P-883	1.766	33:00	0.000	42:00	0.581	1.766
939	<input type="checkbox"/>	P-1547	1.738	33:00	0.000	01:00	0.189	1.738
940	<input type="checkbox"/>	P-208	4.041	31:00	0.001	00:00	1.825	4.040
941	<input type="checkbox"/>	P-1450	2.831	30:00	0.056	16:00	0.964	2.775
942	<input type="checkbox"/>	P-439	2.972	33:00	0.003	66:00	0.675	2.969
943	<input type="checkbox"/>	P-416	1.790	30:00	0.034	16:00	0.605	1.756
944	<input type="checkbox"/>	P-1145	2.762	16:00	0.629	30:00	1.932	2.134
945	<input type="checkbox"/>	P-192	0.307	33:00	0.000	71:00	0.051	0.307
946	<input type="checkbox"/>	P-780	3.488	69:00	0.001	58:00	0.750	3.488
947	<input type="checkbox"/>	P-410	0.038	29:00	0.002	65:00	0.016	0.036
948	<input type="checkbox"/>	P-1245	1.758	29:00	0.105	65:00	0.751	1.653
949	<input type="checkbox"/>	P-1248	0.162	29:00	0.003	16:00	0.054	0.160
950	<input type="checkbox"/>	P-1249	0.141	33:00	0.000	66:00	0.034	0.141
951	<input type="checkbox"/>	P-474	0.423	29:00	0.002	16:00	0.150	0.421
952	<input type="checkbox"/>	P-480	0.130	29:00	0.000	16:00	0.046	0.130
953	<input type="checkbox"/>	P-481	0.143	29:00	0.000	16:00	0.050	0.143
954	<input type="checkbox"/>	P-1491	0.711	30:00	0.042	16:00	0.310	0.669
955	<input type="checkbox"/>	P-1488	1.731	33:00	0.012	17:00	0.644	1.719
956	<input type="checkbox"/>	P-1062	0.630	29:00	0.000	16:00	0.205	0.630
957	<input type="checkbox"/>	P-1063	0.913	29:00	0.004	16:00	0.323	0.909
958	<input type="checkbox"/>	P-1064	0.173	29:00	0.000	16:00	0.057	0.173
959	<input type="checkbox"/>	P-1495	2.429	33:00	0.002	62:00	0.502	2.427
960	<input type="checkbox"/>	P-1496	2.650	33:00	0.002	67:00	0.835	2.649
961	<input type="checkbox"/>	P-529	1.190	29:00	0.091	16:00	0.605	1.099
962	<input type="checkbox"/>	P-530	0.536	30:00	0.001	16:00	0.177	0.535
963	<input type="checkbox"/>	P-531	0.654	29:00	0.032	16:00	0.288	0.622
964	<input type="checkbox"/>	P-1326	0.000	00:00	0.000	00:00	0.000	0.000
965	<input type="checkbox"/>	P-314	0.225	35:00	0.000	58:00	0.086	0.225
966	<input type="checkbox"/>	P-3002	0.048	10:00	0.000	42:00	0.029	0.048
967	<input type="checkbox"/>	P-3003	0.000	00:00	0.000	00:00	0.000	0.000
968	<input type="checkbox"/>	P-3006	0.883	10:00	0.001	42:00	0.540	0.883
969	<input type="checkbox"/>	P-3009	0.127	10:00	0.000	42:00	0.078	0.127



Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
970	<input type="checkbox"/>	P-191	0.752	30:00	0.001	00:00	0.341	0.752
971	<input type="checkbox"/>	P-498	1.388	16:00	0.242	30:00	0.785	1.146
972	<input type="checkbox"/>	P-496	0.345	00:00	0.000	04:00	0.068	0.345
973	<input type="checkbox"/>	P-259	0.584	29:00	0.004	16:00	0.212	0.580
974	<input type="checkbox"/>	P-254	0.119	29:00	0.001	16:00	0.042	0.118
975	<input type="checkbox"/>	P-272	2.257	29:00	0.009	16:00	0.794	2.248
976	<input type="checkbox"/>	P-266	0.233	29:00	0.001	16:00	0.083	0.232
977	<input type="checkbox"/>	P-246	0.228	29:00	0.001	16:00	0.082	0.227
978	<input type="checkbox"/>	P-271	0.155	29:00	0.000	16:00	0.054	0.154
979	<input type="checkbox"/>	P-605	0.033	30:00	0.006	16:00	0.015	0.027
980	<input type="checkbox"/>	P-1413	1.148	35:00	0.000	21:00	0.229	1.148
981	<input type="checkbox"/>	P-104	1.652	16:00	0.139	00:00	1.254	1.513
982	<input type="checkbox"/>	P-1523	0.493	16:00	0.027	00:00	0.401	0.466
983	<input type="checkbox"/>	P-603	0.016	33:00	0.000	21:00	0.002	0.016
984	<input type="checkbox"/>	P-607	0.000	00:00	0.000	00:00	0.000	0.000
985	<input type="checkbox"/>	P-470	1.169	33:00	0.001	42:00	0.195	1.168
986	<input type="checkbox"/>	P-471	0.000	00:00	0.000	00:00	0.000	0.000
987	<input type="checkbox"/>	P-1540	0.236	33:00	0.000	66:00	0.039	0.236
988	<input type="checkbox"/>	P-430	0.000	00:00	0.000	00:00	0.000	0.000
989	<input type="checkbox"/>	P-942	0.102	30:00	0.002	16:00	0.038	0.100
990	<input type="checkbox"/>	P-1520	0.986	29:00	0.006	16:00	0.345	0.980
991	<input type="checkbox"/>	P-1525	0.496	29:00	0.003	16:00	0.173	0.493
992	<input type="checkbox"/>	P-1533	1.037	29:00	0.006	16:00	0.360	1.030
993	<input type="checkbox"/>	P-1538	0.242	29:00	0.001	16:00	0.084	0.240
994	<input type="checkbox"/>	P-115	0.005	29:00	0.000	16:00	0.002	0.005
995	<input type="checkbox"/>	P-685	0.003	00:00	0.000	16:00	0.001	0.003
996	<input type="checkbox"/>	P-746	1.835	29:00	0.011	16:00	0.634	1.824
997	<input type="checkbox"/>	P-952	0.013	33:00	0.000	39:00	0.002	0.013
998	<input type="checkbox"/>	P-943	1.898	30:00	0.033	16:00	0.702	1.865
999	<input type="checkbox"/>	P-946	2.085	30:00	0.029	16:00	0.765	2.056
1000	<input type="checkbox"/>	P-1351	0.612	69:00	0.002	33:00	0.193	0.610
1001	<input type="checkbox"/>	P-817	0.113	29:00	0.002	33:00	0.047	0.111
1002	<input type="checkbox"/>	P-759	0.220	29:00	0.001	16:00	0.079	0.219
1003	<input type="checkbox"/>	P-1388	0.954	29:00	0.005	16:00	0.335	0.948
1004	<input type="checkbox"/>	P-951	0.008	33:00	0.000	07:00	0.001	0.008
1005	<input type="checkbox"/>	P-795	0.879	29:00	0.020	16:00	0.330	0.859
1006	<input type="checkbox"/>	P-796	0.090	29:00	0.000	16:00	0.033	0.090
1007	<input type="checkbox"/>	P-135	0.286	29:00	0.006	16:00	0.109	0.280
1008	<input type="checkbox"/>	P-140	0.002	33:00	0.000	06:00	0.000	0.002
1009	<input type="checkbox"/>	P-810	0.116	33:00	0.001	17:00	0.024	0.116
1010	<input type="checkbox"/>	P-811	1.948	29:00	0.001	16:00	0.716	1.947
1011	<input type="checkbox"/>	P-616	2.989	33:00	0.000	59:00	0.361	2.989
1012	<input type="checkbox"/>	P-2013	0.333	33:00	0.000	21:00	0.079	0.333
1013	<input type="checkbox"/>	P-2014	0.373	33:00	0.000	44:00	0.049	0.373
1014	<input type="checkbox"/>	P-2024	0.994	30:00	0.408	16:00	0.738	0.586
1015	<input type="checkbox"/>	P-3001	0.188	10:00	0.000	42:00	0.115	0.188
1016	<input type="checkbox"/>	P-309B	0.000	00:00	0.000	00:00	0.000	0.000
1017	<input type="checkbox"/>	P-1318B	0.000	00:00	0.000	00:00	0.000	0.000
1018	<input type="checkbox"/>	P-1014	0.000	00:00	0.000	00:00	0.000	0.000
1019	<input type="checkbox"/>	P-178	0.657	35:00	0.000	27:00	0.131	0.657
1020	<input type="checkbox"/>	P-103	0.002	30:00	0.000	16:00	0.001	0.002
1021	<input type="checkbox"/>	P-863B	0.024	29:00	0.000	09:00	0.007	0.024
1022	<input type="checkbox"/>	P-863A	0.087	29:00	0.000	65:00	0.028	0.087
1023	<input type="checkbox"/>	P-1067	0.008	29:00	0.000	11:00	0.002	0.008
1024	<input type="checkbox"/>	P-1068	0.085	29:00	0.000	64:00	0.026	0.084
1025	<input type="checkbox"/>	P-844A	0.878	29:00	0.057	16:00	0.409	0.821
1026	<input type="checkbox"/>	P-844B	0.301	29:00	0.024	16:00	0.148	0.277

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1027	<input type="checkbox"/>	P-1010B	0.012	66:00	0.003	30:00	0.007	0.009
1028	<input type="checkbox"/>	P-1010C	0.299	29:00	0.044	16:00	0.161	0.255
1029	<input type="checkbox"/>	P-1073	0.080	30:00	0.000	68:00	0.019	0.080
1030	<input type="checkbox"/>	P-1074	0.030	66:00	0.000	55:00	0.013	0.030
1031	<input type="checkbox"/>	P-357	8.807	29:00	0.312	16:00	3.477	8.495
1032	<input type="checkbox"/>	P-188A	0.338	30:00	0.002	16:00	0.096	0.336
1033	<input type="checkbox"/>	P-1079	0.014	33:00	0.000	20:00	0.004	0.014
1034	<input type="checkbox"/>	P-1081	0.021	33:00	0.000	28:00	0.006	0.021
1035	<input type="checkbox"/>	P-504	0.762	29:00	0.107	16:00	0.399	0.654
1036	<input type="checkbox"/>	P-1084	0.000	00:00	0.000	00:00	0.000	0.000
1037	<input type="checkbox"/>	P-1082	0.085	29:00	0.005	16:00	0.039	0.080
1038	<input type="checkbox"/>	P-618A	0.598	29:00	0.001	16:00	0.210	0.597
1039	<input type="checkbox"/>	P-618B	0.565	29:00	0.001	16:00	0.199	0.564
1040	<input type="checkbox"/>	P-1100	1.577	29:00	0.008	16:00	0.565	1.569
1041	<input type="checkbox"/>	P-270A	0.020	33:00	0.000	42:00	0.005	0.020
1042	<input type="checkbox"/>	P-270B	0.133	29:00	0.005	16:00	0.060	0.129
1043	<input type="checkbox"/>	P-418B	0.142	29:00	0.000	16:00	0.050	0.141
1044	<input type="checkbox"/>	P-418A	0.715	29:00	0.004	16:00	0.256	0.711
1045	<input type="checkbox"/>	P-256A	0.137	29:00	0.001	16:00	0.049	0.136
1046	<input type="checkbox"/>	P-256B	0.589	29:00	0.004	16:00	0.212	0.585
1047	<input type="checkbox"/>	P-261B	0.101	29:00	0.000	16:00	0.035	0.101
1048	<input type="checkbox"/>	P-246A	0.070	29:00	0.000	16:00	0.025	0.069
1049	<input type="checkbox"/>	P-246B	0.927	29:00	0.004	16:00	0.330	0.923
1050	<input type="checkbox"/>	P-252	0.921	29:00	0.005	16:00	0.330	0.916
1051	<input type="checkbox"/>	P-1137	0.009	69:00	0.000	39:00	0.002	0.009
1052	<input type="checkbox"/>	P-1138	0.262	29:00	0.001	16:00	0.091	0.261
1053	<input type="checkbox"/>	P-1140	0.034	29:00	0.000	16:00	0.011	0.034
1054	<input type="checkbox"/>	P-1155	0.000	00:00	0.000	00:00	0.000	0.000
1055	<input type="checkbox"/>	P-1512B	0.013	69:00	0.000	15:00	0.002	0.013
1056	<input type="checkbox"/>	P-1522	1.358	69:00	0.000	24:00	0.209	1.358
1057	<input type="checkbox"/>	P-1052	0.040	35:00	0.000	45:00	0.014	0.040
1058	<input type="checkbox"/>	P-1058	0.016	35:00	0.000	45:00	0.005	0.016
1059	<input type="checkbox"/>	P-1061	0.042	35:00	0.001	68:00	0.017	0.040
1060	<input type="checkbox"/>	P-1066	0.026	35:00	0.001	68:00	0.011	0.025
1061	<input type="checkbox"/>	P-1069	0.000	30:00	0.000	09:00	0.000	0.000
1062	<input type="checkbox"/>	P-1070	0.006	35:00	0.001	68:00	0.003	0.006
1063	<input type="checkbox"/>	P-1071	0.042	35:00	0.001	68:00	0.016	0.041
1064	<input type="checkbox"/>	P-1072	0.037	35:00	0.003	68:00	0.019	0.034
1065	<input type="checkbox"/>	P-1076	0.073	35:00	0.003	68:00	0.032	0.070
1066	<input type="checkbox"/>	P-1155B	0.007	35:00	0.000	12:00	0.001	0.007
1067	<input type="checkbox"/>	P-1155A	0.003	35:00	0.000	45:00	0.001	0.003
1068	<input type="checkbox"/>	P-1083	0.091	35:00	0.002	68:00	0.034	0.089
1069	<input type="checkbox"/>	P-1088	0.801	35:00	0.055	68:00	0.388	0.745
1070	<input type="checkbox"/>	P-1101	0.007	35:00	0.000	12:00	0.001	0.007
1071	<input type="checkbox"/>	P-1102	0.003	35:00	0.000	45:00	0.001	0.003
1072	<input type="checkbox"/>	P-1103	0.067	30:00	0.009	16:00	0.028	0.057
1073	<input type="checkbox"/>	P-1141	5.610	29:00	1.505	16:00	3.368	4.105
1074	<input type="checkbox"/>	P-1150	0.921	33:00	0.016	69:00	0.240	0.905
1075	<input type="checkbox"/>	P-1151	7.888	29:00	0.323	16:00	3.290	7.565
1076	<input type="checkbox"/>	P-1156	36.836	29:00	4.001	16:00	18.413	32.835
1077	<input type="checkbox"/>	P-1159	8.208	29:00	1.070	16:00	4.225	7.138
1078	<input type="checkbox"/>	P-1160	2.979	29:00	0.487	16:00	1.641	2.492
1079	<input type="checkbox"/>	P-1161	3.771	29:00	0.106	16:00	1.609	3.665
1080	<input type="checkbox"/>	P-1162	0.284	29:00	0.000	40:00	0.086	0.283
1081	<input type="checkbox"/>	P-1163	0.094	53:00	0.055	09:00	0.069	0.039
1082	<input type="checkbox"/>	P-1164	0.692	61:00	0.442	30:00	0.621	0.250
1083	<input type="checkbox"/>	P-1167	0.103	65:00	0.000	29:00	0.037	0.103

Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1084	P-1171	0.088	65:00	0.000	30:00	0.033	0.088
1085	P-1172	1.920	29:00	0.004	40:00	0.657	1.916
1086	P-1177	0.095	53:00	0.000	15:00	0.038	0.095
1087	P-1189	0.000	00:00	0.000	00:00	0.000	0.000
1088	P-1192	0.000	00:00	0.000	00:00	0.000	0.000
1089	P-1193	0.000	00:00	0.000	00:00	0.000	0.000
1090	P-1194	0.187	30:00	0.000	11:00	0.048	0.187
1091	P-1195	5.319	29:00	0.087	64:00	1.906	5.232
1092	P-1196	0.485	29:00	0.011	16:00	0.187	0.474
1093	P-1197	0.006	00:00	0.000	57:00	0.002	0.006
1094	DC_FUTURE_PMP8_(ST_U	0.000	00:00	0.000	00:00	0.000	0.000
1095	DC_FUTURE_PMP8_(ST_D	0.000	00:00	0.000	00:00	0.000	0.000
1096	DC_PMP7_U	0.029	45:00	0.000	00:00	0.012	0.029
1097	DC_PMP7_D	3.910	45:00	0.000	00:00	1.651	3.910
1098	DC_PMP1_U	0.000	00:00	0.000	00:00	0.000	0.000
1099	DC_PMP1_D	0.000	00:00	0.000	00:00	0.000	0.000
1100	DC_PMP2_U	0.026	30:00	0.000	00:00	0.005	0.026
1101	DC_PMP2_D	3.547	30:00	0.000	00:00	0.626	3.547
1102	DC_PMP3_U	0.016	69:00	0.000	00:00	0.015	0.016
1103	DC_PMP3_D	3.926	69:00	0.000	00:00	3.723	3.926
1104	DC_PMP4_U	0.016	69:00	0.000	00:00	0.015	0.016
1105	DC_PMP4_D	3.943	69:00	0.000	00:00	3.632	3.943
1106	DC_PMP6_U	0.016	69:00	0.000	00:00	0.011	0.016
1107	DC_PMP6_D	3.948	69:00	0.000	00:00	2.682	3.948
1108	DC_PMP5_U	0.016	69:00	0.000	00:00	0.013	0.016
1109	DC_PMP5_D	3.950	69:00	0.000	00:00	3.266	3.950
1110	BB_PMP3_U	0.513	30:00	0.000	12:00	0.300	0.513
1111	BB_PMP3_D	6.666	30:00	0.000	12:00	3.901	6.666
1112	BB_PMP2_U	0.509	45:00	0.381	11:00	0.447	0.128
1113	BB_PMP2_D	6.604	45:00	4.947	11:00	5.806	1.657
1114	BB_PMP1_U	0.506	45:00	0.379	11:00	0.445	0.126
1115	BB_PMP1_D	6.570	45:00	4.928	11:00	5.781	1.642
1116	BB_FUTURE_PUMP_4_(U	0.000	00:00	0.000	00:00	0.000	0.000
1117	BB_FUTURE_PUMP_4_(D	0.000	00:00	0.000	00:00	0.000	0.000
1118	CC_PMP_3-MZ_U	0.000	00:00	0.000	00:00	0.000	0.000
1119	CC_PMP_3-MZ_D	0.000	00:00	0.000	00:00	0.000	0.000
1120	CC_PMP_4-HZ1_U	1.177	04:00	1.002	59:00	1.081	0.176
1121	CC_PMP_4-HZ1_D	1.177	04:00	1.002	59:00	1.081	0.176
1122	CC_PMP_5-HZ1_U	1.177	04:00	1.002	59:00	1.081	0.176
1123	CC_PMP_5-HZ1_D	1.177	04:00	1.002	59:00	1.081	0.176
1124	CC_PMP_6-HZ1_U	0.000	00:00	0.000	00:00	0.000	0.000
1125	CC_PMP_6-HZ1_D	0.000	00:00	0.000	00:00	0.000	0.000
1126	CC_PMP_7-HZ2_U	0.175	00:00	0.000	03:00	0.087	0.175
1127	CC_PMP_7-HZ2_D	0.335	00:00	0.000	03:00	0.167	0.335
1128	CC_PMP_8-HZ2_U	0.000	00:00	0.000	00:00	0.000	0.000
1129	CC_PMP_8-HZ2_D	0.000	00:00	0.000	00:00	0.000	0.000
1130	CC_PMP_9-HZ2_(STBY_U	0.000	00:00	0.000	00:00	0.000	0.000
1131	CC_PMP_9-HZ2_(STBY_D	0.000	00:00	0.000	00:00	0.000	0.000
1132	MN_PMP_FUTURE_U	0.000	00:00	0.000	00:00	0.000	0.000
1133	MN_PMP_FUTURE_D	0.000	00:00	0.000	00:00	0.000	0.000
1134	MN_PMP1_U	0.100	68:00	0.000	00:00	0.092	0.100
1135	MN_PMP1_D	0.139	68:00	0.000	00:00	0.127	0.139
1136	MN_PMP3_U	0.000	00:00	0.000	00:00	0.000	0.000
1137	MN_PMP3_D	0.000	00:00	0.000	00:00	0.000	0.000
1138	MN_PMP2_U	0.000	00:00	0.000	00:00	0.000	0.000
1139	MN_PMP2_D	0.000	00:00	0.000	00:00	0.000	0.000
1140	GOLDEN_BEAR_PMP-1_U	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

	ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1141	GOLDEN_BEAR_PMP-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1142	GOLDEN_BEAR_PMP-2_U	0.117	10:00	0.000	42:00	0.072	0.117
1143	GOLDEN_BEAR_PMP-2_D	0.117	10:00	0.000	42:00	0.072	0.117
1144	FCV-1_U	0.000	00:00	0.000	00:00	0.000	0.000
1145	FCV-1_D	0.000	00:00	0.000	00:00	0.000	0.000
1146	DC_PRV_U	1.068	30:00	0.029	66:00	0.428	1.040
1147	DC_PRV_D	1.069	30:00	0.029	66:00	0.428	1.040
1148	BROADWAY_PRV_U	0.027	16:00	0.006	30:00	0.018	0.021
1149	PRV-3_U	0.081	30:00	0.000	16:00	0.020	0.081
1150	P1544	0.005	07:00	0.000	00:00	0.000	0.005
1151	P1552	0.059	33:00	0.000	25:00	0.007	0.059
1152	P1572	0.200	00:00	0.000	03:00	0.013	0.200
1153	P1578	1.694	00:00	0.000	35:00	0.125	1.693
1154	P1580	1.734	33:00	0.000	17:00	0.506	1.734
1155	P1584	0.000	00:00	0.000	00:00	0.000	0.000
1156	P1590	0.080	33:00	0.000	17:00	0.023	0.080
1157	P1594	0.000	00:00	0.000	00:00	0.000	0.000
1158	P1596	0.000	00:00	0.000	00:00	0.000	0.000
1159	P1598	0.000	00:00	0.000	00:00	0.000	0.000
1160	P1600	0.272	29:00	0.029	16:00	0.143	0.242
1161	P1602	0.701	29:00	0.014	16:00	0.278	0.687
1162	P1606	0.000	00:00	0.000	00:00	0.000	0.000
1163	P1608	0.000	00:00	0.000	00:00	0.000	0.000
1164	P1610	0.000	00:00	0.000	00:00	0.000	0.000
1165	P1612	0.017	04:00	0.014	59:00	0.016	0.003
1166	P1614	0.177	00:00	0.000	03:00	0.088	0.177
1167	P1626	0.077	16:00	0.010	00:00	0.053	0.067
1168	P1628	0.316	35:00	0.000	04:00	0.061	0.316
1169	P1634	1.499	30:00	0.072	16:00	0.552	1.427
1170	P1642	0.011	35:00	0.000	06:00	0.002	0.011
1171	P1644	0.307	35:00	0.000	06:00	0.059	0.307
1172	P1646	0.301	30:00	0.014	16:00	0.111	0.287
1173	P1648	0.006	30:00	0.000	16:00	0.002	0.006
1174	P1650	0.250	30:00	0.012	16:00	0.092	0.238
1175	P1652	0.173	30:00	0.008	16:00	0.064	0.165
1176	P1654	0.899	30:00	0.043	16:00	0.331	0.856
1177	P1656	0.015	30:00	0.001	16:00	0.006	0.015
1178	P1676	0.199	29:00	0.012	16:00	0.092	0.187
1179	P-64	0.087	04:00	0.074	59:00	0.080	0.013
1180	P1678	0.609	33:00	0.000	14:00	0.047	0.609
1181	P1680	12.522	29:00	0.583	16:00	5.476	11.940
1182	P1682	0.036	33:00	0.000	65:00	0.009	0.036
1183	P1684	0.044	33:00	0.000	17:00	0.013	0.044
1184	P1686	0.464	29:00	0.013	16:00	0.180	0.450
1185	P1688	0.153	69:00	0.000	15:00	0.041	0.153
1186	P1690	0.078	29:00	0.001	16:00	0.029	0.078
1187	P1700	0.459	30:00	0.022	16:00	0.169	0.437
1188	P1702	0.080	33:00	0.000	17:00	0.023	0.080
1189	P1704	0.096	30:00	0.005	16:00	0.036	0.092
1190	P1708	0.000	00:00	0.000	00:00	0.000	0.000
1191	P1710	0.000	00:00	0.000	00:00	0.000	0.000
1192	P1716	5.609	35:00	0.000	27:00	1.115	5.609
1193	P1718	0.000	00:00	0.000	00:00	0.000	0.000
1194	P1720	1.727	30:00	0.033	16:00	0.584	1.694
1195	P1722	1.981	00:00	0.000	43:00	0.050	1.980
1196	P1724	0.460	30:00	0.000	00:00	0.202	0.460
1197	P1726	0.447	30:00	0.000	00:00	0.203	0.447

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1198	<input type="checkbox"/>	P1728	1.062	35:00	0.000	12:00	0.206	1.061
1199	<input type="checkbox"/>	P1730	1.053	07:00	0.962	66:00	0.970	0.091
1200	<input type="checkbox"/>	P1732	0.445	30:00	0.183	16:00	0.330	0.262
1201	<input type="checkbox"/>	P1734	9.797	00:00	0.000	09:00	0.951	9.797
1202	<input type="checkbox"/>	P1736	2.563	34:00	0.002	01:00	1.412	2.561
1203	<input type="checkbox"/>	P1738	2.391	00:00	0.531	67:00	1.441	1.860
1204	<input type="checkbox"/>	P1740	2.019	00:00	0.001	17:00	0.169	2.018
1205	<input type="checkbox"/>	P1742	0.341	30:00	0.000	00:00	0.152	0.341
1206	<input type="checkbox"/>	P1760	0.332	10:00	0.000	09:00	0.203	0.332
1207	<input type="checkbox"/>	P1762	0.050	30:00	0.002	16:00	0.018	0.048
1208	<input type="checkbox"/>	P1764	1.612	10:00	0.001	42:00	0.988	1.611
1209	<input type="checkbox"/>	P1770	0.044	30:00	0.002	16:00	0.016	0.042
1210	<input type="checkbox"/>	P1790	1.999	33:00	0.011	17:00	0.846	1.988
1211	<input type="checkbox"/>	P1792	0.350	00:00	0.000	12:00	0.037	0.350
1212	<input type="checkbox"/>	P1796	0.083	00:00	0.000	09:00	0.014	0.083
1213	<input type="checkbox"/>	P1802	0.103	33:00	0.000	40:00	0.011	0.103
1214	<input type="checkbox"/>	P1818	0.010	16:00	0.000	00:00	0.008	0.010
1215	<input type="checkbox"/>	P1822	0.002	35:00	0.000	05:00	0.000	0.002
1216	<input type="checkbox"/>	P1824	0.010	35:00	0.000	04:00	0.002	0.010
1217	<input type="checkbox"/>	P1826	0.043	35:00	0.000	04:00	0.008	0.043
1218	<input type="checkbox"/>	P1830	7.758	29:00	0.409	16:00	3.397	7.349
1219	<input type="checkbox"/>	P1836	0.563	30:00	0.027	16:00	0.207	0.536
1220	<input type="checkbox"/>	P1838	0.000	00:00	0.000	00:00	0.000	0.000
1221	<input type="checkbox"/>	P1840	0.087	35:00	0.000	04:00	0.018	0.087
1222	<input type="checkbox"/>	P1842	0.035	35:00	0.000	04:00	0.007	0.035
1223	<input type="checkbox"/>	P1844	0.013	35:00	0.000	04:00	0.003	0.013
1224	<input type="checkbox"/>	P1846	0.007	35:00	0.000	04:00	0.001	0.007
1225	<input type="checkbox"/>	P1848	0.000	00:00	0.000	00:00	0.000	0.000
1226	<input type="checkbox"/>	P1850	0.007	35:00	0.000	04:00	0.001	0.007
1227	<input type="checkbox"/>	P1852	0.000	00:00	0.000	00:00	0.000	0.000
1228	<input type="checkbox"/>	P1854	0.000	00:00	0.000	00:00	0.000	0.000
1229	<input type="checkbox"/>	P1856	0.000	00:00	0.000	00:00	0.000	0.000
1230	<input type="checkbox"/>	P1858	0.000	00:00	0.000	00:00	0.000	0.000
1231	<input type="checkbox"/>	P1860	0.000	00:00	0.000	00:00	0.000	0.000
1232	<input type="checkbox"/>	P1862	0.166	30:00	0.008	16:00	0.061	0.158
1233	<input type="checkbox"/>	P1864	0.170	30:00	0.008	16:00	0.063	0.162
1234	<input type="checkbox"/>	P1866	0.000	00:00	0.000	00:00	0.000	0.000
1235	<input type="checkbox"/>	P1868	0.000	00:00	0.000	00:00	0.000	0.000
1236	<input type="checkbox"/>	P1870	0.000	00:00	0.000	00:00	0.000	0.000
1237	<input type="checkbox"/>	P1872	0.000	00:00	0.000	00:00	0.000	0.000
1238	<input type="checkbox"/>	P1874	0.000	00:00	0.000	00:00	0.000	0.000
1239	<input type="checkbox"/>	P1876	0.277	30:00	0.013	16:00	0.102	0.264
1240	<input type="checkbox"/>	P1878	0.082	30:00	0.004	16:00	0.030	0.078
1241	<input type="checkbox"/>	P1880	0.201	30:00	0.010	16:00	0.074	0.191
1242	<input type="checkbox"/>	P1882	1.496	30:00	0.071	16:00	0.551	1.425
1243	<input type="checkbox"/>	P1884	0.163	30:00	0.008	16:00	0.060	0.155
1244	<input type="checkbox"/>	P1886	0.569	30:00	0.027	16:00	0.210	0.542
1245	<input type="checkbox"/>	P1888	0.021	30:00	0.001	16:00	0.008	0.020
1246	<input type="checkbox"/>	P1890	0.452	30:00	0.022	16:00	0.166	0.431
1247	<input type="checkbox"/>	P1892	0.000	00:00	0.000	00:00	0.000	0.000
1248	<input type="checkbox"/>	P1894	0.463	30:00	0.022	16:00	0.170	0.441
1249	<input type="checkbox"/>	P1896	0.000	00:00	0.000	00:00	0.000	0.000
1250	<input type="checkbox"/>	P1898	0.105	30:00	0.005	16:00	0.039	0.100
1251	<input type="checkbox"/>	P1900	0.000	28:00	0.000	00:00	0.000	0.000
1252	<input type="checkbox"/>	P1902	0.000	00:00	0.000	00:00	0.000	0.000
1253	<input type="checkbox"/>	P1904	0.169	16:00	0.008	00:00	0.132	0.160
1254	<input type="checkbox"/>	P1906	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1255	<input type="checkbox"/>	P1908	0.808	16:00	0.061	00:00	0.594	0.747
1256	<input type="checkbox"/>	P1910	0.594	16:00	0.045	00:00	0.436	0.549
1257	<input type="checkbox"/>	P1912	0.000	00:00	0.000	00:00	0.000	0.000
1258	<input type="checkbox"/>	P1914	0.215	16:00	0.016	00:00	0.158	0.198
1259	<input type="checkbox"/>	P1916	0.145	16:00	0.011	00:00	0.107	0.134
1260	<input type="checkbox"/>	P1918	0.017	16:00	0.001	00:00	0.012	0.016
1261	<input type="checkbox"/>	P1920	0.571	16:00	0.021	00:00	0.467	0.550
1262	<input type="checkbox"/>	P1922	0.066	69:00	0.001	00:00	0.060	0.065
1263	<input type="checkbox"/>	P1924	0.792	16:00	0.056	00:00	0.611	0.737
1264	<input type="checkbox"/>	P1926	0.088	16:00	0.014	00:00	0.058	0.075
1265	<input type="checkbox"/>	P1928	0.133	16:00	0.021	00:00	0.087	0.112
1266	<input type="checkbox"/>	P1930	0.059	16:00	0.006	00:00	0.043	0.053
1267	<input type="checkbox"/>	P1932	0.249	16:00	0.025	00:00	0.163	0.224
1268	<input type="checkbox"/>	P1934	0.347	16:00	0.035	00:00	0.228	0.313
1269	<input type="checkbox"/>	P1936	0.053	16:00	0.005	00:00	0.035	0.048
1270	<input type="checkbox"/>	P1938	0.000	00:00	0.000	00:00	0.000	0.000
1271	<input type="checkbox"/>	P1940	0.000	00:00	0.000	00:00	0.000	0.000
1272	<input type="checkbox"/>	P1942	0.189	16:00	0.019	00:00	0.124	0.170
1273	<input type="checkbox"/>	P1944	0.007	16:00	0.001	00:00	0.005	0.006
1274	<input type="checkbox"/>	P1946	0.000	00:00	0.000	00:00	0.000	0.000
1275	<input type="checkbox"/>	P1948	0.000	00:00	0.000	00:00	0.000	0.000
1276	<input type="checkbox"/>	P1950	0.000	00:00	0.000	00:00	0.000	0.000
1277	<input type="checkbox"/>	P1952	0.110	16:00	0.011	00:00	0.072	0.099
1278	<input type="checkbox"/>	P1954	0.000	00:00	0.000	00:00	0.000	0.000
1279	<input type="checkbox"/>	P1956	0.002	16:00	0.000	05:00	0.001	0.002
1280	<input type="checkbox"/>	P1958	0.185	16:00	0.000	23:00	0.054	0.185
1281	<input type="checkbox"/>	P1960	0.183	16:00	0.000	23:00	0.053	0.183
1282	<input type="checkbox"/>	P1962	0.002	00:00	0.000	01:00	0.000	0.002
1283	<input type="checkbox"/>	P1964	0.979	16:00	0.176	30:00	0.583	0.802
1284	<input type="checkbox"/>	P1966	0.164	16:00	0.016	00:00	0.108	0.148
1285	<input type="checkbox"/>	P1968	0.534	16:00	0.000	23:00	0.155	0.534
1286	<input type="checkbox"/>	P1970	0.333	16:00	0.065	00:00	0.215	0.268
1287	<input type="checkbox"/>	P1972	0.010	16:00	0.000	51:00	0.003	0.010
1288	<input type="checkbox"/>	P1974	0.000	00:00	0.000	00:00	0.000	0.000
1289	<input type="checkbox"/>	P1976	0.018	16:00	0.000	51:00	0.006	0.018
1290	<input type="checkbox"/>	P1978	1.160	16:00	0.182	30:00	0.663	0.979
1291	<input type="checkbox"/>	P1980	1.379	16:00	0.078	30:00	0.679	1.300
1292	<input type="checkbox"/>	P1982	0.210	16:00	0.001	30:00	0.089	0.209
1293	<input type="checkbox"/>	P1984	0.042	16:00	0.007	00:00	0.025	0.034
1294	<input type="checkbox"/>	P1986	0.026	69:00	0.000	00:00	0.023	0.026
1295	<input type="checkbox"/>	P1988	0.000	00:00	0.000	00:00	0.000	0.000
1296	<input type="checkbox"/>	P1990	0.000	00:00	0.000	00:00	0.000	0.000
1297	<input type="checkbox"/>	P1992	0.007	00:00	0.000	01:00	0.001	0.007
1298	<input type="checkbox"/>	P1994	0.034	00:00	0.000	01:00	0.005	0.034
1299	<input type="checkbox"/>	P1996	0.038	30:00	0.003	16:00	0.016	0.036
1300	<input type="checkbox"/>	P1998	1.555	16:00	0.261	30:00	0.876	1.293
1301	<input type="checkbox"/>	P2000	1.385	16:00	0.203	30:00	0.769	1.182
1302	<input type="checkbox"/>	P2002	0.079	16:00	0.001	00:00	0.065	0.078
1303	<input type="checkbox"/>	P2004	0.310	16:00	0.000	30:00	0.127	0.310
1304	<input type="checkbox"/>	P2006	0.293	00:00	0.002	55:00	0.082	0.291
1305	<input type="checkbox"/>	P2008	0.030	16:00	0.000	06:00	0.009	0.030
1306	<input type="checkbox"/>	P2010	0.074	16:00	0.000	29:00	0.027	0.074
1307	<input type="checkbox"/>	P2012	5.973	16:00	0.013	06:00	1.801	5.960
1308	<input type="checkbox"/>	P2014	0.433	16:00	0.000	06:00	0.132	0.433
1309	<input type="checkbox"/>	P2016	4.958	16:00	0.001	51:00	1.467	4.957
1310	<input type="checkbox"/>	P2018	0.574	16:00	0.000	51:00	0.170	0.573
1311	<input type="checkbox"/>	P2020	0.000	00:00	0.000	00:00	0.000	0.000

Test Report Print Title

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1312	<input type="checkbox"/>	P2022	0.521	16:00	0.000	51:00	0.154	0.521
1313	<input type="checkbox"/>	P2024	1.775	16:00	0.003	51:00	0.531	1.772
1314	<input type="checkbox"/>	P2026	4.246	16:00	0.000	51:00	1.262	4.246
1315	<input type="checkbox"/>	P2028	2.454	16:00	0.000	51:00	0.727	2.454
1316	<input type="checkbox"/>	P2030	0.017	16:00	0.000	06:00	0.005	0.017
1317	<input type="checkbox"/>	P2032	0.391	16:00	0.000	51:00	0.116	0.391
1318	<input type="checkbox"/>	P2034	0.061	16:00	0.000	51:00	0.018	0.061
1319	<input type="checkbox"/>	P2036	0.313	16:00	0.000	51:00	0.093	0.313
1320	<input type="checkbox"/>	P2038	0.507	16:00	0.000	51:00	0.151	0.507
1321	<input type="checkbox"/>	P2040	0.167	16:00	0.000	51:00	0.050	0.167
1322	<input type="checkbox"/>	P2042	0.028	16:00	0.000	51:00	0.008	0.028
1323	<input type="checkbox"/>	P2044	0.577	16:00	0.000	51:00	0.172	0.577
1324	<input type="checkbox"/>	P2046	0.000	00:00	0.000	00:00	0.000	0.000
1325	<input type="checkbox"/>	P2048	1.010	16:00	0.000	51:00	0.300	1.010
1326	<input type="checkbox"/>	P2050	0.405	16:00	0.000	51:00	0.120	0.405
1327	<input type="checkbox"/>	P2052	1.336	16:00	0.000	51:00	0.397	1.336
1328	<input type="checkbox"/>	P2054	0.000	00:00	0.000	00:00	0.000	0.000
1329	<input type="checkbox"/>	P2056	0.000	00:00	0.000	00:00	0.000	0.000
1330	<input type="checkbox"/>	P2058	0.000	00:00	0.000	00:00	0.000	0.000
1331	<input type="checkbox"/>	P2060	0.565	16:00	0.032	00:00	0.458	0.533
1332	<input type="checkbox"/>	P2062	0.001	68:00	0.000	00:00	0.001	0.001
1333	<input type="checkbox"/>	P2064	0.487	16:00	0.023	00:00	0.404	0.465
1334	<input type="checkbox"/>	P2066	0.769	16:00	0.040	00:00	0.628	0.730
1335	<input type="checkbox"/>	P2068	0.000	00:00	0.000	00:00	0.000	0.000
1336	<input type="checkbox"/>	P2072	0.000	05:00	0.000	09:00	0.000	0.000
1337	<input type="checkbox"/>	P2074	0.000	30:00	0.000	10:00	0.000	0.000
1338	<input type="checkbox"/>	P2076	0.000	30:00	0.000	10:00	0.000	0.000
1339	<input type="checkbox"/>	P2078	0.001	30:00	0.000	16:00	0.000	0.001
1340	<input type="checkbox"/>	P2082	0.001	30:00	0.000	10:00	0.000	0.001
1341	<input type="checkbox"/>	P2084	0.003	30:00	0.000	16:00	0.001	0.003
1342	<input type="checkbox"/>	P2086	0.000	29:00	0.000	10:00	0.000	0.000
1343	<input type="checkbox"/>	P2088	0.000	00:00	0.000	00:00	0.000	0.000
1344	<input type="checkbox"/>	P2090	0.000	00:00	0.000	00:00	0.000	0.000
1345	<input type="checkbox"/>	P2092	0.000	00:00	0.000	00:00	0.000	0.000
1346	<input type="checkbox"/>	P2094	0.000	00:00	0.000	00:00	0.000	0.000
1347	<input type="checkbox"/>	P2096	0.000	00:00	0.000	00:00	0.000	0.000
1348	<input type="checkbox"/>	P2098	0.000	00:00	0.000	00:00	0.000	0.000
1349	<input type="checkbox"/>	P2100	0.000	00:00	0.000	00:00	0.000	0.000
1350	<input type="checkbox"/>	P2102	0.000	00:00	0.000	00:00	0.000	0.000
1351	<input type="checkbox"/>	P2104	0.000	00:00	0.000	00:00	0.000	0.000
1352	<input type="checkbox"/>	P2106	0.000	00:00	0.000	00:00	0.000	0.000
1353	<input type="checkbox"/>	P2108	0.000	00:00	0.000	00:00	0.000	0.000
1354	<input type="checkbox"/>	P2110	0.000	00:00	0.000	00:00	0.000	0.000
1355	<input type="checkbox"/>	P2112	0.000	00:00	0.000	00:00	0.000	0.000
1356	<input type="checkbox"/>	P2114	0.000	00:00	0.000	00:00	0.000	0.000
1357	<input type="checkbox"/>	P2116	0.000	00:00	0.000	00:00	0.000	0.000
1358	<input type="checkbox"/>	P2118	0.000	00:00	0.000	00:00	0.000	0.000
1359	<input type="checkbox"/>	P2120	0.000	00:00	0.000	00:00	0.000	0.000
1360	<input type="checkbox"/>	P2122	0.000	00:00	0.000	00:00	0.000	0.000
1361	<input type="checkbox"/>	P2124	0.000	00:00	0.000	00:00	0.000	0.000
1362	<input type="checkbox"/>	P2126	0.000	00:00	0.000	00:00	0.000	0.000
1363	<input type="checkbox"/>	P2128	0.000	00:00	0.000	00:00	0.000	0.000
1364	<input type="checkbox"/>	P2130	0.000	00:00	0.000	00:00	0.000	0.000
1365	<input type="checkbox"/>	P2132	0.000	00:00	0.000	00:00	0.000	0.000
1366	<input type="checkbox"/>	P2134	0.000	00:00	0.000	00:00	0.000	0.000
1367	<input type="checkbox"/>	P2136	0.000	00:00	0.000	00:00	0.000	0.000
1368	<input type="checkbox"/>	P2138	0.000	00:00	0.000	00:00	0.000	0.000

		ID	Max.Value (ft)	Max.Time (hrs.)	Min.Value (ft)	Min.Time (hrs.)	Average (ft)	Difference (ft)
1369	<input type="checkbox"/>	P2140	0.000	00:00	0.000	00:00	0.000	0.000
1370	<input type="checkbox"/>	P2142	0.000	00:00	0.000	00:00	0.000	0.000
1371	<input type="checkbox"/>	P2144	0.000	00:00	0.000	00:00	0.000	0.000
1372	<input type="checkbox"/>	P2146	0.000	00:00	0.000	00:00	0.000	0.000
1373	<input type="checkbox"/>	P2148	0.000	00:00	0.000	00:00	0.000	0.000
1374	<input type="checkbox"/>	P2150	0.000	00:00	0.000	00:00	0.000	0.000
1375	<input type="checkbox"/>	P2152	0.000	00:00	0.000	00:00	0.000	0.000
1376	<input type="checkbox"/>	P2154	0.000	00:00	0.000	00:00	0.000	0.000
1377	<input type="checkbox"/>	P2156	0.000	00:00	0.000	00:00	0.000	0.000
1378	<input type="checkbox"/>	P2158	0.000	00:00	0.000	00:00	0.000	0.000
1379	<input type="checkbox"/>	P2160	0.000	00:00	0.000	00:00	0.000	0.000
1380	<input type="checkbox"/>	P2162	0.000	00:00	0.000	00:00	0.000	0.000
1381	<input type="checkbox"/>	P2164	0.000	00:00	0.000	00:00	0.000	0.000
1382	<input type="checkbox"/>	P2166	0.000	00:00	0.000	00:00	0.000	0.000
1383	<input type="checkbox"/>	P2168	0.000	00:00	0.000	00:00	0.000	0.000
1384	<input type="checkbox"/>	P2170	0.000	00:00	0.000	00:00	0.000	0.000
1385	<input type="checkbox"/>	P2172	0.000	00:00	0.000	00:00	0.000	0.000
1386	<input type="checkbox"/>	P2174	0.000	00:00	0.000	00:00	0.000	0.000
1387	<input type="checkbox"/>	P2176	0.000	00:00	0.000	00:00	0.000	0.000
1388	<input type="checkbox"/>	P2178	0.038	16:00	0.002	00:00	0.031	0.036
1389	<input type="checkbox"/>	P2184	0.004	35:00	0.000	05:00	0.001	0.004
1390	<input type="checkbox"/>	P2186	0.007	35:00	0.000	05:00	0.001	0.007
1391	<input type="checkbox"/>	P2188	0.006	35:00	0.000	04:00	0.001	0.006
1392	<input type="checkbox"/>	P2190	0.000	00:00	0.000	00:00	0.000	0.000
1393	<input type="checkbox"/>	P2194	1.025	30:00	0.049	16:00	0.378	0.976
1394	<input type="checkbox"/>	P2196	0.174	35:00	0.000	04:00	0.034	0.174
1395	<input type="checkbox"/>	P2198	0.000	00:00	0.000	00:00	0.000	0.000
1396	<input type="checkbox"/>	P2200	0.534	68:00	0.004	00:00	0.476	0.529
1397	<input type="checkbox"/>	P2202	1.289	16:00	0.000	51:00	0.383	1.289
1398	<input type="checkbox"/>	P2204	0.000	00:00	0.000	00:00	0.000	0.000
1399	<input type="checkbox"/>	P2206	0.000	00:00	0.000	00:00	0.000	0.000
1400	<input type="checkbox"/>	P-1143	1.435	29:00	0.050	16:00	0.602	1.385
1401	<input type="checkbox"/>	P-1444	0.060	29:00	0.002	16:00	0.025	0.057
1402	<input type="checkbox"/>	P-276	0.000	00:00	0.000	00:00	0.000	0.000





**2022 WATER DISTRIBUTION STUDY**

**BUILDOUT MODEL**  
**FIRE FLOW RESULTS**

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)
J-725	0.031	58.653	610.634	1.440	48.547	2.131	20.000
J-766	0.076	63.764	667.453	1.440	42.721	2.262	20.000
J9010	0.000	68.895	759.319	1.440	47.626	2.304	20.000
J-1014	0.005	76.072	650.916	1.440	51.167	2.363	20.000
J-678	0.049	54.853	666.846	1.440	39.645	2.367	20.000
J9084	0.000	81.868	841.135	1.440	54.594	2.398	20.000
J-1013	0.014	73.909	650.914	1.440	51.525	2.489	20.000
J-802	0.233	80.361	840.834	1.440	51.406	2.522	20.000
J-803	0.023	82.227	841.150	1.440	57.359	2.587	20.000
J-677	0.068	59.177	666.846	1.440	44.393	2.589	20.000
J-1043	0.098	67.956	607.147	1.440	48.755	2.607	20.000
J-129	0.016	91.420	841.409	1.440	64.668	2.641	20.000
J9036	0.014	80.971	841.244	1.440	57.661	2.654	20.000
J9008	0.102	97.184	752.738	1.440	68.744	2.672	20.000
J9038	0.052	81.825	841.219	1.440	58.580	2.721	20.000
J-666	0.138	67.951	607.137	1.440	49.644	2.733	20.000
J9034	0.035	85.367	841.411	1.440	62.775	2.829	20.000
J-726	0.012	63.971	650.933	1.440	49.077	2.930	20.000
J-731	0.025	67.975	657.193	1.440	53.438	2.936	20.000
J-1017	0.033	61.380	650.940	1.440	47.212	2.952	20.000
J-965	0.036	63.249	666.263	1.440	50.905	2.971	20.000
J-804	0.005	65.269	650.933	1.440	50.362	2.973	20.000
J-1047	0.034	56.642	665.984	1.440	46.317	3.060	20.000
J-729	0.059	63.109	650.940	1.440	49.224	3.093	20.000
J-763	0.027	59.514	667.627	1.440	49.327	3.132	20.000
J-890	0.034	70.309	667.589	1.440	57.628	3.154	20.000
J-251	0.000	46.306	652.082	1.440	37.907	3.191	20.000
J-714	0.073	67.440	650.954	1.440	53.026	3.213	20.000
J-694	0.030	60.965	665.982	1.440	51.268	3.383	20.000
J9032	0.013	91.568	841.750	1.440	73.257	3.384	20.000
J-485	0.054	47.594	652.062	1.440	39.343	3.407	20.000
J-705	0.102	67.439	665.951	1.440	56.290	3.494	20.000
J-882	0.083	87.757	752.937	1.440	72.155	3.504	20.000
J-1018	0.034	65.334	651.085	1.440	53.156	3.513	20.000
J-814	0.046	80.161	665.371	1.440	67.292	3.515	20.000
J-676	0.041	59.261	667.041	1.440	50.891	3.516	20.000
J-488	0.054	50.179	652.038	1.440	41.802	3.573	20.000
J-779	0.044	55.811	667.062	1.440	48.743	3.668	20.000
J-690	0.065	63.458	666.746	1.440	54.776	3.690	20.000
J9378	0.000	86.565	843.181	1.440	75.019	3.779	20.000
J-452	0.084	58.375	666.992	1.440	50.889	3.792	20.000
J-679	0.071	59.236	666.982	1.440	51.753	3.799	20.000
J-757	0.086	57.283	667.466	1.440	50.252	3.815	20.000
J-614	0.031	56.649	666.000	1.440	49.474	3.836	20.000
J-697	0.030	55.397	666.105	1.440	48.500	3.841	20.000
J-968	0.204	50.544	651.882	1.440	42.324	3.845	20.000
J-821	0.066	68.906	669.344	1.440	59.872	3.875	20.000
J-812	0.065	53.063	652.707	1.440	45.249	3.929	20.000
J-727	0.063	81.053	637.434	1.440	70.729	3.983	20.000
J-988	0.000	65.824	667.217	1.440	58.447	4.021	20.000
J-665	0.226	68.736	607.952	1.440	58.834	4.040	20.000
J-986	0.133	67.121	667.216	1.440	58.923	4.051	20.000
J-787	0.011	67.526	666.154	1.440	59.660	4.061	20.000
J-810	0.071	88.453	667.546	1.440	77.140	4.064	20.000
J-487	0.103	50.613	652.042	1.440	43.124	4.076	20.000
J-771	0.110	67.275	667.572	1.440	59.128	4.110	20.000
J-696	0.043	50.294	666.305	1.440	44.984	4.156	20.000
J-1004	0.000	53.921	754.692	1.440	48.452	4.177	20.000
J-772	0.056	71.299	667.879	1.440	63.069	4.180	20.000
J-451	0.100	65.726	666.992	1.440	58.209	4.186	20.000
J-648	0.846	63.162	751.063	1.440	51.002	4.242	20.000
J-809	0.056	87.493	667.326	1.440	77.238	4.245	20.000
J-708	0.074	57.969	669.052	1.440	52.249	4.247	20.000
J-984	0.003	68.418	667.217	1.440	61.491	4.303	20.000
J-158	0.016	51.027	666.000	1.440	45.774	4.307	20.000
J-163	0.047	56.684	666.081	1.440	50.612	4.325	20.000
J-693	0.052	64.004	666.010	1.440	56.946	4.353	20.000
J-698	0.020	58.804	665.984	1.440	52.536	4.367	20.000
J-793	0.030	60.024	756.805	1.440	54.422	4.375	20.000
J-901	0.028	57.111	667.068	1.440	51.724	4.386	20.000
J-700	0.052	52.389	666.149	1.440	47.196	4.412	20.000
J-144	0.014	63.876	752.713	1.440	57.590	4.427	20.000
J-509	0.046	66.083	652.816	1.440	57.933	4.455	20.000
J-512	0.079	64.636	669.470	1.440	58.383	4.457	20.000
J-791	0.065	76.299	756.441	1.440	68.568	4.498	20.000
J-713	0.075	59.432	651.436	1.440	51.124	4.514	20.000

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)
J-967	0.067	57.424	651.793	1.440	49.812	4.532	20.000
J-1003	0.028	55.343	762.980	1.440	50.868	4.583	20.000
J-160	0.003	56.642	665.984	1.440	51.163	4.589	20.000
J9106	0.000	64.395	667.217	1.440	58.687	4.594	20.000
J-147	0.048	57.375	752.680	1.440	52.118	4.601	20.000
J9334	0.000	79.473	843.181	1.440	72.200	4.610	20.000
J9376	0.000	87.949	843.181	1.440	80.056	4.728	20.000
J-879	0.084	55.921	667.316	1.440	51.446	4.730	20.000
J9372	0.000	82.284	843.181	1.440	75.024	4.731	20.000
J-162	0.000	56.642	665.984	1.440	51.396	4.734	20.000
J-932	0.060	63.599	667.072	1.440	58.278	4.743	20.000
J-742	0.073	76.862	752.743	1.440	69.467	4.745	20.000
J-511	0.055	65.413	651.268	1.440	57.040	4.757	20.000
J-1029	0.164	67.518	666.135	1.440	60.930	4.771	20.000
J-751	0.021	47.505	754.856	1.440	43.449	4.781	20.000
J-800	0.026	67.195	610.389	1.440	61.936	4.785	20.000
J-704	0.143	67.516	666.131	1.440	60.764	4.803	20.000
J-409	0.275	72.564	607.803	1.440	64.304	4.837	20.000
J-739	0.017	71.897	666.263	1.440	65.761	4.855	20.000
J-142	0.023	48.744	752.720	1.440	45.492	4.937	20.000
J9374	0.000	87.949	843.181	1.440	80.685	4.955	20.000
J-737	0.010	58.326	754.879	1.440	53.335	4.968	20.000
J-490	0.074	52.788	652.071	1.440	46.354	4.979	20.000
J-298	0.016	49.115	652.579	1.440	43.358	5.004	20.000
J9006	0.005	56.038	667.588	1.440	52.229	5.006	20.000
J-517	0.099	103.385	759.078	1.440	93.400	5.016	20.000
J-935	0.009	49.589	754.674	1.440	45.660	5.047	20.000
J-715	0.016	69.226	610.084	1.440	64.297	5.054	20.000
J9022	0.356	49.433	753.313	1.440	45.111	5.060	20.000
J9368	0.000	85.138	843.181	1.440	78.413	5.060	20.000
J-752	0.383	86.338	751.656	1.440	76.563	5.060	20.000
J9350	0.000	82.284	843.181	1.440	75.842	5.062	20.000
J9332	0.000	79.473	843.181	1.440	73.307	5.062	20.000
J-887	0.117	81.320	753.051	1.440	73.506	5.080	20.000
J-743	0.090	79.086	752.886	1.440	72.286	5.119	20.000
J-157	0.009	52.325	666.002	1.440	48.040	5.145	20.000
J-957	0.044	93.146	666.400	1.440	85.480	5.153	20.000
J-681	0.284	80.422	752.974	1.440	72.469	5.156	20.000
J-461	0.170	54.576	653.207	1.440	48.196	5.167	20.000
J-297	0.023	47.494	652.829	1.440	42.014	5.197	20.000
J-500	0.099	63.120	650.964	1.440	55.778	5.254	20.000
J-745	0.051	54.002	754.879	1.440	49.756	5.274	20.000
J-808	0.014	86.177	667.283	1.440	79.494	5.280	20.000
J9370	0.000	90.803	843.181	1.440	84.079	5.292	20.000
J-931	0.023	67.909	667.039	1.440	63.233	5.305	20.000
J-248	0.022	56.510	651.678	1.440	49.847	5.306	20.000
J-413	0.032	54.493	666.016	1.440	50.178	5.322	20.000
J-250	0.045	61.418	652.029	1.440	54.512	5.329	20.000
J9348	0.000	86.565	843.181	1.440	80.312	5.335	20.000
J-164	0.055	52.618	666.679	1.440	48.884	5.339	20.000
J-699	0.102	58.803	665.982	1.440	53.955	5.348	20.000
J-820	0.114	78.846	669.330	1.440	72.419	5.361	20.000
J-703	0.175	61.152	666.414	1.440	56.301	5.361	20.000
J-1010	0.009	53.143	762.894	1.440	49.831	5.369	20.000
J9364	0.000	86.565	843.181	1.440	80.385	5.370	20.000
J-308	0.054	54.938	667.044	1.440	51.081	5.372	20.000
J-200	0.006	69.055	609.690	1.440	64.477	5.392	20.000
J-482	0.028	63.800	667.538	1.440	59.425	5.418	20.000
J-749	0.136	90.405	759.062	1.440	82.512	5.432	20.000
J-969	0.077	52.848	652.211	1.440	46.897	5.432	20.000
J-295	0.017	49.974	652.565	1.440	44.445	5.445	20.000
J-691	0.106	64.303	666.701	1.440	59.511	5.448	20.000
J-962	0.035	56.679	666.070	1.440	52.355	5.455	20.000
J-296	0.022	49.656	652.828	1.440	44.172	5.488	20.000
J-662	0.009	50.968	652.864	1.440	45.405	5.525	20.000
J-201	0.008	69.056	609.691	1.440	64.669	5.529	20.000
J-252	0.010	49.917	652.433	1.440	44.455	5.572	20.000
J-692	0.050	65.429	666.305	1.440	60.607	5.588	20.000
J-33	0.000	51.617	652.864	1.440	46.050	5.595	20.000
J-765	0.056	81.410	668.261	1.440	75.774	5.596	20.000
J-516	0.037	109.085	760.260	1.440	100.378	5.599	20.000
J-143	0.015	53.067	752.716	1.440	50.006	5.603	20.000
J9366	0.000	92.230	843.181	1.440	86.047	5.609	20.000
J-822	0.058	84.633	669.714	1.440	78.682	5.654	20.000
J9360	0.000	86.565	843.181	1.440	80.924	5.657	20.000
J-497	0.032	53.970	651.806	1.440	47.962	5.671	20.000

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)
J-748	0.039	84.682	755.826	1.440	78.557	5.673	20.000
J9330	0.000	80.857	843.181	1.440	75.716	5.686	20.000
J-768	0.210	81.027	667.376	1.440	74.617	5.693	20.000
J-276	0.041	40.161	762.873	1.440	38.131	5.750	20.000
J9340	0.000	83.711	843.181	1.440	78.478	5.768	20.000
J-719	0.027	63.300	666.381	1.440	59.382	5.793	20.000
J-777	0.037	56.642	665.984	1.440	52.520	5.797	20.000
J-275	0.010	39.297	762.874	1.440	37.379	5.805	20.000
J9050	0.040	66.825	667.533	1.440	62.688	5.840	20.000
J-204	0.021	75.542	609.690	1.440	71.035	5.841	20.000
J-481	0.015	68.126	667.540	1.440	64.011	5.912	20.000
J9362	0.000	92.230	843.181	1.440	86.601	5.917	20.000
J-695	0.031	54.783	666.686	1.440	51.443	5.927	20.000
J-294	0.034	50.358	652.452	1.440	45.108	5.933	20.000
J-518	0.202	98.223	757.140	1.440	90.648	5.935	20.000
J-277	0.020	38.870	762.886	1.440	37.067	5.944	20.000
J-663	0.001	53.134	652.872	1.440	47.669	5.988	20.000
J-1007	0.006	42.333	762.894	1.440	40.324	5.989	20.000
J-203	0.007	74.677	609.691	1.440	70.469	6.010	20.000
J-659	0.004	53.140	652.886	1.440	47.699	6.022	20.000
J9358	0.000	87.949	843.181	1.440	82.822	6.041	20.000
J9048	0.005	75.993	609.734	1.440	71.967	6.045	20.000
J9110	0.000	59.541	752.688	1.440	56.192	6.063	20.000
J-970	0.115	83.257	652.532	1.440	75.545	6.066	20.000
J-146	0.021	59.539	752.684	1.440	56.124	6.073	20.000
J-132	0.019	92.214	753.245	1.440	85.803	6.076	20.000
J9346	0.000	90.803	843.181	1.440	85.557	6.095	20.000
J-789	0.389	80.555	756.282	1.440	74.247	6.109	20.000
J-987	0.183	58.905	667.218	1.440	55.535	6.132	20.000
J-978	0.046	50.756	652.373	1.440	45.541	6.137	20.000
J-740	0.100	67.553	666.216	1.440	63.398	6.138	20.000
J-806	0.030	63.558	651.977	1.440	57.340	6.152	20.000
J-758	0.044	68.150	667.596	1.440	64.373	6.163	20.000
J-918	0.051	62.261	666.978	1.440	59.125	6.212	20.000
J-964	0.039	65.395	666.225	1.440	61.246	6.236	20.000
J-756	0.036	65.083	667.503	1.440	61.543	6.236	20.000
J-202	0.006	73.380	609.692	1.440	69.527	6.238	20.000
J-264B	0.000	54.794	754.710	1.440	51.730	6.305	20.000
J9004	0.045	51.701	667.559	1.440	49.237	6.305	20.000
J9000	0.080	87.395	752.100	1.440	81.535	6.306	20.000
J-1002	0.002	42.333	762.894	1.440	40.474	6.325	20.000
J-750	0.094	64.393	754.909	1.440	60.292	6.332	20.000
J9352	0.000	82.284	843.181	1.440	77.941	6.346	20.000
J-1012	0.000	62.708	755.011	1.440	58.988	6.348	20.000
J-156	0.020	56.956	666.711	1.440	53.728	6.350	20.000
J9026	0.001	107.358	843.266	1.440	99.996	6.378	20.000
J9060	0.000	48.698	752.614	1.440	46.759	6.388	20.000
J-408	0.027	68.649	608.751	1.440	64.201	6.396	20.000
J9356	0.000	93.657	843.181	1.440	88.676	6.413	20.000
J-145	0.051	74.675	752.686	1.440	70.463	6.426	20.000
J-660	0.007	55.312	652.909	1.440	49.950	6.439	20.000
J-716	0.014	91.637	666.910	1.440	86.726	6.478	20.000
J-1006	0.018	44.727	756.432	1.440	42.692	6.481	20.000
J9322	0.000	79.473	843.181	1.440	75.515	6.527	20.000
J9328	0.000	82.327	843.181	1.440	78.209	6.546	20.000
J-1001	0.017	42.335	762.900	1.440	40.570	6.559	20.000
J9002	0.035	91.405	751.374	1.440	85.103	6.561	20.000
J-769	0.045	74.612	667.539	1.440	70.323	6.563	20.000
J9342	0.000	86.565	843.181	1.440	82.212	6.566	20.000
J-884	0.079	85.560	752.856	1.440	80.853	6.577	20.000
J9338	0.000	83.711	843.181	1.440	79.573	6.605	20.000
J-153	0.003	104.378	751.374	1.440	97.400	6.614	20.000
J-148	0.064	76.855	752.726	1.440	72.822	6.642	20.000
J-774	0.023	69.041	666.656	1.440	65.274	6.643	20.000
J-273	0.069	42.328	762.882	1.440	40.537	6.653	20.000
J9336	0.000	82.284	843.181	1.440	78.320	6.692	20.000
J-274	0.157	44.485	762.871	1.440	42.516	6.700	20.000
J-702	0.043	61.634	667.527	1.440	58.584	6.723	20.000
J9326	0.000	82.284	843.181	1.440	78.382	6.747	20.000
J-502	0.035	45.463	755.133	1.440	43.373	6.748	20.000
J-786	0.136	98.545	757.885	1.440	93.252	6.771	20.000
J-397	0.049	91.406	751.375	1.440	85.330	6.774	20.000
J-807	0.129	86.682	752.451	1.440	81.476	6.810	20.000
J-102	0.050	70.144	667.207	1.440	66.748	6.811	20.000
J-902	0.005	59.331	667.203	1.440	56.732	6.829	20.000
J-736	0.039	57.150	652.159	1.440	51.811	6.829	20.000

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)	
229	J-747	0.079	90.176	758.531	1.440	84.640	6.832	20.000
230	J-1011	0.027	43.630	762.893	1.440	41.878	6.845	20.000
231	J-872	0.255	77.605	659.460	1.440	71.347	6.848	20.000
232	J-755	0.030	87.861	843.179	1.440	83.695	6.851	20.000
233	J9320	0.000	79.473	843.181	1.440	75.840	6.864	20.000
234	J9018	0.069	99.328	763.696	1.440	93.179	6.875	20.000
235	J-571	0.016	63.573	755.011	1.440	60.031	6.884	20.000
236	J-289	0.032	53.766	652.334	1.440	48.716	6.886	20.000
237	J-589	0.044	105.062	762.954	1.440	98.890	6.897	20.000
238	J-520	0.098	93.652	756.570	1.440	88.530	6.902	20.000
239	J9344	0.000	93.657	843.181	1.440	89.292	6.920	20.000
240	J-407	0.044	68.704	608.877	1.440	64.785	6.924	20.000
241	J-928	0.048	93.141	666.389	1.440	88.511	6.957	20.000
242	J-260	0.033	51.963	755.165	1.440	49.605	6.962	20.000
243	J-775	0.030	61.443	667.087	1.440	58.468	6.979	20.000
244	J-876	0.039	88.362	664.336	1.440	81.504	6.989	20.000
245	J-945	0.049	73.439	609.826	1.440	70.390	7.035	20.000
246	J9318	0.000	79.473	843.181	1.440	76.005	7.055	20.000
247	J9056	0.000	107.433	843.439	1.440	101.317	7.069	20.000
248	J9324	0.000	83.797	843.181	1.440	80.148	7.107	20.000
249	J-293	0.042	57.548	653.080	1.440	52.391	7.109	20.000
250	J-966	0.021	59.146	666.774	1.440	56.289	7.132	20.000
251	J-644	0.003	107.449	843.475	1.440	101.594	7.244	20.000
252	J9046	0.153	85.346	757.361	1.440	80.816	7.265	20.000
253	J9314	0.000	82.284	843.181	1.440	78.855	7.281	20.000
254	J-1045	0.011	65.695	651.920	1.440	60.033	7.302	20.000
255	J-391	0.242	95.715	751.341	1.440	89.714	7.373	20.000
256	J-870	0.048	80.918	657.122	1.440	74.957	7.383	20.000
257	J-406	0.004	45.795	762.901	1.440	44.132	7.405	20.000
258	J-513	0.052	67.342	670.728	1.440	64.695	7.497	20.000
259	J-880	0.049	74.589	667.486	1.440	71.672	7.532	20.000
260	J-727B	0.018	88.288	649.164	1.440	81.212	7.535	20.000
261	J-155	0.046	97.898	751.388	1.440	92.244	7.542	20.000
262	J-590	0.123	92.663	764.284	1.440	87.388	7.549	20.000
263	J-709	0.098	76.554	662.030	1.440	71.961	7.581	20.000
264	J-735	0.019	65.717	651.969	1.440	60.278	7.613	20.000
265	J9316	0.000	83.711	843.181	1.440	80.515	7.672	20.000
266	J-272B	0.004	54.041	762.969	1.440	52.189	7.702	20.000
267	J-519	0.100	93.729	756.749	1.440	89.448	7.756	20.000
268	J-686	0.124	68.702	753.872	1.440	65.548	7.767	20.000
269	J-994	0.008	83.647	668.432	1.440	80.427	7.817	20.000
270	J-784	0.125	87.108	666.436	1.440	83.086	7.832	20.000
271	J-460	0.131	59.082	653.628	1.440	54.165	7.901	20.000
272	J-363	0.680	88.973	663.750	1.440	82.867	7.908	20.000
273	J-973	0.095	89.265	751.425	1.440	84.362	7.961	20.000
274	J-781	0.003	76.287	666.413	1.440	73.335	7.962	20.000
275	J-1024	0.066	87.127	666.480	1.440	83.739	7.964	20.000
276	J-137	0.096	90.925	753.265	1.440	86.744	7.968	20.000
277	J-445	0.429	63.832	840.611	1.440	62.000	7.970	20.000
278	J-489	0.615	56.397	840.417	1.440	54.974	8.107	20.000
279	J-1046	0.158	85.160	651.931	1.440	79.017	8.166	20.000
280	J-400	0.061	55.104	667.429	1.440	53.228	8.192	20.000
281	J-521	0.201	98.217	757.127	1.440	93.681	8.193	20.000
282	J-783	0.075	87.125	666.476	1.440	83.402	8.199	20.000
283	J-767	0.098	74.601	667.514	1.440	71.913	8.289	20.000
284	J-501	0.008	89.048	650.922	1.440	82.493	8.327	20.000
285	J-367	0.065	74.337	666.904	1.440	71.731	8.341	20.000
286	J-392	0.020	63.828	667.602	1.440	61.848	8.370	20.000
287	J-154	0.000	67.977	667.197	1.440	65.456	8.380	20.000
288	J-149	0.019	82.489	752.754	1.440	79.505	8.399	20.000
289	J-446	0.111	77.425	842.045	1.440	75.185	8.431	20.000
290	J-1044	0.086	85.895	653.632	1.440	80.184	8.432	20.000
291	J-290	0.101	61.399	653.984	1.440	56.632	8.433	20.000
292	J-394	0.041	88.418	751.466	1.440	83.958	8.470	20.000
293	J-685	0.157	69.555	753.846	1.440	66.699	8.514	20.000
294	J-474	0.062	74.544	667.383	1.440	71.971	8.584	20.000
295	J-91	0.040	72.187	841.932	1.440	70.302	8.638	20.000
296	J-309	0.018	67.989	667.224	1.440	65.592	8.677	20.000
297	J-259	0.042	55.453	755.235	1.440	53.522	8.695	20.000
298	J-746	0.032	69.160	759.931	1.440	65.800	8.745	20.000
299	J-717	0.020	89.484	666.932	1.440	86.524	8.774	20.000
300	J-759	0.074	81.194	667.761	1.440	78.591	8.779	20.000
301	J-972	0.083	79.506	752.856	1.440	76.839	8.785	20.000
302	J-622	0.035	54.940	667.049	1.440	53.026	8.789	20.000
303	J-272	0.020	53.176	762.969	1.440	51.670	8.794	20.000
304	J-723	0.029	90.889	667.181	1.440	85.287	8.809	20.000

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)	
305	J-475	0.068	72.382	667.383	1.440	69.981	8.822	20.000
306	J-670	0.133	60.677	755.316	1.440	58.602	8.836	20.000
307	J9076	0.000	54.781	751.191	1.440	51.073	8.856	20.000
308	J-754	0.086	63.805	667.550	1.440	61.881	8.911	20.000
309	J-390	0.137	88.422	751.476	1.440	84.175	8.916	20.000
310	J-150	0.027	81.354	843.131	1.440	78.956	8.928	20.000
311	J-1026	0.009	87.084	666.381	1.440	84.256	8.935	20.000
312	J-447	0.110	76.504	841.915	1.440	74.544	8.963	20.000
313	J-301	0.032	87.367	657.036	1.440	81.745	8.998	20.000
314	J-927	0.049	93.147	666.402	1.440	90.095	9.024	20.000
315	J-707	0.085	83.364	667.779	1.440	80.622	9.045	20.000
316	J-688	0.046	65.866	667.314	1.440	64.058	9.081	20.000
317	J-444	0.257	75.161	841.808	1.440	73.253	9.094	20.000
318	J-443	0.050	85.511	842.745	1.440	83.176	9.145	20.000
319	J-949	0.007	92.900	669.830	1.440	89.959	9.151	20.000
320	J9052	0.011	90.112	664.384	1.440	85.668	9.160	20.000
321	J-503	0.067	62.797	755.219	1.440	60.708	9.163	20.000
322	J-365	0.061	89.485	666.934	1.440	86.727	9.233	20.000
323	J-464	0.027	70.086	662.072	1.440	66.465	9.258	20.000
324	J-1009	0.048	50.562	756.924	1.440	49.224	9.314	20.000
325	J-286	0.023	69.083	609.753	1.440	67.399	9.316	20.000
326	J-734	0.148	95.739	651.395	1.440	89.485	9.358	20.000
327	J-279	0.070	53.159	762.931	1.440	51.712	9.358	20.000
328	J-869	0.193	87.896	652.258	1.440	82.253	9.422	20.000
329	J-682	0.014	83.011	843.963	1.440	80.471	9.438	20.000
330	J-954	0.072	85.187	756.995	1.440	82.633	9.479	20.000
331	J-125	0.000	83.958	844.153	1.440	81.367	9.484	20.000
332	J-470	0.014	88.161	655.871	1.440	82.609	9.516	20.000
333	J-116	0.000	84.067	844.405	1.440	81.450	9.522	20.000
334	J9108	0.000	87.641	844.182	1.440	84.971	9.528	20.000
335	J-733	0.008	87.902	652.274	1.440	82.364	9.581	20.000
336	J-161	0.225	72.314	667.226	1.440	70.047	9.615	20.000
337	J-939	0.000	86.137	844.190	1.440	83.579	9.711	20.000
338	J-466	0.011	75.129	609.735	1.440	73.450	9.775	20.000
339	J-442	0.179	86.889	843.930	1.440	84.271	9.789	20.000
340	J-473	0.000	87.642	653.672	1.440	82.252	9.797	20.000
341	J-330	0.081	91.466	664.514	1.440	87.372	9.858	20.000
342	J-788	0.139	98.283	757.280	1.440	95.541	9.860	20.000
343	J-465	0.033	70.123	662.159	1.440	66.789	9.887	20.000
344	J-310	0.059	57.252	667.396	1.440	55.648	9.888	20.000
345	J-887	0.049	85.361	752.396	1.440	82.569	9.895	20.000
346	J-472	0.000	88.337	654.279	1.440	82.935	9.911	20.000
347	J-454	0.058	51.460	669.002	1.440	50.311	9.986	20.000
348	J-886	0.041	83.217	752.439	1.440	80.559	9.996	20.000
349	J-471	0.067	88.881	655.537	1.440	83.399	10.015	20.000
350	J-602	0.016	58.891	667.185	1.440	57.674	10.130	20.000
351	J-523	0.242	99.431	757.933	1.440	96.575	10.142	20.000
352	J-422	0.162	87.654	752.699	1.440	84.980	10.181	20.000
353	J9028	0.027	66.988	752.910	1.440	65.464	10.184	20.000
354	J-661	0.011	64.125	658.288	1.440	60.227	10.258	20.000
355	J-329	0.038	94.881	664.413	1.440	90.849	10.263	20.000
356	J-383	0.024	66.743	666.342	1.440	64.904	10.273	20.000
357	J-262	0.015	54.096	755.097	1.440	52.508	10.310	20.000
358	J-2002	0.001	53.967	752.799	1.440	51.031	10.349	20.000
359	J9074	0.000	53.774	752.767	1.440	50.841	10.366	20.000
360	J-606	0.211	87.477	752.289	1.440	84.609	10.377	20.000
361	J-140	0.023	59.547	752.702	1.440	58.253	10.416	20.000
362	J-207	0.056	75.546	609.701	1.440	73.868	10.525	20.000
363	J-208	0.024	75.548	609.704	1.440	73.904	10.547	20.000
364	J-601	0.040	61.482	667.177	1.440	60.286	10.560	20.000
365	J-439	0.106	70.630	753.332	1.440	68.944	10.604	20.000
366	J-381	0.032	71.932	666.342	1.440	70.045	10.632	20.000
367	J-103	0.033	57.159	667.180	1.440	55.626	10.643	20.000
368	J-504	0.039	53.906	754.658	1.440	52.086	10.679	20.000
369	J-284A	0.002	56.688	753.091	1.440	53.794	10.699	20.000
370	J-284C	0.025	57.599	753.198	1.440	54.738	10.834	20.000
371	J-1020	0.008	92.900	669.832	1.440	90.603	10.875	20.000
372	J-257	0.089	79.759	756.443	1.440	77.712	10.965	20.000
373	J-790	0.078	89.524	757.024	1.440	87.096	11.209	20.000
374	J-773	0.171	78.056	760.503	1.440	74.948	11.217	20.000
375	J-593	0.004	54.308	667.587	1.440	53.237	11.239	20.000
376	J-798	0.139	92.031	667.821	1.440	89.771	11.259	20.000
377	J-258	0.079	81.513	756.498	1.440	79.516	11.289	20.000
378	J-712	0.002	69.516	609.756	1.440	68.322	11.352	20.000
379	J-366	0.018	80.848	666.961	1.440	79.072	11.356	20.000
380	J-213	0.024	75.566	609.745	1.440	74.196	11.384	20.000

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)	
381	J-256	0.015	74.023	756.178	1.440	72.260	11.417	20.000
382	J-524	0.069	98.256	757.217	1.440	96.116	11.457	20.000
383	J-476	0.079	76.714	667.400	1.440	74.994	11.510	20.000
384	J-264	0.245	66.903	754.714	1.440	64.985	11.543	20.000
385	J-305	0.070	71.245	609.753	1.440	70.024	11.615	20.000
386	J-359	0.063	89.662	665.342	1.440	86.837	11.633	20.000
387	J-361	0.030	91.335	665.211	1.440	88.492	11.693	20.000
388	J-479	0.014	45.570	755.380	1.440	43.776	11.734	20.000
389	J-785	0.075	108.393	760.659	1.440	105.913	11.766	20.000
390	J-253	0.117	91.028	760.501	1.440	88.041	11.831	20.000
391	J-255	0.041	85.096	756.785	1.440	83.115	11.880	20.000
392	J-762	0.040	63.822	667.589	1.440	62.654	11.929	20.000
393	J-328	0.285	93.209	664.546	1.440	89.873	11.955	20.000
394	J-316	0.042	55.171	667.582	1.440	54.135	11.989	20.000
395	J-306	0.048	69.031	609.634	1.440	67.586	12.022	20.000
396	J-284B	0.022	57.539	763.058	1.440	56.574	12.037	20.000
397	J-254	0.040	87.732	757.881	1.440	85.580	12.100	20.000
398	J-280	0.035	52.492	754.387	1.440	50.236	12.132	20.000
399	J-1028	0.113	84.955	666.457	1.440	83.199	12.188	20.000
400	J-315	0.135	59.496	667.585	1.440	58.369	12.207	20.000
401	J-684	0.223	71.339	754.972	1.440	69.594	12.330	20.000
402	J-1016	0.207	96.963	754.726	1.440	94.705	12.398	20.000
403	J-778	0.295	71.057	759.319	1.440	68.592	12.555	20.000
404	J-770	0.118	68.188	667.685	1.440	66.801	12.767	20.000
405	J-600	0.014	72.290	667.170	1.440	71.219	12.773	20.000
406	J-263	0.018	65.847	755.270	1.440	64.409	12.836	20.000
407	J-268	0.045	72.978	755.761	1.440	71.472	13.039	20.000
408	J-1027	0.008	82.789	666.449	1.440	81.232	13.148	20.000
409	J-650	0.065	75.985	755.716	1.440	74.315	13.347	20.000
410	J-455	0.092	73.293	669.491	1.440	72.084	13.392	20.000
411	J-362	0.034	92.631	665.209	1.440	90.062	13.436	20.000
412	J-711	0.059	73.416	609.774	1.440	72.383	13.475	20.000
413	J-139	0.044	103.099	753.417	1.440	100.926	13.508	20.000
414	J-469	0.149	70.369	609.729	1.440	69.382	13.541	20.000
415	J-825	0.141	63.597	667.067	1.440	62.526	13.617	20.000
416	J-780	0.024	88.425	666.483	1.440	86.913	13.707	20.000
417	J-594	0.002	76.799	667.597	1.440	75.669	13.850	20.000
418	J-358	0.004	92.739	665.458	1.440	90.297	13.877	20.000
419	J-759	0.056	70.478	667.979	1.440	69.238	13.991	20.000
420	J-1025	0.094	89.245	666.379	1.440	87.645	14.142	20.000
421	J-320	0.110	81.205	667.786	1.440	79.792	14.150	20.000
422	J-2003	0.003	56.249	763.076	1.440	55.515	14.244	20.000
423	J-130	0.044	93.985	667.340	1.440	91.927	14.280	20.000
424	J-419	0.075	83.325	752.690	1.440	81.696	14.290	20.000
425	J-319	0.024	81.162	667.687	1.440	79.743	14.387	20.000
426	J-449	0.135	75.077	753.614	1.440	73.852	14.442	20.000
427	J-238	0.025	73.407	609.753	1.440	72.520	14.509	20.000
428	J-950	0.014	69.924	609.699	1.440	68.881	14.548	20.000
429	J-977	0.008	75.643	609.924	1.440	74.690	14.742	20.000
430	J-782	0.106	74.280	756.773	1.440	73.213	14.784	20.000
431	J-341	0.464	93.410	667.011	1.440	91.186	14.836	20.000
432	J-331	0.044	93.973	667.312	1.440	91.968	14.846	20.000
433	J-212	0.016	75.565	609.744	1.440	74.657	14.881	20.000
434	J-916	0.024	58.060	667.264	1.440	57.406	15.019	20.000
435	J9098	0.000	60.515	668.517	1.440	59.564	15.040	20.000
436	J-291	0.026	65.893	662.377	1.440	63.623	15.056	20.000
437	J-269	0.044	86.798	755.720	1.440	85.195	15.065	20.000
438	J9040	0.044	71.379	753.063	1.440	70.404	15.070	20.000
439	J-314	0.012	59.520	667.641	1.440	58.690	15.106	20.000
440	J-265	0.378	62.505	754.542	1.440	60.635	15.187	20.000
441	J-595	0.010	74.766	667.895	1.440	73.868	15.198	20.000
442	J-152	0.003	54.312	667.597	1.440	53.581	15.225	20.000
443	J-327	0.727	92.936	664.913	1.440	90.403	15.273	20.000
444	J-243	0.009	69.074	609.733	1.440	68.400	15.405	20.000
445	J-373	0.202	93.164	666.440	1.440	91.712	15.432	20.000
446	J-232	0.012	75.206	609.914	1.440	74.329	15.447	20.000
447	J-370	0.031	67.906	667.032	1.440	67.052	15.468	20.000
448	J-929	0.007	93.579	666.401	1.440	92.143	15.596	20.000
449	J-999	0.057	91.999	665.747	1.440	89.782	15.610	20.000
450	J-375	0.200	93.141	666.389	1.440	91.676	15.700	20.000
451	J-418	0.136	91.973	752.686	1.440	90.388	15.722	20.000
452	J-1022	0.004	69.074	609.732	1.440	68.405	15.735	20.000
453	J-374	0.276	92.286	666.412	1.440	90.853	15.835	20.000
454	J-721	0.041	72.332	667.266	1.440	71.247	15.857	20.000
455	J-458	0.081	60.370	669.605	1.440	59.581	15.988	20.000
456	J-214	0.028	76.866	609.752	1.440	76.043	16.096	20.000



Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)	
457	J-210	0.044	76.852	609.720	1.440	75.997	16.211	20.000
458	J-380	0.184	89.246	666.381	1.440	87.900	16.216	20.000
459	J-760	0.019	59.688	668.028	1.440	58.955	16.277	20.000
460	J-420	0.048	79.011	752.712	1.440	77.672	16.344	20.000
461	J-241	0.003	69.074	609.733	1.440	68.451	16.382	20.000
462	J-284D	0.003	61.019	763.107	1.440	60.421	16.604	20.000
463	J-813	0.004	69.506	609.731	1.440	68.881	16.722	20.000
464	J-930	0.001	93.147	666.401	1.440	91.840	16.929	20.000
465	J-312	0.059	75.945	667.622	1.440	75.039	16.991	20.000
466	J-131	0.089	94.981	669.643	1.440	93.384	17.069	20.000
467	J-133	0.030	100.127	753.542	1.440	98.604	17.115	20.000
468	J9030	0.007	62.624	752.818	1.440	61.983	17.161	20.000
469	J-317	0.023	63.915	667.804	1.440	63.159	17.294	20.000
470	J-948	0.001	95.492	669.824	1.440	94.080	17.379	20.000
471	J-1038	0.024	83.807	753.804	1.440	82.748	17.443	20.000
472	J-917	0.061	80.848	666.961	1.440	79.969	17.567	20.000
473	J-287	0.127	69.505	609.730	1.440	68.901	17.576	20.000
474	J-267	0.012	81.610	755.722	1.440	80.312	17.603	20.000
475	J-610	0.070	84.120	752.528	1.440	82.769	17.747	20.000
476	J-211	0.028	76.860	609.739	1.440	76.145	17.903	20.000
477	J-864	0.008	75.567	609.748	1.440	74.953	18.097	20.000
478	J-421	0.046	79.016	752.724	1.440	77.818	18.119	20.000
479	J-165	0.018	94.441	755.393	1.440	93.222	18.128	20.000
480	J-353	0.041	93.566	666.372	1.440	91.791	18.150	20.000
481	J9112	0.000	63.357	752.817	1.440	62.754	18.206	20.000
482	J-209	0.030	76.854	609.724	1.440	76.134	18.276	20.000
483	J-404	0.252	92.131	668.053	1.440	90.721	18.298	20.000
484	J-611	0.062	82.066	752.778	1.440	80.838	18.311	20.000
485	J-228	0.027	75.561	609.735	1.440	74.946	18.335	20.000
486	J-974	0.169	82.714	754.276	1.440	81.705	18.526	20.000
487	J-349	0.008	90.205	666.598	1.440	88.749	18.530	20.000
488	J-672	0.016	93.155	666.419	1.440	91.994	18.579	20.000
489	J-229	0.008	75.561	609.735	1.440	74.973	18.617	20.000
490	J-350	0.012	89.344	666.608	1.440	87.876	18.637	20.000
491	J-354	0.005	92.751	666.486	1.440	91.148	18.640	20.000
492	J-387	0.132	87.487	752.313	1.440	85.969	18.706	20.000
493	J-270	0.135	74.962	756.349	1.440	73.921	18.708	20.000
494	J-342	0.178	92.985	667.028	1.440	91.183	18.708	20.000
495	J-355	0.017	92.769	666.529	1.440	91.282	18.788	20.000
496	J-423	0.105	74.857	753.106	1.440	73.842	18.886	20.000
497	J-348	0.006	89.343	666.606	1.440	87.972	18.915	20.000
498	J-356	0.015	92.771	666.533	1.440	91.369	19.208	20.000
499	J-246	0.018	74.786	609.942	1.440	74.109	19.253	20.000
500	J-933	0.082	63.701	667.309	1.440	63.138	19.568	20.000
501	J-386	0.201	94.130	752.675	1.440	92.816	19.572	20.000
502	J-989	0.022	63.700	667.307	1.440	63.149	19.636	20.000
503	J-351	0.006	91.538	666.681	1.440	90.085	19.659	20.000
504	J-79	0.014	83.794	753.774	1.440	82.886	19.803	20.000
505	J-357	0.018	92.334	666.522	1.440	90.962	19.893	20.000
506	J-369	0.033	59.357	667.264	1.440	58.861	20.056	20.000
507	J-992	0.002	79.180	668.104	1.440	78.519	20.097	20.000
508	J-947	0.051	95.503	669.849	1.440	94.282	20.101	20.000
509	J-151	0.056	54.313	667.599	1.440	53.753	20.179	20.000
510	J-1031	0.018	88.117	753.771	1.440	87.179	20.214	20.000
511	J-924	0.010	93.592	666.431	1.440	92.539	20.242	20.000
512	J-326	0.005	92.289	666.417	1.440	90.796	20.284	20.000
513	J-234	0.008	75.202	609.905	1.440	74.589	20.398	20.000
514	J-335	0.013	92.946	669.936	1.440	91.881	20.448	20.000
515	J-347	0.003	89.373	666.674	1.440	88.146	20.679	20.000
516	J-240	0.011	71.236	609.732	1.440	70.795	20.721	20.000
517	J-433	0.020	78.124	755.661	1.440	76.845	20.757	20.000
518	J-596	0.063	77.030	668.130	1.440	76.411	20.869	20.000
519	J-235	0.014	75.218	609.942	1.440	74.606	21.055	20.000
520	J-321	0.054	54.842	668.823	1.440	54.307	21.095	20.000
521	J-332	0.065	95.442	669.710	1.440	94.162	21.113	20.000
522	J-230	0.025	75.151	609.786	1.440	74.634	21.213	20.000
523	J-1037	0.019	83.817	753.826	1.440	82.966	21.529	20.000
524	J-547	0.081	57.341	667.600	1.440	56.797	21.962	20.000
525	J-1019	0.006	69.531	609.789	1.440	69.041	21.964	20.000
526	J-224	0.007	75.562	609.737	1.440	75.103	22.063	20.001
527	J-1030	0.012	83.366	753.784	1.440	82.540	22.186	20.001
528	J-221	0.021	75.562	609.736	1.440	75.117	22.666	20.001
529	J-980	0.061	91.844	667.389	1.440	90.585	22.776	20.001
530	J-2021	0.261	65.819	757.205	1.440	64.384	22.967	20.001
531	J-231	0.012	75.198	609.894	1.440	74.674	22.970	20.001
532	J-862	0.000	75.136	609.752	1.440	74.697	22.977	20.001



Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)
J-1039	0.001	83.366	753.784	1.440	82.569	23.028	20.001
J-906	0.061	72.232	667.035	1.440	71.437	23.210	20.001
J-333	0.006	94.249	669.950	1.440	93.273	23.386	20.001
J-861	0.004	74.697	609.735	1.440	74.260	23.394	20.001
J-1036	0.002	83.800	753.788	1.440	83.016	23.546	20.001
J-352	0.055	93.585	667.416	1.440	92.280	23.594	20.001
J-907	0.029	76.546	667.011	1.440	75.724	23.906	20.001
J-900	0.014	93.604	666.460	1.440	92.744	24.153	20.001
J-905	0.043	67.955	667.145	1.440	67.298	24.739	20.001
J-403	0.136	85.650	669.065	1.440	84.603	24.969	20.001
J-393	0.146	60.801	667.603	1.440	60.299	25.279	20.001
J-514	0.120	64.199	671.459	1.440	63.537	25.313	20.001
J-1032	0.012	92.439	753.764	1.440	91.656	25.505	20.001
J-2022	0.254	72.043	756.598	1.440	70.756	25.617	20.001
J-908	0.031	85.180	666.979	1.440	84.323	25.620	20.001
J-570	0.120	71.910	756.292	1.440	70.689	25.638	20.001
J-134	0.038	95.446	753.719	1.440	94.600	26.338	20.001
J-336	0.014	89.915	669.928	1.440	89.068	26.549	20.001
J-325	0.013	87.312	666.908	1.440	86.387	26.580	20.001
J-237	0.004	75.202	609.904	1.440	74.750	26.834	20.001
J-236	0.002	75.191	609.879	1.440	74.753	26.899	20.001
J-2020	0.558	81.609	758.720	1.440	79.905	26.970	20.001
J-572	0.000	73.675	755.372	1.440	72.669	26.976	20.001
J-904	0.079	65.819	667.207	1.440	65.262	27.047	20.001
J9044	0.054	72.280	753.147	1.440	71.747	27.087	20.001
J-339	0.009	88.411	669.450	1.440	87.364	27.102	20.001
J-216	0.015	75.563	609.739	1.440	75.177	27.105	20.001
J-515	0.001	70.245	667.442	1.440	69.663	27.168	20.001
J-2019	0.062	82.180	760.040	1.440	80.357	27.418	20.001
J-1035	0.007	52.883	667.292	1.440	52.697	27.419	20.001
J-227	0.032	75.574	609.764	1.440	75.201	27.702	20.001
J-669	0.035	75.441	669.457	1.440	74.781	27.924	20.001
J-567	0.257	78.399	761.297	1.440	76.546	28.289	20.001
J-549	0.138	81.532	753.542	1.440	80.730	28.466	20.001
J-217	0.012	75.572	609.759	1.440	75.201	28.484	20.001
J-233	0.046	75.228	609.965	1.440	74.773	28.517	20.001
J-548	0.008	91.469	753.523	1.440	90.609	28.543	20.001
J-311	0.028	59.083	667.629	1.440	58.650	28.549	20.001
J-324	0.028	60.987	668.032	1.440	60.660	28.786	20.001
J-215	0.010	75.562	609.736	1.440	75.205	28.902	20.001
J-218	0.006	75.578	609.774	1.440	75.212	29.232	20.001
J-753	0.066	81.540	753.561	1.440	80.767	29.348	20.001
J9054	0.038	77.308	754.774	1.440	76.457	29.412	20.001
J-554	0.037	50.721	667.292	1.440	50.562	29.677	20.001
J-177	0.177	62.642	667.859	1.440	62.377	30.090	20.001
J-2001	0.000	58.440	763.142	1.440	58.234	30.105	20.001
J-384	0.055	92.355	666.570	1.440	91.713	30.329	20.001
J-343	0.034	86.518	670.072	1.440	85.830	30.389	20.001
J-364	0.022	65.842	667.260	1.440	65.378	30.674	20.001
J-776	0.163	81.512	763.496	1.440	79.580	30.758	20.001
J-550	0.053	81.557	753.600	1.440	80.828	30.782	20.001
J-467	0.018	71.236	609.732	1.440	71.018	30.947	20.001
J-738	0.057	65.592	668.681	1.440	65.105	31.093	20.001
J-710	0.005	90.899	670.203	1.440	90.112	31.135	20.001
J-675	0.002	92.944	669.933	1.440	92.131	31.625	20.001
J-345	0.067	87.374	670.052	1.440	86.710	31.735	20.001
J-478	0.073	68.091	667.461	1.440	67.602	31.756	20.001
J-1041	0.087	81.573	753.637	1.440	80.880	32.058	20.001
J-245	0.047	73.606	610.214	1.440	73.084	32.208	20.001
J-219	0.010	74.697	609.735	1.440	74.398	32.378	20.001
J-720	0.085	91.074	666.608	1.440	90.494	32.422	20.001
J-93	0.021	81.632	753.774	1.440	81.029	32.769	20.001
J-223	0.022	75.562	609.737	1.440	75.289	33.177	20.001
J-816	0.031	69.761	610.321	1.440	69.197	33.305	20.001
J-668	0.140	76.871	669.763	1.440	76.240	33.414	20.001
J-431	0.092	78.171	755.770	1.440	77.251	33.693	20.001
J-1034	0.003	92.432	753.748	1.440	91.783	33.728	20.001
J-934	0.031	78.608	756.781	1.440	77.557	33.832	20.001
J-222	0.009	75.564	609.741	1.440	75.298	33.856	20.001
J-863	0.009	75.564	609.741	1.440	75.299	33.965	20.001
J-435	0.147	78.682	756.951	1.440	77.611	33.982	20.001
J-718	0.041	86.081	669.063	1.440	85.498	34.031	20.001
J-701	0.025	91.089	666.642	1.440	90.550	34.069	20.001
J-982	0.064	55.336	752.964	1.440	54.978	34.104	20.001
J-946	0.013	92.930	669.901	1.440	92.146	34.536	20.001
J-724	0.020	92.930	669.900	1.440	92.144	34.661	20.001

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)	
609	J-640	0.031	57.520	753.014	1.440	57.147	34.963	20.001
610	J-323	0.015	59.590	667.802	1.440	59.252	35.184	20.001
611	J-450	0.128	78.612	753.791	1.440	78.055	35.278	20.001
612	J-643	0.013	57.475	752.910	1.440	57.135	35.541	20.001
613	J-239	0.009	75.566	609.745	1.440	75.318	35.601	20.001
614	J-141	0.000	66.044	752.725	1.440	65.772	35.670	20.001
615	J-338	0.000	84.228	669.777	1.440	83.518	35.925	20.001
616	J-220	0.012	75.561	609.735	1.440	75.297	35.929	20.001
617	J-1033	0.014	95.026	753.747	1.440	94.396	36.493	20.001
618	J-92	0.000	81.632	753.774	1.440	81.064	36.752	20.001
619	J-551B	0.046	88.100	753.731	1.440	87.486	36.929	20.001
620	J-552	0.006	81.636	753.783	1.440	81.079	37.280	20.001
621	J-424	0.131	75.003	753.445	1.440	74.559	37.325	20.001
622	J-744	0.082	80.281	753.650	1.440	79.765	37.405	20.001
623	J-551	0.038	88.106	753.746	1.440	87.505	37.476	20.001
624	J-441	0.011	70.628	753.326	1.440	70.230	37.482	20.001
625	J9016	0.003	88.835	766.430	1.440	86.928	37.696	20.001
626	J-225	0.004	75.561	609.736	1.440	75.316	37.701	20.001
627	J-579	0.063	91.101	760.670	1.440	89.637	38.016	20.001
628	J-368	0.055	65.902	667.398	1.440	65.583	38.068	20.001
629	J-885	0.033	70.616	753.300	1.440	70.229	38.098	20.002
630	J-577	0.154	88.023	763.553	1.440	86.358	38.374	20.002
631	J-266	0.238	72.023	756.553	1.440	71.570	38.426	20.002
632	J-546	0.137	72.525	667.714	1.440	72.151	38.539	20.002
633	J-574	0.494	89.344	766.607	1.440	87.436	38.713	20.002
634	J9072	0.000	58.950	763.149	1.440	58.818	38.753	20.002
635	J-402	0.010	81.876	669.337	1.440	81.292	39.088	20.002
636	J-545	0.005	72.535	667.736	1.440	72.170	39.134	20.002
637	J-302	0.049	69.524	609.773	1.440	69.361	39.191	20.002
638	J-1005	0.040	50.595	757.000	1.440	50.242	39.255	20.002
639	J9102	0.000	59.632	667.900	1.440	59.344	39.292	20.002
640	J-372	0.046	90.705	666.754	1.440	90.272	39.316	20.002
641	J-794	0.042	54.926	757.015	1.440	54.547	40.201	20.002
642	J-576	0.156	86.857	765.856	1.440	85.107	40.333	20.002
643	J-764	0.007	83.371	667.795	1.440	83.151	40.428	20.002
644	J9116	0.000	66.090	752.837	1.440	65.775	40.479	20.002
645	J-285	0.133	54.925	757.015	1.440	54.546	40.505	20.002
646	J9114	0.000	66.088	752.834	1.440	65.775	40.521	20.002
647	J-975	0.016	59.641	667.920	1.440	59.366	40.550	20.002
648	J-730	0.065	72.332	667.266	1.440	71.863	40.807	20.002
649	J-732	0.002	60.799	610.596	1.440	60.107	40.910	20.002
650	J-555	0.040	59.370	667.292	1.440	59.252	40.913	20.002
651	J9024	0.000	63.442	752.710	1.440	63.173	40.984	20.002
652	J-303	0.061	70.388	609.773	1.440	70.234	41.200	20.002
653	J-981	0.018	70.529	753.099	1.440	70.134	41.423	20.002
654	J-226	0.009	75.562	609.736	1.440	75.347	41.581	20.002
655	J-578	0.013	100.385	762.141	1.440	98.808	41.597	20.002
656	J9042	0.003	70.551	753.149	1.440	70.146	41.691	20.002
657	J-940	0.000	68.244	752.815	1.440	67.937	41.828	20.002
658	J-667	0.079	75.604	669.834	1.440	75.068	42.067	20.002
659	J-300	0.000	100.603	769.644	1.440	99.264	42.539	20.002
660	J-244	0.030	71.237	609.736	1.440	71.055	43.566	20.002
661	J-1021	0.004	93.767	669.837	1.440	93.003	43.681	20.002
662	J-1015	0.087	94.114	767.638	1.440	92.256	43.755	20.002
663	J-976	0.019	71.254	609.774	1.440	71.114	43.845	20.002
664	J-334	0.048	73.853	670.784	1.440	73.376	45.237	20.002
665	J-1023	0.037	89.471	666.902	1.440	89.145	45.504	20.002
666	J-95	0.053	92.930	669.899	1.440	92.204	45.618	20.002
667	J-480	0.007	56.212	756.991	1.440	55.878	45.722	20.002
668	J-344	0.016	73.714	670.463	1.440	73.320	46.112	20.002
669	J9100	0.000	60.234	668.032	1.440	60.012	46.219	20.002
670	J-528	0.005	90.832	670.048	1.440	90.132	46.327	20.002
671	J-641	0.049	80.145	753.335	1.440	79.704	46.660	20.002
672	J-581	0.057	85.725	753.240	1.440	85.362	47.094	20.002
673	J-656	0.375	67.917	757.057	1.440	67.538	47.198	20.002
674	J-1000	0.000	85.360	755.394	1.440	84.734	48.143	20.002
675	J-618	0.087	88.264	754.110	1.440	87.695	48.274	20.002
676	J-582	0.031	85.713	753.211	1.440	85.361	49.028	20.002
677	J-911	0.024	79.025	667.745	1.440	78.859	49.190	20.003
678	J9080	0.000	58.815	763.152	1.440	58.727	49.263	20.002
679	J-271	0.000	72.119	756.775	1.440	71.831	49.308	20.003
680	J-910	0.014	76.861	667.742	1.440	76.702	50.188	20.003
681	J9062	0.003	91.007	670.454	1.440	90.378	50.712	20.003
682	J-538	0.001	76.766	667.521	1.440	76.418	50.717	20.003
683	J-138	0.076	72.553	609.779	1.440	72.448	51.048	20.003
684	J-909	0.022	70.373	667.736	1.440	70.226	51.239	20.003

Buildout Fire Flow Results

ID	Static Demand (mgd)	Static Pressure (psi)	Static Head (ft)	Fire-Flow Demand (mgd)	Residual Pressure (psi)	Hydrant Available Flow (mgd)	Hydrant Pressure at Available Flow (psi)
J-322	0.032	60.583	668.098	1.440	60.398	51.383	20.003
J-459	0.013	60.384	669.637	1.440	60.022	51.614	20.003
J-46	0.007	102.161	769.746	1.440	100.927	51.684	20.003
J-561	0.016	80.891	667.059	1.440	80.676	52.244	20.003
J-891	0.110	94.669	768.923	1.440	92.887	52.336	20.003
J-527	0.000	63.567	757.000	1.440	63.257	52.796	20.003
J-819	0.055	70.372	667.734	1.440	70.095	52.884	20.003
J-584	0.007	78.342	753.167	1.440	78.015	53.363	20.003
J-938	0.000	73.951	753.011	1.440	73.669	53.854	20.003
J-617	0.069	84.089	756.455	1.440	83.560	53.884	20.003
J-560	0.038	67.960	667.158	1.440	67.809	54.125	20.003
J-346	0.025	82.321	670.367	1.440	81.961	54.128	20.003
J-585	0.000	72.620	752.934	1.440	72.360	54.646	20.003
J9058	0.033	66.044	752.726	1.440	65.839	55.579	20.003
J-633	0.014	61.438	757.075	1.440	61.209	56.575	20.003
J-96	0.043	69.995	609.863	1.440	69.983	57.185	20.003
J-587	0.009	59.473	752.532	1.440	59.323	57.621	20.003
J-532	0.039	73.507	669.985	1.440	73.107	60.242	20.004
J9078	0.000	59.428	763.496	1.440	59.320	60.305	20.004
J-979	0.000	87.730	670.875	1.440	87.239	60.585	20.004
J-657	0.084	89.563	757.113	1.440	89.182	61.057	20.004
J-556	0.027	68.020	667.296	1.440	67.954	62.443	20.004
J-533	0.025	71.681	670.762	1.440	71.258	63.554	20.004
J-159	0.130	88.672	757.053	1.440	88.252	63.833	20.004
J-971	0.037	80.859	668.985	1.440	80.575	65.156	20.004
J-613	0.051	94.487	758.502	1.440	93.953	65.841	20.004
J-658	0.122	88.733	757.194	1.440	88.345	66.688	20.005
J-564	0.007	57.300	667.507	1.440	57.220	66.953	20.005
J-624	0.028	95.230	760.218	1.440	94.596	67.034	20.005
J-983	0.004	58.615	667.546	1.440	58.526	69.043	20.005
J-623	0.010	97.601	760.703	1.440	96.954	69.182	20.005
J-915	0.044	84.977	671.509	1.440	84.531	69.452	20.005
J-566	0.000	68.206	667.727	1.440	68.088	69.781	20.005
J-654	0.107	67.934	757.096	1.440	67.821	70.340	20.005
J-990	0.008	63.865	667.688	1.440	63.761	70.783	20.005
J-127	0.000	44.150	752.098	1.440	44.125	71.873	20.005
J-655	0.014	61.474	757.157	1.440	61.363	73.278	20.005
J-318	0.026	61.377	668.933	1.440	61.142	73.708	20.006
J-565	0.004	60.807	667.616	1.440	60.711	74.758	20.006
J-483	0.031	72.744	668.221	1.440	72.622	76.078	20.006
J-741	0.010	63.701	667.307	1.440	63.651	78.700	20.006
J-958	0.083	66.685	669.209	1.440	66.434	79.996	20.007
J-531	0.008	85.012	671.591	1.440	84.603	80.609	20.007
J-953	0.007	61.695	667.669	1.440	61.600	80.833	20.007
J-522	0.214	99.021	758.985	1.440	98.684	82.113	20.007
J-626	0.108	109.714	761.713	1.440	109.119	83.586	20.007
J-540	0.019	72.749	668.231	1.440	72.652	83.709	20.007
J-588	0.076	48.496	752.147	1.440	48.459	84.519	20.007
J-559	0.037	57.232	667.350	1.440	57.208	85.241	20.008
J-99	0.032	74.179	671.539	1.440	73.827	86.314	20.008
J-70	0.034	102.663	767.907	1.440	101.682	86.806	20.008
J-991	0.000	74.963	668.352	1.440	74.776	87.359	20.008
J-823	0.049	75.692	670.038	1.440	75.402	88.694	20.008
J-205	0.000	77.153	668.416	1.440	76.959	88.895	20.008
J-337	0.016	76.688	670.340	1.440	76.390	90.442	20.008
J-993	0.082	81.553	668.591	1.440	81.342	92.098	20.009
J-541	0.017	72.752	668.238	1.440	72.672	92.180	20.009
J-955	0.016	83.579	668.276	1.440	83.400	95.092	20.009
J-101	0.025	69.447	610.596	1.440	68.597	95.547	20.009
J-619	0.028	109.504	763.228	1.440	108.861	95.728	20.009
J9012	0.015	111.307	763.397	1.440	110.651	96.681	20.010
J-631	0.048	63.682	757.265	1.440	63.651	96.961	20.010
J-558	0.022	68.896	667.321	1.440	68.880	112.012	20.013
J-128	0.000	50.046	752.061	1.440	50.037	145.549	20.022
J-834	0.001	48.457	752.057	1.440	48.450	146.788	20.022
J-122	0.000	50.037	752.040	1.440	50.033	166.360	20.029
J-995	0.091	61.500	757.218	1.440	61.492	169.965	20.030
J-557	0.024	59.375	667.304	1.440	59.374	313.155	20.102
J-543	0.039	64.121	668.278	1.440	64.116	437.804	20.198
J-903	0.001	59.374	667.303	1.440	59.374	539.474	20.301